



Thomas D. Gatlin
General Manager, Nuclear Plant Operations
803.345.4342

April 17, 2007

Dr. William D. Travers
Regional Administrator
USNRC, Region II
Sam Nunn Atlanta Federal Center
61 Forsyth Street SW Suite, 23T85
Atlanta, GA 30303-8931

Dear Dr. Travers:

Subject: VIRGIL C. SUMMER NUCLEAR STATION
DOCKET NO. 50/395
OPERATING LICENSE NO. NPF-12
RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

Enclosed is the South Carolina Electric & Gas Company (SCE&G) Annual Radiological Environmental Operating Report as required by Regulatory Guide 4.8 and Section 6.9.1.6 of the Virgil C. Summer Nuclear Station Technical Specifications.

If there are any questions, please contact Ms. Susan B. Reese at (803) 345-4591.

Very truly yours,

Thomas D. Gatlin

SBR/TDG/sr
Enclosure

c: K. B. Marsh (w/o enclosure)
S. A. Byrne
N. S. Carns
J. H. Hamilton (w/o enclosure)
R. J. White (w/o enclosure)
R. E. Martin
M. Coleman
M. B. Roberts
NRC Resident Inspector

K. M. Sutton
E. Everett
INPO Records Center
J&H Marsh & McLennan
NSRC
LTD (312)
File (818.02-2, RR 8300)
PRSF (RC-07-0056)

Received 27-Oct-08
Designated Original
per P.M.

IE25



ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

VIRGIL C. SUMMER NUCLEAR STATION

FOR THE OPERATING PERIOD

JANUARY 1, 2006 - DECEMBER 31, 2006

April 2007

Prepared by:

A handwritten signature in cursive script, reading "L. Brett Williams".

Brett Williams
Health Physics Specialist

Reviewed by:

A handwritten signature in cursive script, reading "Michael Roberts".

Michael Roberts
Health Physics Supervisor

Approved by:

A handwritten signature in cursive script, reading "Paul A. Mothena".

Paul Mothena
Manager Health Physics & Safety Services

EXECUTIVE SUMMARY

This Annual Radiological Environmental Operating Report describes the V.C. Summer Environmental Monitoring Program and the program results for the calendar year 2006.

Included are the identification of sample locations, descriptions of environmental sampling and type of analysis, comparisons of present environmental radioactivity levels and pre-operational environmental data, land use census comparisons of doses calculated from environmental measurements, and a summary of environmental radiological sampling results. Quality assurance practices, sampling deviations and unavailable samples are also discussed.

Sampling activities were conducted as prescribed by the Offsite Dose Calculation Manual (ODCM) for V.C. Summer Nuclear Station (VCSNS) and applicable Health Physics Procedures. Required analyses were performed and detection limits met for required samples with exceptions noted. Samples were collected comprising one thousand two hundred seven analyses (1,207) performed to compile the data for the 2006 Environmental Report. Supplemental samples comprising one hundred ninety five (195) analyses were performed on some media for additional information. Based on the results from the annual land use census, the current number of sampling sites for V.C. Summer Nuclear Station is sufficient.

Concentrations observed in the environment in 2006 from V.C. Summer related radionuclide concentrations were within the range of concentrations observed in the past. Review of the data indicated that very low radioactive concentration in shoreline sediment, surface water and drinking water were the only indicators with VCSNS produced radioactivity. These activities were well below the reporting level requirements of the ODCM. It is therefore concluded that VCSNS operations have no significant radiological impact on the health and safety of the public or the environment.

TABLE OF CONTENTS

	<u>PAGE</u>
INTRODUCTION	1
DESCRIPTION OF THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM	2
LAND USE CENSUS	3
MONITORING RESULTS AND DISCUSSION	4
CONCLUSION	7

LIST OF TABLES

<u>TABLE</u>		<u>PAGE</u>
1	Monitoring Methods for Critical Radiation Exposure Pathways	2
2	2006 Fission and Activated Corrosion Product Activity in Sediment	6
3	Required Sampling Site Locations	8
4	Results of the 2006 Land Use Census Verification	10
5	Critical Receptor Evaluation for 2006	11
6	Radiological Environmental Monitoring Program Specifications	12
7	Supplemental Radiological Environmental Monitoring	17
8	Radiological Environmental Monitoring Program Summary for 2006	20
9	Radiological Environmental Monitoring Program Preoperational (Baseline) Summary	26
10	Results of 2006 Environmental Intercomparison Program with Independent Lab, Analytics, Inc.	31
11	2006 Environmental Sampling Program Exceptions	33

LIST OF FIGURES

<u>FIGURE</u>		<u>PAGE</u>
1-1	Control Site Locations (50 mile radius around the Virgil C. Summer Nuclear Station)	34
1-2	Radiological Monitoring Program Local Indicator Sample Sites (5 mile radius around Virgil C. Summer Nuclear Station)	35
1-3	Radiological Monitoring Program Local Indicator Sample Sites (1-mile radius around Virgil C. Summer Nuclear Station)	36

INTRODUCTION

Virgil C. Summer Nuclear Station (VCSNS) utilizes a pressurized water reactor rated at 2900 MWt (990 MWe gross). The station is located adjacent to the Monticello Reservoir near Jenkinsville, South Carolina and approximately 26 miles northwest of Columbia. VCSNS achieved initial criticality on October 22, 1982, reached 50% power December 12, 1982 and 100% power June 10, 1983 following steam generator feedwater modifications. Steam generators were replaced in the fall of 1994. During the ninth refuel the plant was uprated to 2900 MWt (990 MWe gross). VCSNS is currently operating in the 16th fuel cycle.

VCSNS is operating in conjunction with the adjacent Fairfield Pump Storage Facility (FPSF) which consists of eight reversible pump-turbine units of 60 MWe capacity each. During periods of off-peak power demand, base load generating capacity is used to pump water from Parr Reservoir to Monticello Reservoir. Monticello Reservoir has a surface area of approximately 6800 acres and lies about 150 feet above Parr Reservoir whose full pool area is approximately 4400 acres. The pump-turbine units operate in the generating mode to meet peak system loads while Monticello Reservoir also provides condenser cooling water for VCSNS. Cooling water intake and discharge structures are separated by a jetty to ensure adequate circulation within the reservoir.

VCSNS is located in Fairfield County which, along with Newberry County, makes up the principle area within a 10 mile radius of the plant. This area is mainly forest with only about 30% devoted to small farming activities principally producing small grains, feed crops and beef cattle. Significant portions of Lexington and Richland Counties are encompassed within the 20-mile radius of the plant and exhibit similar agricultural activities. Columbia, the state capital, is the only large city within the 50-mile radius of the plant. Small agricultural concerns are predominant, but make up less than 50% of the land area. The main industrial activity is concentrated around Columbia and is generally greater than 20 miles from the VCSNS.

Liquid effluents from VCSNS are released into the Monticello/Parr Reservoirs at two discharge points: the Circulating Water Discharge Canal (CWDC) and the FPSF Penstocks. Non-nuclear drains are released to the CWDC. Effluent from the liquid waste processing system and processed steam generator blowdown are released through the penstocks. Radioactive gaseous effluents from VCSNS are released from three points: the Main Plant Vent, the Reactor Building Purge Exhaust and the Oil Incineration Facility, all considered to be ground level releases.

Radioactive liquid and gaseous releases from the facility and their potential influence on the surrounding biota and man are the primary concern of the Radiological Environmental Monitoring Program at VCSNS. This report summarizes the results of the Radiological Environmental Monitoring Program conducted during 2006. Data trends, control/indicator and preoperational/operational data intercomparisons and other data interpretations are presented.

DESCRIPTION OF THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

The Radiological Environmental Monitoring Program is carried out in its entirety by South Carolina Electric and Gas Company. The program has been designed to meet the following general commitments:

1. To analyze selected samples in important anticipated pathways for the qualification and quantification of radionuclides released to the environment surrounding VCSNS.
2. To establish correlations between levels of environmental radioactivity and radioactive effluents from VCSNS operation.

The program utilizes the concepts of control/indicator and preoperational /operational intercomparisons in order to establish the adequacy of radioactivity source control and to realistically verify the assessment of environmental radioactivity levels and subsequent radiation dose to man.

Sample media and analysis sensitivity requirements have been established to ensure that the maximum dose pathways are monitored and sensitivities represent a small fraction of annual release limits. Effluent dispersion characteristics, demography, hydrology and land use have been considered in selection of environmental sampling locations. These criteria were used to establish both the preoperational and operational phases of the Radiological Environmental Monitoring Program. Elements of the program monitor the impact of gaseous and liquid effluents released from VCSNS.

Specific methods used in monitoring the pathways of these effluents which may lead to radiation exposure of the public, based on existing demography, are summarized below in Table 1. Requirements of the Radiological Environmental Monitoring Program are specified in the VCSNS Offsite Dose Calculation Manual (ODCM). Elements of the program monitor the impact of gaseous and liquid effluents released from VCSNS.

Table 1 - Monitoring Methods for Critical Radiation Exposure Pathways

Effluent Release Type	Exposure Pathway	Monitoring Media
Gaseous	Immersion Dose and other External Dose Vegetation (Ingestion) Milk (Ingestion)	Thermoluminescent Dosimetry (TLD), Area Monitoring, Air Sampling Vegetation and Food Crop Sampling, Milk Sampling, Grass (Forage) Sampling
Liquid	Fish (Ingestion) Water & Shoreline Exposure (Ingestion and Immersion) Drinking Water (Ingestion)	Fish Sampling Surface Water Sampling, Ground Water Sampling, Shoreline and Bottom Sediment Sampling Drinking Water Sampling

Monitoring sites indicative of plant operating conditions are generally located within a 5-mile radius of the plant. Table 6 provides a list of ODCM required sampling locations. Table 7 provides a list of supplemental sampling locations. Maps showing radiological environmental sampling locations within a radius of approximately 5 miles from VCSNS are presented as Figures 1-2 and 1-3. Figure 1-1 shows monitoring sites at distances greater than 10 miles from the plant. These locations indicate regional fluctuations in background radiation levels.

In addition to preoperational/operational data intercomparisons, control/indicator data intercomparisons are utilized. This is done to assess the probability that any observed abnormal measurement of radioactivity concentration is due to random or regional fluctuations rather than to a true increase in local environmental radioactivity concentration.

Environmental data is gathered through multiple types of sampling and measurements at specific locations. Several multiple sampling combinations are in use around the VCSNS. For example, all air sampling locations serve as environmental dosimetry monitoring locations. At these locations, airborne plant effluents are monitored for gamma immersion dose (noble gases), in addition to air contaminants. Monitoring locations Site 6 (1.0 mi. ESE) and Site 7 (1.0 mi. E) have broadleaf vegetation gardens for monitoring gaseous effluent deposition (ingestion pathway) in the two sectors having the highest deposition coefficients (D/Q) with real potential for exposure. Monitoring location Site 18 (16.5 mi. S) serves as a control location for direct radiation and garden monitoring.

Liquid effluents are monitored using three different monitoring media (fish, bottom sediment and surface water) at the two most probable affected bodies of water around the plant: Site 21, Parr Reservoir (2.7 mi. SSW) and Site 23, Monticello Reservoir (0.5 mi. ESE). The control location for liquid effluent comparisons is at Site 22, Neal Shoals (26.0 mi. NNW) on the Broad River.

Quality of analytical measurements is demonstrated by participation in a laboratory intercomparison program. Results of the intercomparison program with an outside vendor and VCSNS Count Room were satisfactory in 2006. The results of each of these quality control checks of the Radiological Environmental Monitoring program verify the technical credibility of analytical data generated and reported by the program.

LAND USE CENSUS

Annually a land use census is performed within a 5-mile radius of VCSNS to verify the adequacy of sample locations. In addition, the location of the maximum exposed individual (MEI) is identified. The results of the land use census performed in 2006 are included in Table 4. A verification of the maximum exposed individual location is presented in Table 5. Identification of the highest offsite dose locations was performed by calculating a hypothetical dose based on predicted VCSNS source term from the Operating License Environmental Report which is higher than actual source terms and 5 year average meteorological data. Exposure pathways used in the analysis were those identified during the land use census.

The location and pathway presently used in the ODCM for offsite organ dose calculations (E 1.1 miles - residence/garden) was found to have a calculated dose of $2.9\text{E}+0$ mrem/yr. In addition, the ODCM required environmental gardens (ESE 1.0 and E 1.0 mile) were found to have a calculated dose of 2.34 and 3.71 mrem/year which are higher calculated doses than garden locations of all real individuals. There were no milking animals or dairy activity found within 5 kilometers of VCSNS. Therefore, changes to the ODCM gaseous effluent calculations or garden sample locations are not indicated.

MONITORING RESULTS AND DISCUSSION

The results of the Radiological Environmental Monitoring Program for 2006 are summarized in Table 8. For comparison, preoperational data are summarized in Table 9. The Radiological Environmental Program attained a program compliance rate of approximately 98.2 %. A listing of program exceptions and their respective causes are included in Table 11. Analysis of the impact of these omissions verified that program quality has not been affected.

Corbicula harvest for possible commercial use was observed in Lake Monticello in 2005. Samples were collected and analyzed for gamma emitting isotopes. No measurable gamma emitting nuclides were detected above background.

Gross beta activities measured in air particulate samples collected at indicator locations around VCSNS were consistent with preoperational levels and not statistically different from control locations. The highest site-specific mean activity ($2.32\text{E}-2$ pCi/m³) was measured at indicator location Site 7 (Lab Garden 1.0 mi. E). The results indicate that the operation of VCSNS has not contributed to detectable increases of airborne gross beta activity in the environment.

Gamma spectroscopy measurements of composited air particulate samples and activated charcoal cartridges support the gross beta activity trend. Only natural background activities were detected. The highest minimum detectable activity (MDA) levels for ¹³⁴Cs, ¹³⁷Cs and ¹³¹I were $1.26\text{E}-2$, $1.84\text{E}-3$ and $1.91\text{E}-2$ pCi/m³, respectively. The average maximum results support the gaseous effluent release data reported in the 2006 Annual Effluent and Waste Disposal Reports for VCSNS. No measurable iodine or particulate were released. 96.8 % of the required indicator/control air samples were collected.

Environmental dosimetry measurements did not differ significantly from preoperational measurements. Indicator and control dosimetry measurements also showed no appreciable differences. Comparison with other operational years shows no statistically significant difference. Monitoring location 4 (Fairfield Hydro 1.2 mi. WNW), was the indicator location showing the highest mean exposure rate of $1.22\text{E}+1$ $\mu\text{R/hr}$. This is similar to the 2005 value of $1.19\text{E}+01$ $\mu\text{R/hr}$ and consistent with the highest mean exposure rate of $1.4\text{E}+1$ $\mu\text{R/hr}$ measured during the preoperational period. 99.3% of the required TLDs were collected.

Gamma spectroscopy measurements of surface water samples did not indicate the presence of activated corrosion or fission products above the respective MDA's for indicator sites. Tritium analysis indicated the presence of tritium slightly above MDA in 4 indicator samples. Site 21 (Parr Res. 2.7 mi. SSW) had tritium concentrations of $5.12\text{E}+2$ and $6.38\text{E}+2$ pCi/l. Site 23 (Monticello Res. 0.5 mi. ESE) had tritium concentrations of $5.10\text{E}+2$ and $6.70\text{E}+2$ pCi/kg. These activities are less than the preoperational mean of $1.4\text{E}+3$ pCi/l. The highest MDA for surface water tritium at all indicator and control sites was $5.17\text{E}+2$ pCi/l. 97.2 % of the required indicator/control surface water samples were collected.

Gamma spectroscopy measurements of the ODCM required ground water samples did not indicate the presence of activated corrosion or fission products above the respective MDAs. Tritium analysis did not indicate the presence of tritium above MDA. The highest MDA for tritium at all indicator and control sites was $4.94\text{E}+2$ pCi/l. All required indicator/control ground water samples were collected.

Gamma spectroscopy measurements of drinking water samples collected from the Jenkinsville and Columbia water supplies did not indicate the presence of activated corrosion or fission product activity above the respective MDAs. Tritium analysis indicated the presence of tritium slightly above MDA in 2 indicator samples. Site 17 (Columbia Water Works 25.0 mi. SE) had tritium concentrations of $5.15\text{E}+2$ and $7.22\text{E}+2$ pCi/l. These levels are less than the preoperational mean of $7.8\text{E}+2$ pCi/l. The highest MDA for tritium at all indicator and control sites was $5.09\text{E}+2$ pCi/l. The highest indicator and control site-specific gross beta activity was measured at Site 17 (Columbia Water Works 25.0 mi. SE) at a level of 4.23 pCi/l. All required indicator/control drinking water samples were collected.

There were no milk samples collected in 2006. Milk sampling is required to be performed at the three highest dose locations within 5 kilometers of the plant or at 5 to 8 kilometers of the plant, if doses are calculated to be greater than 1 mrem per year. Presently there are no locations meeting this criteria for indicator dairies. The closest dairy is approximately 8 kilometers from the plant (see Table 4). Milk samples will be obtained from this dairy if gaseous releases from the plant exceed 5% of quarterly organ dose limits or radionuclides (attributed to the operation of VCSNS) are detected in broadleaf vegetation, grass or air samples at concentrations greater than required LLDs.

Gamma spectroscopy measurement of the grass samples collected indicated ^{137}Cs in 10 of 12 samples at Site 2 (transmission line 1.1 mi. SW) at concentrations ranging from $2.31\text{E}+1$ to $1.83\text{E}+2$ pCi/kg. The maximum preoperational control activity was $3.4\text{E}+2$ pCi/kg. A review of Site 2 air sample results indicated that no ^{137}Cs was detected. All required indicator/control grass samples were collected.

Gamma spectroscopy measurements of the broadleaf samples collected did not indicate the presence of activated corrosion or fission products above the respective MDAs. All of the required indicator/control broadleaf samples were collected.

Gamma spectroscopy measurements of all non-leafy (other vegetation) samples collected did not indicate the presence of activated corrosion or fission products above the respective MDA. All required indicator/control non-leafy (other vegetation) samples were collected.

Gamma spectroscopy measurements of the fish samples collected at indicator sites indicated the presence ^{137}Cs in 2 samples. Site 21 (Parr Res. 2.7 mi. SSW) had a ^{137}Cs concentration of 9.98 pCi/kg and Site 23 (Monticello Res. 0.5 mi. ESE) had a ^{137}Cs concentration of 1.94E+1 pCi/kg. These activities are below the preoperational mean of 2.8E+1 pCi/kg and well below the preoperational max of 1.00E+2 pCi/kg for fish samples. All required indicator/control fish samples were collected.

Gamma spectroscopy measurements of sediment samples resulted in detection of ^{60}Co that is attributed to VCSNS operation. ^{60}Co was detected in 2 indicator samples taken at Site 23 (Monticello Res. 0.5 mi. ESE) at concentrations of 1.49E+1 and 1.57E+1 pCi/kg. ^{137}Cs was detected in 4 of 4 indicator samples taken at Site 21 (Parr Res. 2.7 mi. SSW) and Site 23 (Monticello Res. 0.5 mi. ESE) at concentrations of 1.80E+1 and 2.80E+1 pCi/kg, and 1.08E+2 and 1.16E+2 pCi/kg respectively. ^{137}Cs was detected in 2 of 2 control samples taken at Site 22 (Neal Shoals 26 mi. NNW) at concentrations of 9.99E+1 and 2.00E+2 pCi/kg. All required indicator/control sediment samples were collected.

Radiation doses to man, corresponding to the concentrations of activity in sediment, were calculated using Regulatory Guide 1.109 methodology. A 500-hour/year exposure to shoreline sediment containing maximum and mean concentrations of ^{60}Co , with a shoreline width factor of 1, and a sediment mass of 40 kg/m² was assumed. The results are included in Table 2 and show a maximum dose to the public from contaminated sediment to be 5.34E-3 mrem/yr for 2006 based on sediment samples from Monticello Reservoir.

Table 2 - 2006 Fission and Activated Corrosion Product Activity in Sediment

Location	Radionuclide	Activity (pCi/kg)		Corresponding Calculated Annual Dose Equivalent (mrem/yr)	
				Total Body	
		Maximum	Mean	Maximum	Mean
Monticello Reservoir					
	^{60}Co	1.57E+1	1.53E+1	5.34E-3	5.20E-3
		--	---		

CONCLUSION

As in previous years of VCSNS operation, the presence of fission product activity attributed to residual fallout from atmospheric weapons testing and the Chernobyl accident were detected in environmental media including sediment and grass.

No detectable fission or activation product activity attributed to VCSNS operation was observed in environmental media except for sediment samples from Monticello Reservoir, drinking water tritium from Columbia Water Works and surface water tritium from Parr and Monticello Reservoirs. The dose from this activity represents a small fraction of VCSNS effluent dose limits. The absence of an impact was expected since, historically, releases from VCSNS have been a small fraction of ODCM Specification limits. The dose calculated for the maximally exposed individual will not result in observable effect on the ecosystem or general public. The results of the Radiological Environmental Monitoring Program, therefore, substantiate the continuing adequacy of source control at VCSNS and conformance of station operation to 10 CFR 50, Appendix I design objectives.

Table 3 - Required Sampling Site Locations

Site No.	Description	Distance ¹ (Miles)	Direction ²	Sample Type(s) ³
1	Borrow Pit	1.2	179.8 S	DQ
2	Transmission Line	1.1	225.0 SW	AP, RI, DQ
3	Firing Range	1.2	270.0 W	DQ
4	Fairfield Hydro	1.2	289.5 WNW	DQ
5	Transmission Line Entrance	0.9	144.0 SE	DQ
6	Env. Lab Garden	1.0	111.0 ESE	AP, RI, GA, DQ
7	Environmental Lab Garden	1.0	97.8 E	AP, RI, DQ, GA
8	Monticello Res. S of Rd 224	1.5	62.0 ENE	DQ
9	Ball Park	2.3	41.6 NE	DQ
10	Meteorological Tower #2	2.5	25.5 NNE	DQ
12	Old Hwy 99	4.2	349.4N	DQ
13	North Dam	2.9	333.0 NNW	DQ
14	Dairy (Shealy) ⁴	6.5	277.0 W	MK, GR
16	Dairy (Parr) ⁴	20.0	275.5 W	MK, GR
16a	TLD Location	28.0	278.6W	DQ
17	Columbia Water Works	25.0	144.0 SE	AP, RI, DQ, DW
18	Residence/Pine Island Club ⁵	16.5	165.0 S	DQ, GA
19	Residence/Little Saluda	21.0	224.0 SSW	DQ
20	Residence/Whitmire	22.0	309.5 NW	DQ
21	Parr Reservoir	2.7	199.5 SSW	SW, FH, BS
22	Neal Shoals	26.0	343.1 NNW	SW, FH, BS
23	Discharge Canal (Mont, Res.)	0.5	104.5 ESE	SW, FH, BS
26	On Site Well (P2)	460 Ft	270.0 W	GW
27	On Site Well (P5)	510 Ft	180.0 S	GW
28	Nuclear Training Center (EOF) ⁶	2.6	170.2 SSE	DW
29	Trans. Line WSW of VCSNS	1.0	260.6 WSW	DQ
30	Oak Tree North of Borrow Pit ⁷	1.0	196.2 SSW	DQ, AP, RI
31	McCrorey-Liston School	6.6	11.5 NNE	DQ
32	Clark Bridge Road and Brooks Drive	4.6	24.0 NNE	DQ
33	Rd 48 near Hwy 213	4.2	68.0 ENE	DQ
34	Rd 419 North of Hwy 60	4.9	111.0 ESE	DQ
35	Glenn's Bridge Road	4.6	132.0 SE	DQ
36	Woods Behind Jenk. Post Office	3.1	151.0 SSE	DQ
37	Residence	4.9	304.8 NW	DQ
39	LMWTF	14.0	168.0 SSE	DW
41	Below Catwalk at Trestle	3.8	182.0 S	DQ
42	Broad River Rd (Residence Peak)	3.8	198.0 SSW	DQ
43	Hwy 176 and Rd 435	5.2	236.0 SW	DQ
44	Rd 28 at Cannon's Creek	2.8	256.6 WSW	DQ
45	Rd 33 at Pomaria	5.8	253.2 WSW	DQ
46	Rd 28 at Heller's Creek	3.7	291.5 WNW	DQ
47	Fairfield Tailrace	1.0	316.0 NW	DQ
52	Monticello (Rd 11)	3.8	13.0 NNE	DQ

Site No.	Description	Distance ¹ (Miles)	Direction ²	Sample Type(s) ³
53	Rd 359	3.0	46.5 NE	DQ
54	Jenkinsville School	1.7	72.5 ENE	DQ
55	St. Barnabas Church	2.8	91.5 E	DQ
56	Old Jenkinsville Diner	2.0	144.0 SE	DQ
58	Residence	2.5	157.0 SSE	DQ
59	Nuclear Training Center (EOF) ⁶	2.6	170.2 SSE	DQ, GW
60	Rd 98 near Rd 28	3.5	274.6 W	DQ

Footnotes

- Distance given is the distance between the site location and the VCSNS reactor containment building.
- Direction given in degrees from true north-south line through center of reactor containment building.
- Sample Types:

AP = Air Particulate	GW = Ground Water	GA = Garden
RI = Air Radioiodine	DW = Drinking Water	FH = Fish
DQ = Quarterly TLD	MK = Milk	BS = Bottom Sediment
SW = Surface Water	GR = Grass (Forage)	
- Site 14 and 16 are not presently in use. If conditions change, requiring a renewal of dairy sampling these sites will be reactivated.
- Site 18 consists of 2 locations in close proximity to Lake Murray. Garden product samples are taken at the Wyse residence. The TLD is located on Pine Island.
- Site 28 for drinking water and site 59 for quarterly TLD measurements are co-located at the location of the SCE&G Nuclear Training Center which also serves as the Virgil C. Summer Station Emergency Offsite Facility.
- Site 30 air sampler and TLD though not in line of sight are located in the same sector.

Table 4 - Results of the 2006 Land Use Census Verification

Sector	Nearest Residence	Miles	Nearest Garden	Miles	Nearest Cattle	No. Milked	Miles	Nearest Goat	No. Milked	Miles
N	P. Oliver	3.73			John Robinson	0	3.4			
NNE	Bessie Crumblin	2.9	Virgil Harrison	3.21	Wi/Charles Coleman	0	4.97			
NE	Eartha Guinyard	1.5	David Stone	2.1	David Stone	0	2.1			
ENE	Robert Martin	1.53	Essie Mae Glenn	1.68				Robert Martin	0	1.53
E	Lynn Mincy	1.2	Lynn Mincy	1.2						
ESE	Carrie Lee Martin	1.1								
SE	Mary White	1.44	Mary White	1.44	Sim Robertson	0	4.7			
SSE	Ronnie Mann	2.39	Ronnie Mann	2.39						
S	Kelly Boulware	3.56	Kelly Boulware	3.56	Shirley Counts	0	5			
SSW	Nick Bates	3.11	Nora Wicker	3.77	G.A. Mayers	0	4.7			
SW	Marvin Miller	3.3	Marvin Miller	3.3				Shakkori	0	4.7
WSW	Ron Hope	2.9	Mary Davis	3	Ken/Virg Graham		4.98	Steve All		4.83
W	Jerry Cassado	2.55	Marion Livingston	2.8	Marion Livingston	0	2			
W					Ken/Virg Graham	90	5			
WNW	Lorraine Wicker	4.24	Ronnie Leitzey (B)	4.72	Ronnie Leitzey (C)	1	4.15	Ronnie Leitzey	15	4.15
NW	Louise Workman	3.9								
NNW	Frank March	2.9	Frank March	2.9	Frank March	0	2.9			

(A) Change In Closest Residence

(B) Change In Closest Garden

(C) Change In Closest Beef Cattle

Table 5 Critical Receptor Evaluation for 2006

NAME	SECTOR	MILES	PATHWAY	X/Q	D/Q	DOSE* mRem/y
John Robinson	N	3.4	B	2.826E-07	8.134E-10	8.15E-02
P. Oliver	N	3.73	Res	2.364E-07	6.634E-10	8.80E-03
Bessie Crumblin	NNE	2.9	Res	3.764E-07	1.133E-09	1.41E-02
Virgil Harrison	NNE	3.21	Res,Gar	3.074E-07	9.012E-10	2.48E-01
Will/Charles Coleman	NNE	4.97	B	1.340E-07	3.501E-10	3.51E-02
Eartha Guinyard	NE	1.5	Res	2.013E-06	6.733E-09	7.55E-02
David Stone	NE	2.1	Res,Gar,B	9.677E-07	2.980E-09	1.11E+00
Robert Martin	ENE	1.53	Res,G	2.005E-06	5.809E-09	1.45E-01
Essie Mae Glenn	ENE	1.68	Res,Gar	1.632E-06	4.606E-09	1.27E+00
Garden-7 **	E	1	Res,Gar	4.425E-06	1.357E-08	3.71E+00
Lynn Mincy ¹	E	1.2	Res,Gar	2.889E-06	8.461E-09	2.33E+00
Garden-6 **	ESE	1	Res,Gar	2.638E-06	8.616E-09	2.34E+00
Carrie Lee Martin	ESE	1.1	Res	2.104E-06	6.721E-09	7.88E-02
Glover / Kennedy	ESE	5	Res,Gar,B	8.902E-08	1.944E-10	7.53E-02
John White	SE	1.44	Res,Gar	7.172E-07	2.689E-09	7.19E-01
Sim Robertson	SE	4.7	Res,B	6.182E-08	1.697E-10	6.41E-02
Ronnie Mann	SSE	2.39	Res,Gar	1.586E-07	6.976E-10	1.84E-01
Kelly Boulware	S	3.56	Res,Gar	9.170E-08	4.277E-10	1.12E-01
Shirley Counts	S	5	Res,Gar,B	4.644E-08	2.063E-10	7.48E-02
Nick Bates	SSW	3.11	Res	1.459E-07	8.621E-10	5.66E-03
Nora Wicker	SSW	3.77	Res,Gar	9.775E-08	5.628E-10	1.45E-01
G.A. Mayers	SSW	4.7	Res,Gar,B	6.270E-08	3.505E-10	1.25E-01
Marvin Miller	SW	3.3	Res,Gar	1.306E-07	9.599E-10	3.39E-01
Shakkori	SW	4.7	Res,G	6.324E-08	4.473E-10	7.82E-03
Ron Hope	WSW	2.9	Res	1.434E-07	9.265E-10	5.60E-03
Mary Davis	WSW	3	Res,Gar	1.334E-07	8.581E-10	2.20E-01
Steve All	WSW	4.83	Res,G	5.044E-08	3.038E-10	5.59E-03
Ken/Virg Graham	WSW	4.98	B	4.750E-08	2.850E-10	2.84E-02
Jerry Cassado	W	2.55	Res	2.021E-07	8.654E-10	7.68E-03
Marion Livingston	W	2	B	3.416E-07	1.532E-09	1.53E-01
Marion Livingston	W	2.8	Res,Gar	1.660E-07	6.982E-10	1.85E-01
Marion Livingston	W	2 & 2.8	Res,Gar,B	BOTH	BOTH	3.38E-01
Ken/Virg Graham	W	5	Res,Gar,B,C/M	5.208E-08	1.967E-10	1.06E-01
Lorraine Wicker	WNW	4.24	Res	4.940E-08	1.669E-10	1.85E-03
Ronnie Leitzsey	WNW	4.15	C/M,B,G/M,G	5.150E-08	1.751E-10	1.75E-01
Ronnie Leitzsey	WNW	4.72	Res,Gar	4.023E-08	1.314E-10	3.57E-02
Ronnie Leitzsey	WNW	4.15 & 4.72	Res,Gar,C/M,B,G/M,G	BOTH	BOTH	2.11E-01
Louise Workman	NW	3.9	Res	1.108E-07	3.211E-10	4.13E-03
Frank March	NNW	2.9	Res,Gar,B	3.509E-07	9.675E-10	3.65E-01
ODCM ORGAN DOSE	E	1.1	Res,Gar	3.536E-06	1.059E-08	2.90E+00

Pathway

Res = Residence

Gar = Garden

B = Beef

C/M = Cow/Milk

G = Goat

G/M = Goat/Milk

Footnotes:

¹ Maximum exposed individual.

* Hypothetical dose based on Operating License Environmental Report Source Term.

X/Q and D/Q were derived from ODCM 5-year average meteorological data

** ODCM required environmental gardens.

Table 6 – Radiological Environmental Monitoring Program Specifications

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
AIRBORNE: I. Particulate	A) 3 Indicator samples to be taken at locations (in different sectors) beyond but as close to the exclusion boundary as practicable where the highest offsite sector ground level concentrations are anticipated. ²	Continuous sampler operation with weekly collection.	2 7 30	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
	B) 1 Indicator sample to be taken in the sector beyond but as close to the exclusion boundary as practicable corresponding to the residence having the highest anticipated offsite ground level concentration or dose. ²	Continuous sampler operation with weekly collection.	6	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
	C) 1 Indicator sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A). ^{2,4}	Continuous sampler operation with weekly collection.	N/A	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
	D) 1 Control sample to be taken at a location at least 10 air miles from the site and not in the most prevalent wind directions. ²	Continuous sampler operation with weekly collection.	17	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
II. Radioiodine	A) 3 Indicator samples to be taken at two locations as given in I(A) above	Continuous sampler operation with weekly canister collection.	2 7 30	Gamma Isotopic for Iodine 131 weekly.
	B) 1 Indicator sample to be taken at the location as given in I(B) above.	Continuous sampler operation with weekly canister collection.	6	Gamma Isotopic for Iodine 131 weekly.
	C) 1 Indicator sample to be taken at the location as given in I(C) above.	Continuous sampler operation with weekly canister collection.	N/A	Gamma Isotopic for Iodine 131 weekly.
	D) 1 Control sample to be taken at a location similar in nature to I(D) above.	Continuous sampler operation with weekly canister collection.	17	Gamma Isotopic for Iodine 131 weekly.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
III. Direct	<p>A) 13 Indicator stations to form an inner ring of stations in the 13 accessible sectors within 1 to 2 miles of the plant.</p> <p>B) 16 indicator stations to form an outer ring of stations in the 16 accessible sectors within 3 to 5 miles of the plant.</p> <p>C) 11 Stations to be placed in special interest areas such as population centers, nearby residences, schools and in 4 or 5 areas to serve as controls.</p>	<p>Monthly or quarterly exchange^{5,7} two or more dosimeters at each location.</p> <p>Monthly or quarterly exchange^{5,7} two or more dosimeters at each location.</p> <p>Quarterly exchange⁷; two or more dosimeters at each location</p>	<p>1,2,3,4,5,6,7,8,9,10,29,30,47</p> <p>12,13,32,33,34,35,36,37,41,42,43,44,46,53,55,60</p> <p>16,17,18,19,20,31,45,52,54,56,58</p>	<p>Gamma dose monthly or quarterly</p> <p>Gamma dose monthly or quarterly</p> <p>Gamma dose quarterly.</p>
WATERBORNE IV. Surface Water	<p>A) 1 Indicator sample downstream to be taken at a location which allows for mixing a dilution in the ultimate receiving river.</p> <p>B) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.</p> <p>C) 1 Indicator sample to be taken in the upper reservoir of the pumped storage facility at the plant discharge canal.</p>	<p>Time composite samples with collection every month⁵</p> <p>Time composite samples with collection every month⁵</p> <p>Time composite samples with collection every month⁵</p>	<p>21^{3,6}</p> <p>22³</p> <p>23³</p>	<p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium⁷</p> <p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium⁷.</p> <p>Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium⁷.</p>
V. Ground Water	<p>A) 2 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.</p> <p>B) 1 Control sample from unaffected location</p>	<p>Quarterly grab sampling⁷</p> <p>Quarterly grab sampling⁷</p>	<p>26 27</p> <p>59</p>	<p>Gamma isotopic and tritium analyses quarterly⁷.</p> <p>Gamma isotopic and tritium analyses quarterly⁷.</p>

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
VI. Drinking Water	A) 1 Indicator sample from a nearby public ground water supply source.	Monthly grab sampling ⁵ .	28	Monthly ⁵ gamma isotopic, gross beta and quarterly ⁷ composite for tritium analyses.
	B) 1 Indicator (finished water) sample from the nearest downstream water supply.	Monthly composite sampling.	17	Monthly ⁵ gamma isotopic, and gross beta and quarterly ⁷ composite for tritium analyses.
	C) 1 Control (finished water) sample from an unaffected water supply.	Monthly composite sampling.	39	Monthly ⁵ gamma isotopic, and gross beta and quarterly ⁷ composite for tritium analyses
INGESTION: VII. Milk ⁴	A) Samples from milking animals in 3 locations within 5 km having the highest dose potential. If there are none then 1 sample from milking animals in each of 3 areas between 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year. ¹⁰	Semimonthly when animals are on pasture ⁸ , monthly other times ⁵	To be supplied when milk animals are found in accordance with criteria VII.A.	Gamma isotopic and I-131 analysis semimonthly ^a when animals are on pasture, monthly other times ⁵
	B) 1 Control sample to be taken at the location of a dairy > 20 miles distance and not in the most prevalent wind direction ² .	Semimonthly when animals are on pasture ⁸ , monthly other times ^{5,11}	16	Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times ⁵
	C) 1 Indicator grass (forage) sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A), above, when animals are on pasture	Monthly when available ⁵	To be supplied when milk animals are found in accordance with criteria VII.A.	Gamma isotopic.
	D) 1 Control grass (forage) sample to be taken at the location of VII(B) above.	Monthly when available ^{5,11}	16	Gamma isotopic.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
VIII. Food Products	A) 2 Samples of broadleaf vegetation grown in the 2 nearest offsite location of highest calculated annual average ground level D/Q if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5-8 km where the doses are calculated to be greater than 1 mrem/yr ¹⁰ .	Monthly when available ⁵ .	6 7	Gamma isotopic on edible portion.
	B) 1 Control sample for the same foods taken at least 10 miles distance and not in the most prevalent wind direction if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5 to 8 km where the doses are calculated to be greater than 1 mrem/yr ¹⁰ .	Monthly when available ⁵ .	18	Gamma isotopic on edible portion.
IX. Fish	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	23 ³	Gamma isotopic on edible portions semiannually ⁹ .
	B) 1 Indicator sample to be taken at a location in the lower reservoir.	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	21 ³	Gamma isotopic on edible portions semiannually ⁹ .
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated	Semiannual ⁹ collection of the following specie types if available: bass; bream, crappie; catfish, carp.	22 ³	Gamma isotopic on edible portions semiannually ⁹ .
AQUATIC: X. Sediment	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual grab sample. ⁹	23 ³	Gamma isotopic.
	B) 1 Indicator sample to be taken on or near the shoreline of the lower reservoir.	Semiannual grab sample. ⁹	21 ³	Gamma isotopic.
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual grab sample. ⁹	22 ³	Gamma isotopic.

FOOTNOTES

1. Reserved for future use.
2. Sample site locations are based on 5-year average meteorological analysis.
3. Though generalized areas are noted for simplicity of sample site enumeration, airborne, water and sediment sampling is done at the same location whereas biological sampling sites are generalized areas in order to reasonably assure availability of samples.
4. Milking animal and garden survey results will be analyzed annually. If the survey should indicate new dairying activity the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator Locations.
5. Not to exceed 35 days.
6. Time composite samples are samples which are collected with equipment capable of collecting an aliquot at time intervals which are short (e.g. hourly) relative to the compositing period.
7. At least once per 100 days.
8. At least once per 18 days.
9. At least once per 200 days.
10. The dose shall be calculated for the maximum organ and age group, using the guidance/methodology contained in Regulatory Guide 1.109, Rev. 1 and the parameters particular to the site.
11. Milk and forage sampling at the control location is only required when locations meeting the criteria of VII(A) are being sampled.

Table 7 – Supplemental Radiological Environmental Monitoring

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
AIRBORNE: S-I. Particulate	A) 1 Indicator sample monitoring the nearest community with the highest anticipated dose or ground level concentration.	Continuous sampler operation with weekly collection.	8	Gross beta following filter change; Monthly Composite (by location) for gamma isotopic.
S-II. Radioiodine	A) 1 Indicator sample to be taken from the location of S-1(A) above.	Continuous sampler operation with weekly collection.	8	Gamma isotopic for I-131 weekly.
S-III. Direct	A) 5 stations to be placed within the exclusion boundary.	Quarterly exchange ⁷ ; two or more dosimeters at each location.	61,62,63, 68 & 99	Gamma dose quarterly.
	B) 2 stations to be placed around VCSNS sludge lagoons.	Quarterly exchange ⁷ ; two or more dosimeters at each location.	94,97	Gamma dose quarterly.
WATERBORNE: S-IV. Surface Water	A) 1 indicator sample to be taken of the combined wastewater discharge.	Composite samples with monthly collection. ^{13,5}	77	Gamma isotopic and tritium.
	B) 1 Indicator sample taken at each storm drain outfall.	Daily sample with monthly composite.	72,73	Gamma isotopic and tritium.
S-V. Groundwater	A) 4 Indicator samples to be taken at NPDES monitoring wells.	Semiannual ⁹	GW-9, GW-12, GW-13A, GW15	Gamma isotopic, tritium and other as directed.
	B) 1 Control sample to be taken at NPDES monitoring wells.	Semiannual ⁹	GW-8	Gamma isotopic, tritium and other as directed.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
INGESTION: S-VII. Milk ⁴	A) 1 Sample from one of the nearest affected dairies at or beyond 5 miles.	Biweekly grab sample. ^{8,14,13}	14	Gamma isotopic and I-131 analysis biweekly.
	B) 1 Control sample to be taken at the location of a dairy greater than 20 miles distance and not in the most prevalent wind direction.	Biweekly grab sample. ^{8,14,13}	16	Gamma isotopic and I-131 analysis biweekly.
	C) 1 Indicator grass (forage) sample to be taken at the location of S-VII(A) above.	Monthly when available. ¹⁴	14	Gamma isotopic.
S-VII. Milk ⁴	D) 1 Control grass (forage) sample to be taken at the location of S-VII(B) above.	Monthly when available. ¹⁴	16	Gamma isotopic.
	E) 2 Indicator grass (forage) samples to be taken at 2 of the locations beyond but as close to the exclusion boundary as practical where the highest offsite sectorial ground level concentrations are anticipated.	Monthly when available.	2,7	Gamma isotopic.
	F) 1 Control grass (forage) sample to be used for routine monitoring along with S-IV(E) above.	Monthly when available.	18	Gamma isotopic.
S-VIII. Food Products	A) 1 Indicator sample of various types of foods grown in the area surrounding the plant (root, fruit, grain).	Annually during growing season. ¹¹	6,7	Gamma isotopic on edible portion.

FOOTNOTES

1. Reserved for future use.
2. Reserved for future use.
3. Reserved for future use.
4. Milking animal and garden survey results will be analyzed annually. If the survey should indicate new activity the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator Locations.
5. Not to exceed 35 days.
6. Reserved for future use.

7. At least once per 100 days.
 8. At least once per 18 days.
 9. At least once per 200 days.
 10. Reserved for future use.
 11. At least once per 400 days.
 12. Reserved for future use.
 13. Weekly, when circulating water is not operational.
 14. Milk and grass (forage) sampling is not required unless VCSNS gaseous releases exceed 5% of quarterly organ dose limits or radionuclides (attributed to VCSNS operation) are detected in broadleaf vegetation, grass or air samples at concentrations greater than required LLD. Sampling should continue for 2 months after plant releases are reduced to less than trigger levels and milk contamination levels have returned to background levels.
- ☐ The ODCM requires semimonthly sampling when animals are on pasture, monthly at other times.

Table 8 – Radiological Environmental Monitoring Program Summary for 2006

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Air Particulate (pCi/m ³)	Gross Beta (302)	6.41E-3 (1.0E-2)	2.08E-2 (250/250) (8.41E-3 to 4.18E-2)	Site 7 Environmental Lab Garden (1.0 mi E.)	2.32E-2 (51/51) (1.29E-2 to 4.18E-2)	2.01E-2 (52/52) (8.05E-3 to 3.63E-2)	0
	Gamma Spec (66)						
	¹³⁴ Cs	1.26E-2 (5.0E-2)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.84E-3 (6.0E-2)	All < LLD			All < LLD	0
Air Radioiodine (pCi/m ³)	¹³¹ I (302)	1.91E-2 (7.0E-2)	All < LLD			All < LLD	0
Direct (TLD) ⁵ (μR/hr)	Gamma(135) Quarterly	N/A	8.60E+0 (115/115) (5.60E+0 to 1.25E+1)	Site 4, Fairfield Hydro (1.2 mi., WNW)	1.22E+1 (4/4) (1.19E+1 to 1.25E+1)	8.52E+0 (20/20) (5.98+0 to 1.08E+1)	0
	Gamma(24) Special Interest	N/A	9.11E+0 (24/24) (5.50E+0 to 1.17E+1)	Site 52 Monticello Rt. 11 (3.8 mi., NNE)	1.14E+1 (4/4) (1.12E+1 to 1.17E+1)	N/A	0
Surface Water (pCi/l)	³ H (35)	5.17E+2 (2.0E+3)	5.83E+2 (4/23) (5.10E+2 to 6.70E+2)	Site 23 Discharge Canal Monticello Res. (0.5 mi ESE)	5.90E+2 (2/12) (5.10E+2 to 6.70E+2)	All < LLD	0
	Gamma Spec(35)						
	⁵⁴ Mn	2.17E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	2.47E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	5.35E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	2.25E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	4.87E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	4.35E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	2.80E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.90E+0 (1.5E+1)	All < LLD			All < LLD	0

Table 8 (cont.) - Radiological Environmental Monitoring Program Summary for 2006

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Surface Water (Continued)	¹³⁷ Cs	2.19E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	1.35E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	5.78E+0 (1.5E+1)	All < LLD			All < LLD	0
Ground Water (pCi/l)	³ H (12)	4.94E+2 N/A	All < LLD			All < LLD	0
	Gamma Spec (12)						
	⁵⁴ Mn	2.07E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	2.02E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	4.49E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	2.34E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	4.75E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	3.46E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	2.12E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.82E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.04E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	6.63E+0 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	2.60E+0 (1.5E+1)	All < LLD			All < LLD	0

Table 8 (Cont.) - Radiological Environmental Monitoring Program Summary for 2006

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Drinking Water ⁵ (pCi/l)	Gross Beta (36)	2.05E+0 (4.00E+0)	2.14E+0 (18/24) (1.28E+0 to 4.23E+0)	Site 17, Columbia Water Works (25 mi, SE)	2.26E+0 (9/12) (1.28E+0 to 4.23E+0)	2.06E+0 (9/12) (1.56E+0 to 2.65E+0)	0
	³ H (36)	5.09E+2 (2.0E+3)	6.19E+2 (2/24) (5.15E+2 to 7.22E+2)	Site 17, Columbia Water Works (25 mi, SE)	6.19E+2 (2/12) (5.15E+2 to 7.22E+2)	All < LLD	0
	Gamma Spec (72) ¹⁰						
	⁵⁴ Mn	3.97E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	3.66E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	7.44E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	4.05E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	7.72E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	6.12E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	5.63E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³¹ I	3.84E-1 (1.0E+0)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.78E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.90E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	1.35E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	5.61E+0 (1.5E+1)	All < LLD			All < LLD	0

Table 8 (Cont.)- Radiological Environmental Monitoring Program Summary for 2006

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Grass (pCi/kg wet)	Gamma Spec (36)						
	¹³¹ I	2.57E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	2.20E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.78E+1 (8.0E+1)	6.89E+1 (10/24) (2.31E+1 to 1.83E+2)	Site 2 Transmission Line (1.1 mi SW)	6.89E+1(10/12) (2.31E+1 to 1.83E+2)	All < LLD	0
Broadleaf Vegetation (pCi/kg wet)	Gamma Spec (36)						
	¹³¹ I	2.11E+ 1 (6.0E+ 1)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.98E+ 1 (6.0E+ 1)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.26E+ 1 (8.0E+ 1)	All < LLD			All < LLD	0
Other Vegetation (pCi/kg wet)	Gamma Spec (9)						
	¹³¹ I	1.18E+1 (6.0E+ 1)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.16E+ 1 (6.0E+ 1)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.65E+ 1 (8.0E + 1)	All < LLD			All < LLD	0
Fish ⁷ (pCi/kg wet)	Gamma Spec (18)						
	⁵⁴ Mn	2.12E+ 1 (1.3E+ 2)	All < LLD			All < LLD	0
	⁵⁸ Co	1.93E + 1 (1.3E+ 2)	All < LLD			All < LLD	0
	⁵⁹ Fe	5.23E+ 1 (2.6E+ 2)	All < LLD			All < LLD	0

Table 8 (Cont.)- Radiological Environmental Monitoring Program Summary for 2006

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Fish ⁷ (Cont)	⁶⁰ Co	2.40E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁶⁵ Zn	5.37E+1 (2.6E+2)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.85E+1 (1.3E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.35E+1 (1.5E+2)	1.47E+1 (2/12) (9.98E+0 to 1.94E+1)	Site 23 Monticello Reservoir (0.5 mi ESE)	1.94E+1 (1/6) (1.94E+1 to 1.94E+1)	All < LLD	0
Sediment (pCi/kg) ⁸	Gamma Spec (6)						
	⁵⁴ Mn	1.84E+1 N/A	All < LLD			All < LLD	0
	⁵⁸ Co	1.65E+1 N/A	All < LLD			All < LLD	0
	⁶⁰ Co	2.01E+1 N/A	1.53E+1 (2/4) (1.49E+1 to 1.57E+1)	Site 23 Monticello Reservoir (0.5 mi ESE)	1.53E+1 (2/2) (1.49E+1 to 1.57E+1)	All < LLD	0
	¹³⁴ Cs	1.70E+1 (1.5E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	* (1.8E+2)	6.74E+1 (4/4) (1.80E+1 to 1.16E+2)	Site 23 Monticello Reservoir (0.5 mi ESE)	1.12E+2 (2/2) (1.08E+2 to 1.16E+2)	1.50E+2 (2/2) (9.99E+1 to 2.00E+2)	0

Table 8 (cont) - Radiological Environmental Monitoring Program Summary for 2006

Footnotes

1. Includes indicator and control analyses. Does not include supplemental samples. Site 8 Air Particulates and Air Radioiodines are included as indicators.
2. Values given are maximum MDA values for indicator locations calculated from the program data analyses with maximum acceptable LLD values allowed from NRC guidelines are given in parentheses.
3. Mean and range are based on detectable measurements only. The fractions of detectable measurements (i.e., number of positive results/total number of measurements) at specific locations are indicated in parentheses.
4. Any confirmed measured level of radioactivity in any environmental medium that exceeds the reporting requirements of ODCM, Section 1.4.1.2.
5. Detection sensitivity is approximately 10 mrem/yr (1.0 μ R/hr).
6. Elevated levels of ^{214}Pb and ^{214}Bi were observed in Jenkinsville drinking water samples. The values are not reported here because they are naturally occurring (do not originate from VCSNS) and furnish no quantifiable information of interest.
7. Fish include 3 groups (Bass, Bream/Crappie, Catfish/Carp.)
8. Elevated levels of ^{214}Pb and ^{214}Bi plus other ^{226}Ra daughter products and ^{228}Ac plus other ^{232}Th daughter products were observed in all sediment samples. The values are not reported here because they are naturally occurring (do not originate from VCSNS) and furnish no quantifiable information of interest.
9. Reserved for future use.
10. Drinking water resin prepared and counted for ^{131}I as separate sample.
11. Reserved for future use.
- * All measurements had positive results, no MDA values calculated.

Table 9– Radiological Environmental Program Preoperational (Baseline) Summary

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
Air Particulate (pCi/m ³) (1981-1982)	Gross Beta (1300)	4.1E-3 (1.0E-2)	1.1E-1 (562/564) ⁴ (1.3E-2 to 5.5E-1)	Site 13, North Dam (2.9 mi NNW)	1.3E-1 (52/52) (2.1E-2 to 5.5E-1)	1.2E-1 (153/155) (7.9E-3 to 6.1E-1)	0
			2.7E-2 (456/462) ⁴ (9.3E-3 to 6.6E-2)	Site 8, Mon. Res. S of Rd 224 (1.5 ENE)	3.0E-2 (42/42) (1.2E-2 to 6.0E-2)	2.8E-2 (125/126) (1.2E-2 to 5.8E-2)	
	Gamma Spec (307)						
	¹³⁴ Cs	3.0E-3 (1.0E-2)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.1E-3 (1.0E-2)	3.2E-3 (22/241) (1.5E-3 to 5.2E-3)	Site 10, Met Tower (2.4 mi NNE)	3.8E-3 (2/22) (2.5E-3 to 5.2E-3)	4.2E-3 (4/66) (3.2E-3 to 5.6E-3)	0
Air Radiiodine (pCi/m ³) (1982)	¹³¹ I (290)	3.6E-2 (7.0E-2)	All < LLD			All < LLD	0
Direct (TLD) ⁵ (μR/hr) (1978-1982)	Gamma (1220) Monthly	0.5 N/A	9.9 (915/915) (6.7 to 14.7)	Site 13, North Dam (2.9 mi NNW)	13.1 (61/61) (12.2 to 14.2)	9.7 (305/305) (6.4 to 13.5)	0
	Gamma (161) Quarterly	0.5 N/A	10.2 (154/154) (6.8 to 14.7)	Site 55, St. Barnabas Church (2.8 mi E)	14.0(7/7) (13.1 to 14.7)		0
Surface Water (pCi/l) (1981-1982)	³ H (43)	1.1E+3 (2.0E+3)	1.4E+3 (18/29) (1.1E+3 to 2.4E+3)	Site 17, Columbia Canal (24.7 mi, SE)	1.6E+3 (2/7) (1.4E+3 to 1.8E+3)	1.2E+3 (6/14) (6.7E+2 to 1.6E+3)	0
	Gamma Spec (140)						
	⁵⁴ Mn	2.7E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	2.9E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	6.0E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	2.4E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	7.9E-1 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	5.2E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	3.3E-1 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.0E-1 (1.5E+1)	All < LLD			All < LLD	0

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
	¹³⁷ Cs	2.2E-1 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	2.2E+0 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La (1982 only)	5.5E-1 (1.5E+1)	All < LLD			All < LLD	0
Ground Water (pCi/l) (1981-1982)	³ H (29)	9.0E+2 (2.0E+3)	1.5E+3 (16/16) (9.5E+2 to 2.3E+3)	Site 26, Onsite Well P4 (265 ft, W)	1.6E+3 (8/8) (9.5E+2 to 2.3E+3)	1.3E+3 (13/13) (1.0E+3 to 1.9E+3)	0
	Gamma Spec (32)						
	⁵⁴ Mn	3.7E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	3.8E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	7.8E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	3.8E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	8.1E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	6.8E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	4.6E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.7E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.8E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	1.9E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La (1982 only)	5.0E0 (1.5E+1)	All < LLD			All < LLD	0
Drinking Water ⁶ (pCi/l) (1981-1982)	Gross Beta ⁷	(2.0E+0)					
	³ H (14)	6.3E+2 (1.0E+3)	7.8E+2 (6/14) (6.8E+2 to 9.8E+2)	Site 28, Jenkinsville (2.0 mi SE) ⁷	8.4E+2 (3/7) (7.0E+2 to 9.8E+2)		0
	Gamma Spec (44)						
	⁵⁴ Mn	3.0E-1 (1.5E+1)	All < LLD				0
	⁵⁸ Co	2.7E-1 (1.5E+1)	All < LLD				0

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
	⁵⁹ Fe	9.6E0 (3.0E+1)	All < LLD				0
	⁶⁰ Co	2.6E-1 (1.5E+1)	All < LLD				0
	⁶⁵ Zn	3.4E-1 (3.0E+1)	All < LLD				0
	⁹⁵ Zr	4.8E-1 (1.5E+1)	All < LLD				0
	¹³¹ I	3.4E-1 (1.5E+1)	All < LLD				0
	⁹⁵ Nb	7.4E-1 (1.0E+0)	All < LLD				0
	¹³⁴ Cs	2.2E-1 (1.0E+1)	All < LLD				0
	¹³⁷ Cs	2.4E-1 (1.8E+1)	All < LLD				0
	¹⁴⁰ Ba	2.5E0 (6.0E+1)	All < LLD				0
	¹⁴⁰ La (1982 only)	4.4E-1 (1.5E+1)	All < LLD				0
Milk (pCi/l) (1981-1982)	Gamma Spec (94)						
	¹³¹ I	6.3E-1 (1.0E+0)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.3E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	4.6E0 (1.5E+1)	4.1E+0 (8/47) (2.8E+0 to 6.1E+0)	Site 14, Dairy (5.1 mi., W)	4.1E+0 (8/47) (2.8E+0 to 6.1E+0)	5.7E+0 (37/47) (3.7E+0 to 9.2E+0)	0
	¹⁴⁰ Ba	1.1E+1 (1.5E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	4.4E+0 (1.5E+1)	All < LLD			All < LLD	0
Grass (pCi/kg wet) (1981-1982)	Gamma Spec (82)						
	¹³¹ I	6.7E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	2.7E+1 (8.0E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.3E+1 (8.0E+1)	5.0E+1 (13/51) (1.6E+1 to 1.6E+2)	Site 14, Dairy (5.1 mi W)	5.9E+1 (5/29) (1.6E+1 to 1.6E+2)	1.3E+2 (6/31) (1.3E+1 to 3.4E+2)	0

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
Broadleaf Vegetation (pCi/kg wet) (1980-1982)	Gamma Spec (10)						
	¹³¹ I	3.7E+1 (6.0E+1)	All < LLD				0
	¹³⁴ Cs	1.9E+1 (8.0E+1)	All < LLD				0
	¹³⁷ Cs	2.1E+1 (8.0E+1)	3.1E+1 (2/7) (1.8E+1 to 3.6E+1)	Site 2, Trans. Line (1.2 mi SW)	3.6E+1 (1/1) (Single Value)	All < LLD	0
Other Vegetation (pCi/kg wet) (1980-1982)	Gamma Spec (32)						
	¹³⁴ Cs	8.4E+0 (8.0E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.0E+1 (8.0E+1)	All < LLD			All < LLD	0
Fish (pCi/kg wet) (1980 - 1982)	Gamma Spec (92)						
	¹³⁴ Cs	1.4E+1 (1.3E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.8E+1 (1.3E+2)	2.8E+1 (50/71) (1.1E+1 to 1.0E+2)	Site 24, Recreation Lake (5.5 mi, N)	3.4E+1 (17/23) 1.2E+1 to 1.0E+2	3.1E+1 (19/21) (1.0E+1 to 7.9E+1)	0
	⁵⁸ Co	2.6E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁵⁴ Mn	1.8E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁵⁹ Fe	9.0E+1 (2.6E+2)	All < LLD			All < LLD	0
	⁶⁵ Zn	4.1E+1 (2.6E+2)	All < LLD			All < LLD	0
	⁶⁰ Co	1.8E+1 (1.3E+2)	All < LLD			All < LLD	0
Sediment (pCi/kg) (1980-1982)	Gamma Spec (24)						
	¹³⁴ Cs	2.3E+1 (1.5E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.4E+1 (1.5E+2)	1.7E+2 (12/18) (2.6E+1 to 4.5E+2)	Site 21, Parr Reservoir (2.7 mi, SSW)	2.6E+2 (6/6) (2.6E+1 to 4.5E+2)	4.2E+2 (6/6) (1.8E+1 to 1.0E+3)	0

Table 9 (Cont.)- Radiological Environmental Program Preoperational (Baseline) Summary

Footnotes

1. Values given are MDA values calculated from the program data analyses with maximum acceptable LLD values allowed from NRC guidelines given in parentheses.
2. Mean and range are based on detectable measurements only. The fractions of detectable measurements at specific locations are indicated in parentheses.
3. A non-routine measurement is any confirmed measured level of radioactivity in an environmental medium that exceeds the reporting requirements of VCSNS ODCM, Section 1.4.1.2.
4. The baseline values are high because of the fallout from the Chinese bomb test in 1980. The first set of data reflects the 1981 baseline. The second set of data reflects the 1982 baseline, essentially free of bomb test fallout. The 1982 data covers the period 1/1/82 - 10/22/82.
5. Detection sensitivity is approximately 5 mrem/yr (0.5 μ R/hr) determined from the analyses of five years of preoperational data.
6. No control location was specified for drinking water during the preoperational monitoring period.
7. Inconclusive data.

**Table 10 - Results of 2006 Environmental Intercomparison Program with
Independent Lab, Analytics, Inc.**

Comparison Study (Measurement Unit)	Date	Nuclides	Vendor Lab Results	Env Lab Results	Agreement
Gamma Isotopic Liquid 4 Liter (pCi/l)	9/20	¹³¹ I	80	91	Yes
		¹⁴¹ Ce	88	97	Yes
		⁵¹ Cr	288	353	Yes
		⁵⁹ Fe	45	60	Yes
		¹³⁴ Cs	87	94	Yes
		¹³⁷ Cs	179	200	Yes
		⁵⁸ Co	112	117	Yes
		⁵⁴ Mn	115	126	Yes
		⁶⁵ Zn	148	162	Yes
		⁶⁰ Co	137	154	Yes
Gamma Filter (pCi)	9/25	¹⁴¹ Ce	77	80	Yes
		⁵¹ Cr	253	249	Yes
		⁵⁹ Fe	39	55	Yes
		¹³⁴ Cs	76	60	Yes
		¹³⁷ Cs	157	160	Yes
		⁵⁸ Co	98	98	Yes
		⁵⁴ Mn	101	108	Yes
		⁶⁵ Zn	130	143	Yes
		⁶⁰ Co	120	114	Yes
Alpha/Beta Water (pCi/l)	3/31	Alpha	38	44	Yes
		Beta	262	270	Yes
Gamma Isotopic Pulverized Soil (pCi/g)	3/23	¹⁴¹ Ce	1.48E-1	1.49E-1	Yes
		⁵¹ Cr	4.00E-1	3.28E-1	Yes
		¹³⁴ Cs	1.73E-1	1.50E-1	Yes
		¹³⁷ Cs	2.27E-1	2.65E-1	Yes
		⁵⁸ Co	1.50E-1	1.43E-1	Yes
		⁵⁴ Mn	1.34E-1	1.43E-1	Yes
		⁵⁹ Fe	1.24E-1	1.37E-1	Yes
		⁶⁵ Zn	2.52E-1	2.60E-1	Yes
		⁶⁰ Co	1.83E-1	1.65E-1	Yes
I-131 Solid (pCi)	3/23	¹³¹ I	100	117	Yes

Comparison Study (Measurement Unit)	Date	Nuclides	Vendor Lab Results	Env Lab Results	Agreement
Gamma Isotopic Liquid 1 Liter (pCi/l)	3/23	¹³¹ I	67	69	Yes
		¹⁴¹ Ce	87	102	Yes
		⁵¹ Cr	234	310	Yes
		¹³⁴ Cs	101	103	Yes
		¹³⁷ Cs	74	79	Yes
		⁵⁸ Co	88	94	Yes
		⁵⁴ Mn	78	93	Yes
		⁵⁹ Fe	72	86	Yes
		⁶⁵ Zn	148	148	Yes
		⁶⁰ Co	107	116	Yes
Tritium (pCi/l)	3/29	³ H	4210	3670	Yes
Gross Beta Filter (pCi)	9/25	N/A	83	81	Yes
Charcoal Cartridge (pCi)	9/20	¹³¹ I	90	94	Yes
Gamma Isotopic Gas Simulated 4 Liter (pCi)	9/21	¹⁴¹ Ce	734	708	Yes
		⁵¹ Cr	2400	2290	Yes
		¹³⁴ Cs	726	752	Yes
		¹³⁷ Cs	1500	1480	Yes
		⁵⁸ Co	934	878	Yes
		⁵⁴ Mn	961	991	Yes
		⁵⁹ Fe	373	415	Yes
		⁶⁵ Zn	1240	1270	Yes
		⁶⁰ Co	1140	1130	Yes

The station uses the criteria for accepting licensee's measurements contained in the NRC Inspection Procedure 83502.3 to determine if agreement has been achieved between the Environmental Countroom and the Off-site Vendor (Analytics). Analytics uses a normal resolution of 30 which corresponds to a comparison ratio of 0.75 to 1.33. However, some of the environmental samples have very low count rates which lead to greater uncertainty and a resolution of less than 15. Such is the case with Fe-59 in Gamma Isotopic Liquid (4l) and Gamma Filter. The Fe-59 analysis are considered to be in agreement and within the 0.6 to 1.66 band established for resolutions less than 15.

Table 11 – 2006 Environmental Sampling Program Exceptions

Media	Sample Location	Month (Week No.)	Cause for Exception
Air Particulate & Radioiodine	Site 2	Jan (3)	Breaker tripped caused by storm.
	Site 2	May (21)	Breaker tripped caused by storm.
	Site 6	May (22)	Breaker tripped caused by State sampler. Rewired to separate breakers.
	Site 6, 8, & 30	Jun (24)	Breaker tripped caused by storm.
	Site 30	Jul (30)	Loss of power due to problem with substation.
	Site 6, 7, & 8	Nov (44)	Samples lost while being transported to lab for analysis.
Direct Radiation	Site 44	Dec (52)	TLD missing
Surface Water	Site 21	Apr (16)	Equipment failure


A project to improve air sampler reliability was implemented in June of 2006. Upgrades were made to the air sample station electrical power supplies and circuits. Since these upgrades were completed no samples have been missed due to breaker trips.



LEGEND

- CONTROL SAMPLE LOCATIONS
- A=AIR PARTICULATE SITE
- D=DIRECT (TLD) SITE
- I=AIRBORNE RADIOIODINE SITE
- W=WATER SITE
- O=OTHER (GARDEN PRODUCTS, FISH, SEDIMENT, GRASS, MILK)

REFERENCE:
THE BASE FOR THIS MAP WAS PREPARED FROM A
PORTION OF USGS STATE OF GEORGIA, 1970.



South Carolina Electric & Gas Co.
Virgil C. Summer Nuclear Station


Regional Location Map

Figure 1-1

REV. DATE 12-5

LEGEND

- PRIMARY SAMPLE LOCATIONS
- A = AIR PARTICULATE SAMPLE SITE
- D = DIRECT (TLD) SAMPLE SITE
- I = AIRBORNE RADIOIODINE SAMPLE SITE
- W = WATER SAMPLING LOCATION
- O = OTHER
- = TLD (ID) SAMPLING LOCATIONS

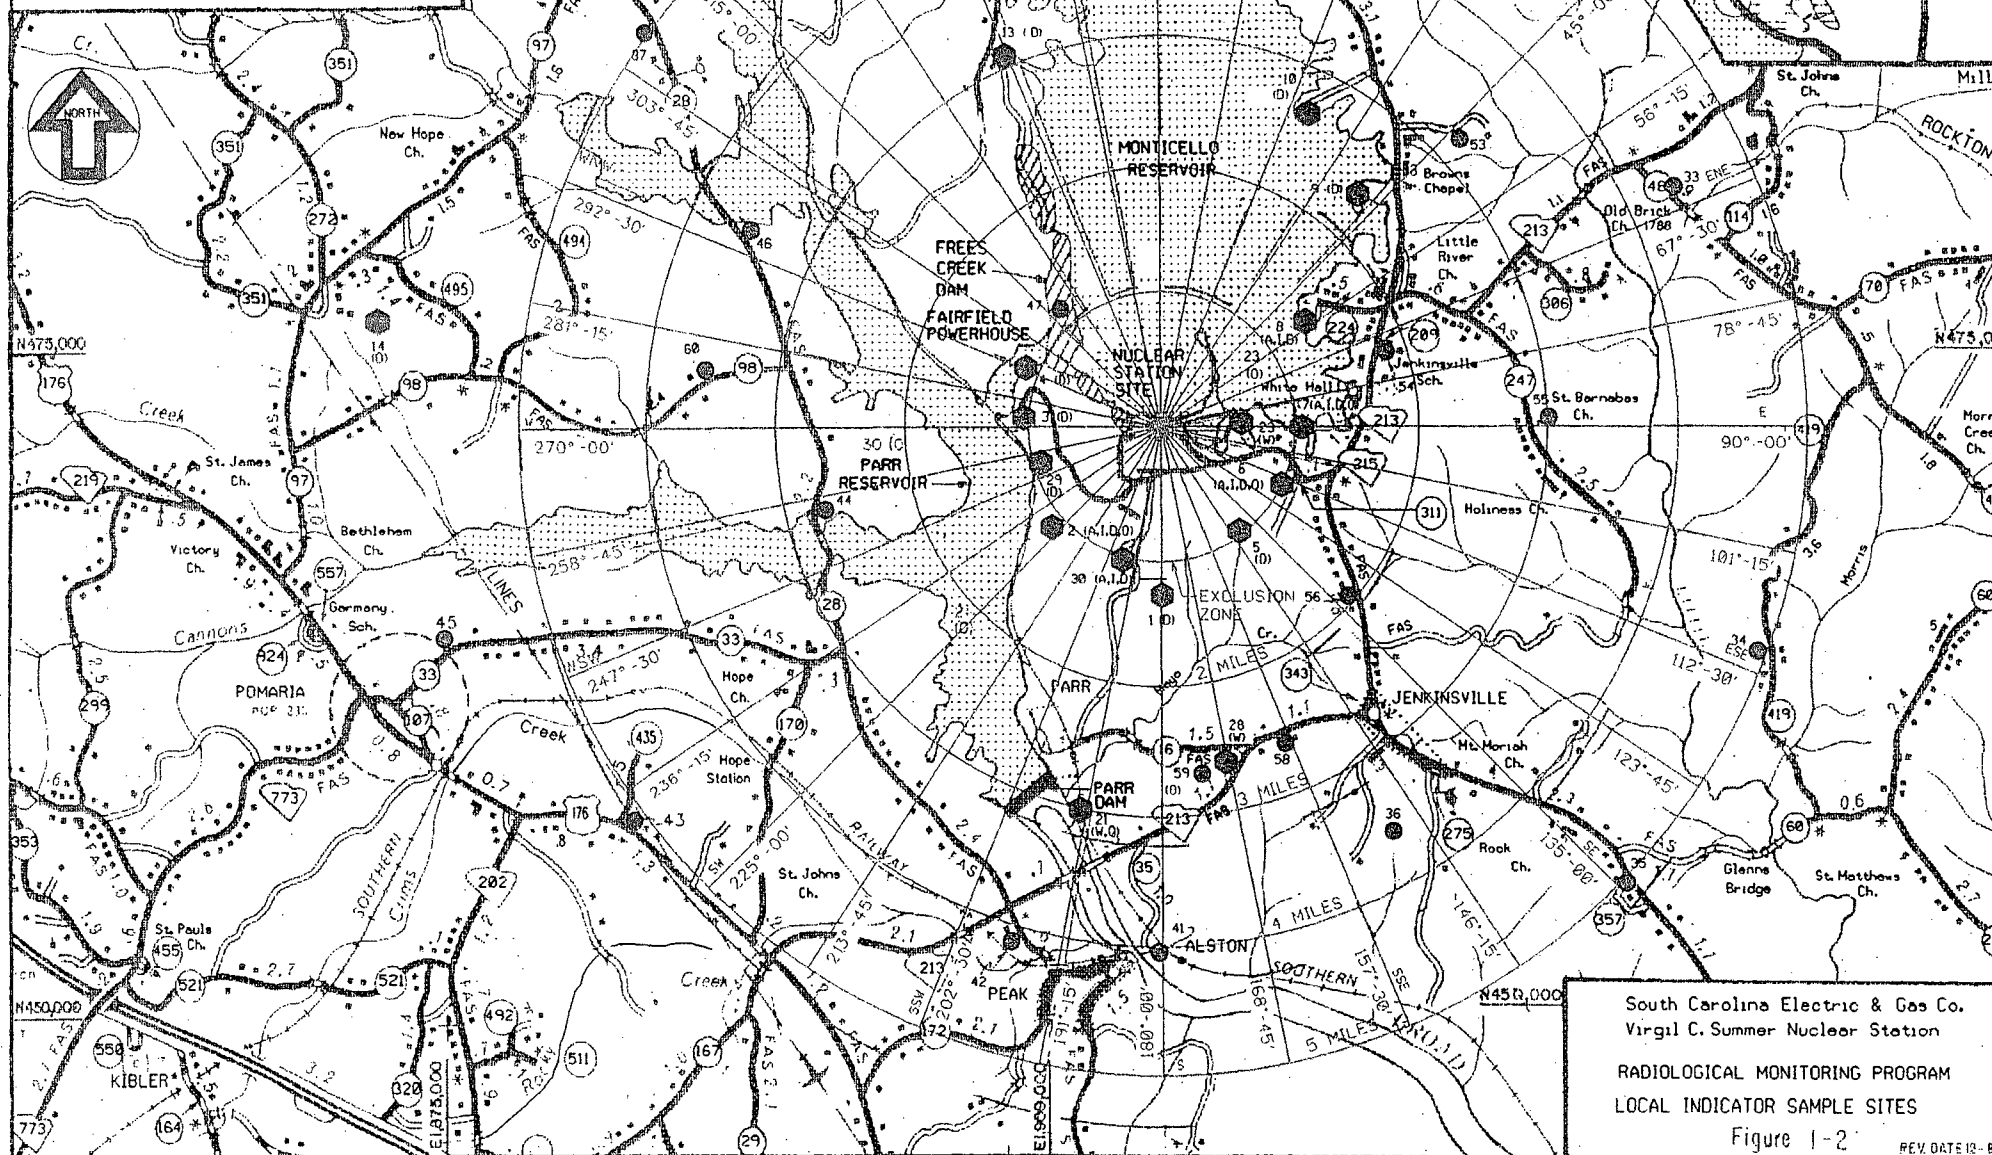

South Carolina Electric & Gas Co.
Virgil C. Summer Nuclear Station

RADIOLOGICAL MONITORING PROGRAM
LOCAL INDICATOR SAMPLE SITES

Figure 1-2

REV. DATE 12-67

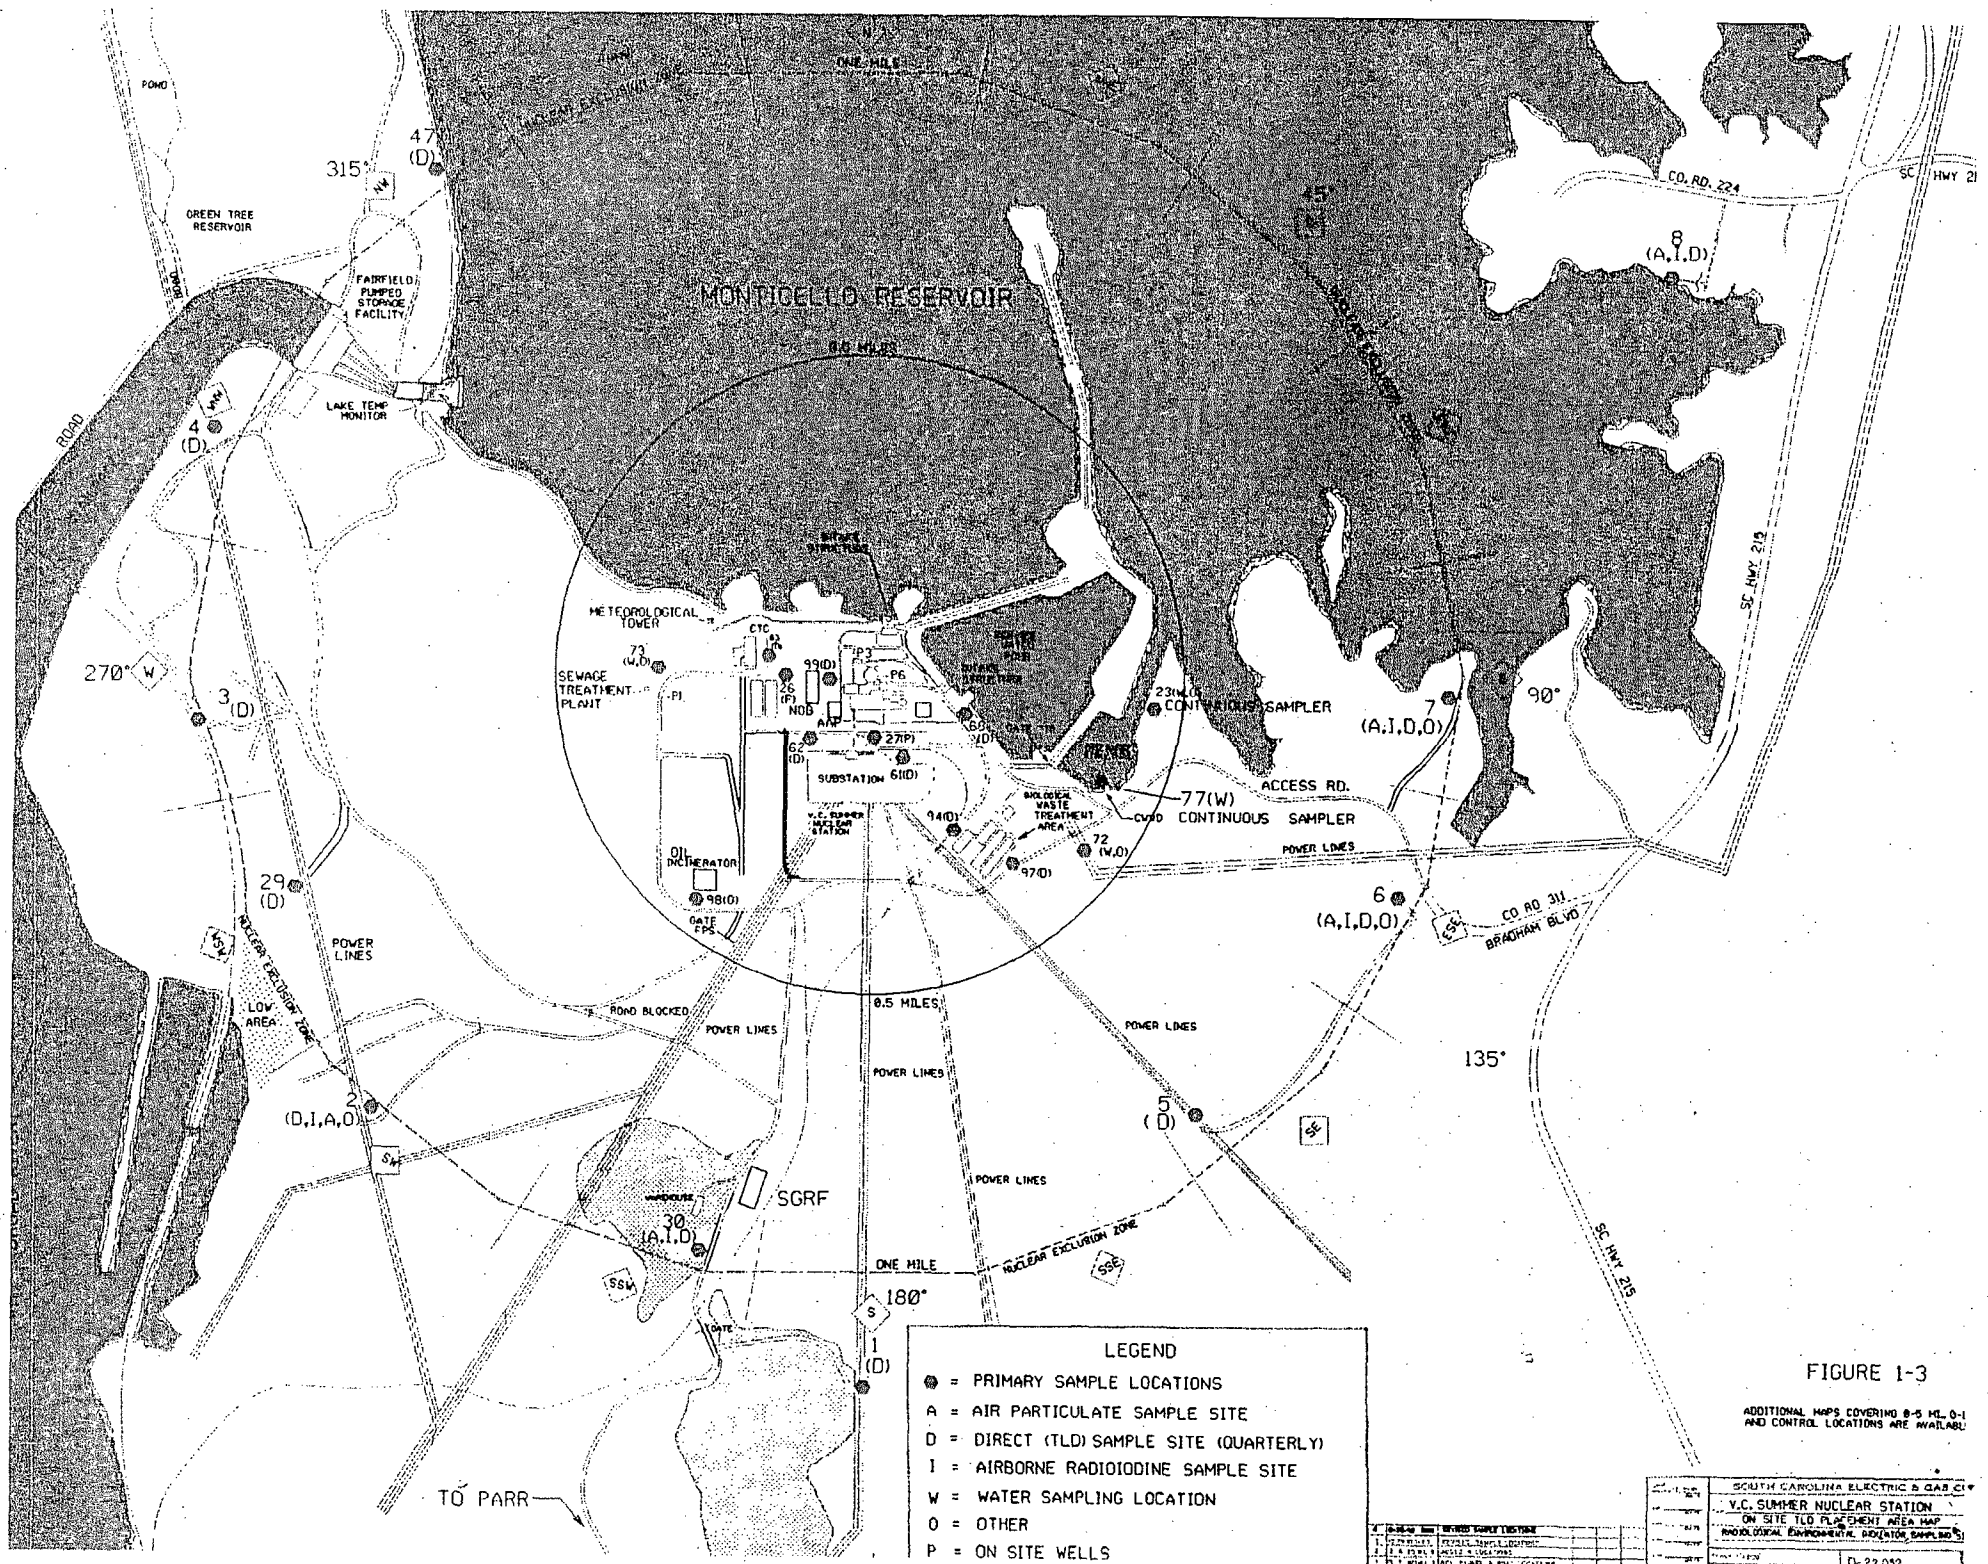


FIGURE 1-3

ADDITIONAL MAPS COVERING 0-5 MI. 0-1 AND CONTROL LOCATIONS ARE AVAILABLE

SOUTH CAROLINA ELECTRIC & GAS CO.	
V.C. SUMMER NUCLEAR STATION	
ON SITE TLD PLACEMENT AREA MAP	
PHOTOGRAPHIC ENVIRONMENTAL MONITORING	
DATE	10/1/78
BY	J. L. HARRIS
SCALE	1" = 1/2 MI.
PROJECT NO.	100-100000
REVISION	1
APPROVED	
DATE	