



U.S. Standard Sieve Nos.

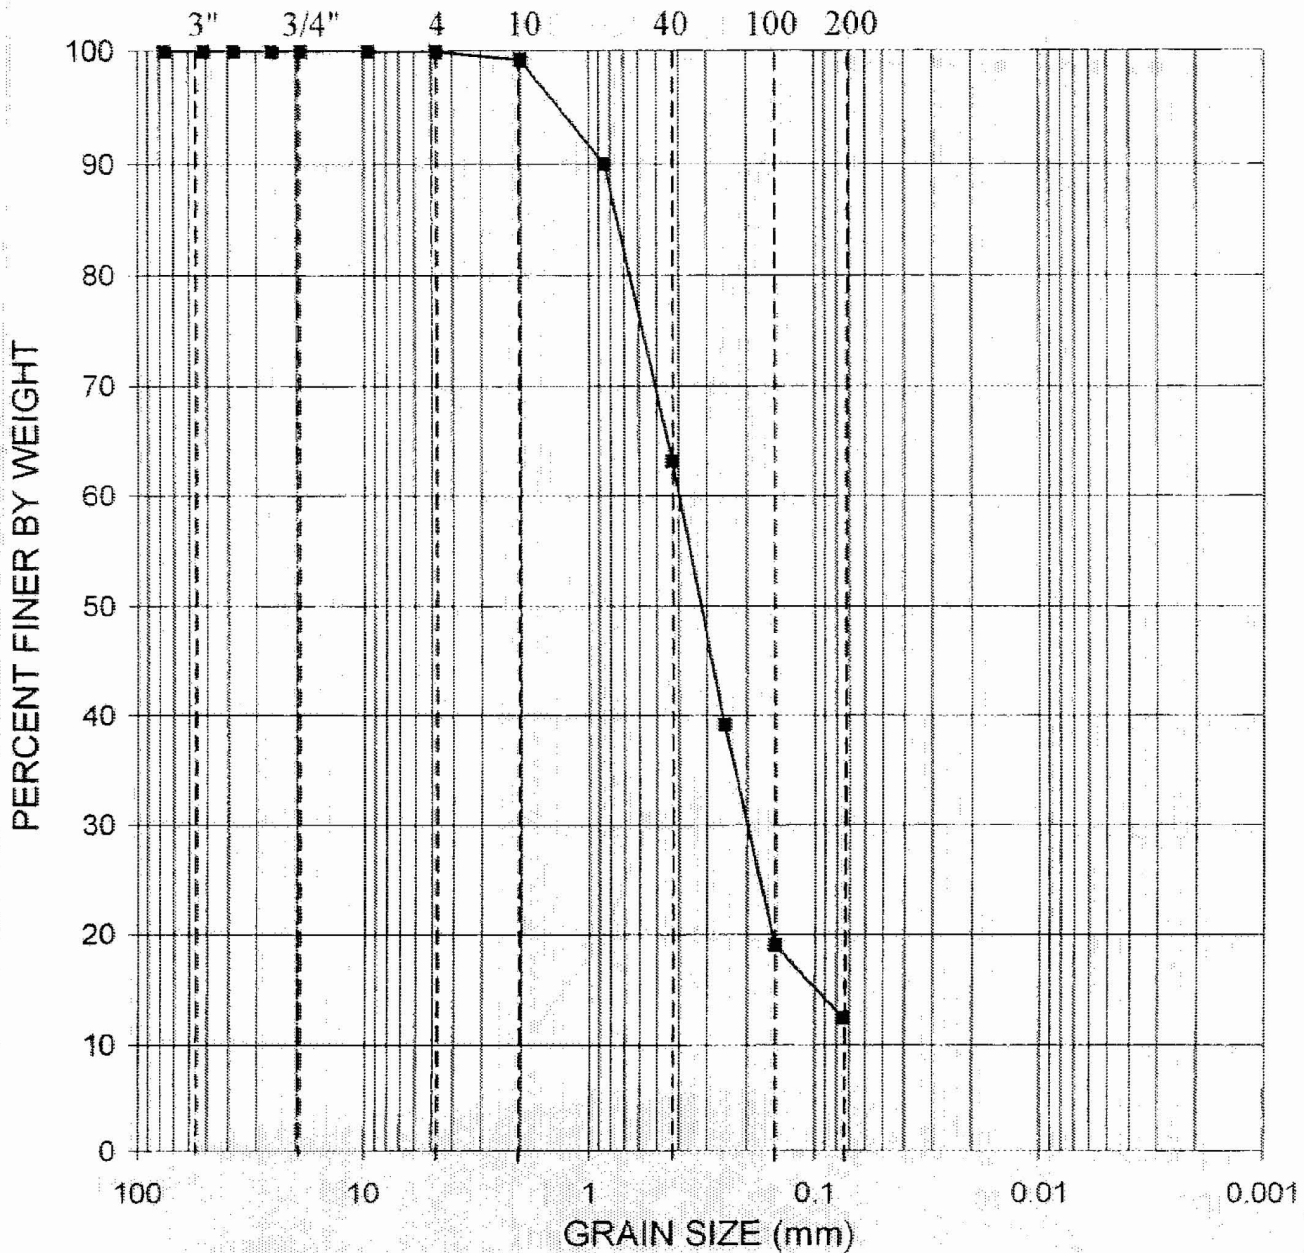

GRAVEL	SAND	SILT OR CLAY
--------	------	--------------


GRADATION CURVE

ASTM D422

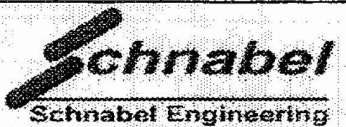Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.:	06120048.00	Date:	9/14/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI		
B-423	2.5	Silty SAND, brown	SM				

PERCENT FINER BY WEIGHT


U.S. Standard Sieve Nos.

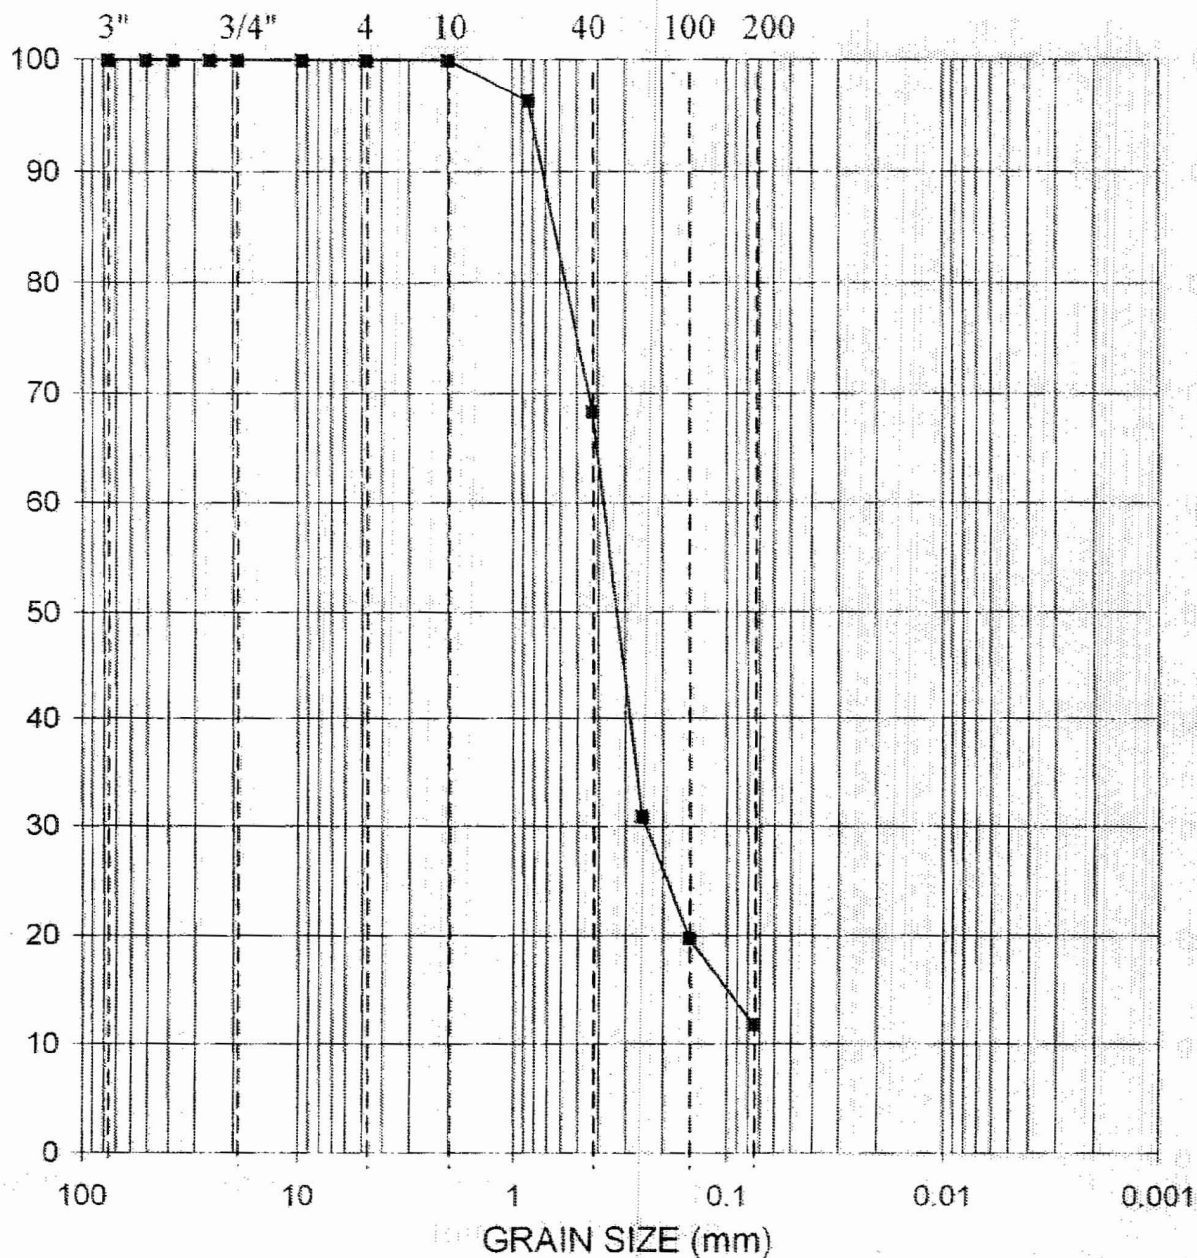


GRAVEL	SAND	SILT OR CLAY
--------	------	--------------

GRADATION CURVE

ASTM D422

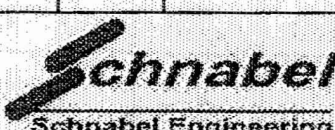
Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.:	06120048.00	Date:	9/14/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI		
B-423	23.5	Poorly Graded SAND, with silt, brown	SP-SM				

U.S. Standard Sieve Nos.

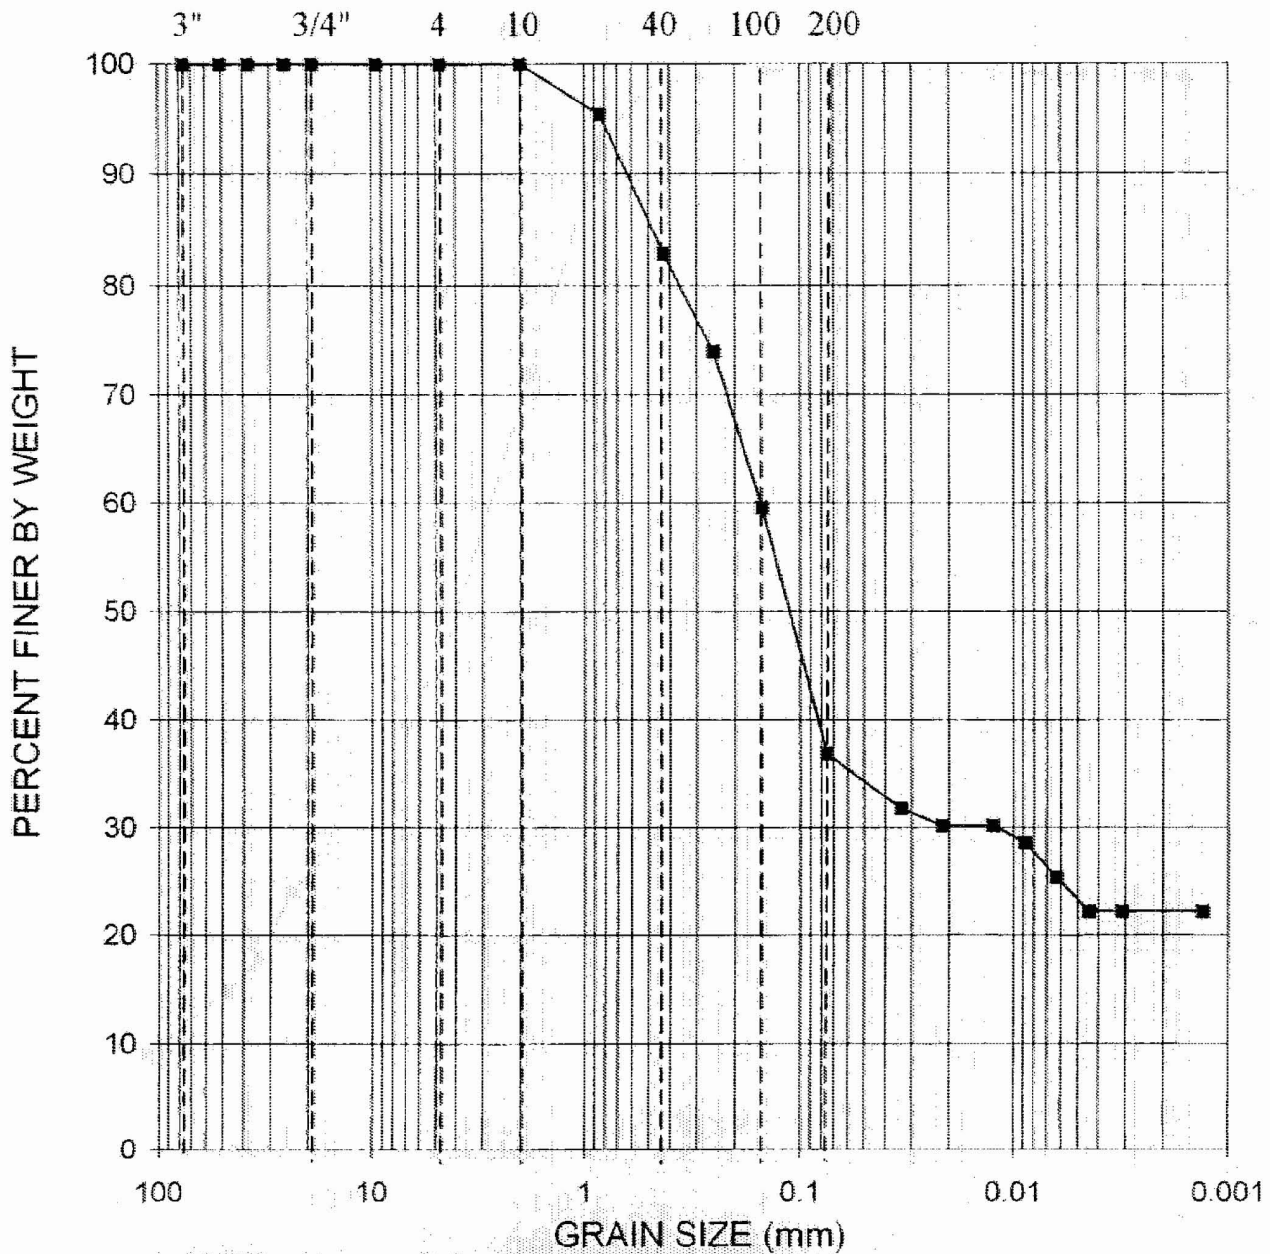


GRADATION CURVE

ASTM D422

Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.	06120048.00	Date:	9/21/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI		
B-423	38.5	Clayey SAND, light gray-brown	SC	43	28		

U.S. Standard Sieve Nos.

PERCENT FINER BY WEIGHT

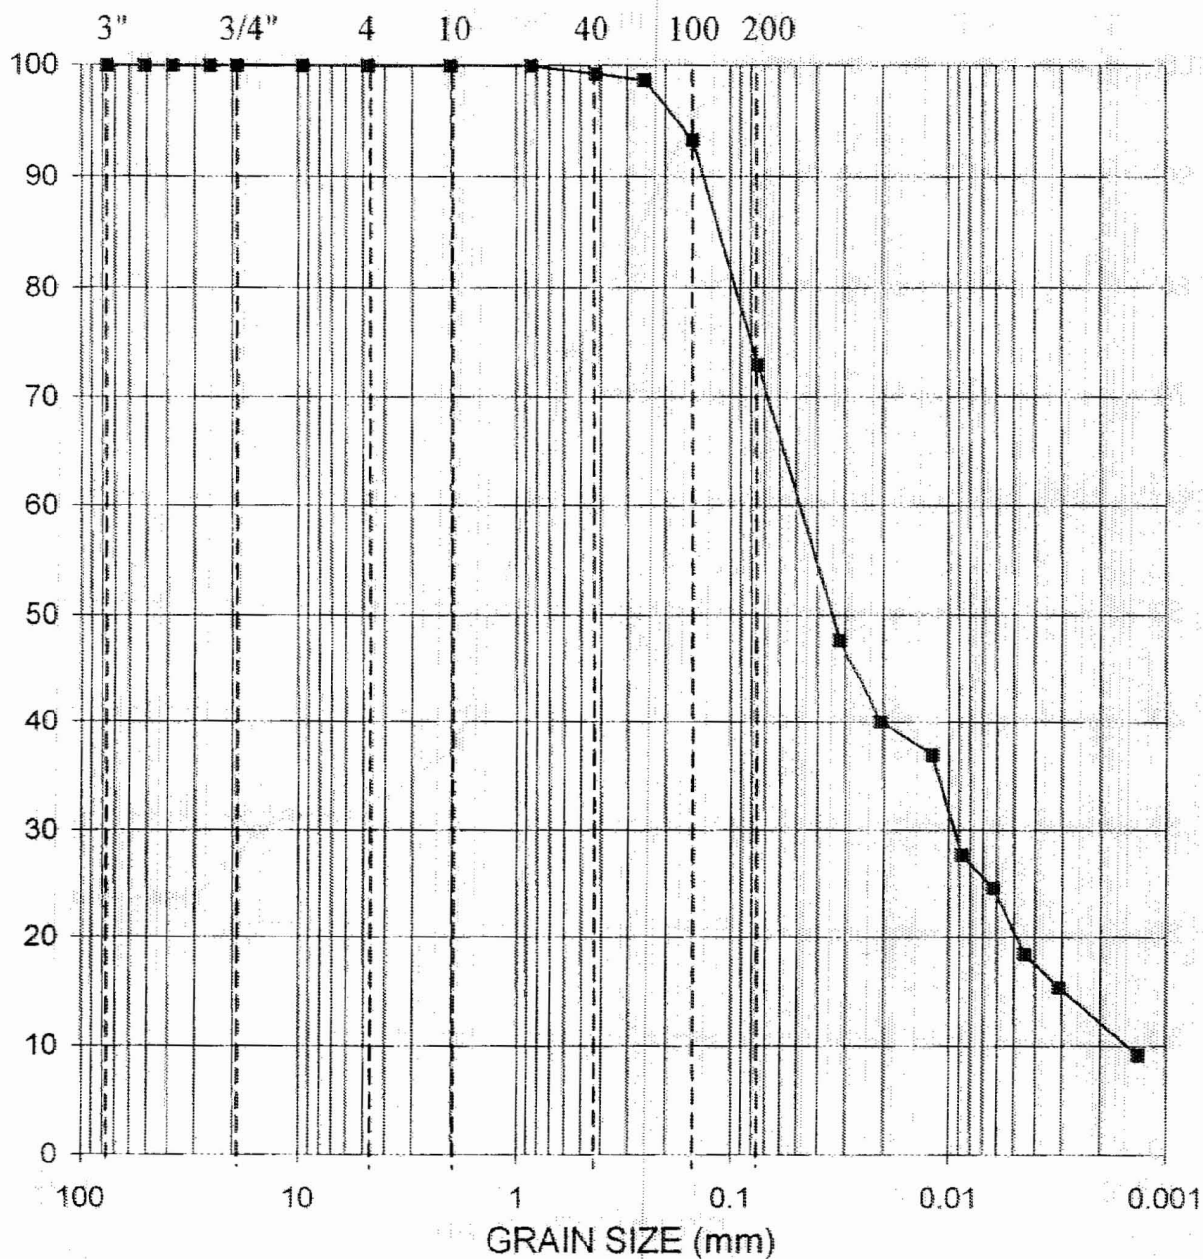

GRAVEL	SAND	SILT OR CLAY
--------	------	--------------


GRADATION CURVE

ASTM D422

Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.:	06120048.00	Date:	9/21/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI		
B-423	43.5	FAT CLAY, with sand, gray	CH	55	35		

U.S. Standard Sieve Nos.

PERCENT FINER BY WEIGHT

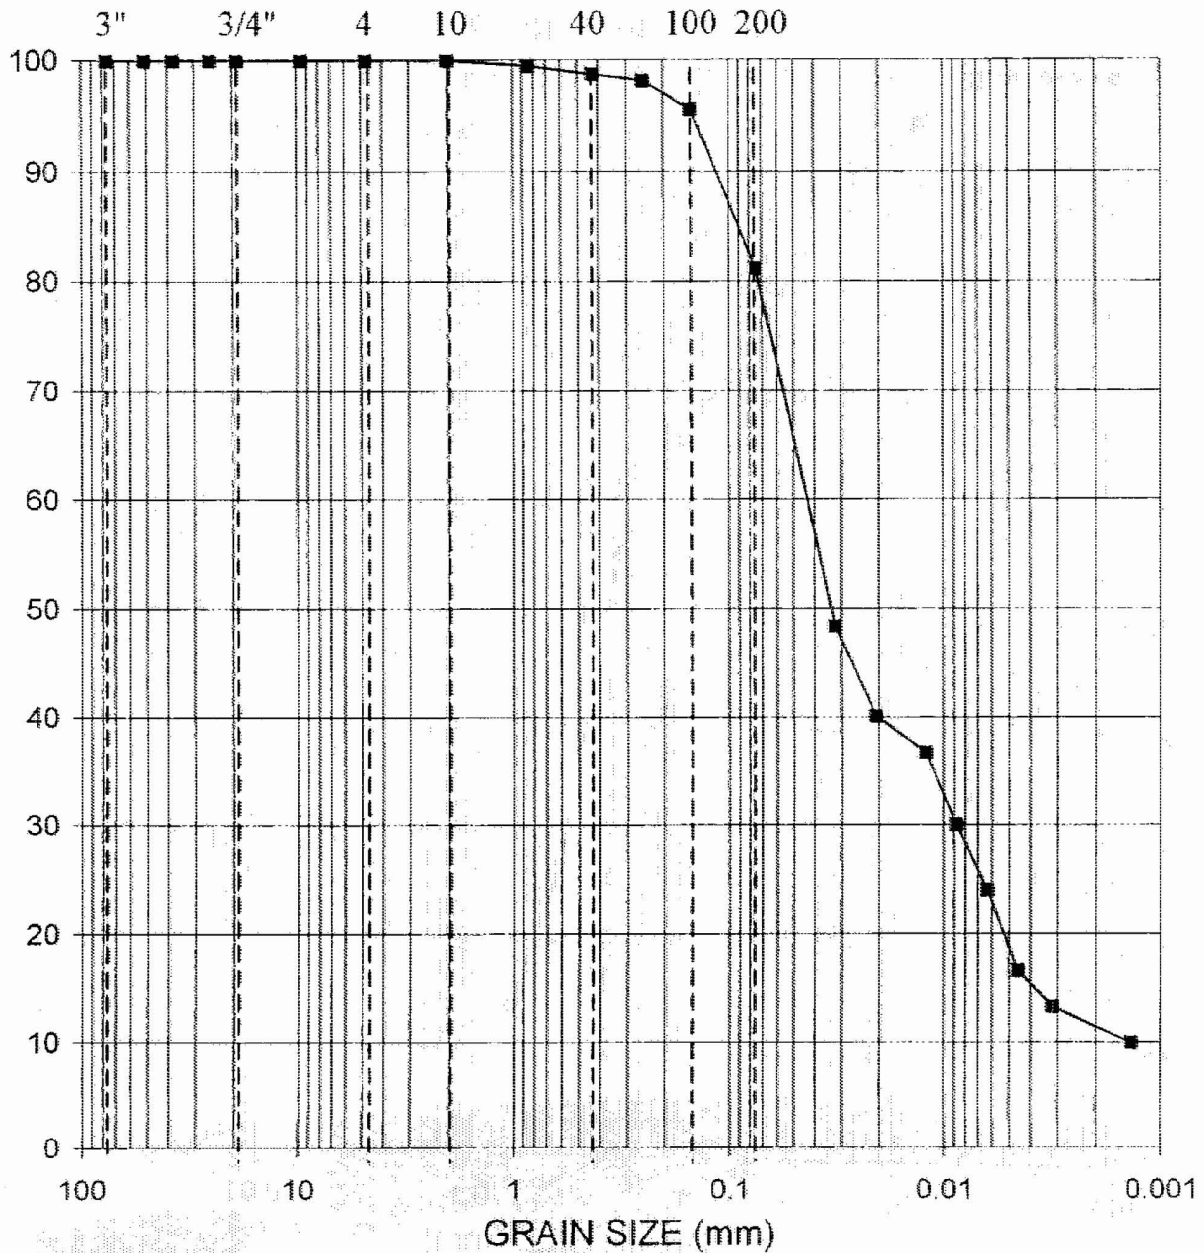

GRAVEL	SAND	SILT OR CLAY
--------	------	--------------


GRADATION CURVE

ASTM D422

Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.:	06120048.00	Date:	9/22/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI		
B-423	53.5	FAT CLAY, with sand, dark gray	CH	80	46		

PERCENT FINER BY WEIGHT


U.S. Standard Sieve Nos.

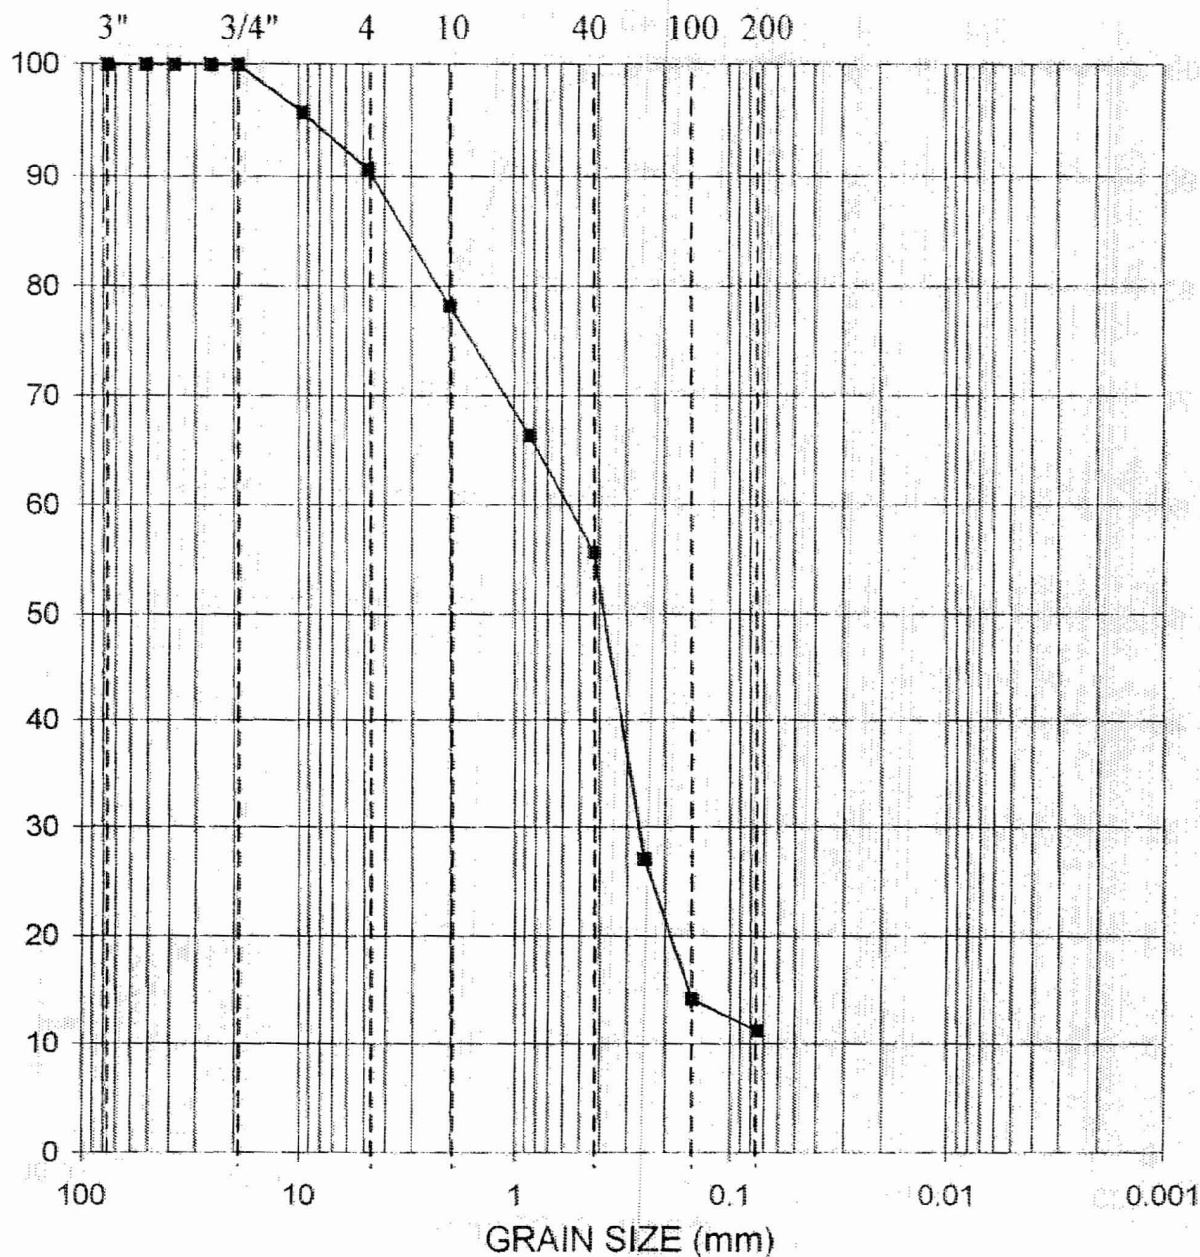

GRAVEL	SAND	SILT OR CLAY
--------	------	--------------


GRADATION CURVE

ASTM D422

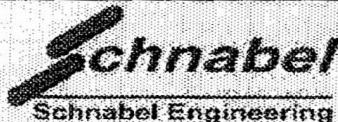Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.:	06120048.00	Date:	9/14/2006
Boring No.	Depth (ft)	Sample Description	Class	LL	PI		
B-423	78.5	Sandy SILT, trace shells, green	ML				

PERCENT FINER BY WEIGHT

U.S. Standard Sieve Nos.

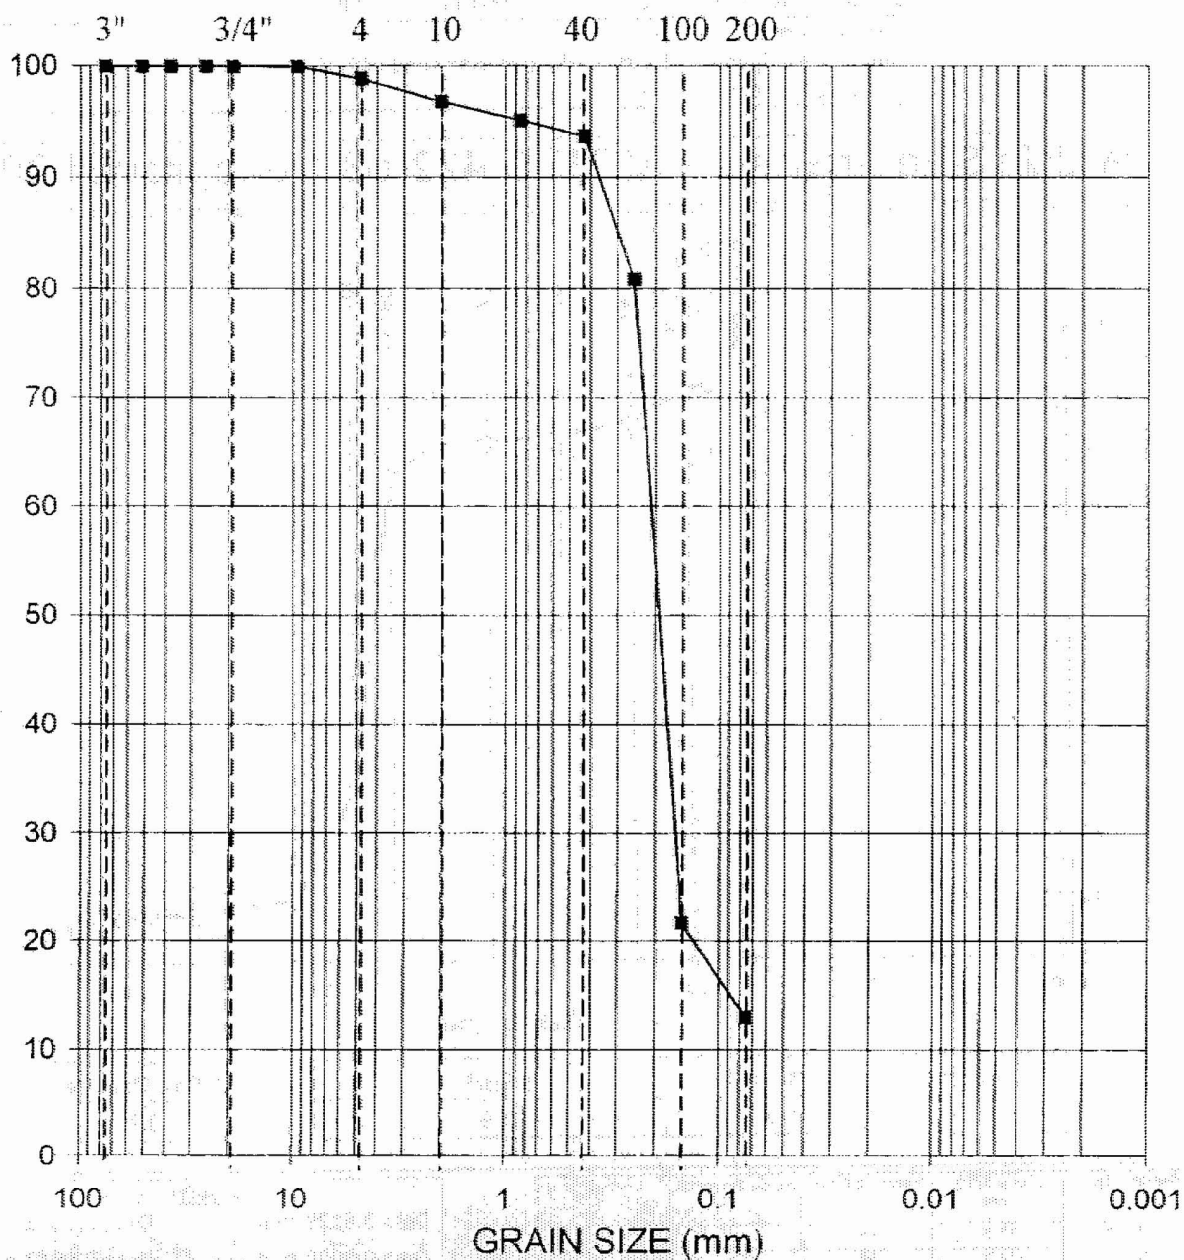

GRAVEL	SAND	SILT OR CLAY
--------	------	--------------

GRADATION CURVE

ASTM D422


Project:		Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No. 06120048.00		Date: 9/14/2006	
Boring No.	Depth (ft)	Sample Description			Class	LL	PI	
B-423	93.5	Silty SAND, trace shells, gray			SM			

GeoTesting express

a subsidiary of Geocomp Corporation

Client: Schnabel Engineering, Inc.	Project: Subsurface Investigation Calvert Cliffs Nuclear PP	Project No: GTX-6880
Location: Calvert County, MD	Boring ID: B-423	Sample Type: tube
Sample ID: S-24	Test Date: 10/25/06	Tested By: sam
Depth: 103.5-105.3 ft	Test ID: 98379	Checked By: mcm
Test Comment: ---	Sample Description: Moist, dark olive gray sand with clay	
Sample Comment: ---		

Particle Size Analysis - ASTM D 422-63 (reapproved 2002)

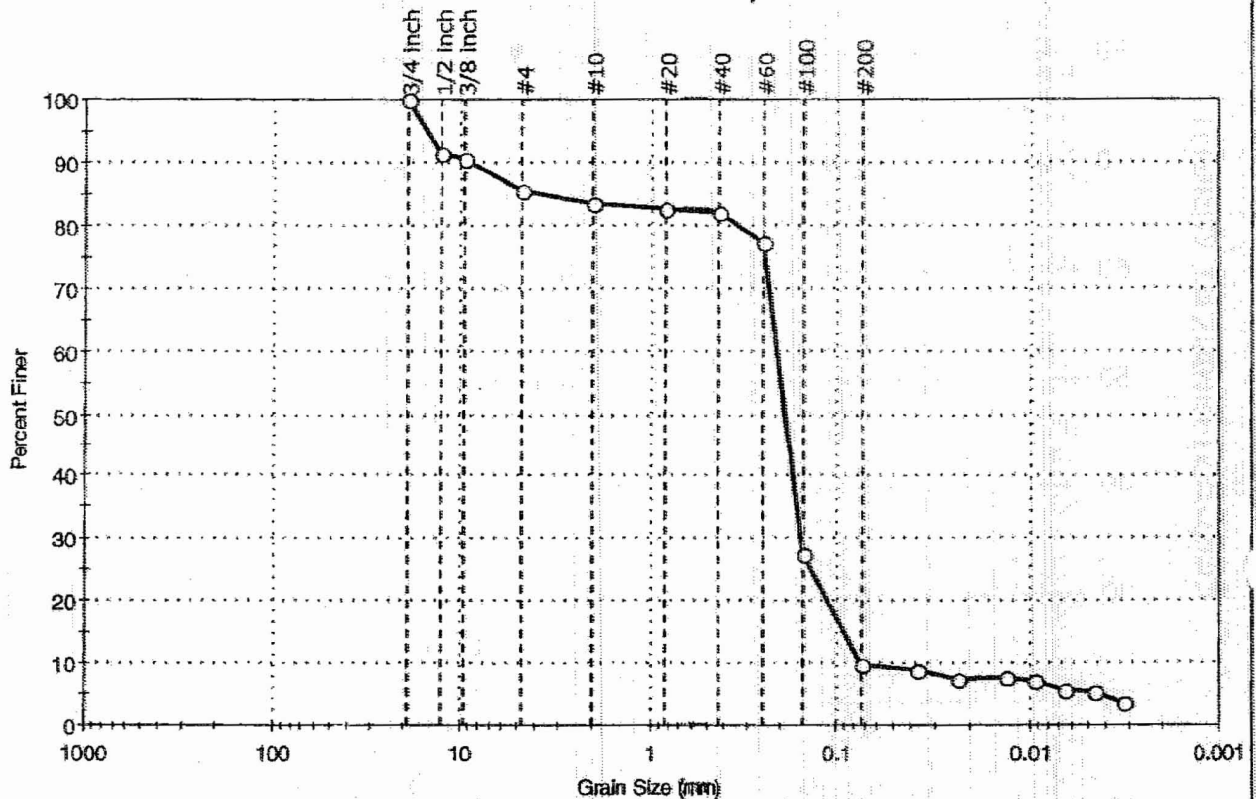

% Cobble	% Gravel	% Sand	% Silt & Clay Size
---	14.4	75.9	9.7

Sieve Name	Sieve Size, mm	Percent Finer	Spec. Percent	Complies
3/4 inch	19.00	100		
1/2 inch	12.70	92		
3/8 inch	9.51	91		
#4	4.75	86		
#10	2.00	84		
#20	0.84	83		
#40	0.42	82		
#60	0.25	77		
#100	0.15	27		
#200	0.074	10		
---	Particle Size (mm)	Percent Finer	Spec. Percent	Complies
---	0.0373	9		
---	0.0231	7		
---	0.0132	8		
---	0.0093	7		
---	0.0066	6		
---	0.0046	5		
---	0.0032	3		

Coefficients

D ₈₅ = 3.6129 mm	D ₃₀ = 0.1531 mm
D ₆₀ = 0.2090 mm	D ₁₅ = 0.0913 mm
D ₅₀ = 0.1884 mm	D ₁₀ = 0.0749 mm
C _u = 2.790	C _c = 1.497

Classification

ASTM Poorly graded sand with silty clay (SP-SC)


AASHTO Silty Gravel and Sand (A-2-4 (0))

Sample/Test Description

Sand/Gravel Particle Shape : ANGULAR


Sand/Gravel Hardness : HARD

U.S. Standard Sieve Nos.

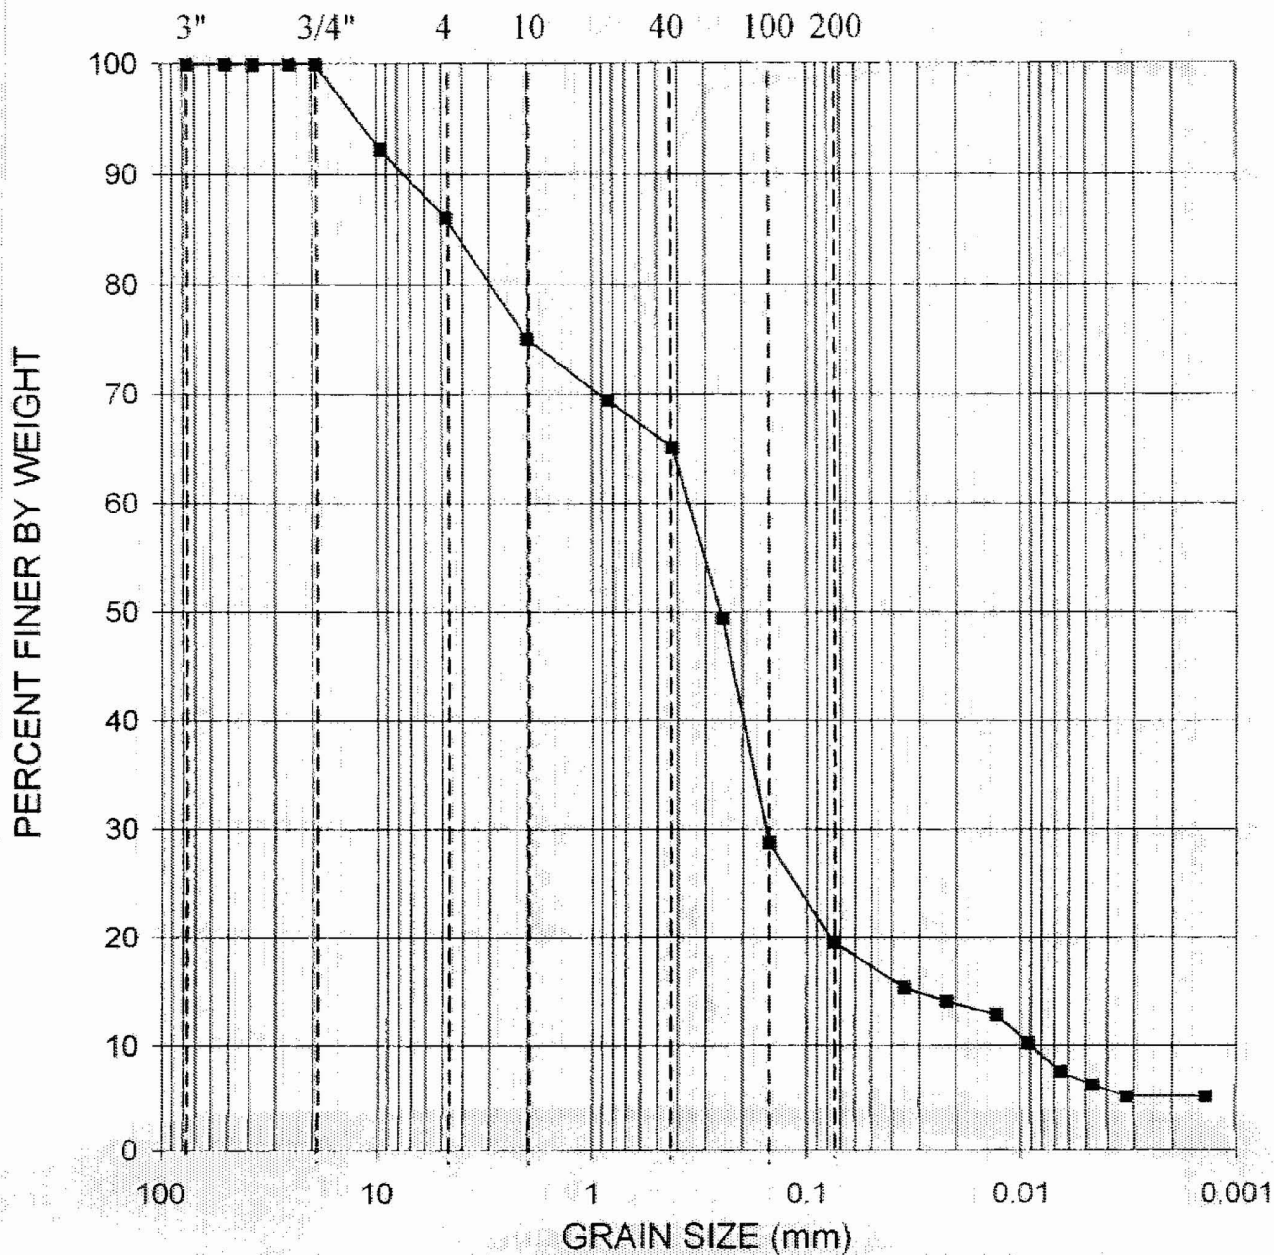

U.S. Standard Sieve Nos.

PERCENT FINER BY WEIGHT

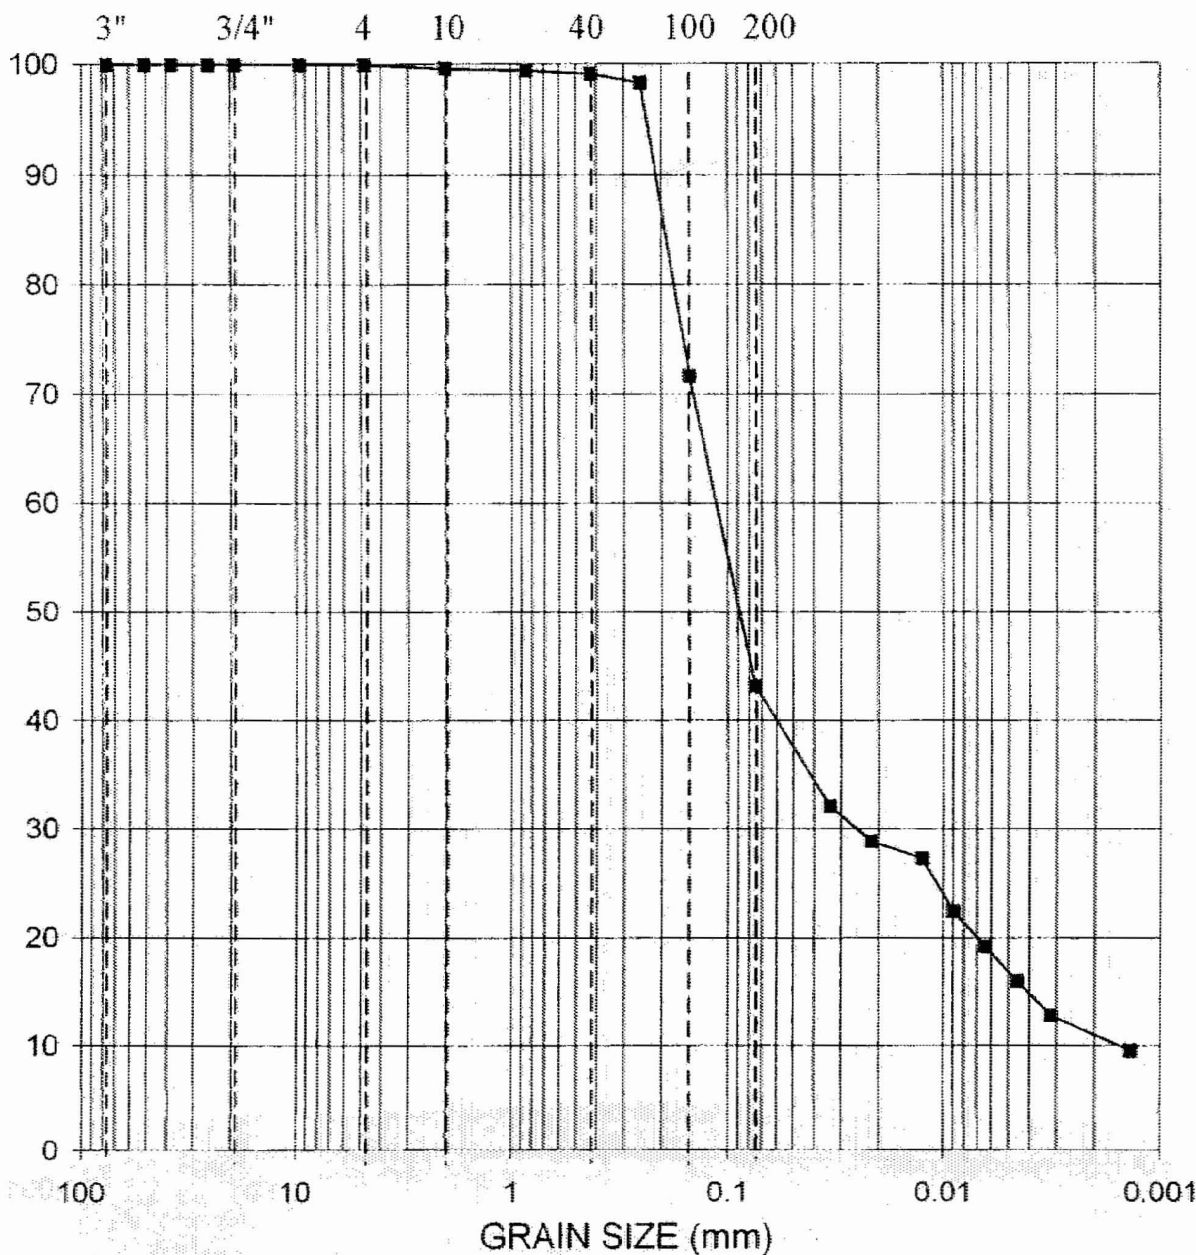

GRAVEL SAND SILT OR CLAY


GRADATION CURVE

ASTM D422

Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland			Contract No.:	06120048.00	Date:	9/22/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI		
B-423	138.5	Silty SAND, contains shells, green	SM				

PERCENT FINER BY WEIGHT

U.S. Standard Sieve Nos.

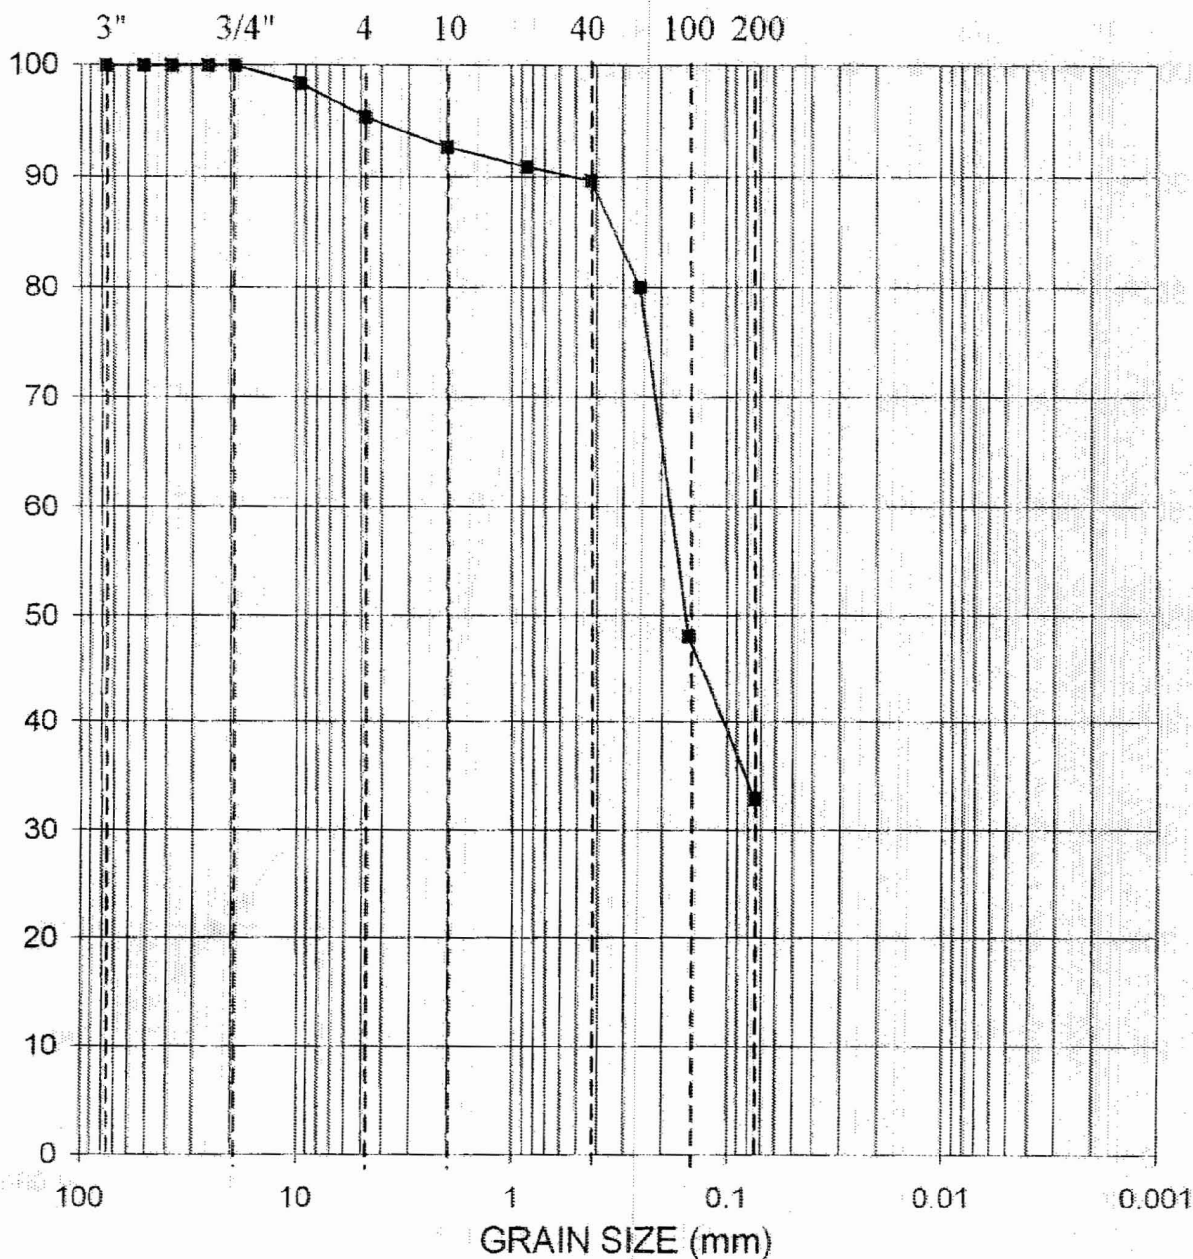

GRAVEL

SAND

SILT OR CLAY


GRADATION CURVE

ASTM D422

Project:	Constellation Energy Group COLA Project, Calvert Cliffs Nuclear Power Plant (CCNPP), Calvert County, Maryland				Contract No.:	06120048.00	Date:	9/14/2006
Boring No.	Depth (ft)	Sample Description	Class.	LL	PI			
B-423	148.5	Silty SAND, trace shells, green	SM					

Client: Schnabel Engineering, Inc.
Project: Subsurface Investigation Calvert Cliffs Nuclear PP
Location: Calvert County, MD
Project No: GTX-6880
Boring ID: B-423
Sample Type: tube
Tested By: sam
Sample ID: S-35
Test Date: 09/12/06
Checked By: mcm
Depth: 158.5-160.1 ft
Test ID: 95815
Test Comment: ---
Sample Description: Moist, olive gray organic clay
Sample Comment: ---

Particle Size Analysis - ASTM D 422-63 (reapproved 2002)

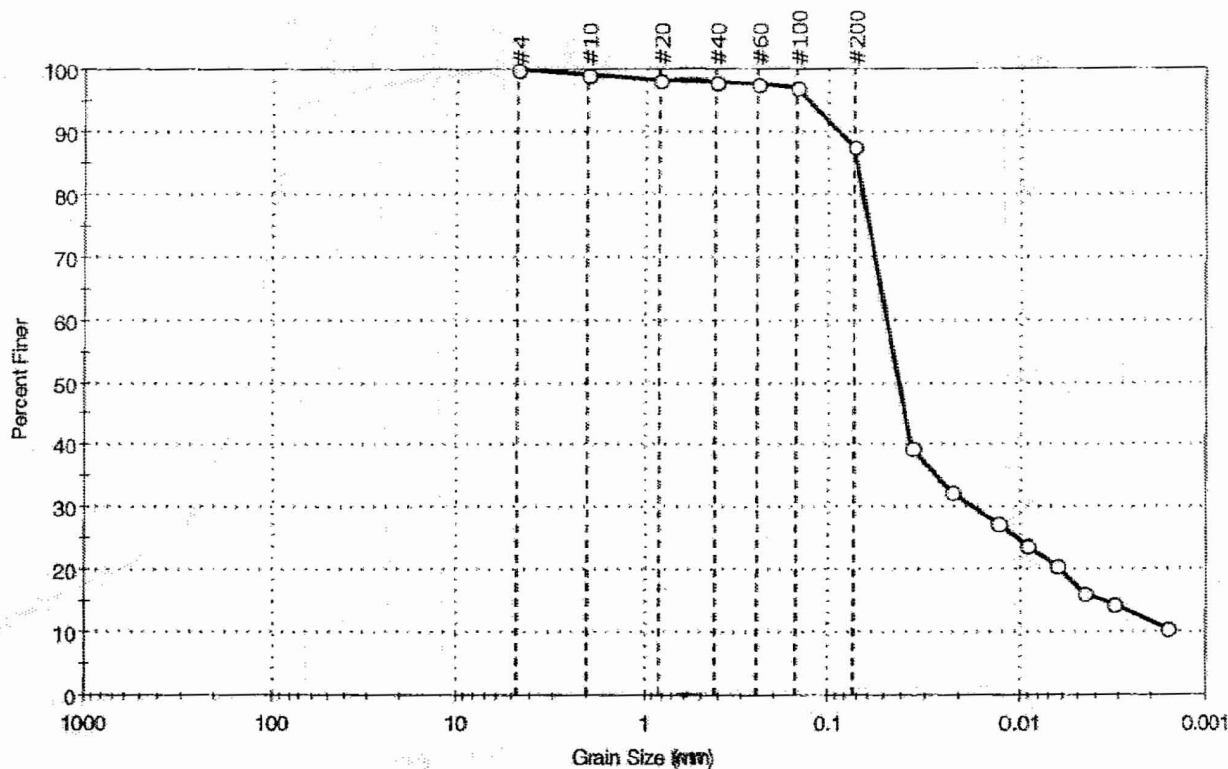

% Cobble	% Gravel	% Sand	% Silt & Clay Size
—	0.0	12.4	87.6

Sieve Name	Sieve Size, mm	Percent Finer	Spec. Percent	Complies
#4	4.75	100		
#10	2.00	99		
#20	0.84	98		
#40	0.42	96		
#60	0.25	96		
#100	0.15	97		
#200	0.074	88		
---	Particle Size (mm)	Percent Finer	Spec. Percent	Complies
---	0.0354	39		
---	0.0223	32		
---	0.0129	26		
---	0.0092	24		
---	0.0065	21		
---	0.0046	16		
---	0.0032	14		
---	0.0017	11		

Coefficients

D₈₅ = 0.0711 mm D₃₀ = 0.0171 mm
D₆₀ = 0.0485 mm D₁₅ = 0.0037 mm
D₅₀ = 0.0416 mm D₁₀ = 0.0015 mm
C_u = N/A C_c = N/A

Classification

ASTM organic clay (OH)

AASHTO Clayey Soils (A-7-6 (59))


Sample/Test Description

Sand/Gravel Particle Shape: ANGULAR

Sand/Gravel Hardness: HARD

Client:	Schnabel Engineering, Inc.	Project No:	GTX-6880
Project:	Subsurface Investigation Calvert Cliffs Nuclear PP	Tested By:	sam
Location:	Calvert County, MD	Checked By:	mcm
Boring ID:	B-423	Sample Type:	tube
Sample ID:	S-39	Test Date:	09/28/06
Depth:	178.5-179.8 ft	Test Id:	95825
Test Comment:	---		
Sample Description:	Dry, olive clayey sand		
Sample Comment:	---		

Particle Size Analysis - ASTM D 422-63 (reapproved 2002)

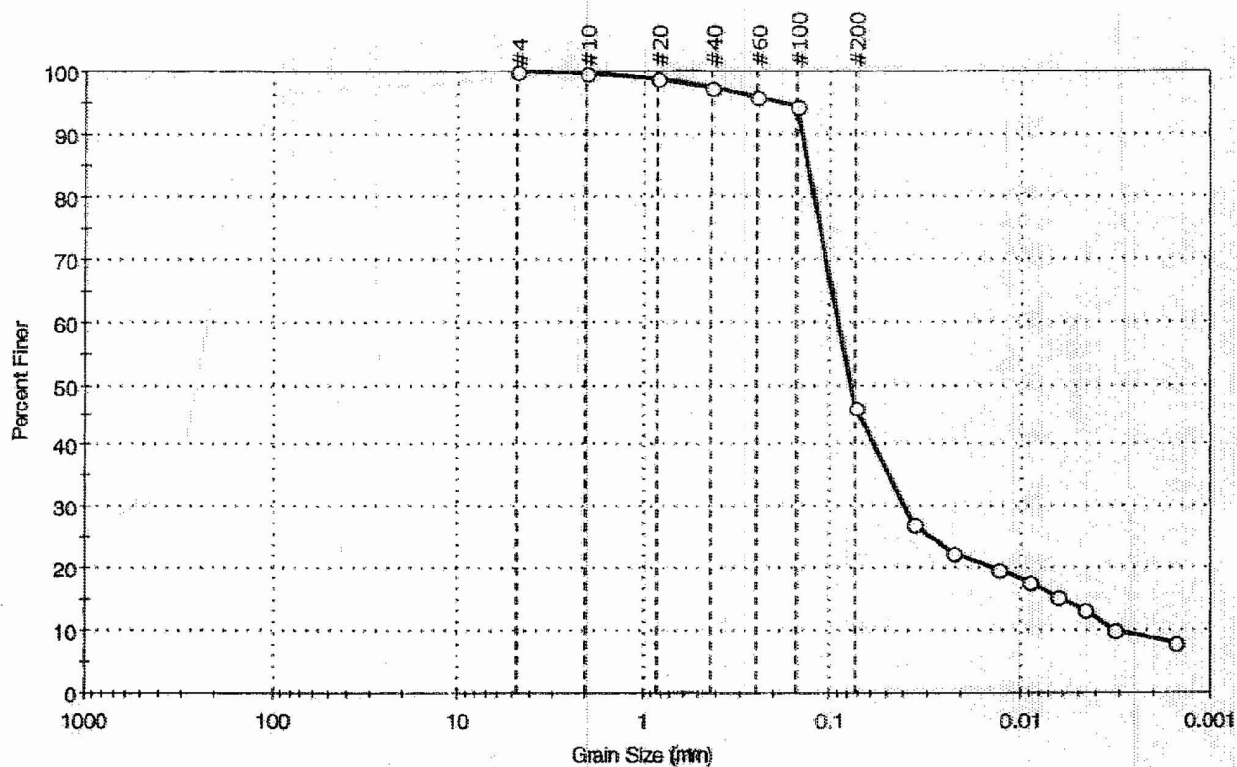

% Cobble	% Gravel	% Sand	% Silt & Clay Size
—	0.0	53.6	46.4

Sieve Name	Sieve Size, mm	Percent Finer	Spec. Percent	Complies
#4	4.75	100		
#10	2.00	100		
#20	0.85	99		
#40	0.425	97		
#60	0.25	96		
#100	0.15	94		
#200	0.075	46		
---	Particle Size (mm)	Percent Finer	Spec. Percent	Complies
---	0.0356	27		
---	0.0223	22		
---	0.0125	20		
---	0.0091	18		
---	0.0065	15		
---	0.0046	13		
---	0.0033	10		
---	0.0015	8		

Coefficients

D ₈₅ = 0.1308 mm	D ₃₀ = 0.0398 mm
D ₆₀ = 0.0905 mm	D ₁₅ = 0.0060 mm
D ₅₀ = 0.0781 mm	D ₁₀ = 0.0031 mm
C _u = N/A	C _c = N/A

Classification

ASTM Silty sand (SM)

AASHTO Clayey Soils (A-7-5 (13))

Sample/Test Description

Sand/Gravel Particle Shape : ---

Sand/Gravel Hardness : ---