


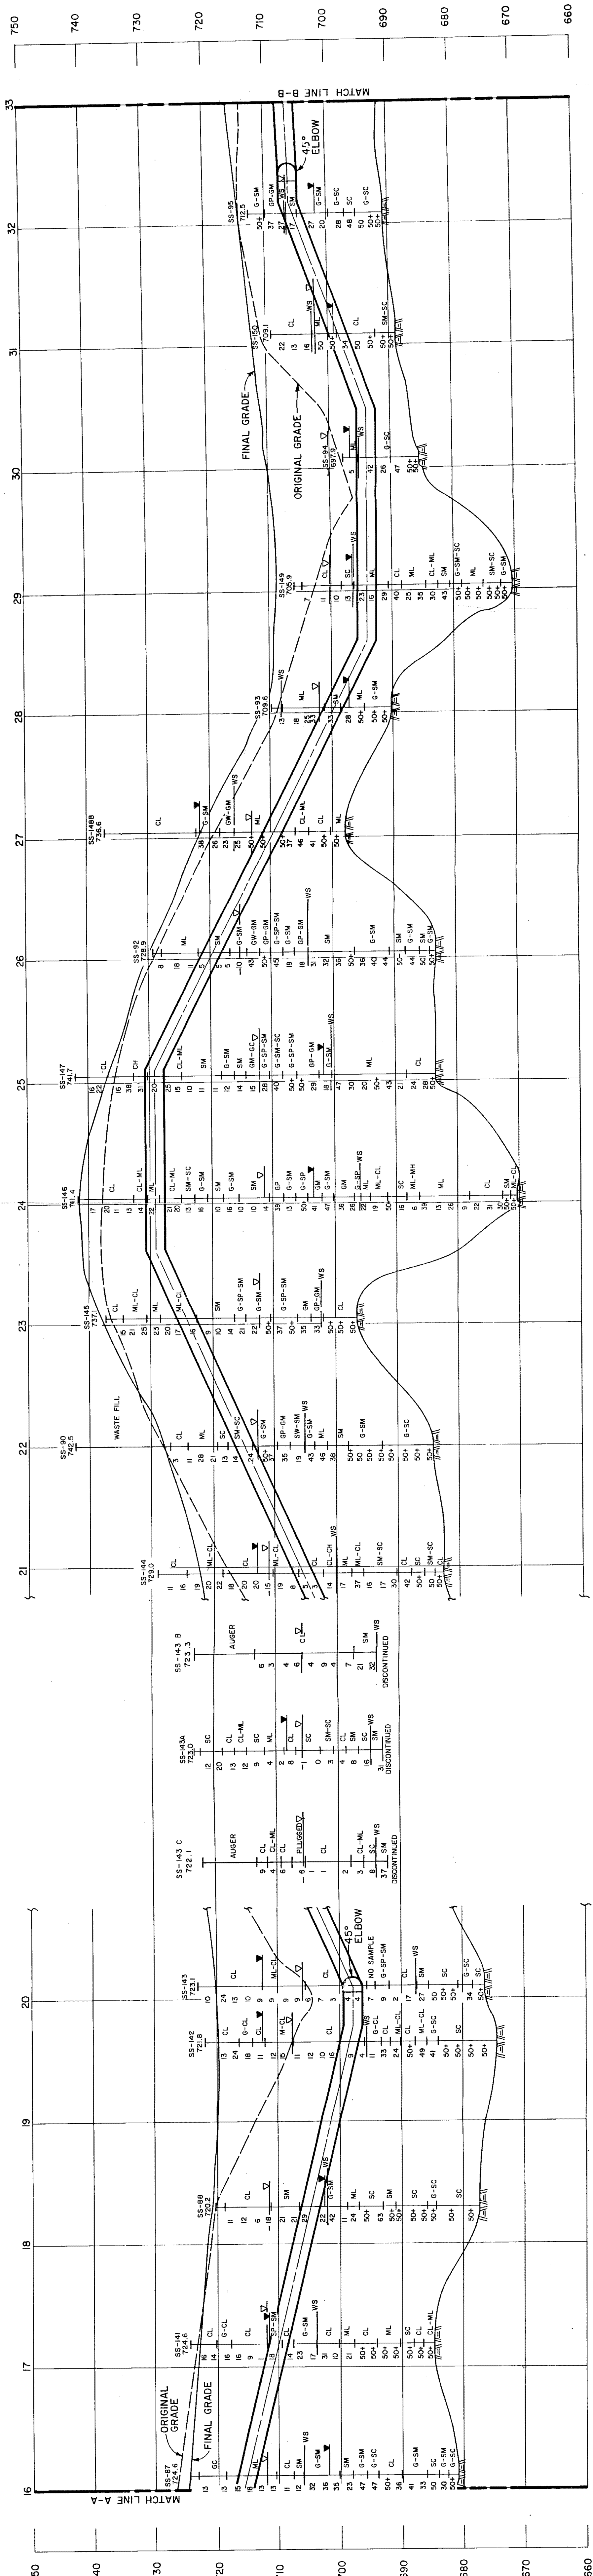

52. DESIGN WATER TABLE
 53. WATER TABLE (24 HR)
 MH SOIL CLASSIFICATION
 13 BLOW COUNT
 POTENTIALLY LIQUEFIABLE
 SOIL (SEE NOTE)
 WEATHERED SHALE

NOTE: LIQUEFACTION BASED ON TOP OF
GROUND ACCELERATION OF 0.22g
AND SEED-IDRISS (1981)
CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT

ERCW PIPELINE
SECTION A-A SHEET 2 OF 4
FIGURE 2.5-549

 $\wedge - \wedge$