


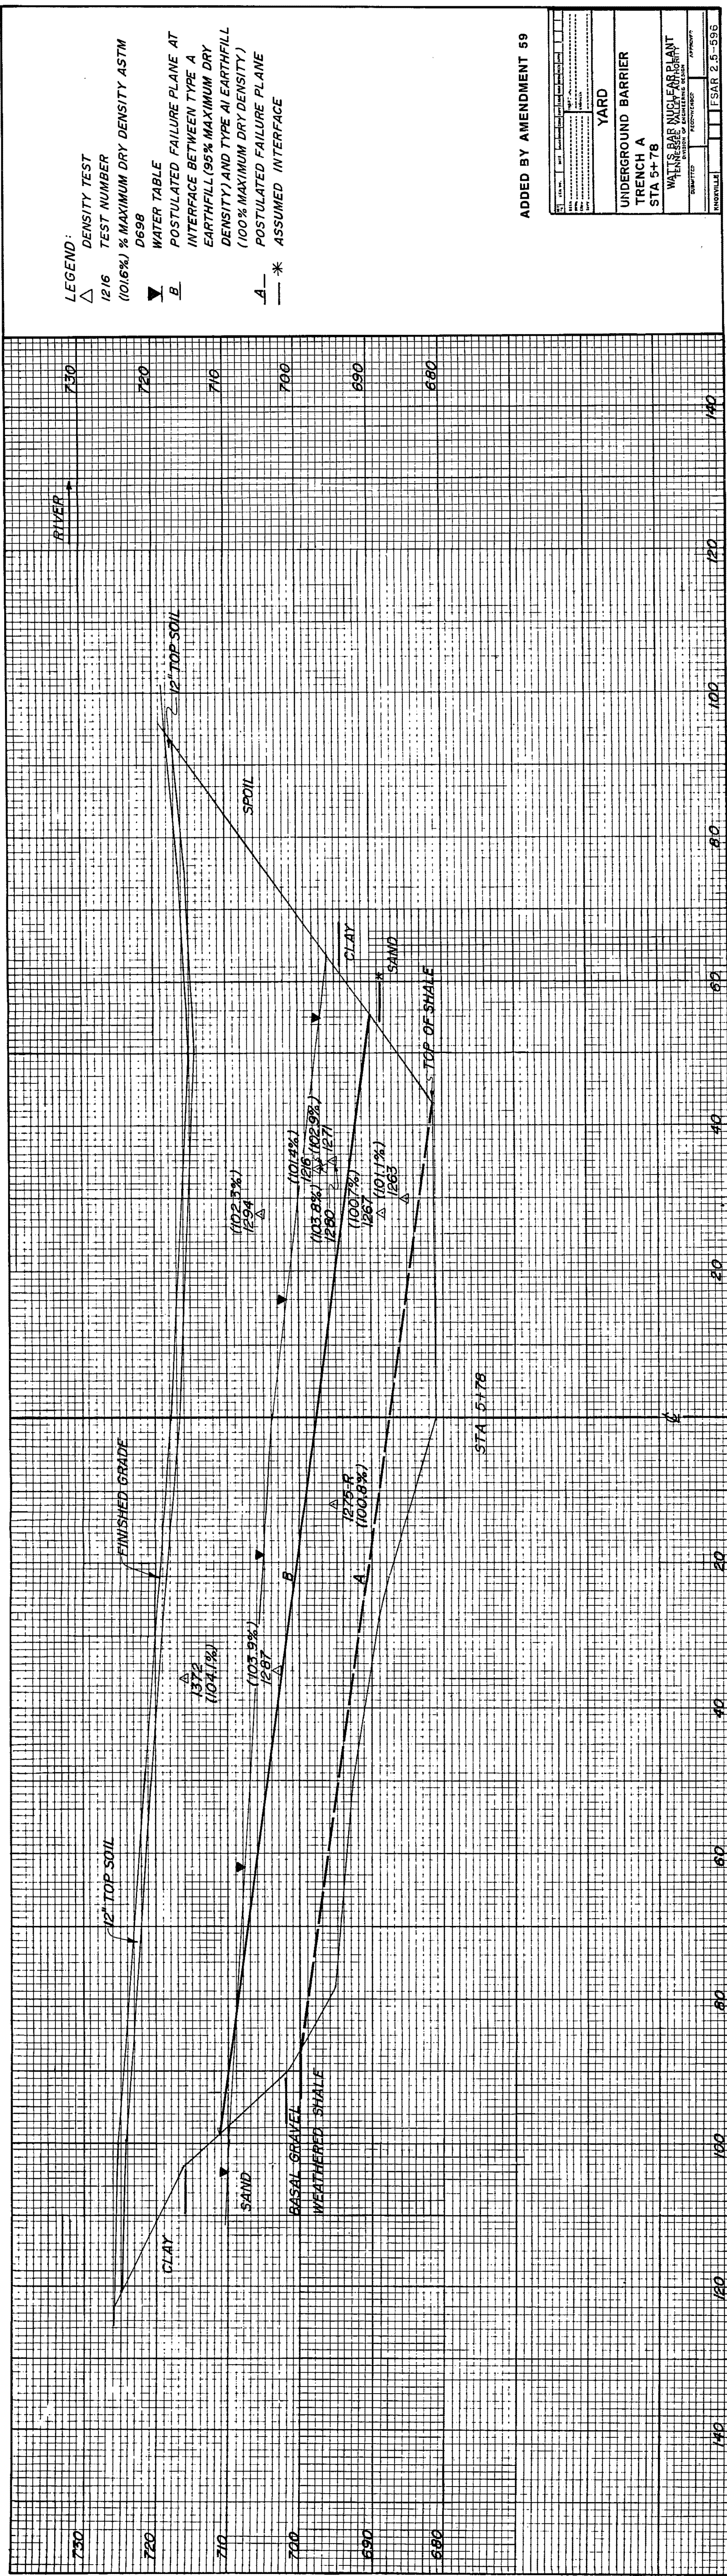

ADDED BY AMENDMENT 59

YARD	
UNDERGROUND BARRIER	
TRENCH A	
STA 5+78	
WATTS BAR NUCLEAR PLANT	
DESIGNED BY	APPROVED BY
DATE	DATE
TSSAR 2.5-596	