


35

750
740
730
720
710
700
690
680
670
660

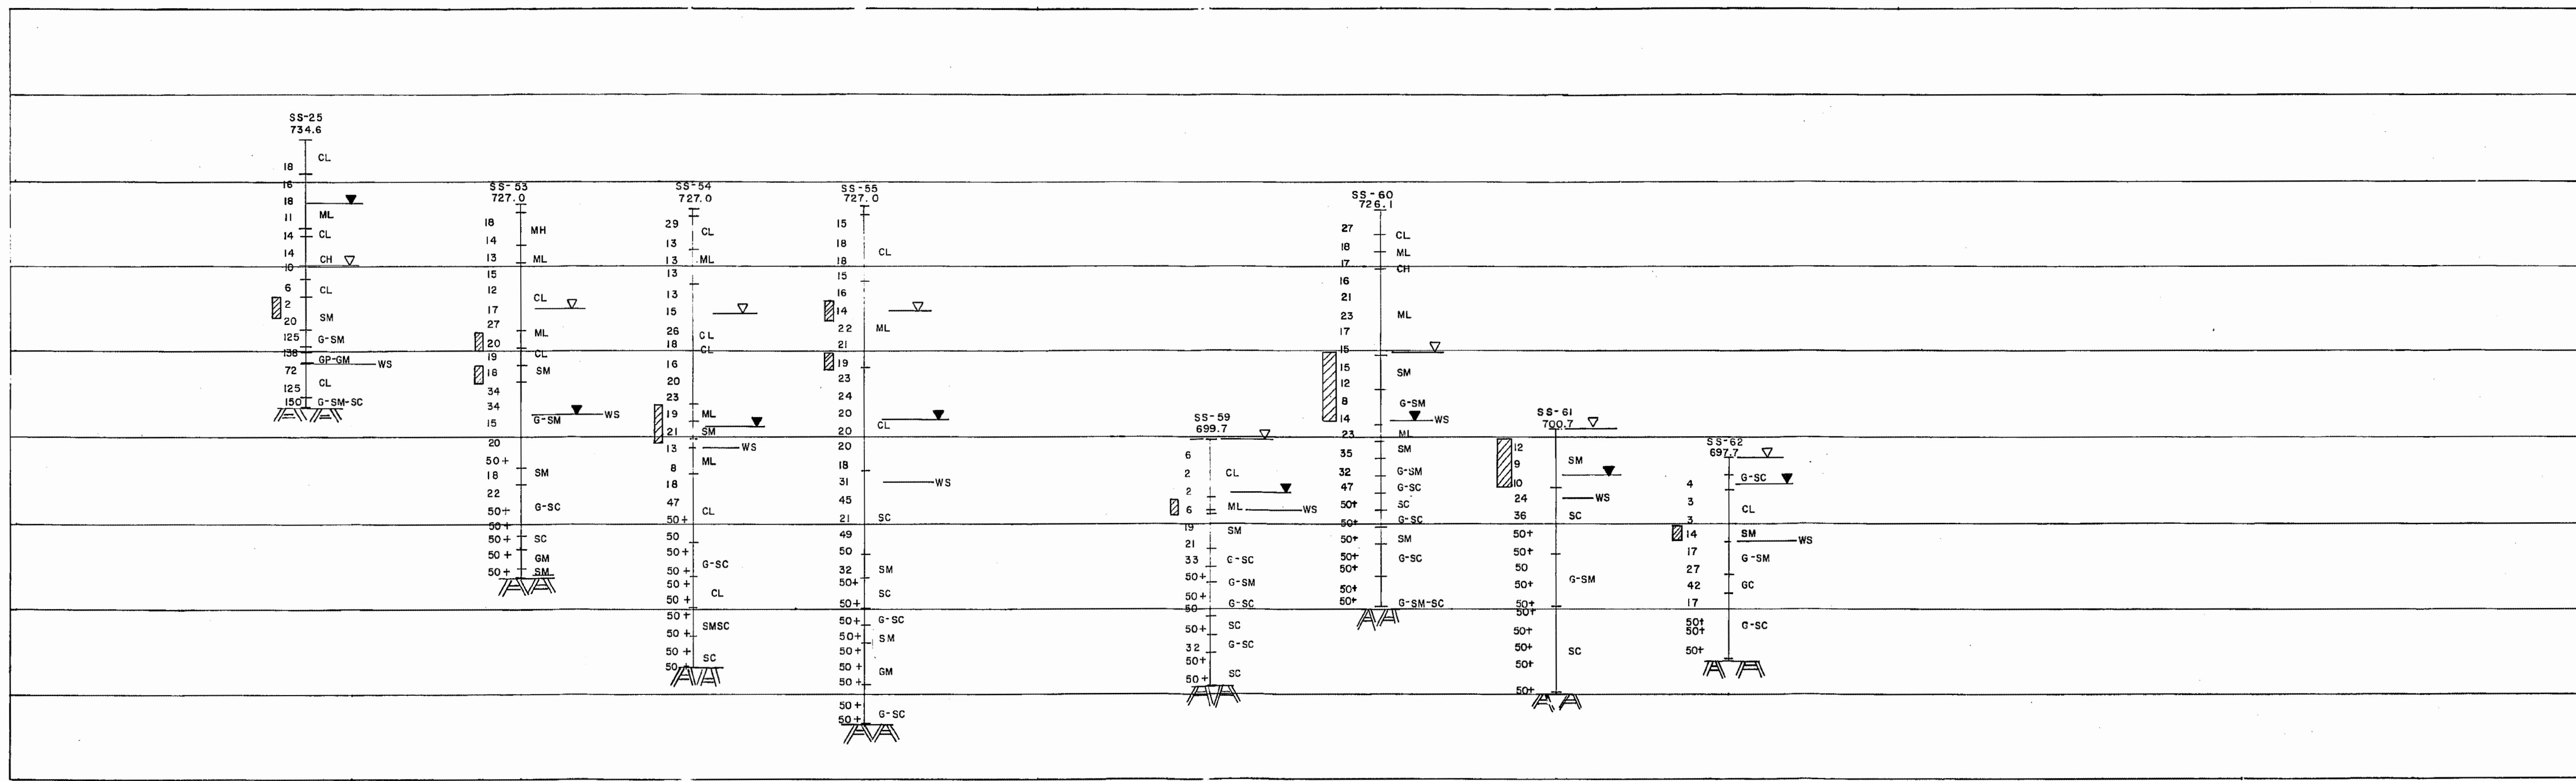

750
740
730
720
710
700
690
680
670
660

- ▽ DESIGN WATER TABLE
- ▼ WATER TABLE (24 HR)
- MH SOIL CLASSIFICATION
- 13 BLOW COUNT
- ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
- WS WEATHERED SHALE

NOTE:
1. LIQUEFACTION BASED ON
TOP OF GROUND ACCELERATION
OF 0.4g AND SEED-IDRISS
(1971) CORRELATION FOR
SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
FINAL SAFETY
ANALYSIS REPORT
MISCELLANEOUS ERCW PIPING
AND IE CONDUIT
SOIL BORINGS
FIGURE 2.5-579