


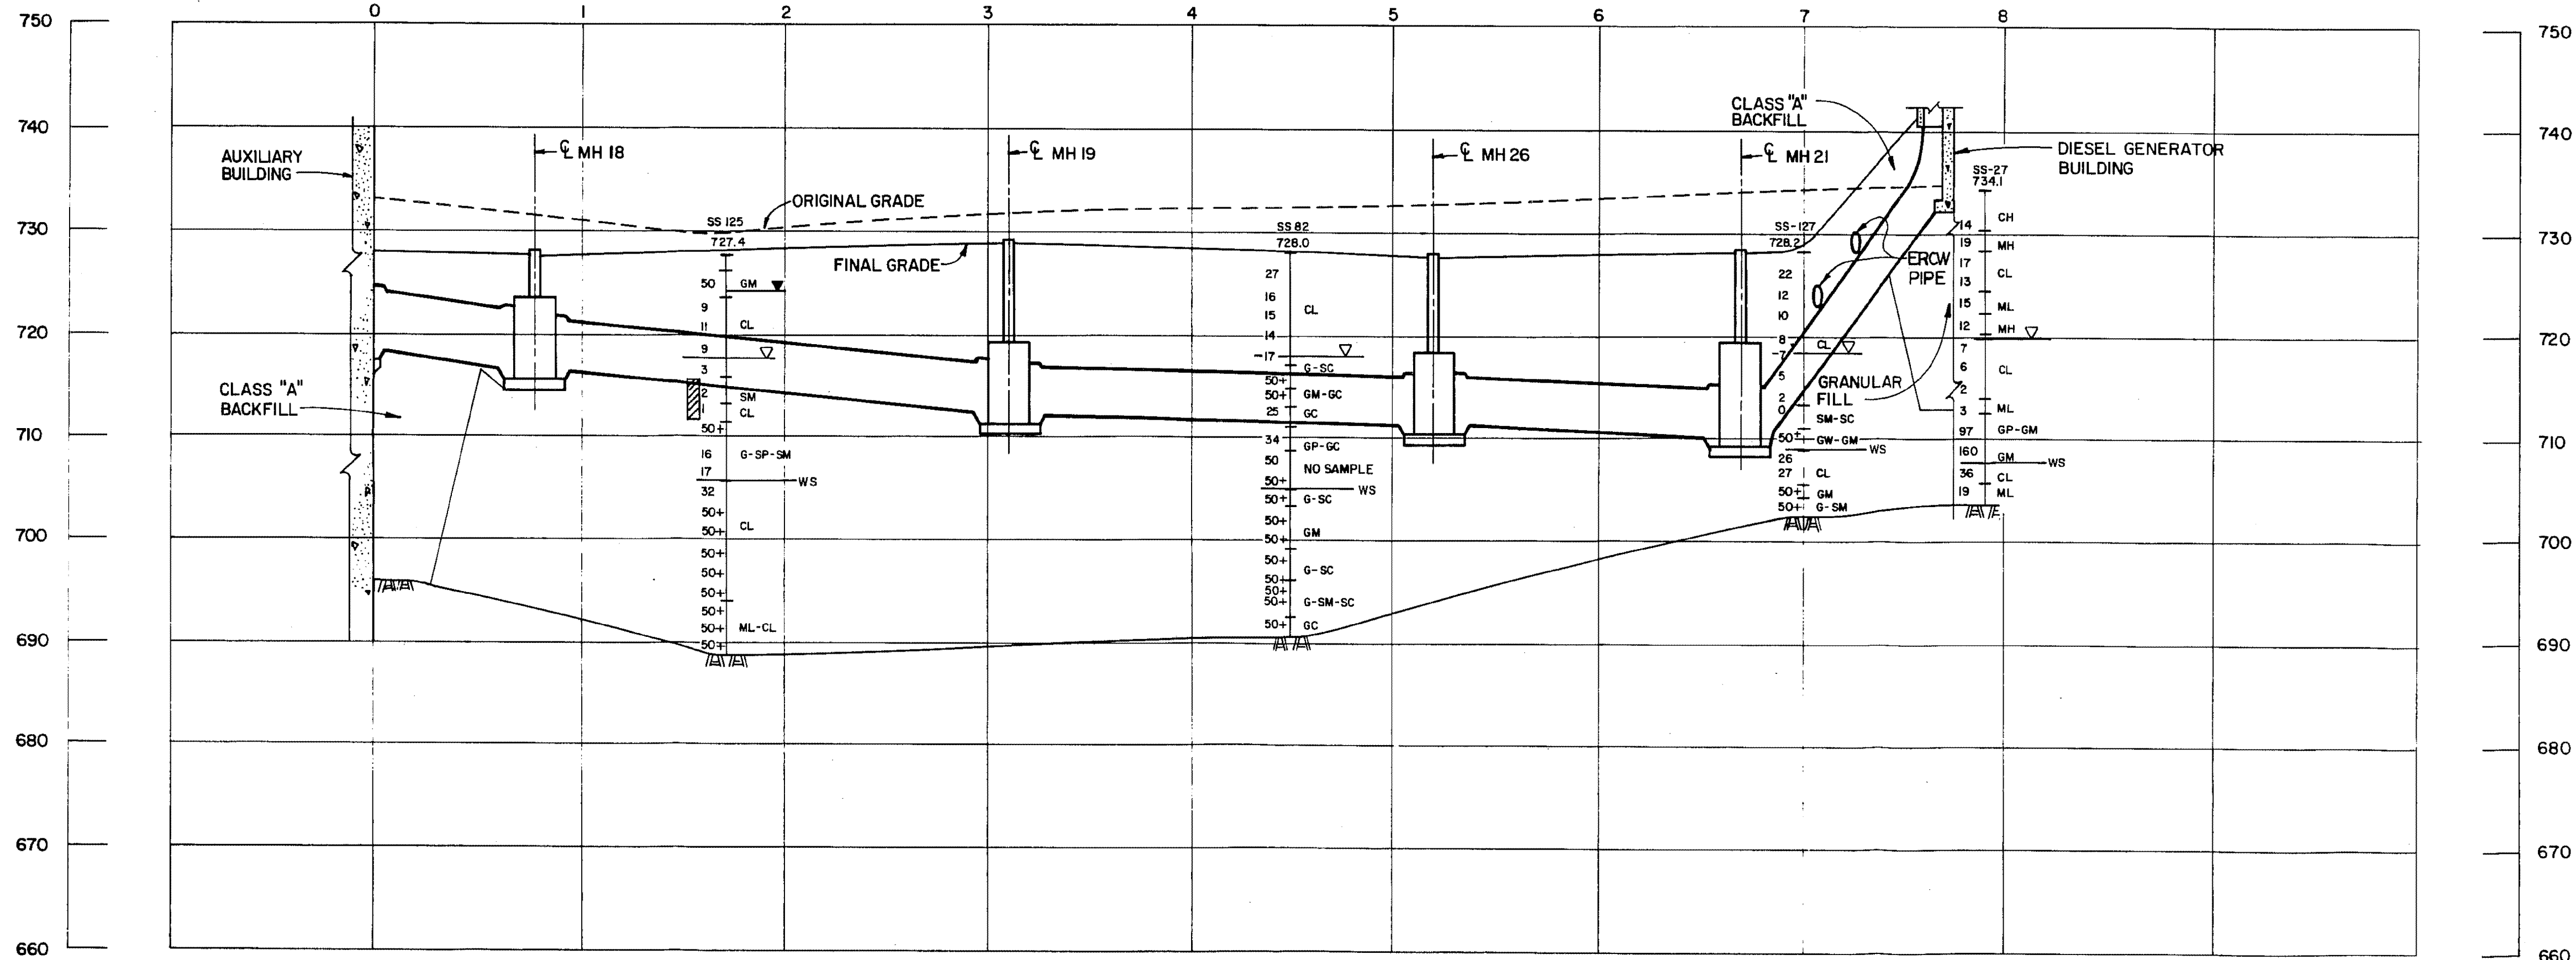

▽ DESIGN WATER TABLE
 ▽ WATER TABLE (24 HR)
 MH SOIL CLASSIFICATION
 13 BLOW COUNT
 ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
 -WS WEATHERED SHALE

NOTE: LIQUEFACTION BASED ON TOP OF
 GROUND ACCELERATION OF 0.22 g
 AND SEED-IDRISS (1981)
 CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 CATEGORY I ELECTRICAL CONDUITS
 SECTION G-G
 FIGURE 2.5-555