


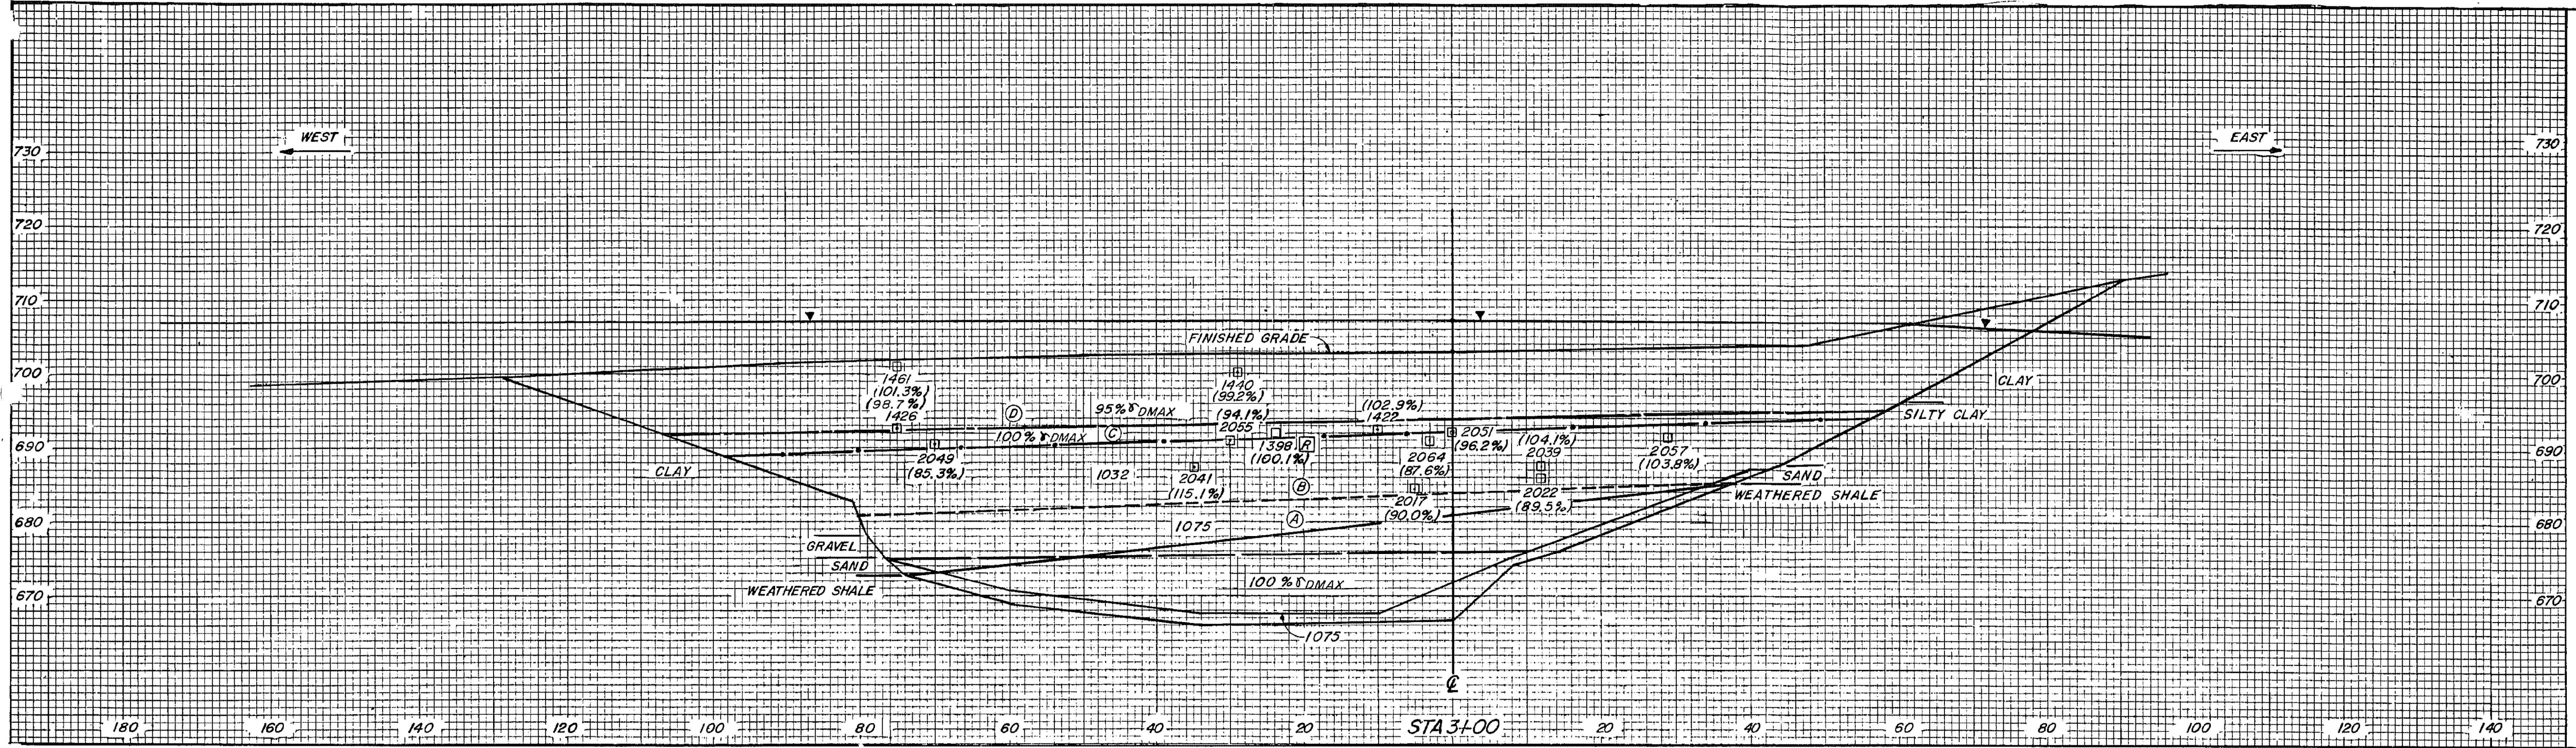

- LEGEND
- DENSITY TEST
 - 2057 TEST NUMBER
 - (103.8%) % MAXIMUM DRY DENSITY ASTM D698 OR % RELATIVE DENSITY ASTM D2049
 - ▽ WATER TABLE
 - ① POTENTIAL FAILURE PLANE
 - MATERIAL INTERFACE
 - 1075 CRUSHED STONE AND 100% δ_{DMAX} FILL
 - - - 1075 AND 1032 CRUSHED STONE
 - 1032 CRUSHED STONE AND 100% δ_{DMAX} FILL
 - - - 100% AND 95% δ_{DMAX}

ADDED BY AMENDMENT 59

REV	DATE	BY	CHKD	APP'D
1	11/15/65	W. J. HARRIS		
YARD				
UNDERGROUND BARRIER				
TRENCH B				
STA 3+00				
WATTS BAR NUCLEAR PLANT				
TENNESSEE VALLEY AUTHORITY				
DIVISION OF ENGINEERING & SURVEYING				
SUBMITTED	RECOMMENDED	BY	DATE	
KNOXVILLE		FSAP 2.5-604		