


33

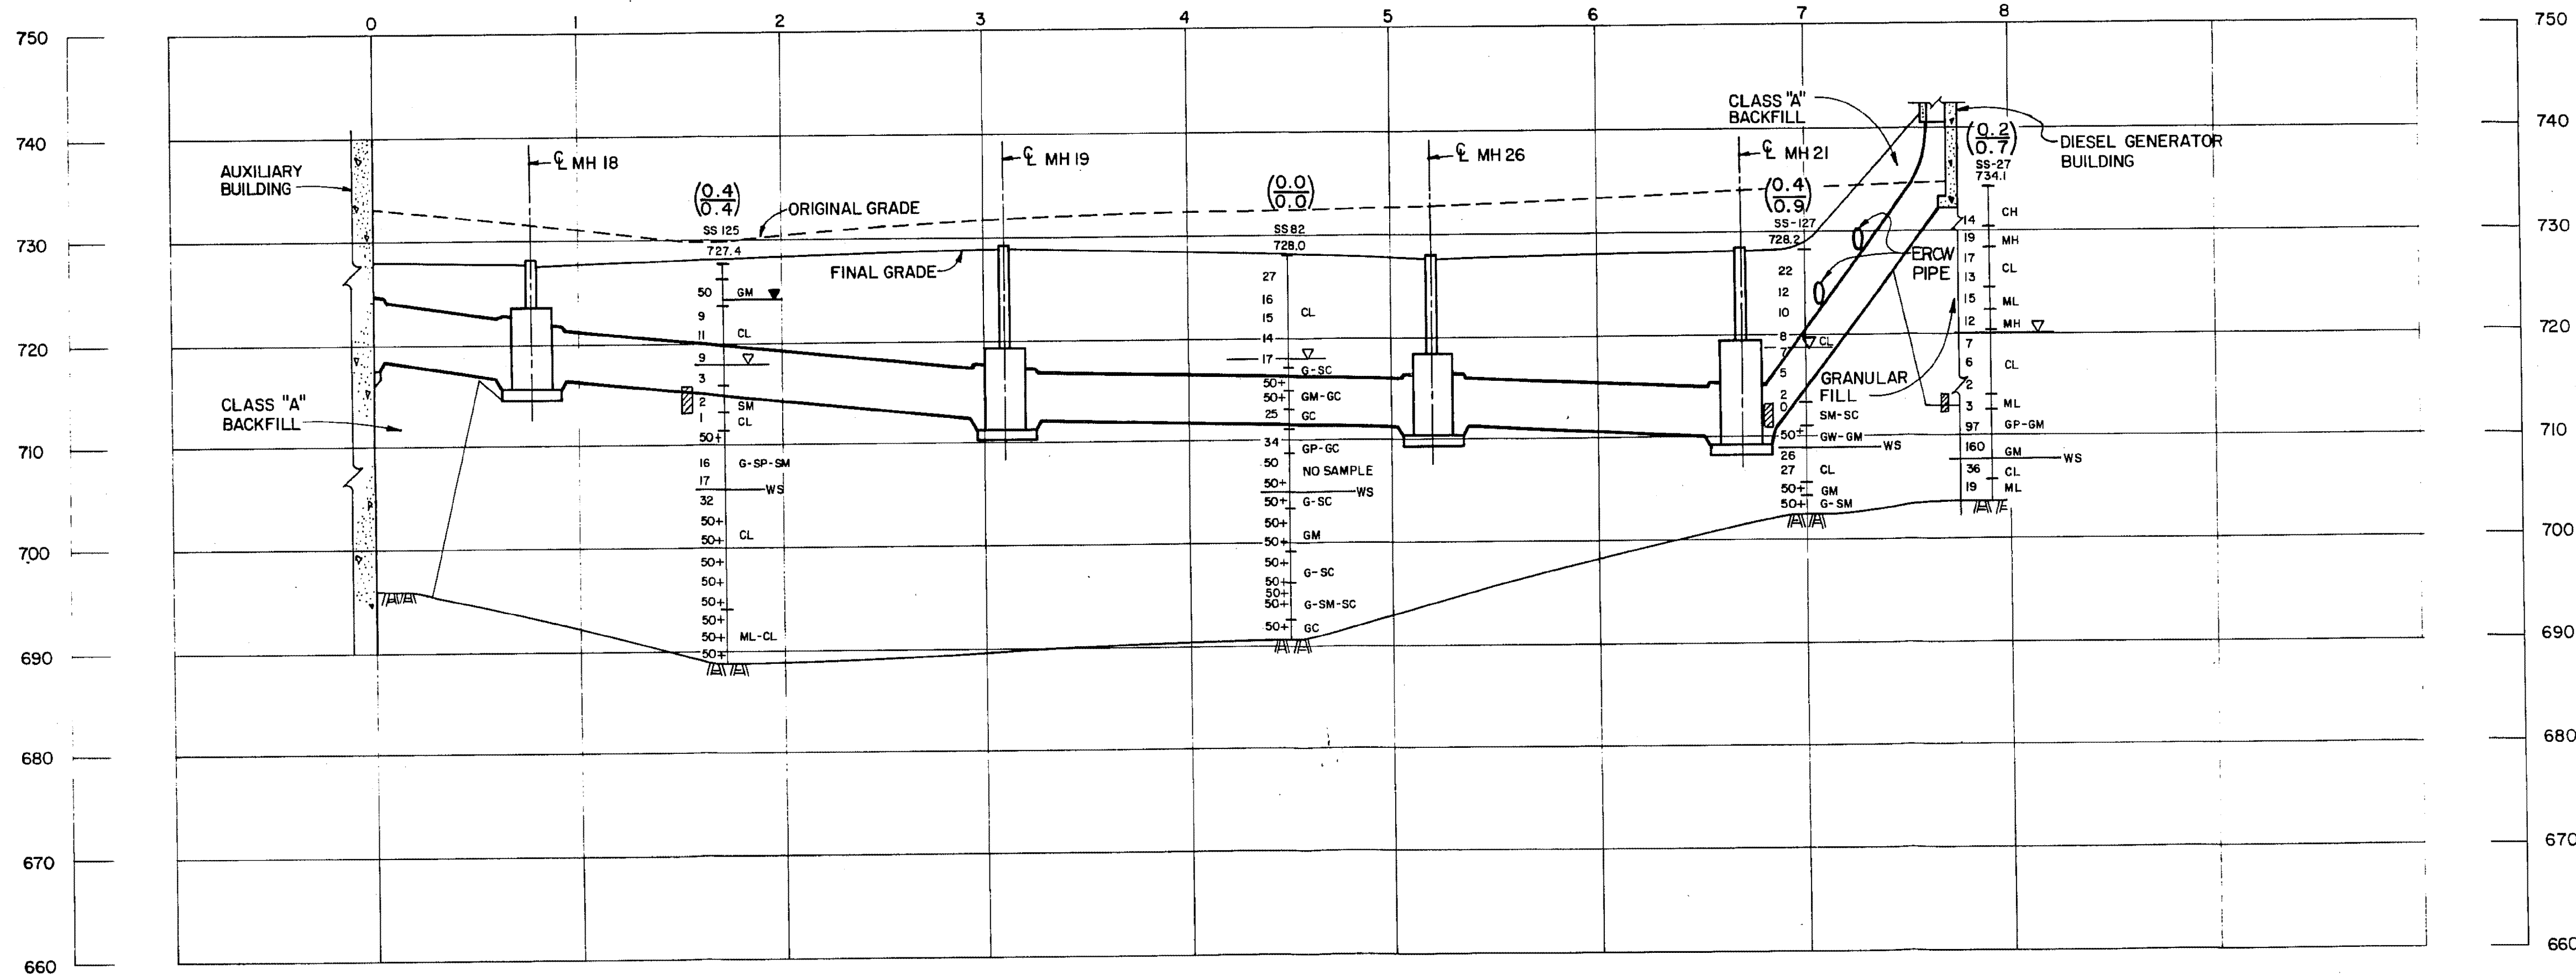

G-G

POTENTIAL SETTLEMENT BASED ON 1.5 % ϵ CRITERIA (INCHES)
 (0.2)
 (0.7) POTENTIAL SETTLEMENT BASED ON 6 % ϵ CRITERIA (INCHES)

▽ DESIGN WATER TABLE
 ▼ WATER TABLE (24 HR)
 MH SOIL CLASSIFICATION
 13 BLOW COUNT
 ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)

-WS WEATHERED SHALE

NOTE:
 1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED - IDRISS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT

CATEGORY I ELECTRICAL CONDUITS
 SECTION G-G
 FIGURE 2.5-577