


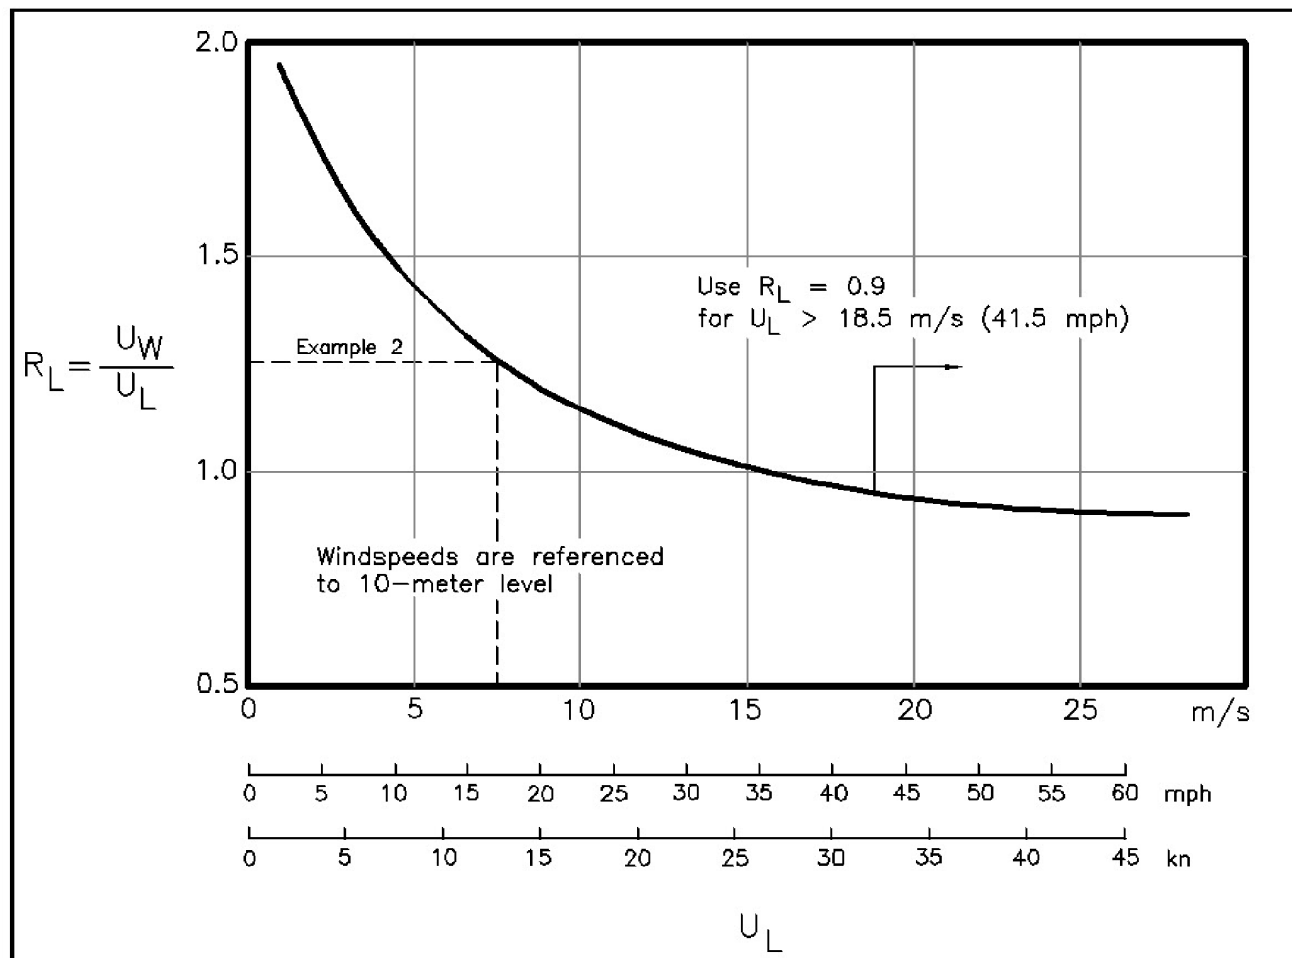

SOURCE: USACE, EM 1110-2-1100 PART II (2008)

Progress Energy Carolinas

**Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 2, Final Safety Analysis Report**

New Hill, North Carolina

Ratio R_L of Wind Speed Overwater U_W to Wind
Speed Overland U_L as a Function of
Wind Speed Overland U_L

FIGURE 2.4.3-235

Rev 2