

**MAINE YANKEE
INDEPENDENT SPENT FUEL STORAGE INSTALLATION
License No. DPR-36**

**ANNUAL RADIOLOGICAL ENVIRONMENTAL
OPERATING REPORT**

January - December 2012



March 2013

Prepared by:
**Radiological Safety & Control Services
91 Portsmouth Avenue
Stratham, NH 03885-2468**

EXECUTIVE SUMMARY

The Maine Yankee Independent Spent Fuel Storage Installation (ISFSI) has been in operation since 2001. All fuel has been transferred into dry storage casks and placed at the Independent Spent Fuel Storage Installation. The Radiological Environmental Monitoring Program (REMP) for the Maine Yankee ISFSI located in Wiscasset, ME was continued for the period January through December 2012 in compliance with the Maine Yankee Off-Site Dose Calculation Manual (ODCM).

No changes were made to the ODCM during 2012. By design, there are no liquid or gaseous effluents associated with the operation of the ISFSI. Therefore, the ODCM only requires monitoring of direct exposure from the facility. TLDs were used to measure direct gamma exposure at nine locations in the vicinity of the ISFSI and one control location 5.2 kilometers away. The results of these measurements showed no significant change in exposure rates and potential doses to members of the public during the monitoring period. The results of the monitoring performed in 2012 also show that operating the Maine Yankee ISFSI results in only a small fraction of the 40 CFR Part 190 and 10 CFR Part 72.104 direct radiation dose limit of 25 mrem/year to members of the public.

TABLE OF CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>
1.0	INTRODUCTION	6
2.0	GENERAL ISFSI AND SITE INFORMATION	7
3.0	PROGRAM DESIGN	7
3.1	MONITORING ZONES	7
3.2	PATHWAYS MONITORED	8
3.3	DESCRIPTION OF MONITORING PROGRAM	8
4.0	RADIOLOGICAL DATA SUMMARY TABLES	13
5.0	ANALYSIS OF ENVIRONMENTAL RESULTS	38
5.1	SAMPLING PROGRAM DEVIATIONS	38
5.2	DIRECT RADIATION PATHWAY	38
6.0	REFERENCES	39

LIST OF TABLES

<u>Table</u>	<u>Title</u>	<u>Page</u>
3.1	Radiological Environmental Monitoring Program	9
3.2	Radiological Environmental Monitoring Locations	10
4.1	TLD Measurements by Quarter.....	14
4.2	Exposure Rates from TLD Measurements.....	15
4.3	Environmental TLD Data Summary.....	16
4.4	Direct Dose from ISFSI Operations	17

LIST OF FIGURES

<u>Figure</u>	<u>Title</u>	<u>Page</u>
3.1	Radiological Environmental Monitoring Locations (within 0.28 km).....	11
3.2	Direct Radiation Monitoring Locations (outside 1 km)	12
4.1	Exposure Rate Trend at TL-I-02	18
4.2	Exposure Rate Trend at TL-I-04	20
4.3	Exposure Rate Trend at TL-I-06	22
4.4	Exposure Rate Trend at TL-I-08	24
4.5	Exposure Rate Trend at TL-I-10	26
4.6	Exposure Rate Trend at TL-I-12	28
4.7	Exposure Rate Trend at TL-I-14	30
4.8	Exposure Rate Trend at TL-I-15	32
4.9	Exposure Rate Trend at TL-I-16	34
4.10	Exposure Rate Trend at Control Location TL-O-36	36

1.0 INTRODUCTION

This report summarizes the findings of the Radiological Environmental Monitoring Program (REMP) conducted by Maine Yankee in the vicinity of the Independent Spent Fuel Storage Installation in Wiscasset, Maine during the calendar year 2012. It is submitted annually in compliance with Appendix A, of the Off-site Dose Calculation Manual (ODCM). The remainder of this report is organized as follows:

- Section 2: Provides a brief description of the Maine Yankee site and its environs.
- Section 3: Provides a description of the overall REMF design. Included is a summary of the requirements for REMF sampling, tables listing routine TLD monitoring locations with compass sectors and distances from the ISFSI, and maps showing the location of each of the TLD monitoring locations.
- Section 4: Provides a complete set of TLD data showing measured results (mR), TLD data converted to exposure rates (μ R per hour) and calculated doses (mrem per year). This section also provides the summarized exposure rate data in the format specified by the NRC Branch Technical Position on Environmental Monitoring (Reference 1).
- Section 5: Provides the results of the monitoring program. The performance of the program in meeting ODCM requirements is discussed, and the data acquired during the year is analyzed.
- Section 6: References

2.0 GENERAL ISFSI AND SITE INFORMATION

The Maine Yankee Independent Spent Fuel Storage Installation (ISFSI) is located in the town of Wiscasset, Lincoln County, Maine, approximately six miles northeast of Bath, Maine. The site vicinity is rural and lightly populated.

The ISFSI site is located near Bailey Point, a peninsula bounded to the east by the Back River and to the west by a shallow inlet known as Bailey Cove, both of which are part of the Montsweag Bay-Sheepscot River Estuary. Bailey point is an elongated bedrock ridge with flat or gently rolling topography rising to an average elevation of about 25 feet above sea level.

The Radiological Environmental Monitoring Program (REMP) for the ISFSI began pre-operational measurements in the 4th quarter of 1999, approximately 2 years prior to the initial spent fuel transfer to the ISFSI. The ISFSI REMP has been in continuous operation since this transfer began.

3.0 PROGRAM DESIGN

The Radiological Environmental Monitoring Program (REMP) for the Maine Yankee ISFSI was designed to provide assurance to regulatory agencies and the public that the station's environmental impact is known and within anticipated limits. The direct dose limit for members of the public from operation of the ISFSI is 25 mrem per year (References 3 and 4).

The detailed sampling requirements of the REMP are given in the ODCM. The sampling requirements specified in the ODCM are summarized in Table 3.1 of this report. Details of the monitored locations are shown in Table 3.2, as well as Figures 3.1 and 3.2 of this report.

3.1 Monitoring Zones

The REMP is designed to allow comparison of levels of radioactivity in samples from the area possibly influenced by the ISFSI to levels found in areas not influenced by the ISFSI. The first area is called "indicator stations". The second area is called "control stations". The distinction between the two is based on relative direction from the facility and distance. Analysis of survey data from the two zones aids in determining if there is a significant difference between the two areas. It can also help in differentiating between radioactivity or radiation due to releases and that due to other fluctuations in the environment, such as seasonal variations in the natural background.

3.2 Pathways Monitored

Based on the design of the ISFSI, only the direct radiation exposure pathway is monitored by the REMP. This pathway is monitored by the collection of thermoluminescent dosimeters (TLDs) which are described in more detail below.

3.3 Description of Monitoring Program

3.3.1 Direct Radiation

Direct gamma radiation exposure was continuously monitored during 2012 with the use of thermoluminescent dosimeters (TLDs). At each monitoring location, these TLDs are sealed in plastic bags and attached to an object such as a tree, fence or utility pole. The TLDs are posted and retrieved on a quarterly basis. All TLDs are provided and processed by a National Voluntary Laboratory Accreditation Program (NVLAP) certified vendor. The TLDs are placed at various locations around the Independent Spent Fuel Storage Installation (ISFSI). Table 3.2 lists the Station ID Codes, distances and direction of the TLDs from the ISFSI.

3.3.2 Special Monitoring

Special samples can be taken that are not required in the ODCM. The sample locations do not appear in Table 3.1 or 3.2 of this report. For this monitoring period, no samples were collected as part of the Maine Yankee ISFSI Radiological Environmental Monitoring Program.

Table 3.1
Radiological Environmental Monitoring Program

Exposure Pathway and/or Sample Media	Collection			Analysis	
	Number of Sample Locations	Routine Sampling Mode	Collection Frequency	Analysis Type	Analysis Frequency
Direct Radiation (TLD)	Total Locations:10 (9 around perimeter of the site and 1 offsite control location)	Continuous	Quarterly	Gamma dose	Each TLD

Table 3.2
Radiological Environmental Monitoring Locations

Station Code	Station Description	Zone *	Distance From ISFSI (km)	Direction From ISFSI
TL-O-36	Wiscasset Fire Station (O)	2	5.2	NW
TL-I-02	Spent Fuel Storage (I)**	1	< 0.28	N
TL-I-04	Spent Fuel Storage (I)**	1	< 0.28	NE
TL-I-06	Spent Fuel Storage (I)**	1	< 0.28	E
TL-I-08	Spent Fuel Storage (I)**	1	< 0.28	SE
TL-I-10	Spent Fuel Storage (I)**	1	< 0.28	S
TL-I-12	Spent Fuel Storage (I)**	1	< 0.28	SW
TL-I-14	Spent Fuel Storage (I)**	1	< 0.28	W
TL-I-15	Spent Fuel Storage (I)**	1	< 0.28	WNW
TL-I-16	Spent Fuel Storage (I)**	1	< 0.28	NW

*2 = Control TLD; 1 = Indicator TLD

**I = Inner Ring TLD; O = Outer Ring TLD

BAILEY COVE

MONTWEAG BAY

25 acre/yr boundary

TL-1-01

TL-1-02

TL-1-03

TL-1-04

TL-1-05

TL-1-06

TL-1-07

TL-1-08

TL-1-09

TL-1-10

TL-1-11

TL-1-12

TL-1-13

TL-1-14

TL-1-15

TL-1-16

BACK RIVER

LITTLE OAK ISLAND

0 100 METERS

Moine Trenches

CPS3 ENVIRONMENTAL FLU LOCATIONS

Moine Trenches

Moine Trench 15753 SITE Plan with 25 acre/yr boundary
Based on 8760 Hour Annual Occupancy

Figure 3.2
Direct Radiation Monitoring Locations
(outside 1 km)



4.0 RADIOLOGICAL DATA SUMMARY TABLES

This section summarizes the analytical results of the environmental samples, which were collected during the monitoring period.

- Data from direct radiation measurements made by TLDs are presented in Table 4.1.
- The direct measurements presented in Table 4.1 are converted to exposure rates in the following manner:
 - The total TLD exposure time is determined from the anneal and read dates.
 - The total deployment time is determined from the placement and retrieval dates.
 - The non-deployment time is converted to exposure and subtracted from the TLD reading presented in Table 4.1.
 - The resulting net exposure (deployment exposure) is divided by the deployment time in hours to calculate the exposure rate in μR per hour.
 - The calculated exposure rates are presented in Table 4.2.
- The summarized exposure rate results, shown in Table 4.3, are presented in a format similar to that prescribed in the NRC's Radiological Assessment Branch Technical Position on Environmental Monitoring (Reference 1).
- Table 4.4 presents the estimated direct dose from ISFSI operations as determined by TLD data shown in Table 4.1.

Table 4.1
TLD Measurements by Quarter
(mR)

Station ID	Direction	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr
TL-I-02	N	26	23	25	39
TL-I-04	NE	23	21	27	38
TL-I-06	E	36	32	36	55
TL-I-08	SE	30	26	31	41
TL-I-10	S	29	26	26	42
TL-I-12	SW	28	26	27	39
TL-I-14	W	29	23	26	41
TL-I-15	WNW	31	25	30	45
TL-I-16	NW	31	25	28	39
TL-O-36	Control	25	20	24	35
TL-O-36a	Control Backup	31	23	27	36

Table 4.2
Exposure Rates from TLD Measurements
(μ R per hour)

Station ID	Direction	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Annual Ave
TL-I-02	N	6.6	5.9	5.6	9.3	6.8
TL-I-04	NE	5.2	5.0	6.5	8.8	6.4
TL-I-06	E	11.1	10.2	10.5	16.7	12.1
TL-I-08	SE	8.4	7.3	8.3	10.2	8.5
TL-I-10	S	7.9	7.3	6.1	10.7	8.0
TL-I-12	SW	7.5	7.3	6.5	9.3	7.6
TL-I-14	W	7.9	5.9	6.1	10.2	7.5
TL-I-15	WNW	8.8	6.9	7.8	12.1	8.9
TL-I-16	NW	8.8	6.9	7.0	9.3	8.0
TL-O-36	Control	7.5	5.2	5.9	7.7	6.5

Table 4.3
Environmental TLD Data Summary
(μ R per hour)

Inner Ring TLDs	Control TLD's	Station With Highest Mean	
Mean (Range) (No. Measurements)*	Mean (Range) (No. Measurements)*	Station #	Mean (Range) (No. Measurements)*
8.2	6.5	TL-I-06	12.1
(5.0 – 16.7)	(5.2 – 7.7)		(10.2 – 16.7)
(36)	(8)		(4)

* Each "measurement" is based on quarterly readings

Table 4.4
Direct Dose from ISFSI Operations
(mrem)

	Q1		Q2		Q3		Q4		
Station ID	Net TLD Result	Calculated Dose	Net TLD Result	Calculated Dose	Net TLD Result	Calculated Dose	Net TLD Result	Calculated Dose	Annual Dose
TL-I-02	0.00	0.00	1.50	0.09	0.00	0.00	3.50	0.05	0.14
TL-I-04	0.00	0.00	0.00	0.00	1.50	0.09	2.50	0.04	0.13
TL-I-06	8.00	0.12	10.50	0.62	10.50	0.62	19.50	0.29	1.65
TL-I-08	2.00	0.03	4.50	0.27	5.50	0.33	5.50	0.08	0.70
TL-I-10	1.00	0.01	4.50	0.27	0.50	0.03	6.50	0.10	0.41
TL-I-12	0.00	0.00	4.50	0.27	1.50	0.09	3.50	0.05	0.41
TL-I-14	1.00	0.01	1.50	0.09	0.50	0.03	5.50	0.08	0.22
TL-I-15	3.00	0.04	3.50	0.21	4.50	0.27	9.50	0.14	0.66
TL-I-16	3.00	0.04	3.50	0.21	2.50	0.15	3.50	0.05	0.45

Max Dose => 1.65

Notes:

1. Doses based on a 32.5 hour occupancy in both of the first and fourth quarters and a 130 hour occupancy in both of the second and third quarters.
2. Some of the net TLD results were negative and rounded up to zero


Figure 4.1
Exposure Rate Trend at TL-I-02

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations - TL-I-02 : REMP TLD [Exposure Rate]

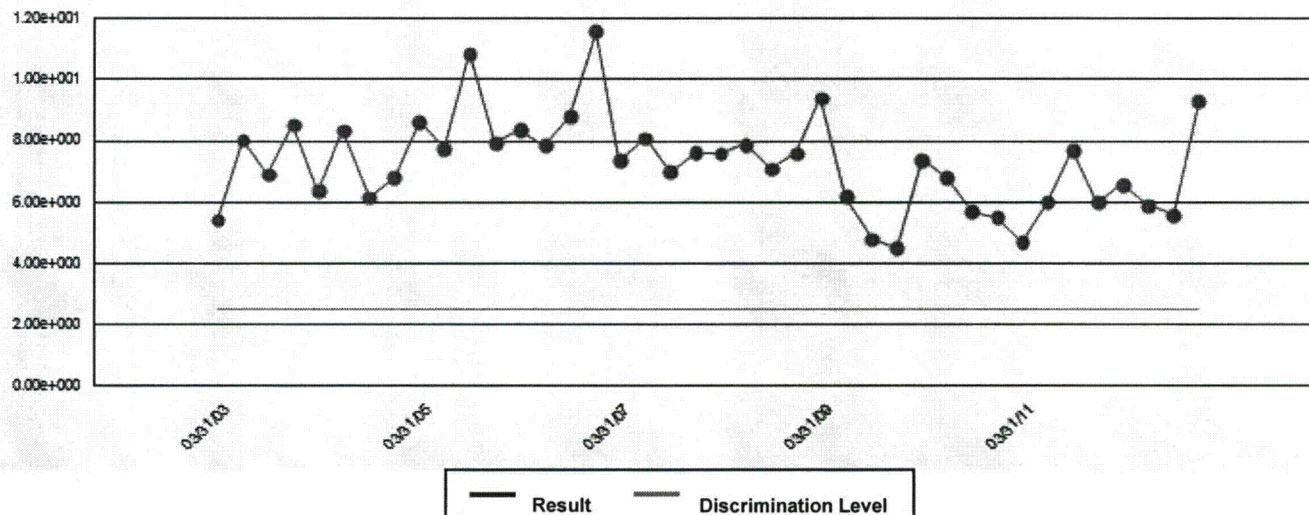

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-02-001	03/31/2003	5.4E+000 $\mu\text{R/h}$ † *	1.18E+000	2.5E+000
TL-I-02-002	06/30/2003	8.0E+000 $\mu\text{R/h}$ † *	1.10E+000	2.5E+000
TL-I-02-003	09/30/2003	6.9E+000 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000
TL-I-02-004	12/31/2003	8.5E+000 $\mu\text{R/h}$ † *	9.00E-001	2.5E+000
TL-I-02-005	03/31/2004	6.4E+000 $\mu\text{R/h}$ † *	8.20E-001	2.5E+000
TL-I-02-006	06/30/2004	8.3E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-007	09/30/2004	6.2E+000 $\mu\text{R/h}$ † *	6.60E-001	2.5E+000
TL-I-02-008	12/31/2004	6.8E+000 $\mu\text{R/h}$ † *	7.40E-001	2.5E+000
TL-I-02-009	03/31/2005	8.6E+000 $\mu\text{R/h}$ † *	8.60E-001	2.5E+000
TL-I-02-010	06/30/2005	7.8E+000 $\mu\text{R/h}$ † *	7.80E-001	2.5E+000
TL-I-02-011	09/30/2005	1.1E+001 $\mu\text{R/h}$ † *	1.08E+000	2.5E+000
TL-I-02-012	12/31/2005	8.0E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-013	03/31/2006	8.4E+000 $\mu\text{R/h}$ † *	8.40E-001	2.5E+000
TL-I-02-014	06/30/2006	7.9E+000 $\mu\text{R/h}$ † *	7.80E-001	2.5E+000
TL-I-02-015	09/30/2006	8.8E+000 $\mu\text{R/h}$ † *	8.80E-001	2.5E+000
TL-I-02-016	12/31/2006	1.2E+001 $\mu\text{R/h}$ † *	1.16E+000	2.5E+000
TL-I-02-017	03/31/2007	7.4E+000 $\mu\text{R/h}$ † *	7.40E-001	2.5E+000
TL-I-02-018	06/30/2007	8.1E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-019	09/30/2007	7.0E+000 $\mu\text{R/h}$ † *	7.00E-001	2.5E+000
TL-I-02-020	12/31/2007	7.6E+000 $\mu\text{R/h}$ † *	7.60E-001	2.5E+000
TL-I-02-021	03/31/2008	7.6E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-022	06/30/2008	7.9E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-023	09/30/2008	7.1E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-024	12/31/2008	7.6E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-025	03/31/2009	9.4E+000 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000
TL-I-02-026	06/30/2009	6.2E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-027	09/30/2009	4.8E+000 $\mu\text{R/h}$ † *	4.00E-001	2.5E+000
TL-I-02-028	12/31/2009	4.5E+000 $\mu\text{R/h}$ † *	4.00E-001	2.5E+000
TL-I-02-029	03/31/2010	7.4E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-030	06/30/2010	6.8E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-02 : REMP TLD [Exposure Rate]

Continued...

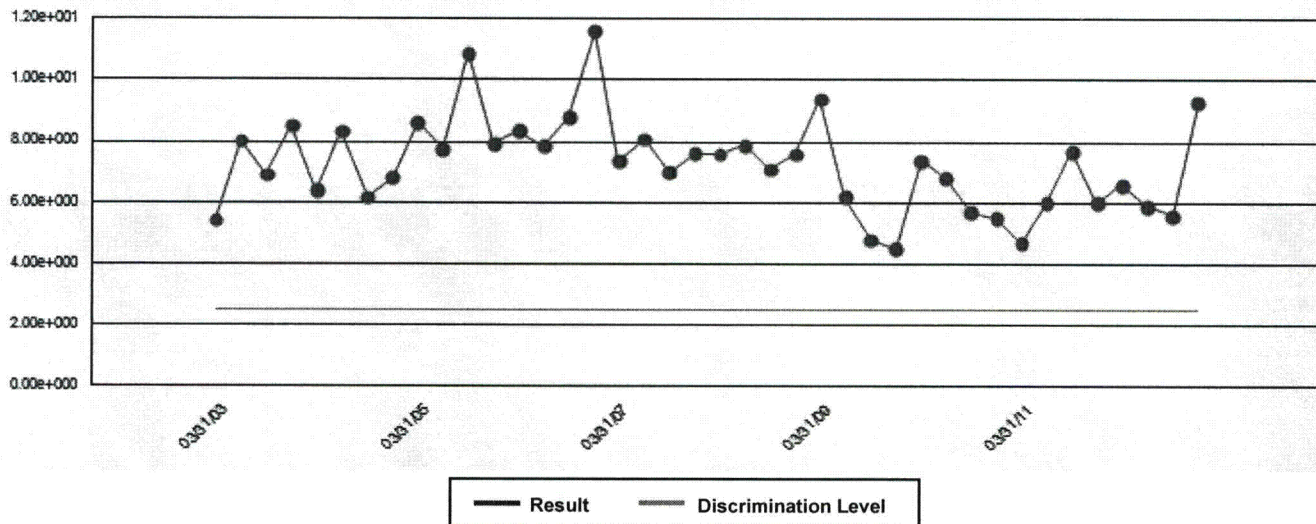

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-02-031	09/30/2010	5.7E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-032	12/31/2010	5.5E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-033	03/31/2011	4.7E+000 $\mu\text{R/h}$ † *	4.00E-001	2.5E+000
TL-I-02-034	06/30/2011	6.0E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-035	09/30/2011	7.7E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-02-036	12/31/2011	6.0E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-037	03/31/2012	6.6E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-038	06/30/2012	5.9E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-039	09/30/2012	5.6E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-02-040	12/31/2012	9.3E+000 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.
Results marked with † are greater than the Discrimination Level


Figure 4.2
Exposure Rate Trend at TL-I-04

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations – TL-I-04 : REMP TLD [Exposure Rate]

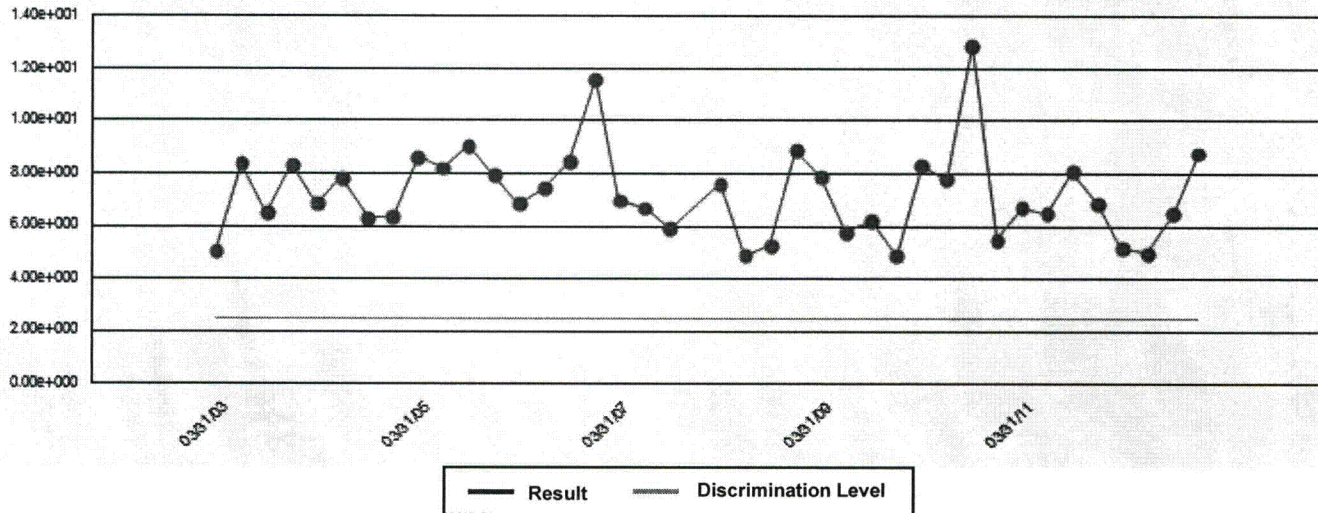

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-04-001	03/31/2003	5.1E+000 $\mu\text{R/h}$ † *	1.26E+000	2.5E+000
TL-I-04-002	06/30/2003	8.4E+000 $\mu\text{R/h}$ † *	1.02E+000	2.5E+000
TL-I-04-003	09/30/2003	6.5E+000 $\mu\text{R/h}$ † *	7.20E-001	2.5E+000
TL-I-04-004	12/31/2003	8.3E+000 $\mu\text{R/h}$ † *	1.14E+000	2.5E+000
TL-I-04-005	03/31/2004	6.9E+000 $\mu\text{R/h}$ † *	7.80E-001	2.5E+000
TL-I-04-006	06/30/2004	7.8E+000 $\mu\text{R/h}$ † *	1.08E+000	2.5E+000
TL-I-04-007	09/30/2004	6.3E+000 $\mu\text{R/h}$ † *	6.20E-001	2.5E+000
TL-I-04-008	12/31/2004	6.3E+000 $\mu\text{R/h}$ † *	4.20E-001	2.5E+000
TL-I-04-009	03/31/2005	8.6E+000 $\mu\text{R/h}$ † *	8.60E-001	2.5E+000
TL-I-04-010	06/30/2005	8.2E+000 $\mu\text{R/h}$ † *	8.20E-001	2.5E+000
TL-I-04-011	09/30/2005	9.1E+000 $\mu\text{R/h}$ † *	9.00E-001	2.5E+000
TL-I-04-012	12/31/2005	8.0E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-04-013	03/31/2006	6.9E+000 $\mu\text{R/h}$ † *	6.80E-001	2.5E+000
TL-I-04-014	06/30/2006	7.5E+000 $\mu\text{R/h}$ † *	7.40E-001	2.5E+000
TL-I-04-015	09/30/2006	8.4E+000 $\mu\text{R/h}$ † *	8.40E-001	2.5E+000
TL-I-04-016	12/31/2006	1.2E+001 $\mu\text{R/h}$ † *	1.16E+000	2.5E+000
TL-I-04-017	03/31/2007	7.0E+000 $\mu\text{R/h}$ † *	7.00E-001	2.5E+000
TL-I-04-018	06/30/2007	6.7E+000 $\mu\text{R/h}$ † *	6.60E-001	2.5E+000
TL-I-04-019	09/30/2007	5.9E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-04-021	03/31/2008	7.6E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-04-022	06/30/2008	4.9E+000 $\mu\text{R/h}$ † *	4.00E-001	2.5E+000
TL-I-04-023	09/30/2008	5.3E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-04-024	12/31/2008	8.9E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-04-025	03/31/2009	7.9E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-04-026	06/30/2009	5.8E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-04-027	09/30/2009	6.2E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-04-028	12/31/2009	4.9E+000 $\mu\text{R/h}$ † *	4.00E-001	2.5E+000
TL-I-04-029	03/31/2010	8.3E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-04-030	06/30/2010	7.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-04-031	09/30/2010	1.3E+001 $\mu\text{R/h}$ † *	1.20E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-04 : REMP TLD [Exposure Rate]

Continued...

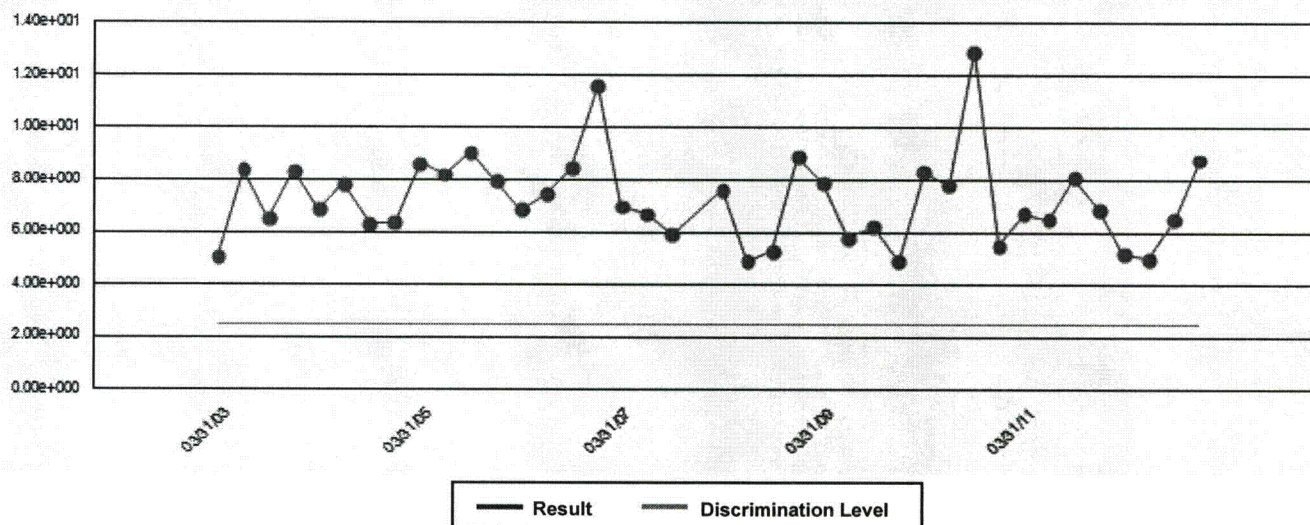

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-04-032	12/31/2010	5.5E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-04-033	03/31/2011	6.7E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-04-034	06/30/2011	6.5E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-04-035	09/30/2011	8.1E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-04-036	12/31/2011	6.9E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-04-037	03/31/2012	5.2E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-04-038	06/30/2012	5.0E+000 μ R/h † *	4.00E-001	2.5E+000
TL-I-04-039	09/30/2012	6.5E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-04-040	12/31/2012	8.8E+000 μ R/h † *	8.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.3
Exposure Rate Trend at TL-I-06

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations – TL-I-06 : REMP TLD [Exposure Rate]

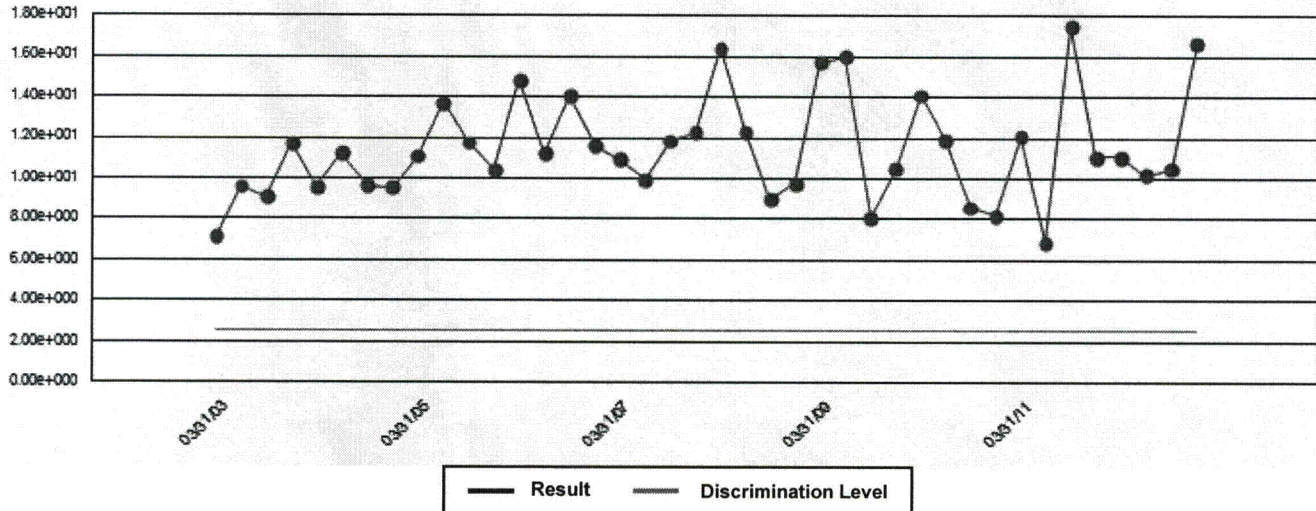

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-06-001	03/31/2003	7.1E+000 µR/h † *	1.36E+000	2.5E+000
TL-I-06-002	06/30/2003	9.6E+000 µR/h † *	1.00E+000	2.5E+000
TL-I-06-003	09/30/2003	9.1E+000 µR/h † *	1.46E+000	2.5E+000
TL-I-06-004	12/31/2003	1.2E+001 µR/h † *	1.16E+000	2.5E+000
TL-I-06-005	03/31/2004	9.6E+000 µR/h † *	9.40E-001	2.5E+000
TL-I-06-006	06/30/2004	1.1E+001 µR/h † *	1.72E+000	2.5E+000
TL-I-06-007	09/30/2004	9.7E+000 µR/h † *	1.20E+000	2.5E+000
TL-I-06-008	12/31/2004	9.6E+000 µR/h † *	1.24E+000	2.5E+000
TL-I-06-009	03/31/2005	1.1E+001 µR/h † *	1.12E+000	2.5E+000
TL-I-06-010	06/30/2005	1.4E+001 µR/h † *	1.38E+000	2.5E+000
TL-I-06-011	09/30/2005	1.2E+001 µR/h † *	1.18E+000	2.5E+000
TL-I-06-012	12/31/2005	1.0E+001 µR/h † *	1.04E+000	2.5E+000
TL-I-06-013	03/31/2006	1.5E+001 µR/h † *	1.48E+000	2.5E+000
TL-I-06-014	06/30/2006	1.1E+001 µR/h † *	1.12E+000	2.5E+000
TL-I-06-015	09/30/2006	1.4E+001 µR/h † *	1.40E+000	2.5E+000
TL-I-06-016	12/31/2006	1.2E+001 µR/h † *	1.16E+000	2.5E+000
TL-I-06-017	03/31/2007	1.1E+001 µR/h † *	1.10E+000	2.5E+000
TL-I-06-018	06/30/2007	1.0E+001 µR/h † *	1.00E+000	2.5E+000
TL-I-06-019	09/30/2007	1.2E+001 µR/h † *	1.18E+000	2.5E+000
TL-I-06-020	12/31/2007	1.2E+001 µR/h † *	1.22E+000	2.5E+000
TL-I-06-021	03/31/2008	1.6E+001 µR/h † *	1.60E+000	2.5E+000
TL-I-06-022	06/30/2008	1.2E+001 µR/h † *	1.20E+000	2.5E+000
TL-I-06-023	09/30/2008	9.0E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-06-024	12/31/2008	9.8E+000 µR/h † *	1.00E+000	2.5E+000
TL-I-06-025	03/31/2009	1.6E+001 µR/h † *	1.60E+000	2.5E+000
TL-I-06-026	06/30/2009	1.6E+001 µR/h † *	1.60E+000	2.5E+000
TL-I-06-027	09/30/2009	8.1E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-06-028	12/31/2009	1.1E+001 µR/h † *	1.00E+000	2.5E+000
TL-I-06-029	03/31/2010	1.4E+001 µR/h † *	1.40E+000	2.5E+000
TL-I-06-030	06/30/2010	1.2E+001 µR/h † *	1.20E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-06 : REMP TLD [Exposure Rate]

Continued...

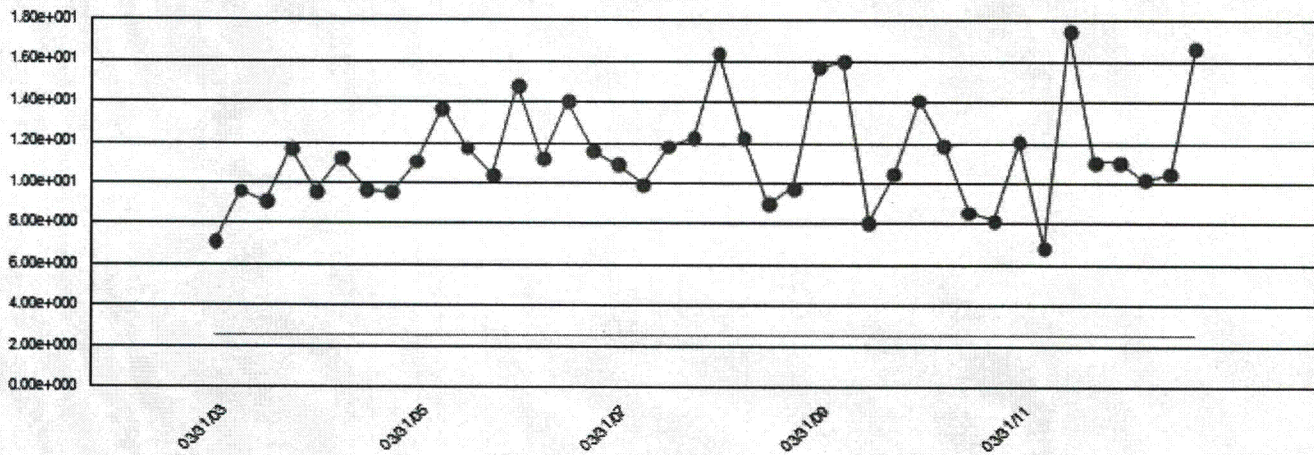

Result Discrimination Level

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-06-031	09/30/2010	8.6E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-06-032	12/31/2010	8.2E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-06-033	03/31/2011	1.2E+001 μR/h † *	1.20E+000	2.5E+000
TL-I-06-034	06/30/2011	6.9E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-06-035	09/30/2011	1.8E+001 μR/h † *	1.80E+000	2.5E+000
TL-I-06-036	12/31/2011	1.1E+001 μR/h † *	1.20E+000	2.5E+000
TL-I-06-037	03/31/2012	1.1E+001 μR/h † *	1.20E+000	2.5E+000
TL-I-06-038	06/30/2012	1.0E+001 μR/h † *	1.00E+000	2.5E+000
TL-I-06-039	09/30/2012	1.1E+001 μR/h † *	1.00E+000	2.5E+000
TL-I-06-040	12/31/2012	1.7E+001 μR/h † *	1.60E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.4
Exposure Rate Trend at TL-I-08

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations – TL-I-08 : REMP TLD [Exposure Rate]

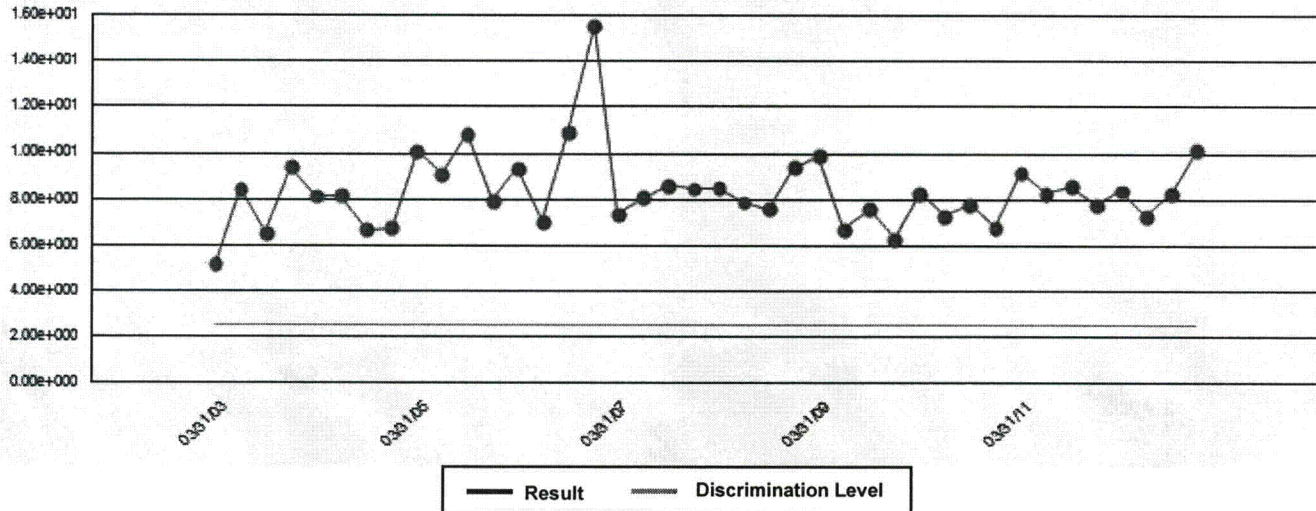

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-08-001	03/31/2003	5.2E+000 μR/h † *	1.18E+000	2.5E+000
TL-I-08-002	06/30/2003	8.4E+000 μR/h † *	1.24E+000	2.5E+000
TL-I-08-003	09/30/2003	6.5E+000 μR/h † *	9.20E-001	2.5E+000
TL-I-08-004	12/31/2003	9.4E+000 μR/h † *	1.00E+000	2.5E+000
TL-I-08-005	03/31/2004	8.2E+000 μR/h † *	1.14E+000	2.5E+000
TL-I-08-006	06/30/2004	8.2E+000 μR/h † *	1.14E+000	2.5E+000
TL-I-08-007	09/30/2004	6.7E+000 μR/h † *	5.80E-001	2.5E+000
TL-I-08-008	12/31/2004	6.8E+000 μR/h † *	5.40E-001	2.5E+000
TL-I-08-009	03/31/2005	1.0E+001 μR/h † *	1.02E+000	2.5E+000
TL-I-08-010	06/30/2005	9.1E+000 μR/h † *	9.20E-001	2.5E+000
TL-I-08-011	09/30/2005	1.1E+001 μR/h † *	1.08E+000	2.5E+000
TL-I-08-012	12/31/2005	8.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-013	03/31/2006	9.3E+000 μR/h † *	9.40E-001	2.5E+000
TL-I-08-014	06/30/2006	7.0E+000 μR/h † *	7.00E-001	2.5E+000
TL-I-08-015	09/30/2006	1.1E+001 μR/h † *	1.08E+000	2.5E+000
TL-I-08-016	12/31/2006	1.6E+001 μR/h † *	1.56E+000	2.5E+000
TL-I-08-017	03/31/2007	7.4E+000 μR/h † *	7.40E-001	2.5E+000
TL-I-08-018	06/30/2007	8.1E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-019	09/30/2007	8.6E+000 μR/h † *	8.60E-001	2.5E+000
TL-I-08-020	12/31/2007	8.5E+000 μR/h † *	8.40E-001	2.5E+000
TL-I-08-021	03/31/2008	8.5E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-022	06/30/2008	7.9E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-023	09/30/2008	7.6E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-024	12/31/2008	9.4E+000 μR/h † *	1.00E+000	2.5E+000
TL-I-08-025	03/31/2009	9.9E+000 μR/h † *	1.00E+000	2.5E+000
TL-I-08-026	06/30/2009	6.7E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-08-027	09/30/2009	7.6E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-028	12/31/2009	6.3E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-08-029	03/31/2010	8.3E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-08-030	06/30/2010	7.3E+000 μR/h † *	8.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-08 : REMP TLD [Exposure Rate]

Continued...

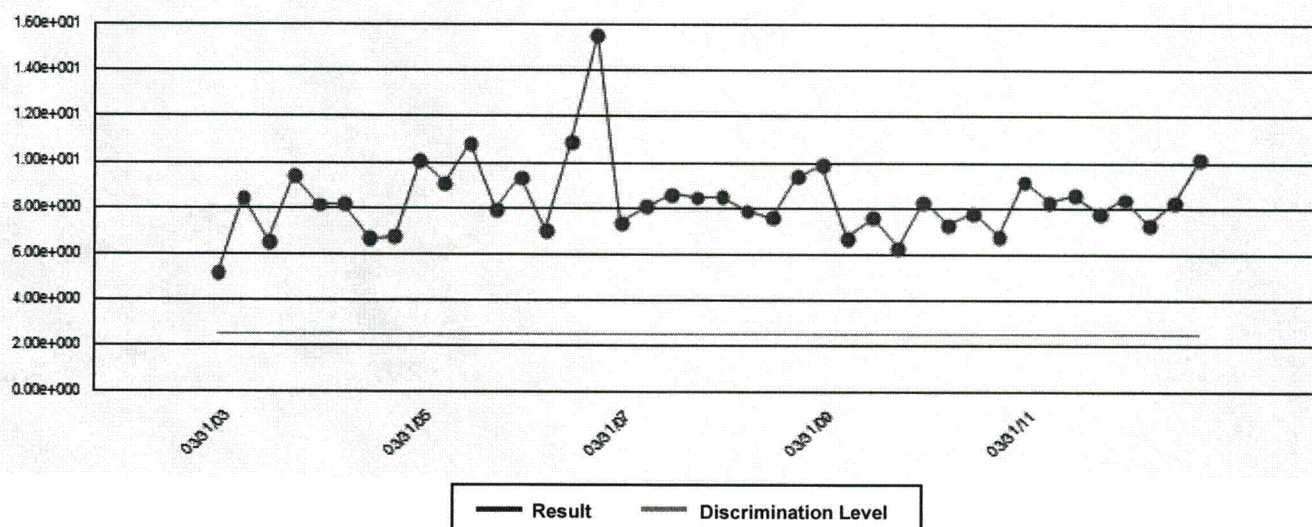

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-08-031	09/30/2010	7.8E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-032	12/31/2010	6.8E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-08-033	03/31/2011	9.2E+000 μ R/h † *	1.00E+000	2.5E+000
TL-I-08-034	06/30/2011	8.3E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-035	09/30/2011	8.6E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-036	12/31/2011	7.8E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-037	03/31/2012	8.4E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-038	06/30/2012	7.3E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-039	09/30/2012	8.3E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-08-040	12/31/2012	1.0E+001 μ R/h † *	1.00E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.5
Exposure Rate Trend at TL-I-10

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations - TL-I-10 : REMP TLD [Exposure Rate]

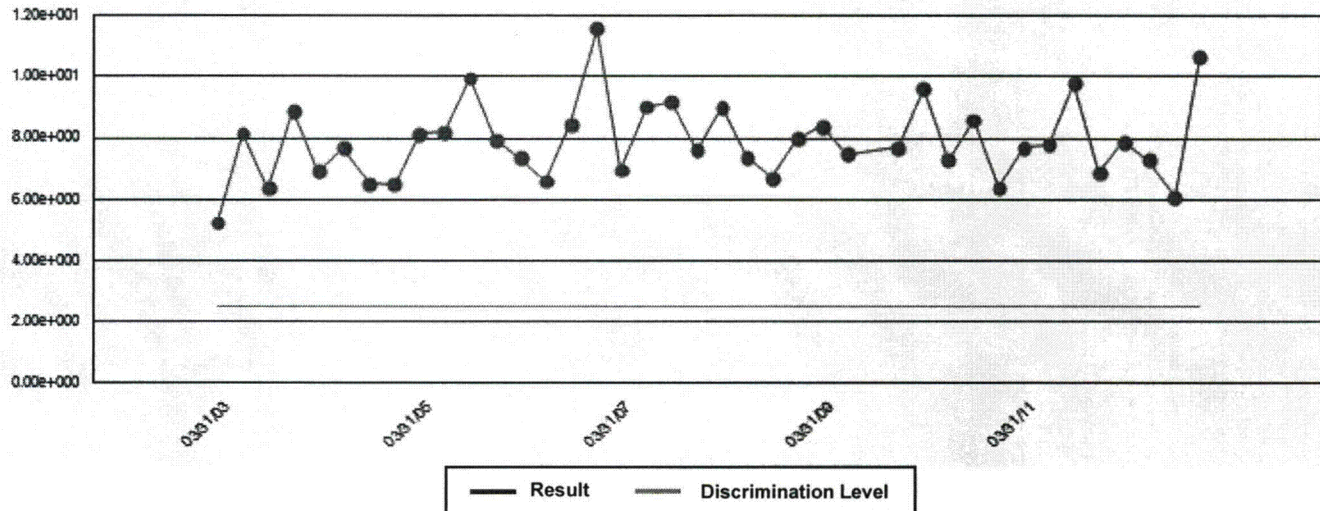

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-10-001	03/31/2003	5.2E+000 μR/h † *	1.18E+000	2.5E+000
TL-I-10-002	06/30/2003	8.2E+000 μR/h † *	1.04E+000	2.5E+000
TL-I-10-003	09/30/2003	6.4E+000 μR/h † *	1.10E+000	2.5E+000
TL-I-10-004	12/31/2003	8.9E+000 μR/h † *	8.60E-001	2.5E+000
TL-I-10-005	03/31/2004	6.9E+000 μR/h † *	8.60E-001	2.5E+000
TL-I-10-006	06/30/2004	7.7E+000 μR/h † *	1.06E+000	2.5E+000
TL-I-10-007	09/30/2004	6.5E+000 μR/h † *	8.40E-001	2.5E+000
TL-I-10-008	12/31/2004	6.5E+000 μR/h † *	9.60E-001	2.5E+000
TL-I-10-009	03/31/2005	8.1E+000 μR/h † *	8.20E-001	2.5E+000
TL-I-10-010	06/30/2005	8.2E+000 μR/h † *	8.20E-001	2.5E+000
TL-I-10-011	09/30/2005	1.0E+001 μR/h † *	1.00E+000	2.5E+000
TL-I-10-012	12/31/2005	8.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-013	03/31/2006	7.4E+000 μR/h † *	7.40E-001	2.5E+000
TL-I-10-014	06/30/2006	6.6E+000 μR/h † *	6.60E-001	2.5E+000
TL-I-10-015	09/30/2006	8.4E+000 μR/h † *	8.40E-001	2.5E+000
TL-I-10-016	12/31/2006	1.2E+001 μR/h † *	1.16E+000	2.5E+000
TL-I-10-017	03/31/2007	7.0E+000 μR/h † *	7.00E-001	2.5E+000
TL-I-10-018	06/30/2007	9.0E+000 μR/h † *	9.00E-001	2.5E+000
TL-I-10-019	09/30/2007	9.2E+000 μR/h † *	9.20E-001	2.5E+000
TL-I-10-020	12/31/2007	7.6E+000 μR/h † *	7.60E-001	2.5E+000
TL-I-10-021	03/31/2008	9.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-022	06/30/2008	7.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-023	09/30/2008	6.7E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-10-024	12/31/2008	8.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-025	03/31/2009	8.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-026	06/30/2009	7.5E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-028	12/31/2009	7.7E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-029	03/31/2010	9.6E+000 μR/h † *	1.00E+000	2.5E+000
TL-I-10-030	06/30/2010	7.3E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-10-031	09/30/2010	8.6E+000 μR/h † *	8.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-10 : REMP TLD [Exposure Rate]

Continued...

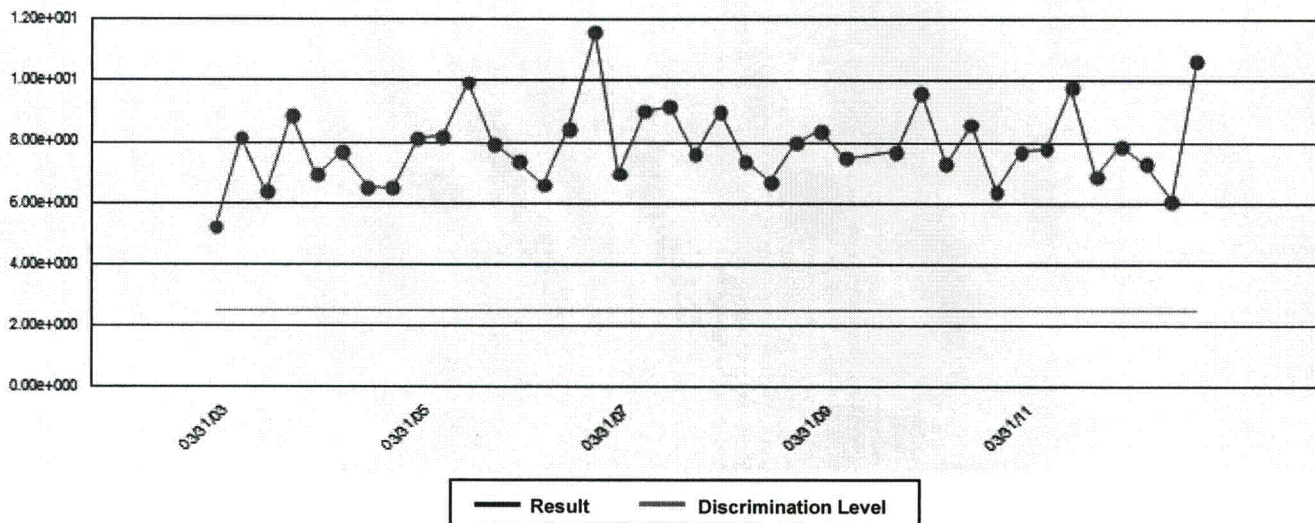

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-10-032	12/31/2010	6.4E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-10-033	03/31/2011	7.7E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-10-034	06/30/2011	7.8E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-10-035	09/30/2011	9.8E+000 μ R/h † *	1.00E+000	2.5E+000
TL-I-10-036	12/31/2011	6.9E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-10-037	03/31/2012	7.9E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-10-038	06/30/2012	7.3E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-10-039	09/30/2012	6.1E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-10-040	12/31/2012	1.1E+001 μ R/h † *	1.00E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.6
Exposure Rate Trend at TL-I-12

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations - TL-I-12 : REMP TLD [Exposure Rate]

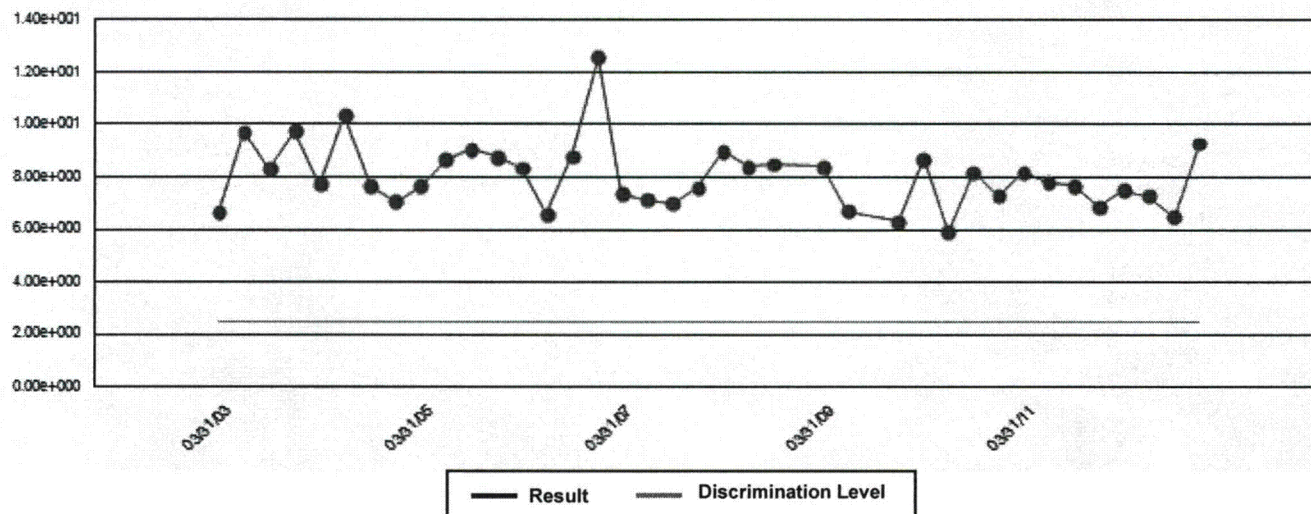

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-12-001	03/31/2003	6.7E+000 μR/h † *	1.30E+000	2.5E+000
TL-I-12-002	06/30/2003	9.7E+000 μR/h † *	1.38E+000	2.5E+000
TL-I-12-003	09/30/2003	8.3E+000 μR/h † *	1.14E+000	2.5E+000
TL-I-12-004	12/31/2003	9.8E+000 μR/h † *	7.80E-001	2.5E+000
TL-I-12-005	03/31/2004	7.7E+000 μR/h † *	1.50E+000	2.5E+000
TL-I-12-006	06/30/2004	1.0E+001 μR/h † *	1.14E+000	2.5E+000
TL-I-12-007	09/30/2004	7.6E+000 μR/h † *	7.00E-001	2.5E+000
TL-I-12-008	12/31/2004	7.1E+000 μR/h † *	7.40E-001	2.5E+000
TL-I-12-009	03/31/2005	7.6E+000 μR/h † *	7.60E-001	2.5E+000
TL-I-12-010	06/30/2005	8.7E+000 μR/h † *	8.60E-001	2.5E+000
TL-I-12-011	09/30/2005	9.1E+000 μR/h † *	9.00E-001	2.5E+000
TL-I-12-012	12/31/2005	8.8E+000 μR/h † *	8.80E-001	2.5E+000
TL-I-12-013	03/31/2006	8.4E+000 μR/h † *	8.40E-001	2.5E+000
TL-I-12-014	06/30/2006	6.6E+000 μR/h † *	6.60E-001	2.5E+000
TL-I-12-015	09/30/2006	8.8E+000 μR/h † *	8.80E-001	2.5E+000
TL-I-12-016	12/31/2006	1.3E+001 μR/h † *	1.26E+000	2.5E+000
TL-I-12-017	03/31/2007	7.4E+000 μR/h † *	7.40E-001	2.5E+000
TL-I-12-018	06/30/2007	7.2E+000 μR/h † *	7.20E-001	2.5E+000
TL-I-12-019	09/30/2007	7.0E+000 μR/h † *	7.00E-001	2.5E+000
TL-I-12-020	12/31/2007	7.6E+000 μR/h † *	7.60E-001	2.5E+000
TL-I-12-021	03/31/2008	9.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-12-022	06/30/2008	8.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-12-023	09/30/2008	8.5E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-12-025	03/31/2009	8.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-12-026	06/30/2009	6.7E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-12-028	12/31/2009	6.3E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-12-029	03/31/2010	8.7E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-12-030	06/30/2010	5.9E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-12-031	09/30/2010	8.2E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-12-032	12/31/2010	7.3E+000 μR/h † *	8.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-12 : REMP TLD [Exposure Rate]

Continued...

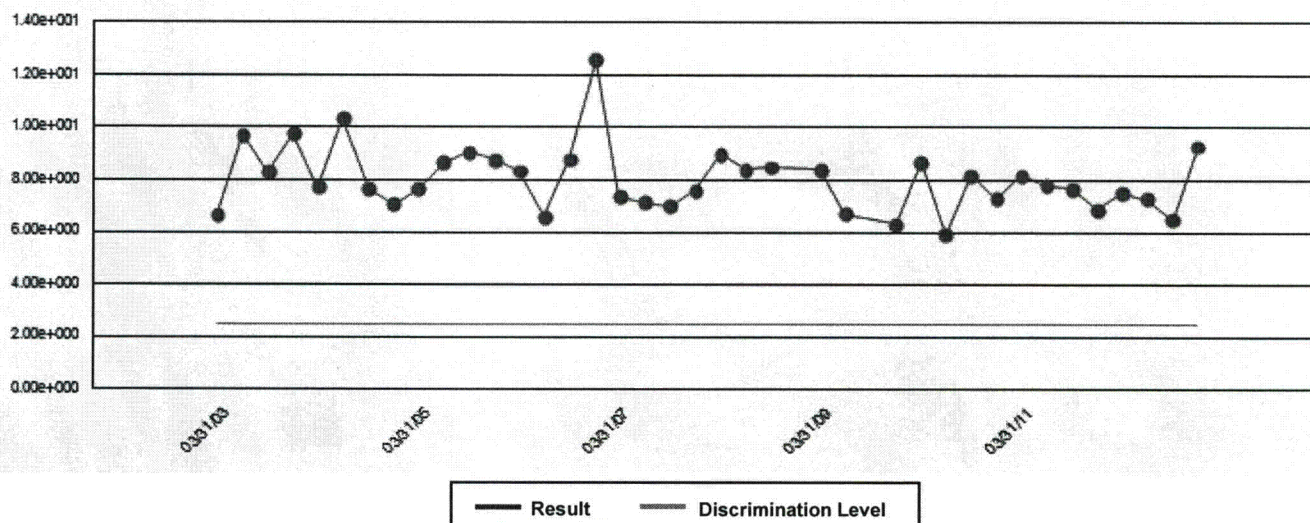

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-12-033	03/31/2011	8.2E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-12-034	06/30/2011	7.8E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-12-035	09/30/2011	7.7E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-12-036	12/31/2011	6.9E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-12-037	03/31/2012	7.5E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-12-038	06/30/2012	7.3E+000 μ R/h † *	8.00E-001	2.5E+000
TL-I-12-039	09/30/2012	6.5E+000 μ R/h † *	6.00E-001	2.5E+000
TL-I-12-040	12/31/2012	9.3E+000 μ R/h † *	1.00E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.
Results marked with † are greater than the Discrimination Level


Figure 4.7
Exposure Rate Trend at TL-I-14

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations - TL-I-14 : REMP TLD [Exposure Rate]

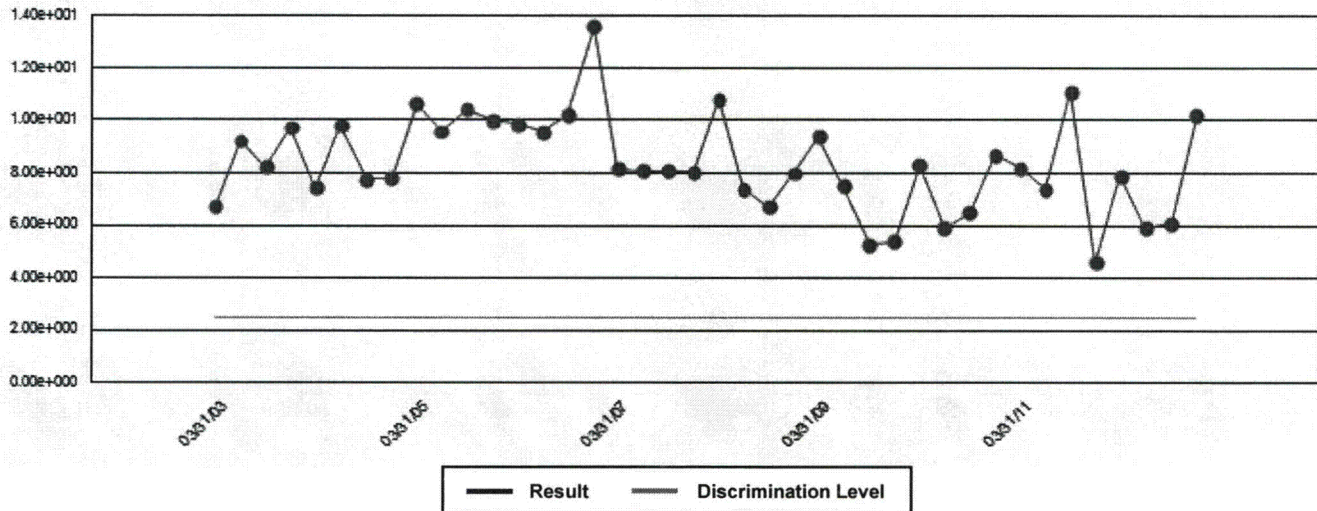

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-14-001	03/31/2003	6.7E+000 μR/h † *	1.26E+000	2.5E+000
TL-I-14-002	06/30/2003	9.2E+000 μR/h † *	1.04E+000	2.5E+000
TL-I-14-003	09/30/2003	8.3E+000 μR/h † *	9.20E-001	2.5E+000
TL-I-14-004	12/31/2003	9.7E+000 μR/h † *	1.00E+000	2.5E+000
TL-I-14-005	03/31/2004	7.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-006	06/30/2004	9.8E+000 μR/h † *	1.28E+000	2.5E+000
TL-I-14-007	09/30/2004	7.8E+000 μR/h † *	8.80E-001	2.5E+000
TL-I-14-008	12/31/2004	7.8E+000 μR/h † *	9.20E-001	2.5E+000
TL-I-14-009	03/31/2005	1.1E+001 μR/h † *	1.06E+000	2.5E+000
TL-I-14-010	06/30/2005	9.6E+000 μR/h † *	9.60E-001	2.5E+000
TL-I-14-011	09/30/2005	1.0E+001 μR/h † *	1.04E+000	2.5E+000
TL-I-14-012	12/31/2005	1.0E+001 μR/h † *	1.00E+000	2.5E+000
TL-I-14-013	03/31/2006	9.8E+000 μR/h † *	9.80E-001	2.5E+000
TL-I-14-014	06/30/2006	9.6E+000 μR/h † *	9.60E-001	2.5E+000
TL-I-14-015	09/30/2006	1.0E+001 μR/h † *	1.02E+000	2.5E+000
TL-I-14-016	12/31/2006	1.4E+001 μR/h † *	1.36E+000	2.5E+000
TL-I-14-017	03/31/2007	8.2E+000 μR/h † *	8.20E-001	2.5E+000
TL-I-14-018	06/30/2007	8.1E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-019	09/30/2007	8.1E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-020	12/31/2007	8.1E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-021	03/31/2008	1.1E+001 μR/h † *	1.00E+000	2.5E+000
TL-I-14-022	06/30/2008	7.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-023	09/30/2008	6.7E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-14-024	12/31/2008	8.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-025	03/31/2009	9.4E+000 μR/h † *	1.00E+000	2.5E+000
TL-I-14-026	06/30/2009	7.5E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-027	09/30/2009	5.3E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-14-028	12/31/2009	5.4E+000 μR/h † *	6.00E-001	2.5E+000
TL-I-14-029	03/31/2010	8.3E+000 μR/h † *	8.00E-001	2.5E+000
TL-I-14-030	06/30/2010	5.9E+000 μR/h † *	6.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-14 : REMP TLD [Exposure Rate]

Continued...

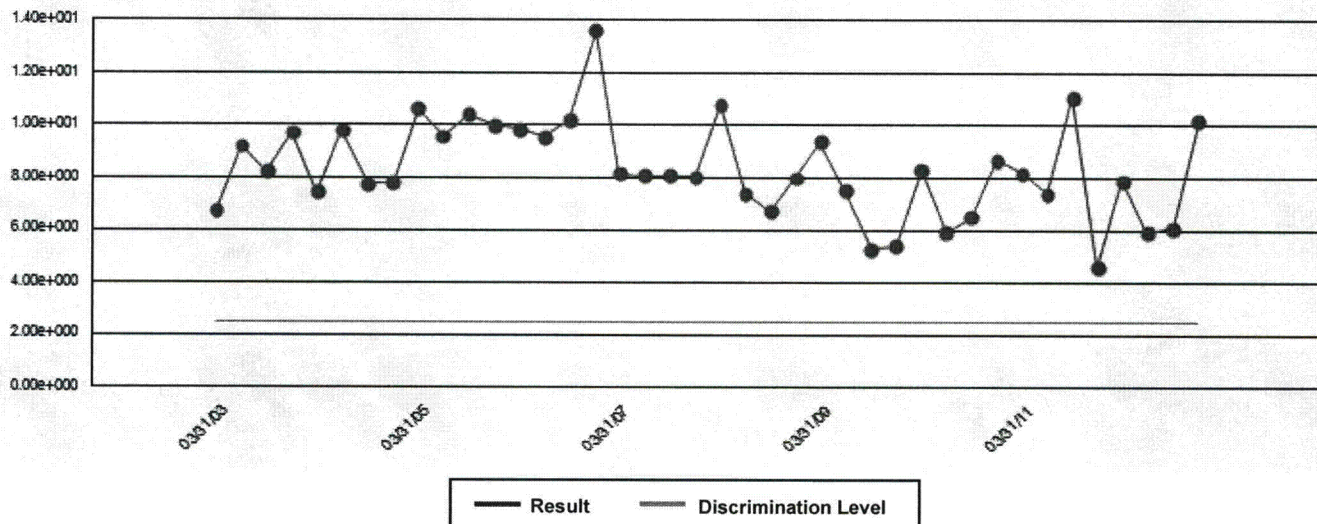

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-14-031	09/30/2010	6.5E+000 µR/h † *	6.00E-001	2.5E+000
TL-I-14-032	12/31/2010	8.7E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-14-033	03/31/2011	8.2E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-14-034	06/30/2011	7.4E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-14-035	09/30/2011	1.1E+001 µR/h † *	1.20E+000	2.5E+000
TL-I-14-036	12/31/2011	4.6E+000 µR/h † *	4.00E-001	2.5E+000
TL-I-14-037	03/31/2012	7.9E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-14-038	06/30/2012	5.9E+000 µR/h † *	6.00E-001	2.5E+000
TL-I-14-039	09/30/2012	6.1E+000 µR/h † *	6.00E-001	2.5E+000
TL-I-14-040	12/31/2012	1.0E+001 µR/h † *	1.00E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.8
Exposure Rate Trend at TL-I-15

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations – TL-I-15 : REMP TLD [Exposure Rate]

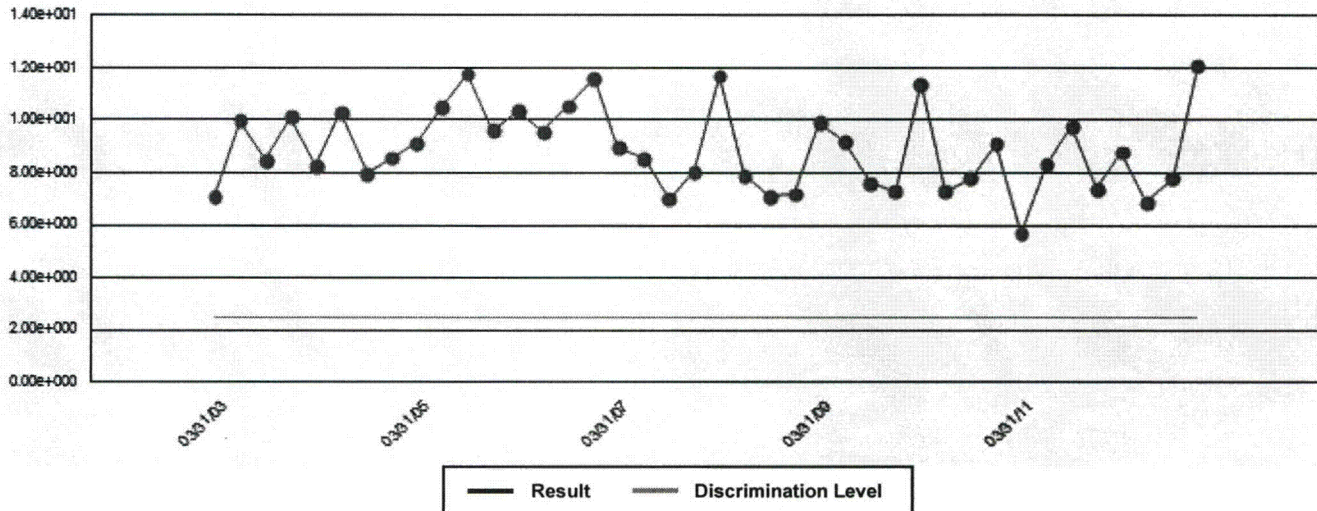

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-15-001	03/31/2003	7.1E+000 µR/h † *	1.62E+000	2.5E+000
TL-I-15-002	06/30/2003	1.0E+001 µR/h † *	1.34E+000	2.5E+000
TL-I-15-003	09/30/2003	8.5E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-004	12/31/2003	1.0E+001 µR/h † *	1.08E+000	2.5E+000
TL-I-15-005	03/31/2004	8.3E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-006	06/30/2004	1.0E+001 µR/h † *	1.06E+000	2.5E+000
TL-I-15-007	09/30/2004	8.0E+000 µR/h † *	8.40E-001	2.5E+000
TL-I-15-008	12/31/2004	8.6E+000 µR/h † *	6.00E-001	2.5E+000
TL-I-15-009	03/31/2005	9.1E+000 µR/h † *	9.20E-001	2.5E+000
TL-I-15-010	06/30/2005	1.1E+001 µR/h † *	1.06E+000	2.5E+000
TL-I-15-011	09/30/2005	1.2E+001 µR/h † *	1.18E+000	2.5E+000
TL-I-15-012	12/31/2005	9.6E+000 µR/h † *	9.60E-001	2.5E+000
TL-I-15-013	03/31/2006	1.0E+001 µR/h † *	1.04E+000	2.5E+000
TL-I-15-014	06/30/2006	9.6E+000 µR/h † *	9.60E-001	2.5E+000
TL-I-15-015	09/30/2006	1.1E+001 µR/h † *	1.06E+000	2.5E+000
TL-I-15-016	12/31/2006	1.2E+001 µR/h † *	1.16E+000	2.5E+000
TL-I-15-017	03/31/2007	9.0E+000 µR/h † *	9.00E-001	2.5E+000
TL-I-15-018	06/30/2007	8.6E+000 µR/h † *	8.60E-001	2.5E+000
TL-I-15-019	09/30/2007	7.0E+000 µR/h † *	7.00E-001	2.5E+000
TL-I-15-020	12/31/2007	8.1E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-021	03/31/2008	1.2E+001 µR/h † *	1.20E+000	2.5E+000
TL-I-15-022	06/30/2008	7.9E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-023	09/30/2008	7.1E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-024	12/31/2008	7.2E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-025	03/31/2009	9.9E+000 µR/h † *	1.00E+000	2.5E+000
TL-I-15-026	06/30/2009	9.2E+000 µR/h † *	1.00E+000	2.5E+000
TL-I-15-027	09/30/2009	7.6E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-028	12/31/2009	7.3E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-15-029	03/31/2010	1.1E+001 µR/h † *	1.20E+000	2.5E+000
TL-I-15-030	06/30/2010	7.3E+000 µR/h † *	8.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-15 : REMP TLD [Exposure Rate]

Continued...

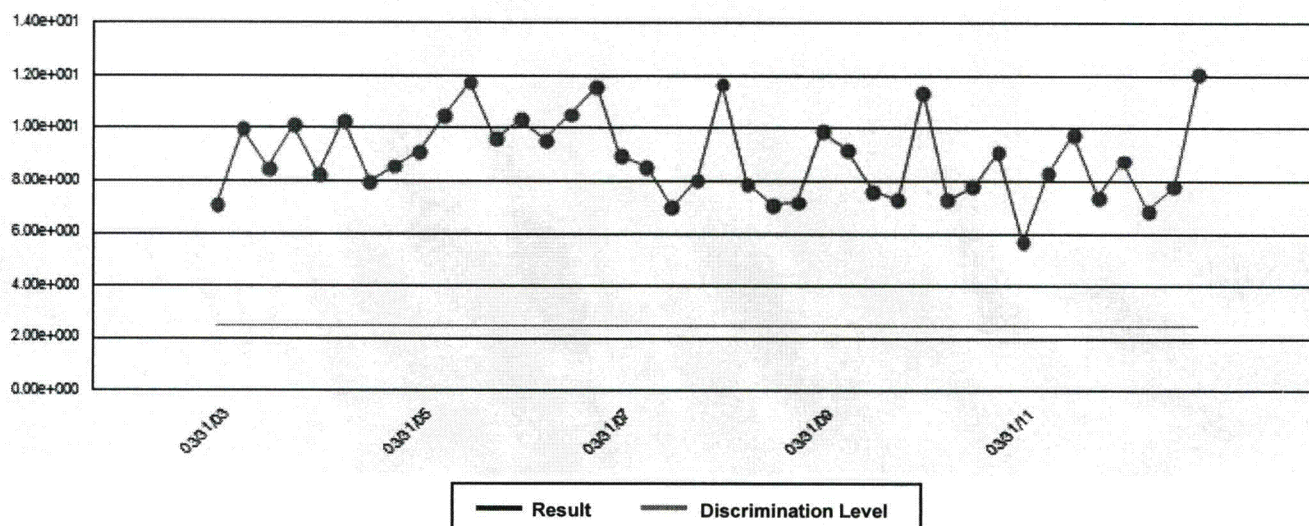

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-15-031	09/30/2010	7.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-15-032	12/31/2010	9.1E+000 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000
TL-I-15-033	03/31/2011	5.7E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-15-034	06/30/2011	8.3E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-15-035	09/30/2011	9.8E+000 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000
TL-I-15-036	12/31/2011	7.4E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-15-037	03/31/2012	8.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-15-038	06/30/2012	6.9E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-15-039	09/30/2012	7.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-15-040	12/31/2012	1.2E+001 $\mu\text{R/h}$ † *	1.20E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.9
Exposure Rate Trend at TL-I-16

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Indicator Locations - TL-I-16 : REMP TLD [Exposure Rate]

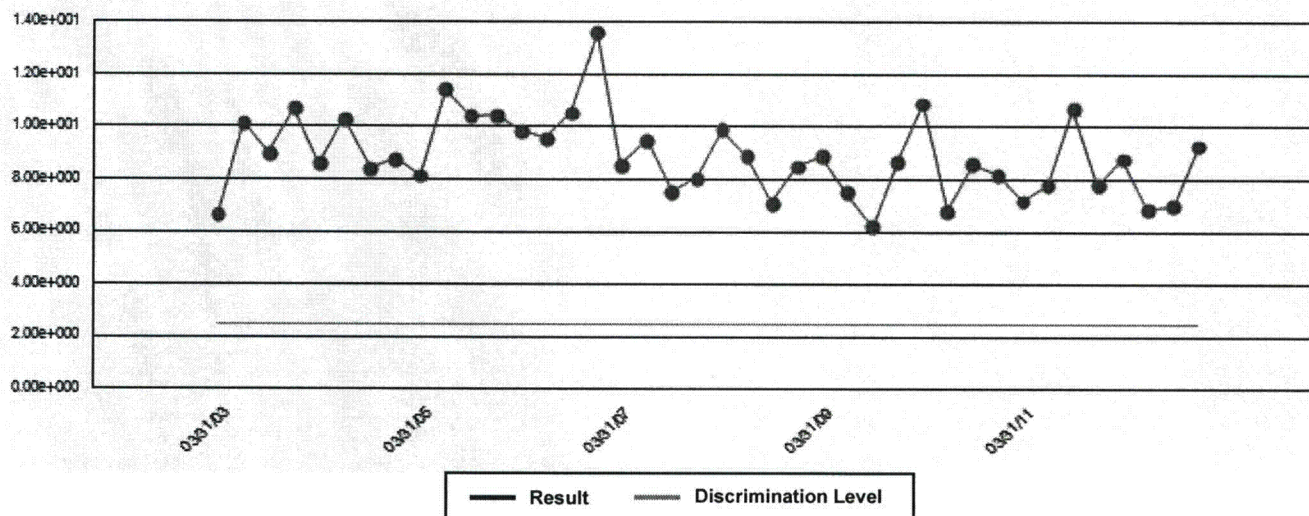

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-16-001	03/31/2003	6.7E+000 µR/h † *	1.22E+000	2.5E+000
TL-I-16-002	06/30/2003	1.0E+001 µR/h † *	1.48E+000	2.5E+000
TL-I-16-003	09/30/2003	9.0E+000 µR/h † *	1.16E+000	2.5E+000
TL-I-16-004	12/31/2003	1.1E+001 µR/h † *	1.16E+000	2.5E+000
TL-I-16-005	03/31/2004	8.6E+000 µR/h † *	9.80E-001	2.5E+000
TL-I-16-006	06/30/2004	1.0E+001 µR/h † *	1.14E+000	2.5E+000
TL-I-16-007	09/30/2004	8.4E+000 µR/h † *	1.16E+000	2.5E+000
TL-I-16-008	12/31/2004	8.8E+000 µR/h † *	8.80E-001	2.5E+000
TL-I-16-009	03/31/2005	8.1E+000 µR/h † *	8.20E-001	2.5E+000
TL-I-16-010	06/30/2005	1.1E+001 µR/h † *	1.14E+000	2.5E+000
TL-I-16-011	09/30/2005	1.0E+001 µR/h † *	1.04E+000	2.5E+000
TL-I-16-012	12/31/2005	1.0E+001 µR/h † *	1.04E+000	2.5E+000
TL-I-16-013	03/31/2006	9.8E+000 µR/h † *	9.80E-001	2.5E+000
TL-I-16-014	06/30/2006	9.6E+000 µR/h † *	9.60E-001	2.5E+000
TL-I-16-015	09/30/2006	1.1E+001 µR/h † *	1.06E+000	2.5E+000
TL-I-16-016	12/31/2006	1.4E+001 µR/h † *	1.36E+000	2.5E+000
TL-I-16-017	03/31/2007	8.6E+000 µR/h † *	8.60E-001	2.5E+000
TL-I-16-018	06/30/2007	9.5E+000 µR/h † *	9.60E-001	2.5E+000
TL-I-16-019	09/30/2007	7.5E+000 µR/h † *	7.60E-001	2.5E+000
TL-I-16-020	12/31/2007	8.1E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-021	03/31/2008	9.9E+000 µR/h † *	1.00E+000	2.5E+000
TL-I-16-022	06/30/2008	8.9E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-023	09/30/2008	7.1E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-024	12/31/2008	8.5E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-025	03/31/2009	8.9E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-026	06/30/2009	7.5E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-027	09/30/2009	6.2E+000 µR/h † *	6.00E-001	2.5E+000
TL-I-16-028	12/31/2009	8.7E+000 µR/h † *	8.00E-001	2.5E+000
TL-I-16-029	03/31/2010	1.1E+001 µR/h † *	1.00E+000	2.5E+000
TL-I-16-030	06/30/2010	6.8E+000 µR/h † *	6.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Indicator Locations - TL-I-16 : REMP TLD [Exposure Rate]

Continued...

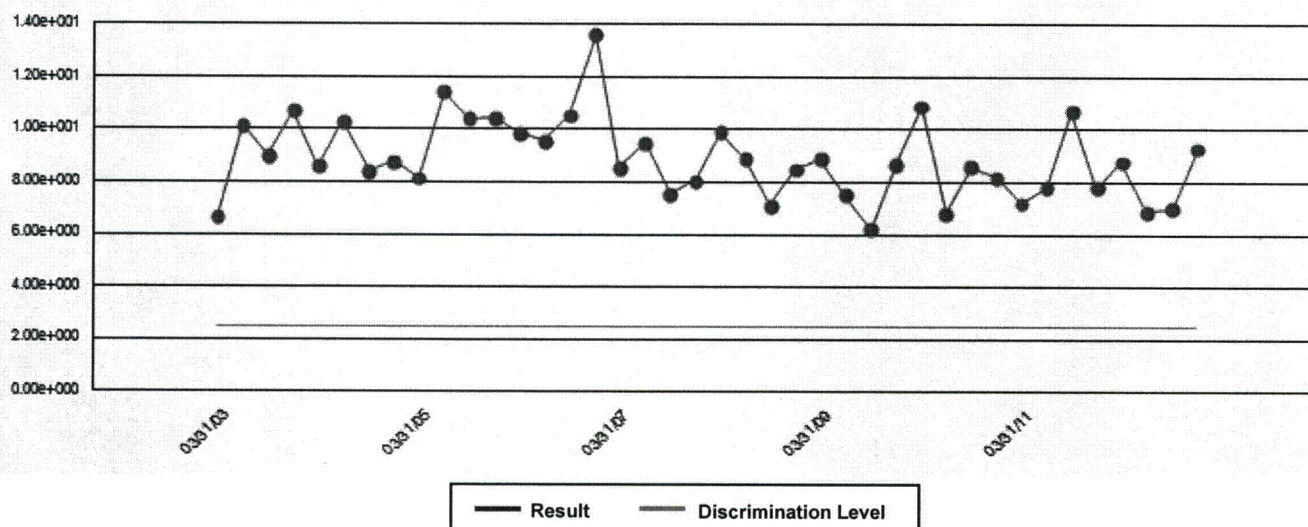

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-I-16-031	09/30/2010	8.6E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-16-032	12/31/2010	8.2E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-16-033	03/31/2011	7.2E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-16-034	06/30/2011	7.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-16-035	09/30/2011	1.1E+001 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000
TL-I-16-036	12/31/2011	7.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-16-037	03/31/2012	8.8E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-I-16-038	06/30/2012	6.9E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-16-039	09/30/2012	7.0E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-I-16-040	12/31/2012	9.3E+000 $\mu\text{R/h}$ † *	1.00E+000	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level


Figure 4.10
Exposure Rate Trend at Control Location TL-O-36

Trend Report

3/30/2013

Displays: Samples collected between 03/31/2003 and 12/31/2012

Control Location - TL-O-36 : REMP TLD [Exposure Rate]

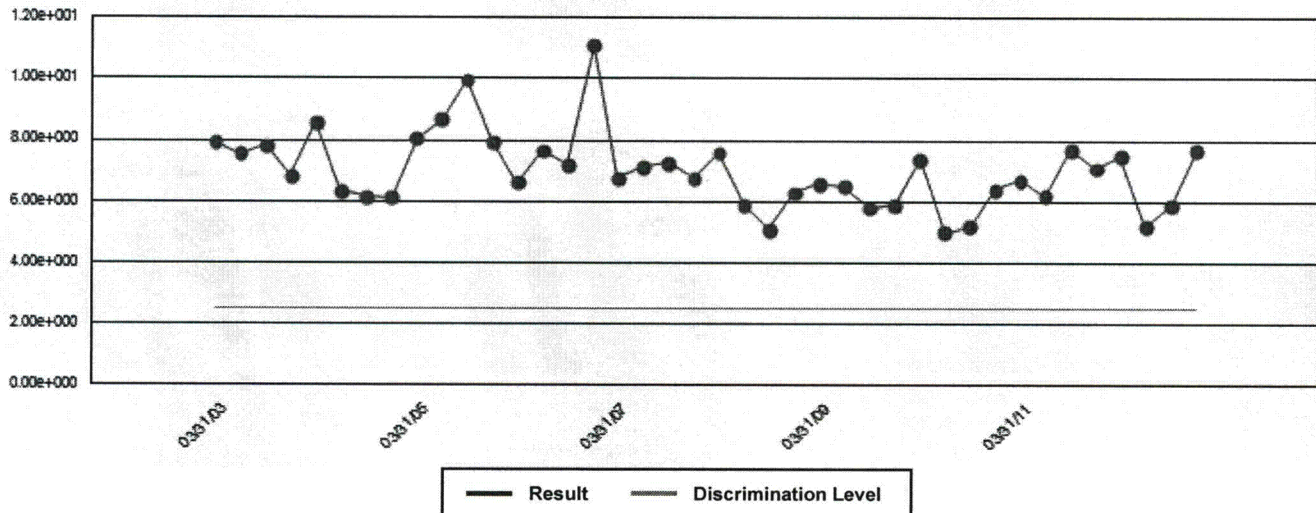

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-O-36-001	03/31/2003	7.9E+000 μR/h † *	1.68E+000	2.5E+000
TL-O-36-002	06/30/2003	7.5E+000 μR/h † *	1.04E+000	2.5E+000
TL-O-36-003	09/30/2003	7.8E+000 μR/h † *	1.34E+000	2.5E+000
TL-O-36-004	12/31/2003	6.8E+000 μR/h † *	6.80E-001	2.5E+000
TL-O-36-005	03/31/2004	8.6E+000 μR/h † *	6.80E-001	2.5E+000
TL-O-36-006	06/30/2004	6.3E+000 μR/h † *	6.80E-001	2.5E+000
TL-O-36-007	09/30/2004	6.1E+000 μR/h † *	5.60E-001	2.5E+000
TL-O-36-008	12/31/2004	6.1E+000 μR/h † *	4.80E-001	2.5E+000
TL-O-36-009	03/31/2005	8.1E+000 μR/h † *	8.00E-001	2.5E+000
TL-O-36-010	06/30/2005	8.7E+000 μR/h † *	8.60E-001	2.5E+000
TL-O-36-011	09/30/2005	1.0E+001 μR/h † *	1.00E+000	2.5E+000
TL-O-36-012	12/31/2005	8.0E+000 μR/h † *	8.00E-001	2.5E+000
TL-O-36-013	03/31/2006	6.6E+000 μR/h † *	6.60E-001	2.5E+000
TL-O-36-014	06/30/2006	7.7E+000 μR/h † *	7.60E-001	2.5E+000
TL-O-36-015	09/30/2006	7.2E+000 μR/h † *	7.20E-001	2.5E+000
TL-O-36-016	12/31/2006	1.1E+001 μR/h † *	1.12E+000	2.5E+000
TL-O-36-017	03/31/2007	6.8E+000 μR/h † *	6.80E-001	2.5E+000
TL-O-36-018	06/30/2007	7.2E+000 μR/h † *	7.20E-001	2.5E+000
TL-O-36-019	09/30/2007	7.3E+000 μR/h † *	7.20E-001	2.5E+000
TL-O-36-020	12/31/2007	6.8E+000 μR/h † *	6.80E-001	2.5E+000
TL-O-36-021	03/31/2008	7.6E+000 μR/h † *	8.00E-001	2.5E+000
TL-O-36-022	06/30/2008	5.9E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-023	09/30/2008	5.1E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-024	12/31/2008	6.3E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-025	03/31/2009	6.6E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-026	06/30/2009	6.5E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-027	09/30/2009	5.8E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-028	12/31/2009	5.9E+000 μR/h † *	6.00E-001	2.5E+000
TL-O-36-029	03/31/2010	7.4E+000 μR/h † *	8.00E-001	2.5E+000
TL-O-36-030	06/30/2010	5.0E+000 μR/h † *	6.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

Trend Report


Displays: Samples collected between 03/31/2003 and 12/31/2012

3/30/2013

MY ISFSI

Control Location - TL-O-36 : REMP TLD [Exposure Rate]

Continued...

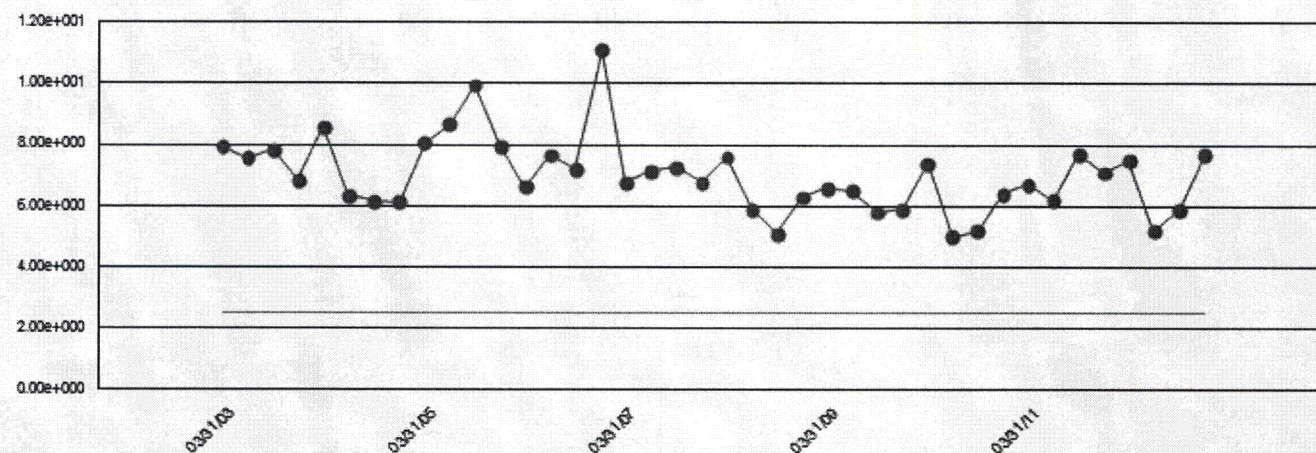

Result Discrimination Level

Sample Name	Date Collected	Result	2 Sigma Error	Discrimination Level
TL-O-36-031	09/30/2010	5.2E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-O-36-032	12/31/2010	6.4E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-O-36-033	03/31/2011	6.7E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-O-36-034	06/30/2011	6.2E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-O-36-035	09/30/2011	7.7E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-O-36-036	12/31/2011	7.1E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-O-36-037	03/31/2012	7.5E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000
TL-O-36-038	06/30/2012	5.2E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-O-36-039	09/30/2012	5.9E+000 $\mu\text{R/h}$ † *	6.00E-001	2.5E+000
TL-O-36-040	12/31/2012	7.7E+000 $\mu\text{R/h}$ † *	8.00E-001	2.5E+000

Results marked with * are greater than 2 Sigma Error.

Results marked with † are greater than the Discrimination Level

MY 2012 Annual REO Report

5.0 ANALYSIS OF ENVIRONMENTAL RESULTS

5.1 Sampling Program Deviations

A sampling program deviation is defined as samples that are unobtainable due to hazardous conditions or to malfunction of sampling equipment. Such deviations do not compromise the program's effectiveness and in fact are considered insignificant with respect to what is normally anticipated for this Radiological Environmental Monitoring Program.

No deviations of the sampling requirements occurred during this monitoring period.

5.2 Direct Radiation Pathway

5.2.1 Exposure Rates

Direct radiation is continuously measured at 9 indicator locations surrounding the Maine Yankee ISFSI, along with 1 control location (Wiscasset Fire Station) using thermoluminescent dosimeters (TLDs). These dosimeters are collected every calendar quarter for readout at the NVLAP certified dosimetry services vendor.

Review of the data in Tables 4.2 and 4.3 shows that most indicator locations were slightly elevated in comparison to the control location exposure rates. Figures 4.1 through 4.10 provide exposure rate trends of the monitoring locations since 2003. Review of Figures 4.1 through 4.10 shows no significant difference in exposure rates over time at either the indicator or control locations. The data listed under each of the trend graphs show values for the result errors and discrimination levels. Note that these values are estimated and are shown only for information.

5.2.2 Direct Doses from ISFSI Operations

A dose estimate is the potential dose to any real member of the public that could use portions of the site or be present adjacent to the site for recreational activities throughout the year. Direct exposure above background can be estimated by subtracting the average TLD value of the control station from the indicator location measurements. As in previous years, the 2012 dose estimate assumes a total of 325 hours occupancy for the dose calculation; of which 32.5 hours are used in both the first and fourth quarters and 130 hours are used in both the

second and third quarters. The most likely location for exposure to a member of the public from the ISFSI is along the Back River, Bailey Cove or Montsweag Bay for boating and fishing and the mud flats in the Cove or Bay exposed at low tides which is worked by clam diggers and worm diggers; however, the time estimates are conservatively applied to all monitoring locations.

Table 4.4 presents the results of the dose calculations. The highest calculated dose is at Station ID number TL-I-06. The maximum calculated annual dose at that location is 1.65 mrem. This value is only 7 percent of the 25 mrem per year limit. It is noted that most of the mud flat region in Bailey Cove that is used by the public is situated further away from this Station. As a result, actual exposures from direct radiation would be much less than the maximum calculated value.

6.0 REFERENCES

1. USNRC Radiological Assessment Branch Technical Position, "An Acceptable Radiological Environmental Monitoring Program," Revision 1, November 1979.
2. Maine Yankee Off-site Dose Calculation Manual, Revision 34.
3. 40 CFR Part 190, "Environmental Radiation Protection Standards for Nuclear Power Operation".
4. 10 CFR Part 72.104, "Criteria for Radioactive Materials in Effluents and Direct Radiation from an ISFSI or MRS".

ENCLOSURE 2


MAINE YANKEE INDEPENDENT SPENT FUEL STORAGE INSTALLATION
ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT
JANUARY – DECEMBER 2012

April 2013

**MAINE YANKEE
INDEPENDENT SPENT FUEL STORAGE INSTALLATION
License No. DPR-36**

**ANNUAL RADIOACTIVE EFFLUENT
RELEASE REPORT**

January - December 2012

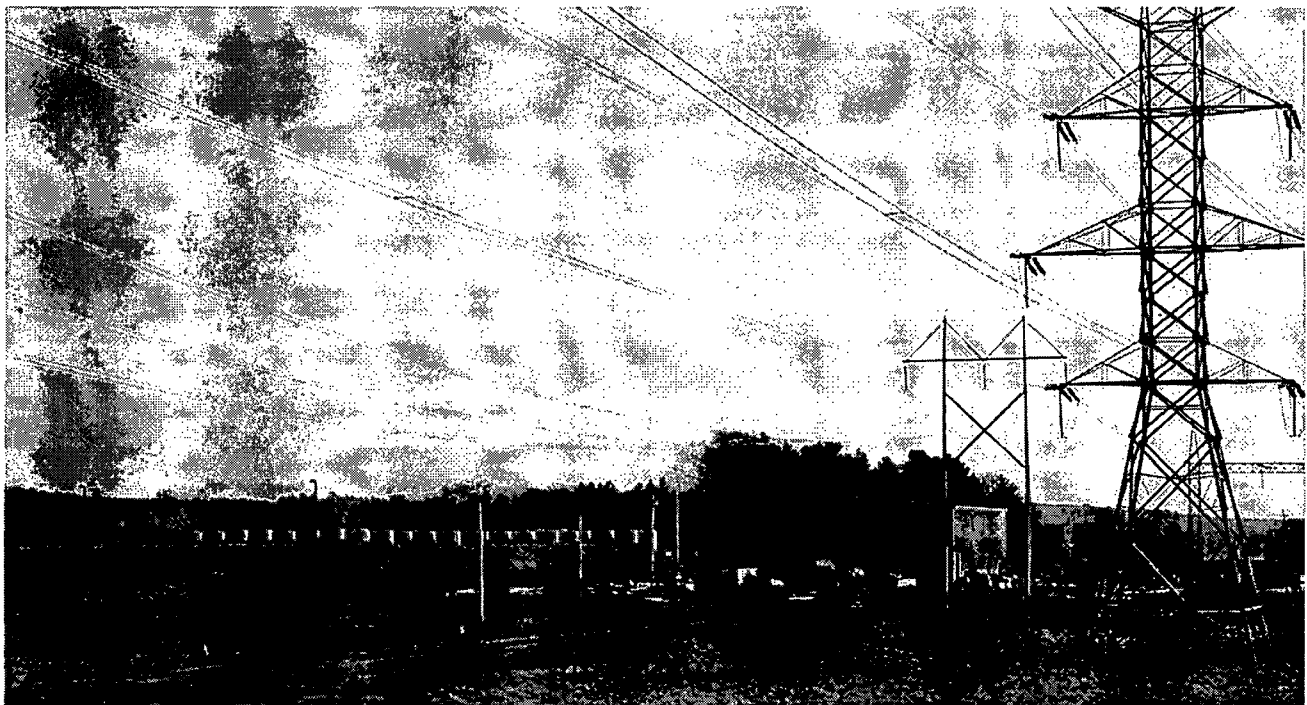

March 2013
Prepared by:

Radiological Safety & Control Services
91 Portsmouth Avenue
Stratham, NH 03885-2468

EXECUTIVE SUMMARY

Tables 1 and 2 summarize the quantity of radioactive gaseous and liquid effluents, respectively, for each quarter of 2012. There were no gaseous or liquid releases in 2012. Table 3 summarizes waste shipped off-site for disposal for each half year of 2012. There was no waste shipped in 2012.

Appendices A through C indicate the status of reportable items per the requirements of the Off-site Dose Calculation Manual (ODCM). There were no reportable items in 2012.

Table 1

**MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Gaseous Effluents-Summation of All Releases**

Nuclides Released	Units	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Error
A. Fission and Activation Gases						
Total Release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	
B. Iodines						
Total Iodines released	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	
C. Particulates						
Particulates Released	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	
Gross alpha radioactivity	Ci	N/A*	N/A*	N/A*	N/A*	
D. Tritium						
Total release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average release rate	µCi/s	N/A*	N/A*	N/A*	N/A*	
Percent of regulatory limit	%	N/A*	N/A*	N/A*	N/A*	

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1A

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Gaseous Effluents - Ground Level Releases - Batch Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1B

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Gaseous Effluents - Ground Level Releases - Continuous Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1C

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Gaseous Effluents - Elevated Releases – Batch Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 1D

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Gaseous Effluents - Elevated Releases – Continuous Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Total
1. Fission Gases						
Krypton-85	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-85m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-87	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Krypton-88	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-135m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Xenon-138	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
2. Iodines						
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-133	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-135	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
3. Particulates						
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others-						
Plutonium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Curium-243,244	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-234	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Uranium-238	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Thorium-232	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Radium-226	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no gaseous effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 2

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Liquid Effluents - Summation of All Releases

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Error
A. Fission and Activation Products						
Total Release (not including tritium, gases, alpha)	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
Percent of applicable limit	%	N/A*	N/A*	N/A*	N/A*	
B. Tritium						
Total Release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
Percent of applicable limit	%	N/A*	N/A*	N/A*	N/A*	
C. Dissolved and Entrained Gases						
Total Release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
Percent of applicable limit	%	N/A*	N/A*	N/A*	N/A*	
D. Gross Alpha Radioactivity						
Total release	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Average diluted concentration during period	µCi/ml	N/A*	N/A*	N/A*	N/A*	
E. Volume of Waste Released (prior to dilution)	Liters	N/A*	N/A*	N/A*	N/A*	
F. Volume of Dilution Water Used During Period	Liters	N/A*	N/A*	N/A*	N/A*	

N/A*= Not Applicable

There are no liquid effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 2A

**MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Liquid Effluents – Batch Mode**

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Totals
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-58	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iron-59	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zinc-65	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Manganese-54	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Chromium-51	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zirconium-Niobium-95	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Molybdenum-99	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Technetium-99m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cerium-141	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others- Iron-55	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Antimony-125	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period (above)	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Dissolved and Entrained Gasses	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Tritium	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Gross Alpha	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no liquid effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 2B

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
2012 Liquid Effluents – Continuous Mode

Nuclides Released	Unit	1st Quarter	2nd Quarter	3rd Quarter	4th Quarter	Totals
Strontium-89	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Strontium-90	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-134	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cesium-137	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iodine-131	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-58	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cobalt-60	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Iron-59	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zinc-65	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Manganese-54	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Chromium-51	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Zirconium-Niobium-95	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Molybdenum-99	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Technetium-99m	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Barium-Lanthanum-140	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Cerium-141	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Others- Iron-55	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Antimony-125	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Unidentified	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Total for period (above)	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Dissolved and Entrained Gasses	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Tritium	Ci	N/A*	N/A*	N/A*	N/A*	N/A*
Gross Alpha	Ci	N/A*	N/A*	N/A*	N/A*	N/A*

N/A*= Not Applicable

There are no liquid effluents associated with the Maine Yankee Independent Spent Fuel Storage Installation (ISFSI)

Table 3

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
First Half 2012 Low Level Waste Shipments

Resins, Filters and Evaporator Bottoms		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Dry Active Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Irradiated Components		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Other Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				

Table 3A

MAINE YANKEE ISFSI
Effluent and Waste Disposal Annual Report
Second Half 2012 Low Level Waste Shipments

Resins, Filters and Evaporator Bottoms		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Dry Active Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Irradiated Components		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				
Other Waste		Volume		Curies Shipped
Waste Class	Solidifying Agent	ft ³	m ³	Curies
A		0	0	0
B		0	0	0
C		0	0	0
All		0	0	0
Major radionuclides for above data:				

Appendix A

Radiation Dose Assessment

There were no gaseous or liquid effluent releases in 2012. Therefore, an assessment of radiation doses to the most likely exposed member(s) of the public to show compliance with 40CFR190 or 10CFR72.104 from effluents was not required.

Appendix B
Unplanned Releases

There were no unplanned releases of radioactive materials from the site in 2012.

Appendix C

Off-site Dose Calculation Manual Changes

There were no changes to the Off-site Dose Calculation Manual in 2012.