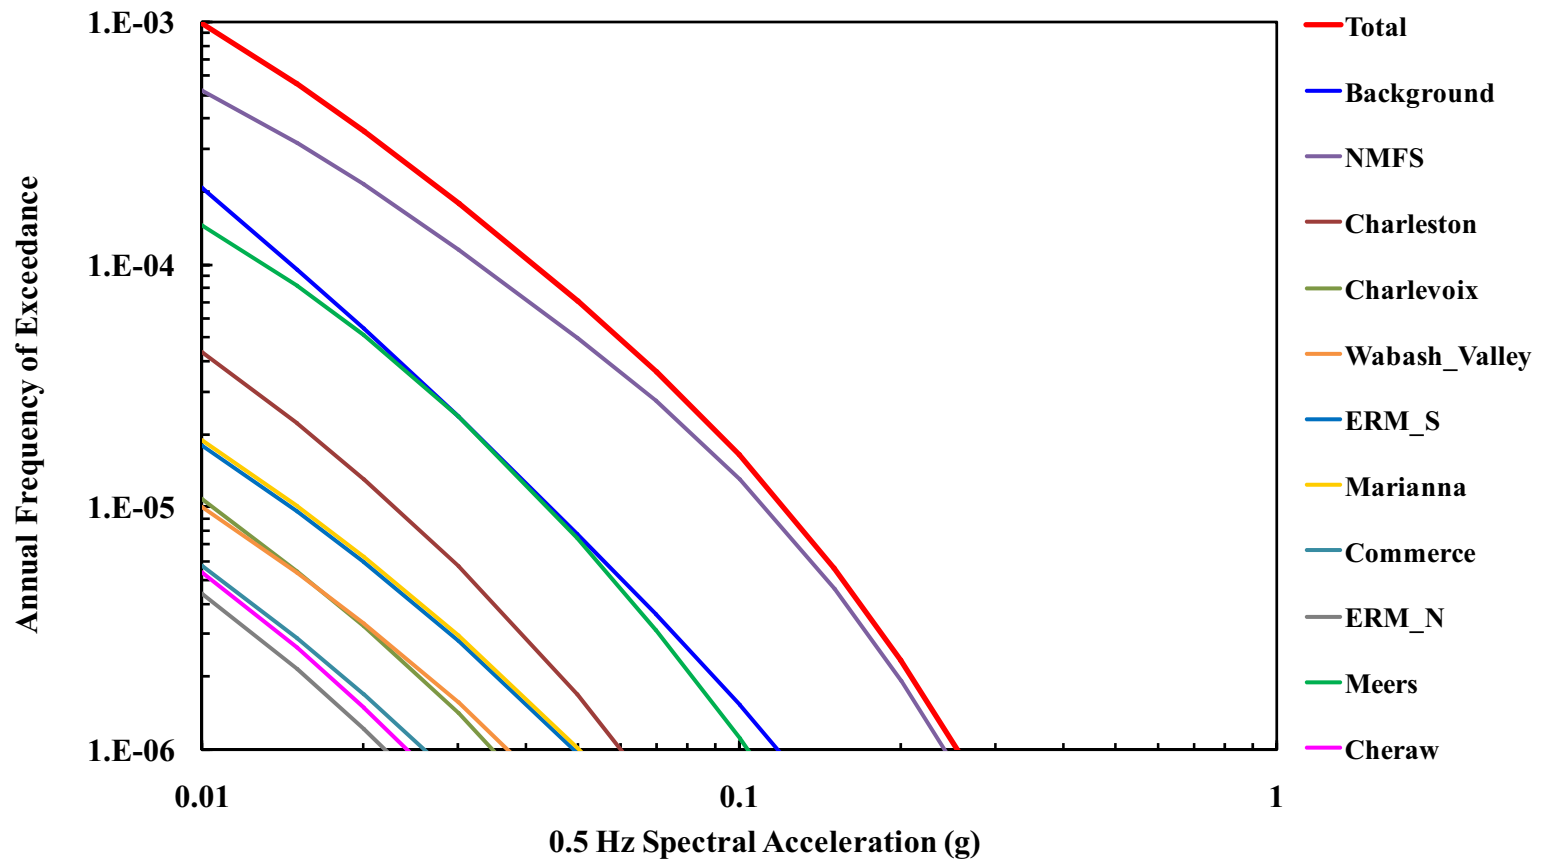


**Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR**



**Figure 2.5.2-210 Contribution to 0.5 Hz Rock Total Mean Hazard**