

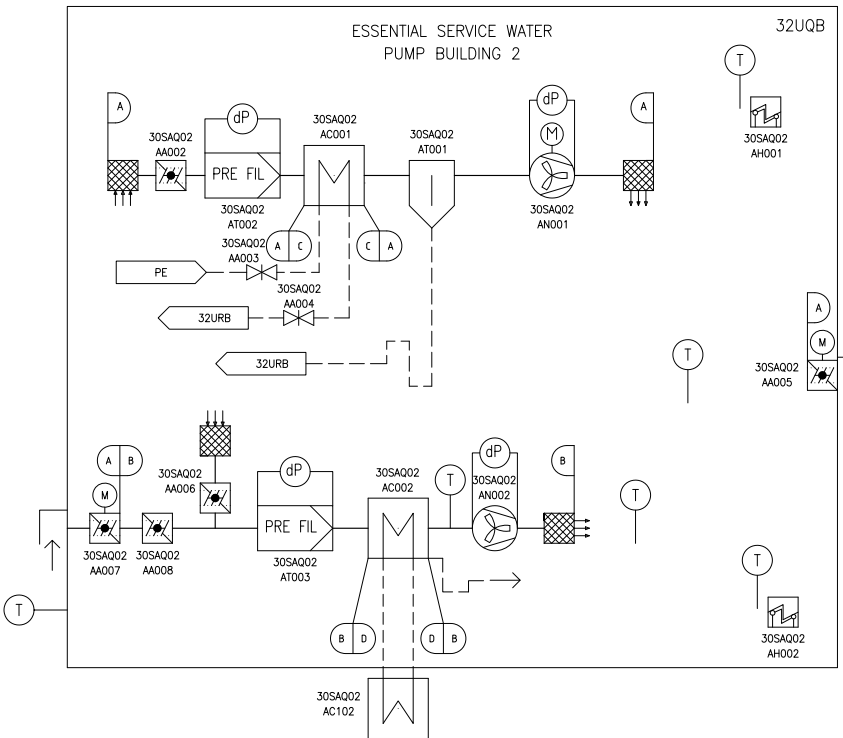
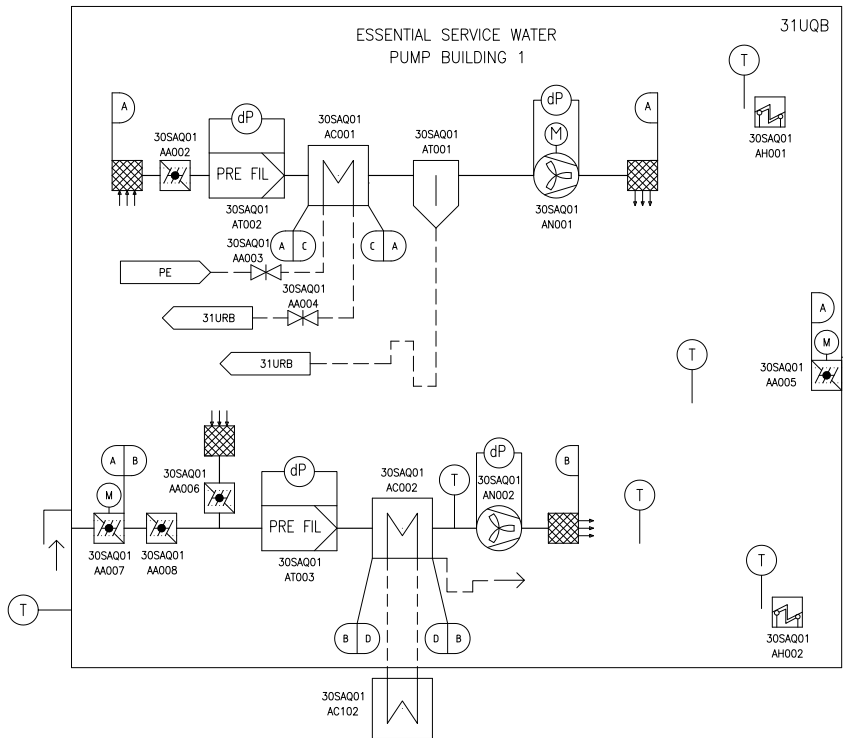


Figure 9.4.11-1—Essential Service Water Pump Building Ventilation System

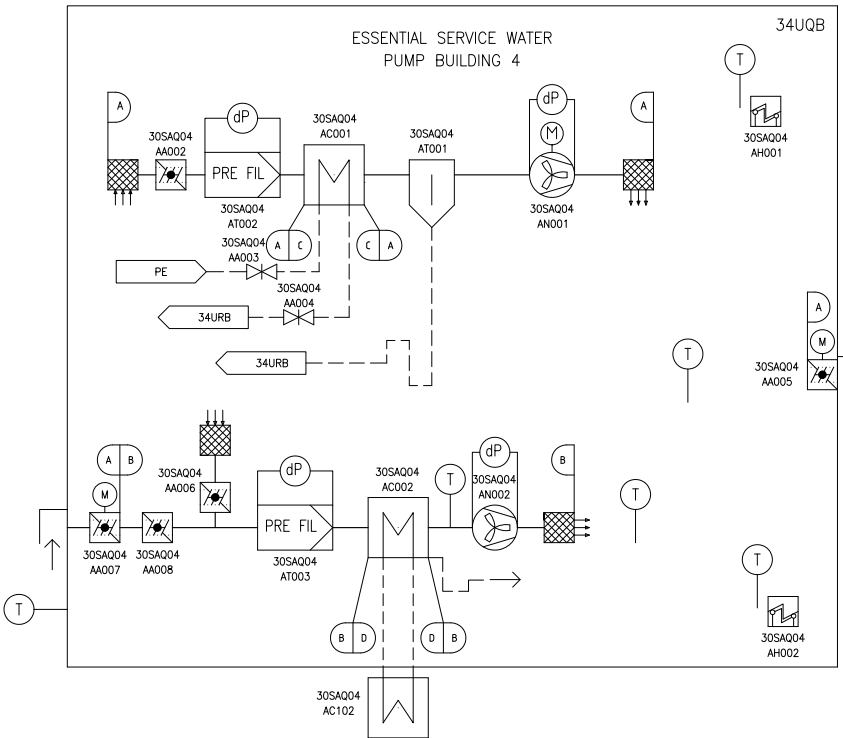

SAQ -- ESSENTIAL SERVICE WATER PUMP BUILDING VENTILATION SYSTEM  
PE -- ESSENTIAL SERVICE WATER SYSTEM  
31UQB -- ESSENTIAL SERVICE WATER PUMP BUILDING 1  
32UQB -- ESSENTIAL SERVICE WATER PUMP BUILDING 2  
33UQB -- ESSENTIAL SERVICE WATER PUMP BUILDING 3  
34UQB -- ESSENTIAL SERVICE WATER PUMP BUILDING 4  
31URB -- ESSENTIAL SERVICE WATER COOLING TOWER STRUCTURE BUILDING 1  
32URB -- ESSENTIAL SERVICE WATER COOLING TOWER STRUCTURE BUILDING 2  
33URB -- ESSENTIAL SERVICE WATER COOLING TOWER STRUCTURE BUILDING 3  
34URB -- ESSENTIAL SERVICE WATER COOLING TOWER STRUCTURE BUILDING 4

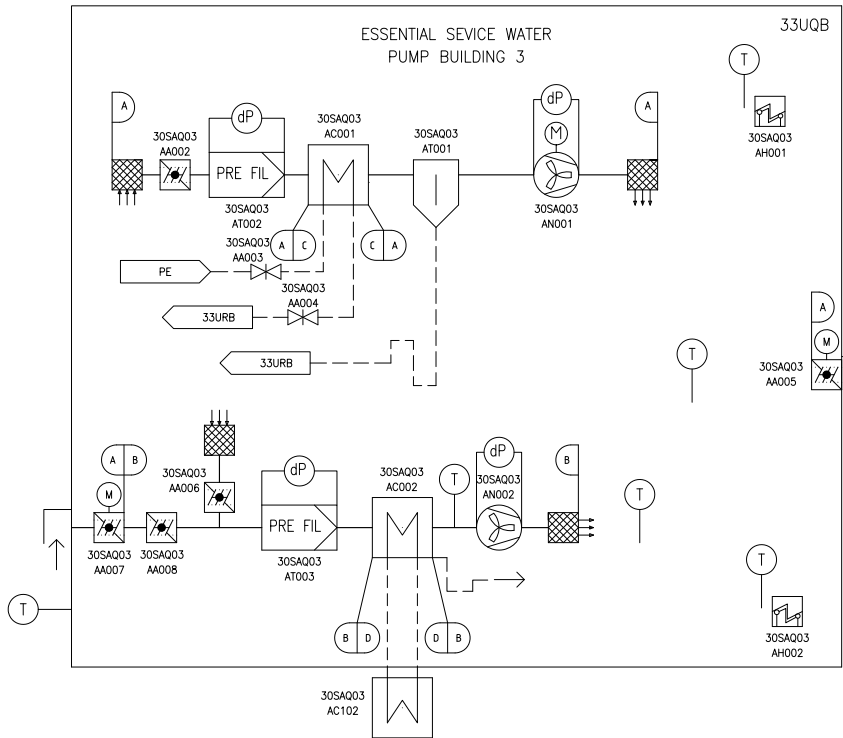

D	D	II
C	C	I
B	N/A	II
A	N/A	I
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

REV 004  
SAQ01T2