

## **2.4S.12 Groundwater**

The following site-specific supplement addresses COL License Information Item 2.32.

This section describes the hydrogeologic conditions present at, and in the vicinity of, the STP 3 & 4 site. Regional and local groundwater resources that could be affected by the construction and operation of STP 3 & 4 are discussed. The regional and site-specific data on the physical and hydrologic characteristics of these groundwater resources are summarized in order to provide the basic data for an evaluation of impacts on the aquifers of the area.

The STP site covers an area of approximately 12,220 acres and is located on the coastal plain of southeastern Texas in Matagorda County. The power station lies approximately 10 mi north of Matagorda Bay. Nearby communities include Palacios, approximately 10 mi to the southwest and Bay City, approximately 12 mi to the northeast (Figure 2.4S.12-1). The closest major metropolitan center is Houston, approximately 90 mi to the northeast.

The 7000-acre Main Cooling Reservoir (MCR) is the predominant feature at the STP site, as shown in Figure 2.4S.12-2. The reservoir is fully enclosed with a compacted earth embankment, and it encompasses the majority of the southern and central portion of the site. The existing STP 1 & 2 facilities are located just outside of the MCR northern embankment. STP 3 & 4 is located further north of the embankment and to the northwest of STP 1 & 2.

The STP site, in general, has less than 15 ft of natural relief in the 4.5 mi distance from the northern to southern boundary. The northern section is at an elevation of approximately 30 ft above mean sea level (MSL). The southeastern section is at an elevation of approximately 15 ft above MSL. The Colorado River flows along the southeastern site boundary. There are also several unnamed drainages within the site boundaries, one of which feeds Kelly Lake.

Regional and local surface water features are described in Subsection 2.4S.1 and a geologic overview is presented in Subsection 2.5S.1.

### **2.4S.12.1 Description and Onsite Use**

This section describes the regional and local groundwater aquifers and associated geologic formations, groundwater sources and sinks, and onsite use of groundwater.

#### **2.4S.12.1.1 Regional Hydrogeologic Setting**

The STP site is located in Matagorda County and lies in the Gulf Coastal Plains physiographic province within the Coastal Prairies sub-province, which extends as a broad band parallel to the Texas Gulf Coast (Figure 2.4S.12-3). The Coastal Prairies sub-province is characterized by relatively flat topography with land elevation ranging from sea level along the coast to 300 ft above sea level along the western boundary. The geologic materials underlying the Coastal Prairies sub-province consist of deltaic sands and muds (Reference 2.4S.12-1).

The STP site is underlain by a thick wedge of southeasterly dipping sedimentary deposits of Holocene age through Oligocene age. The site overlies what has been referred to as the "Coastal Lowland Aquifer System" (Figure 2.4S.12-4). This aquifer system contains numerous local aquifers in a thick sequence of mostly unconsolidated Coastal Plain sediments of alternating and interfingering beds of clay, silt, sand, and gravel. The sediments reach thicknesses of thousands of feet and contain groundwater that ranges from fresh to saline. Large amounts of groundwater are withdrawn from the aquifer system for municipal, industrial, and irrigation needs (Reference 2.4S.12-2).

The lithology of the aquifer system is generally sand, silt, and clay and reflects three depositional environments: continental (alluvial plain), transitional (delta, lagoon, and beach), and marine (continental shelf). The depositional basin thickens towards the Gulf of Mexico, resulting in a wedge-shaped configuration of hydrogeologic units. Numerous oscillations of ancient shorelines resulted in a complex, overlapping mixture of sand, silt, and clay (Reference 2.4S.12-2).

As part of the United States Geological Survey's (USGS) Regional Aquifer-System Analysis (RASA) program, the aquifer system was subdivided into five permeable zones and two confining units. The term "Gulf Coast Aquifer" is generally used in Texas to describe the composite of the sands, silts, and clays of the Coastal Lowland Aquifer System. Comparison of the USGS aquifer system nomenclature to that used in Texas is shown in Figure 2.4S.12-5. A cross-sectional representation is shown in Figure 2.4S.12-6 (Reference 2.4S.12-2).

The Texas nomenclature is used to describe the Gulf Coast Aquifer beneath the site. The hydrogeologic units commonly used to describe the aquifer system (from shallow to deep) are as follows (Figure 2.4S.12-5).

- Chicot Aquifer
- Evangeline Aquifer
- Burkeville Confining Unit
- Jasper Aquifer
- Catahoula Confining Unit (restricted to where present in the Jasper Aquifer)
- Vicksburg-Jackson Confining Unit

The base of the Gulf Coast Aquifer is identified as either its contact with the top of the Vicksburg-Jackson Confining Unit or the approximate depth where groundwater has a total dissolved solids concentration of more than 10,000 milligrams per liter (mg/L). The aquifer system is recharged by the infiltration of precipitation that falls on aquifer outcrop areas in the northern and western portion of the province. Discharge occurs by evapotranspiration, loss of water to streams and rivers as base flow, upward leakage to shallow aquifers in low lying coastal areas or in the Gulf of Mexico, and pumping.



In the shallow zones, the specific yield for sandy deposits generally ranges between 10 percent and 30 percent. For the confined aquifer, the storage coefficient is estimated to range between  $1 \times 10^{-4}$  and  $1 \times 10^{-3}$ . The productivity of the aquifer system is directly related to the thickness of the sands in the aquifer system that contain freshwater. The aggregated sand thickness ranges from 0 ft at the up dip limit of the aquifer system to as much as 2000 ft in the east. Estimated values of transmissivity are reported to range from 5000 ft<sup>2</sup>/day to nearly 35,000 ft<sup>2</sup>/day (Reference 2.4S.12-2).

The hydrogeologic conceptual model presented in this subsection was developed from multiple conceptual hydrogeologic models that vary in scale and hydrostratigraphic framework. Considerations of the scale and framework were not mutually exclusive, but were intertwined during a series of steps designed to develop a tenable site hydrogeologic conceptual model. Four steps were involved in the development of the scale-dependent conceptual models, and include:

- A regional "desktop" study based on published state, federal and other sources;
- A review of documentation addressing STP Units 1 & 2;
- A site-specific geotechnical, geologic, and hydrogeologic field study conducted for proposed Units 3 & 4; and
- An evaluation of site-specific data in conjunction with regional and local information.

The first step of site model conceptualization involved formulating an understanding of the hydrogeologic conditions in Southern Texas and Matagorda County by reviewing regional geologic and hydrogeologic information available from the USGS and the TWDB. Research indicates that the USGS and the State of Texas developed separate regional hydrogeologic conceptual models to describe the Coastal Lowlands Aquifer System, with the Texas model being the more widely used. Although nomenclature between the two conceptual models varies significantly, the frameworks are largely comparable (Figure 2.4S.12-5).

The second step involved a review of documentation addressing local hydrogeologic conditions, such as the STP Units 1 & 2 UFSAR and the Annual Environmental Operating Report, to resolve the temporal and localized unknowns. Incorporating the conceptual site model with regional concepts, the Chicot aquifer was subdivided into two distinct confined aquifers – the "Deep Aquifer" and the "Shallow Aquifer".

During the third step, a site-specific subsurface site investigation (SI) was implemented at the proposed Units 3 & 4 site area, concentrated within the STP northern site boundaries and the proposed Units 3 & 4 facility footprint.

The fourth step involved evaluation of the SI field data with the regional and local STP information. This included evaluation of:

- regional & local groundwater movement;

- vertical gradients between the aquifers;
- site-specific slug test results and local and regional pumping test results; and
- natural and manmade (i.e., MCR) impacts on water levels in the Shallow Aquifer.

From this effort, site-specific data were integrated with existing STP Units 1 & 2 information and regional information to formulate the conceptual site model described in the following sections.

#### **2.4S.12.1.2 Regional Groundwater Aquifers**

The STP site is located over the Gulf Coast Aquifer System as shown on Figure 2.4S.12-7 (Reference 2.4S.12-3). The Gulf Coast Aquifer has not been declared a Sole Source Aquifer (SSA) by the United States Environmental Protection Agency (EPA) (Reference 2.4S.12-4). A SSA is the sole or principal source of drinking water for an area that supplies 50 percent or more of drinking water with no reasonably available alternative source should the aquifer become contaminated. Figure 2.4S.12-8 shows the location of SSAs in EPA Region VI, which includes Texas. The nearest Texas SSA is the Edwards I and II Aquifer System, which is located approximately 150 mi northwest of STP. Based on a southeasterly groundwater flow beneath Matagorda County, toward the Gulf of Mexico, and the distances to the identified SSAs, STP 3 & 4 will not adversely impact the SSAs in EPA Region VI. The identified SSAs are beyond the boundaries of the local and regional hydrogeologic systems associated with the STP site.

The principal aquifer used in Matagorda County is the Chicot Aquifer, which extends to a depth of greater than 1000 ft in the vicinity of the STP site, as shown on Figure 2.4S.12-9. The Chicot Aquifer is comprised of Holocene alluvium in river valleys and the Pleistocene age Beaumont, Montgomery, and Bentley Formations, and the Willis Sand (Reference 2.4S.12-5). Groundwater flow is, in general, southeasterly from the recharge areas north and west of the county to the Gulf of Mexico. Numerous river systems and creeks flow south and southeasterly through Matagorda County. River channel incisions can act as localized areas of recharge and discharge to the underlying aquifer system, resulting in localized hydraulic sources and sinks.

The Chicot Aquifer geologic units used for groundwater supply in the STP site area are the Beaumont Formation and the Holocene alluvium in the Colorado River floodplain. The following sections describe the pertinent details of these units.

##### **2.4S.12.1.2.1 Beaumont Formation**

The Beaumont Formation consists of fine-grained mixtures of sand, silt, and clay deposited in alluvial and deltaic environments. In the upper portion of the Beaumont Formation, sands occur as sinuous bodies, representing laterally discontinuous channel deposits, while the clays and silts tend to be more laterally continuous, representing their deposition as natural levees and flood deposits. The deeper portion of the unit, the Deep Aquifer, is greater than about 250 ft below ground surface in the vicinity of the site and has thicker and more continuous sands. This portion of the

Beaumont Formation is the primary groundwater production zone for most of Matagorda County. Well yields in this interval are typically between 500 gallons per minute (gpm) and 1500 gpm with yields of up to 3500 gpm reported (Reference 2.4S.12-6). Groundwater occurs in this zone under confined conditions.

#### **2.4S.12.1.2.2 Holocene Alluvium**

Holocene alluvium of the Colorado River floodplain occurs in a relatively narrow band surrounding the river. The alluvial deposits are typically coarser-grained than the materials found in the Beaumont Formation. The alluvium consists of silt, clay, fine- to coarse-grained sand, and gravel, along with wood debris and logs (Reference 2.4S.12-6). In the immediate site area, the alluvium is too thin to be a significant source of groundwater. Since the alluvial materials are deposited in a channel incised into the Beaumont Formation, it is likely that the alluvium is in contact with the shallow aquifer units in the Beaumont Formation.

#### **2.4S.12.1.3 Local Hydrogeology**

The local hydrogeologic system is identified in the STP site area and it includes areas of groundwater - surface water interactions within a few miles of the site. The Beaumont Formation within the Chicot Aquifer (and to a lesser, extent, the Holocene alluvium associated with the Colorado River floodplain) is the principal water-bearing unit used for groundwater supply in the vicinity of STP. Within this area, the Chicot Aquifer is divided into two aquifer units, the Shallow Aquifer and the Deep Aquifer. The base of the Shallow Aquifer is 90 ft to 150 ft deep in the site area. The Shallow Aquifer has limited production capability and is used for livestock watering and occasional domestic use. Potentiometric heads are generally within 15 ft of ground surface (Reference 2.4S.12-6). The Deep Aquifer is the primary groundwater production zone and lies below depths of 250 ft to 300 ft. An overlying zone of predominately clay materials, usually greater than 150 ft thick, separates the Shallow and Deep Aquifers.

Recharge to the Shallow Aquifer is considered to be a few miles north of the site. Discharge is to the Colorado River alluvial material east of the site. Recharge to the Deep Aquifer is further north in Wharton County where the aquifer outcrops. Discharge from the Deep Aquifer is to Matagorda Bay, groundwater production wells, and the Colorado River estuary, approximately 5 mi southeast of the site. Shallow Aquifer groundwater quality is generally inferior to that of the Deep Aquifer (Reference 2.4S.12-6).

The Shallow Aquifer has been subdivided into upper and lower zones over the site area. Both zones respond to pumping as confined or semi-confined aquifers with somewhat different potentiometric heads. The Upper Shallow Aquifer is comprised of interbedded sand layers to depths of approximately 50 ft below ground surface. The Lower Shallow Aquifer consists of the sand layers between depths of approximately 50 ft to 150 ft below ground surface.

Aquifer pumping tests performed at the site in support of STP 1 & 2 indicate well yields from 10 gpm to 300 gpm in the Shallow Aquifer. These tests also indicate a variable degree of hydraulic connection between the Upper and Lower Shallow Aquifer zones

(Reference 2.4S.12-7). Analysis of the aquifer pumping tests indicates that groundwater occurs under confined conditions at the four test sites. A pumping test conducted at STP Production Well 5 confirmed confined conditions in the Deep Aquifer (Reference 2.4S.12-8).

#### **2.4S.12.1.4 Site Specific Hydrogeology**

A geotechnical and hydrogeological investigation was performed to provide information on the STP 3 & 4 site to depths of 600 ft below ground surface. Subsurface information was collected from over 150 geotechnical borings and cone penetrometer tests (CPTs). A detailed description of the geotechnical subsurface investigation, including the locations of these borings and CPTs, boring logs, and soil testing data is provided in Subsection 2.5S.4.

Twenty-eight (28) groundwater observation wells were installed in the vicinity of the STP 3 & 4 site between October and December 2006. An additional 26 wells were installed in July and August 2008 along the northern perimeter of the MCR and the site boundary, and around Kelly Lake. The wells were completed in the Upper and Lower Shallow Aquifer. The wells were located to a) supplement the existing STP piezometer network in order to provide an adequate distribution for determining groundwater flow directions and b) provide additional information on the hydraulic gradients beneath the site. Well pairs were installed at all but two locations to determine vertical gradients. Figure 2.4S.12-10 shows the locations of observation wells and piezometers at the STP site. Table 2.4S.12-1 presents the installation information for the 54 observation wells. Field hydraulic conductivity tests (slug tests) were conducted in each observation well. Monthly water level measurements from the first 28 STP 3 & 4 groundwater observation wells were collected from December 2006 to December 2007. In 2008, quarterly measurements were conducted. The September and December 2008 quarterly measurements events are included from each of the 54 observation wells.

The subsurface data collected in 2006 and 2007 as part of the STP 3 & 4 site subsurface investigation confirmed the aquifer conditions described for STP 1 & 2. The top of the uppermost sand layer within the Upper Shallow Aquifer is encountered at a depth of about 15 ft to 30 ft below ground surface at STP 3 & 4. The groundwater level is about 5 ft to 10 ft below ground surface. The unit is comprised of sand and silty sand, approximately 15 ft to 20 ft thick. Multiple sandy units that are separated by silts and clays define the Lower Shallow Aquifer. The groundwater level in these sand intervals is about 10 ft to 15 ft below ground surface beneath the STP 3 & 4 facility area.

#### **2.4S.12.1.5 Groundwater Sources and Sinks**

The natural regional flow pattern in the Beaumont Formation is from recharge areas, where the sand layers outcrop at the surface, to discharge areas, which are either at the Gulf of Mexico or the Colorado River Valley alluvium. The outcrop areas for the Beaumont Formation sands are in northern Matagorda County (Shallow Aquifer) and Wharton County (Deep Aquifer), to the north of Matagorda County. In the outcrop areas, precipitation falling on the ground surface can infiltrate directly into the sands and recharge the aquifer. Superimposed on this simplistic flow pattern is the influence

of heavy pumping within the aquifer. Concentrated pumping areas can alter or reverse the regional flow pattern. Further discussion of regional groundwater use and flow patterns is presented in Subsection 2.4S.12.2.

The Holocene alluvium receives recharge from infiltration of precipitation and groundwater flow from the Shallow Aquifer in the Beaumont Formation. In the site area, flow paths in the alluvium are short due to the limited surface area. Discharge from the Holocene alluvium contributes to the base flow of the Colorado River. The Colorado River is dammed to the south of Bay City to supply irrigation water canals. During certain times of the year the only sources of water to the Colorado River below the dam are irrigation tail water releases and base flow created by seepage from the Holocene alluvium. Because there are no flow-gaging stations downstream of the dam, the amount of base flow contributed by seepage is not known (Reference 2.4S.12-6).

The MCR is unlined and may act as a local recharge source to the Shallow Aquifer at the STP site. The historical, normal maximum operating level of the 7000-acre MCR is at an elevation of 49 ft above mean sea level, imposing a head of up to 20 ft above ground surface. The capacity of the reservoir at this elevation is 202,700 acre-ft. The reservoir embankment dike is designed to lower the hydraulic gradient across the embankment to the extent that the potentiometric levels of the soil layers in the plant area stay below the ground surface. This is accomplished through the use of low permeability clay (compacted fill), relief wells, and sand drainage blankets. Discharge to the environment from the MCR occurs primarily from seepage through the reservoir floor to the groundwater. Groundwater flow from the reservoir is intercepted, in part, by the relief well system around the perimeter of the MCR, which is collected in toe and drainage ditches around the periphery of the reservoir embankment and then discharges to surface water features at various locations. Seepage discharge from the reservoir is composed of two parts: (a) seepage that is collected and discharged through about 770 relief wells that have been installed in the embankment around the reservoir to relieve excess hydrostatic pressure, and (b) seepage through the Upper Shallow Aquifer that bypasses the relief wells and continues down gradient. During the design stage, total seepage of the MCR was estimated to be 3530 gpm or approximately 5700 acre-ft/yr. Of this value, approximately 68 percent or 3850 acre-ft/yr would be discharged through the relief wells (Reference 2.4S.12-9).

#### **2.4S.12.1.6 Plant Groundwater Use**

Groundwater is currently used on the site to support STP 1 & 2 plant operations. The water is pumped from the Deep Aquifer using five production wells (Production Wells 5 through 8 and the Nuclear Training Facility [NTF] well). The production well depths are between 600 and 700 ft below ground surface with well capacities between 200 and 500 gpm as shown on Table 2.4S.12-2.

Figure 2.4S.12-10 shows the location of the existing site production wells. No sustained pumping is permitted within 4000 ft of the STP 1 & 2 plant area in order to minimize the potential for subsidence resulting from lowering of the Deep Aquifer zone potentiometric head. The exception is the NTF well, which was installed to provide

water to the Nuclear Training Facility. (The NTF well only provides fire protection water to the NTF. Potable water for the NTF is supplied by Production Well 8.)

Groundwater use from these wells includes a makeup water source for the Essential Cooling Pond (ECP), makeup of demineralized water, the potable and sanitary water system, and the plant fire protection system (Reference 2.4S.12-9). Table 2.4S.12-3 presents the combined monthly groundwater withdrawals from the five production wells between 1995 and 2006. From the data in this table, the average annual groundwater use for operation of STP Units 1 and 2 from 2001 through 2006 was determined to be approximately 798 gpm (approximately 1288 acre-feet/year).

Groundwater is projected to be the main source of water for STP 3 & 4 plant operations. Based on the results of an operating plant (Units 3 and 4) water balance calculation (Reference 2.4S.12-25) and a site groundwater use calculation (Reference 2.4S.12-26), STPNOC has determined that the STP site groundwater operating permit limit provides adequate groundwater supply for water uses required for the operation of STP Units 1 and 2 and the construction, initial testing, and operation of STP Units 3 and 4. Water uses projected for the operation of STP Units 3 & 4 are derived from system design data as well as from operational water use data for specific systems for which such data is available (Reference 2.4S.12-25). Conservative water use projections for simultaneous operation of both STP Units 3 and 4 include a total estimated normalized groundwater demand of approximately 975 gpm (approximately 1574 acre-feet/year), and approximately 3434 gpm for maximum short-term steady-state conditions. The impacts to the local groundwater aquifer system are discussed in Subsection 2.4S.12.3.3.

The groundwater supply wells to be used for STP 3 & 4 are not a safety-related water source because the Ultimate Heat Sink (UHS) has a 30-day supply of water, which is sufficient to allow plant shutdown without additional water supply.

## **2.4S.12.2 Groundwater Sources**

This section describes historical and projected groundwater use, groundwater flow directions, groundwater hydraulic gradients, temporal groundwater trends, aquifer properties, and hydrogeochemical characteristics. STP site groundwater information is based on groundwater observation wells installed at the site, as shown on Figure 2.4S.12-10.

### **2.4S.12.2.1 Historical and Projected Groundwater Use**

Groundwater pumpage in the Gulf Coast Aquifer system was relatively small and constant from 1900 until the late 1930s. Pumping rates increased sharply between 1940 and 1960 and then increased relatively slowly through the mid 1980s. By the mid 1980s withdrawals were primarily from the east and central area of the aquifer system. This included the Houston area but some of the greatest pumpage was associated with rice irrigation centered in Jackson, Wharton, and portions of adjacent counties including Matagorda. The highest water demand was from the upper portion of the Deep Aquifer (Reference 2.4S.12-2).

Problems associated with groundwater pumpage, such as land subsidence, saltwater encroachment, stream base-flow depletion, and larger pumping lifts have caused pumpage to be curtailed in some areas. By the mid 1980s, the Texas Water Development Board (TWDB) had made projections of groundwater use to 2030. For the 10 counties that withdrew the largest amount of water from the Gulf Coast aquifer system during 1985, state officials projected a large decline in pumping from six counties, which included Matagorda County. The county was expected to experience a net decrease of 48 percent or 15 million gallons per day (mgd), with pumping rates decreasing from 31 mgd to approximately 16 mgd (Reference 2.4S.12-2). The water use projections undergo revisions and updating as technical and socioeconomic factors change. These factors are discussed later in this section.

The EPA monitors drinking water supply systems throughout the country and displays the results on their Safe Drinking Water Information System (SDWIS) website (Reference 2.4S.12-10). Table 2.4S.12-4 presents a listing of SDWIS water supply systems in Matagorda County as of March 2007. Figure 2.4S.12-11 shows the locations of these water supply systems. A total of 40 systems are identified in Matagorda County by SDWIS with seven systems serving greater than 1000 people, 18 systems serving greater than 100 to less than 1000 people, and 15 systems serving less than or equal to 100 people. The closest SDWIS water supply systems are the onsite water supply (Water system ID TX1610051) and the Nuclear Training Facility water supply (Water system ID TX1610103). The nearest nonsite related SDWIS water supply system is the Selkirk Water System, which is located across the Colorado River from the STP, approximately 4 mi to the southeast (Water system ID TX1610027).

Groundwater use in the site area is controlled by the TWDB and locally (Matagorda County) by the Coastal Plains Groundwater Conservation District. The TWDB maintains a statewide database of wells called the Water Information Integration and Dissemination (WIID) system. This database includes water wells and petroleum production wells (Reference 2.4S.12-11). The Coastal Plains Groundwater Conservation District, in conjunction with the Coastal Bend Groundwater Conservation District (Wharton County), also maintains a database of water wells (Reference 2.4S.12-12).

Information from the TWDB database was used to prepare Figure 2.4S.12-12, which shows well locations near the STP site as of March 2007. Plate I in Appendix 2.4S.12-A shows known well locations in Matagorda County. This database includes water wells, driller's logs and petroleum wells, as designated on the figure and plate legends. Information for water wells contained in the database for Matagorda County is presented in tabular form in Appendices 2.4S.12-A1 and 2.4S.12-A2. The search area for wells was limited to Matagorda County because pumping effects in the Deep Aquifer and flow information in the Shallow Aquifer suggest that groundwater impacts from groundwater use or accidents at STP would be limited to this area. The tables show a total of 838 water wells in Matagorda County. It should be noted that Appendix 2.4S.12-A2 (Driller's Report database) includes 18 wells identified as being in other counties, but the well coordinates plot within Matagorda County. It is not known if these entries have erroneous county names or location coordinates.

Figure 2.4S.12-13 presents the water well information from the Coastal Plains Groundwater Conservation District in the STP area as of March 2007. Plate II in Appendix 2.4S.12-A and Appendix 2.4S.12-A3 present the data for Matagorda County. The database includes 1989 water wells in Matagorda County and water use values for a portion of the wells. The larger number of wells in this database is primarily a result of including single-family domestic wells.

The TWDB conducts water use surveys throughout the state. The surveys are based on water user submitted information and may include estimated values. These surveys do not include single-family, domestic well groundwater use. The results of these surveys are divided up into use categories and water supply media (groundwater or surface water). Table 2.4S.12-5 presents regional historical groundwater and surface water use data for Matagorda County (Reference 2.4S.12-13). The table indicates that irrigation is the greatest groundwater user, followed by manufacturing, steam electric power generation, and municipal supply.

The TWDB also prepares estimates of future total water demand as part of water supply planning. These estimates have uncertainties associated with population growth projections, assumptions about climatic conditions (drought or wet years), and schedules for implementation of water conservation measures. The estimates of future water demand for steam electric power generation include increased demand based on higher generation capacity and increased reservoir blowdown to maintain water quality. Table 2.4S.12-6 presents projected water demand through the year 2060 (Reference 2.4S.12-14). This information was combined with historical water use to prepare the graphical representation of historic water use and projected water demand, as shown on Figure 2.4S.12-14. The relative percentages of water use categories are projected to remain the same as the historical data.

The CPGCD Groundwater Management Plan approved by TWDB on October 10, 2004, states (Reference 2.4S.12-24):

- The Regional Water Planning Group (Region K) estimates 49,221 acre-feet per year (AF/Y) of usable groundwater is available from the Gulf Coast aquifer in Matagorda County.
- The average total groundwater withdrawn in Matagorda County from the Gulf Coast aquifer was 30,233 AF/Y between 1980 and 2000.
- The 2050 groundwater supply for Matagorda County is projected to be 35,785 AF/Y.

However, the CPGCD claims that little science was used in the development of these estimates and cautions their use (Reference 2.4S.12-24).

Further complicating the situation, the TWDB-approved projected water demands are not presented with separate surface water and groundwater amounts. Using Region K estimates, CPGCD projects surface and groundwater demands for Matagorda County will exceed projected supplies in the future. Water conservation strategies and



desalination of sea water and deeper brackish groundwater have been proposed by Region K and the CPGCD to help meet the projected demand.

#### **2.4S.12.2.2 Groundwater Flow Directions**

A regional potentiometric surface map for the Deep Aquifer in Matagorda County in 1967 is presented on Figure 2.4S.12-15 (Reference 2.4S.12-6). Figure 2.4S.12-16 presents a potentiometric surface map for the Gulf Coast Aquifer from data collected between 2001 and 2005 (Reference 2.4S.12-15). Comparison of the figures suggests the regional flow direction of northwest to southeast is represented on both figures with localized flow disturbances caused by pumping. Comparison of the figures also suggests that groundwater elevations have increased in some parts of Matagorda County. In 1967, groundwater elevations above mean sea level were primarily located in the northern portion of the county. In the 2001-2005 potentiometric surface map, groundwater elevations in the northern and central portions of the county were above mean sea level. The hydraulic gradient in the STP site area for the 1967 potentiometric surface map is approximately 0.0006 ft/ft and for the 2001 to 2005 map is approximately 0.0002 ft/ft. Regional potentiometric surface maps are not available for the Shallow Aquifer due primarily to its limited regional use.

Using available information from the existing STP site piezometers, site-specific groundwater level measurements from November 1, 2005 and May 1, 2006 were used to develop potentiometric surface maps for the Upper and Lower Shallow Aquifer (Figure 2.4S.12-17) and the Deep Aquifer (Figure 2.4S.12-18). The Upper Shallow Aquifer groundwater flow direction in the vicinity of STP 3 & 4 is generally toward the southeast. There is also an apparent southerly flow direction along the west side of the MCR. This southerly flow direction may be influenced by controlled leakage from the MCR or by the operation of the relief wells adjacent to the MCR dike. The groundwater flow direction in the vicinity of STP 3 & 4 in the Lower Shallow Aquifer is generally easterly. The Lower Shallow Aquifer flow direction turns southeasterly near the eastern edge of the site. Both the Upper and Lower Shallow Aquifer flow directions are consistent with flow toward the Holocene alluvium in the Colorado River floodplain. The potentiometric maps for the Deep Aquifer show the influence of onsite groundwater production, with a majority of the onsite groundwater flow toward the production wells. The onsite Deep Aquifer potentiometric surface suggests a reversal of the regional flow direction in the southern portion of the map, where flow is north towards the pumping wells, rather than toward the southeast.

The potentiometric surface maps were used to estimate hydraulic gradients at the site. For each map, a flow line originating in the area of STP 3 & 4 was drawn. The hydraulic gradient along these flow lines is estimated by dividing the head change along the flow line by the length of the flow line. The Upper Shallow Aquifer potentiometric surfaces indicate a hydraulic gradient of approximately 0.001 ft/ft. The Lower Shallow Aquifer maps indicate a hydraulic gradient of approximately 0.0004 ft/ft. The Deep Aquifer has a hydraulic gradient between approximately 0.0008 ft/ft and 0.002 ft/ft. The hydraulic gradient in the Deep Aquifer adjacent to STP 3 & 4 appears to be influenced primarily by changes in pumping at Production Well 6.

Monthly and quarterly groundwater level measurements have been collected from the Shallow Aquifer observation wells for the STP 3 & 4 subsurface investigation. The measurements are presented on Table 2.4S.12-7. Well construction information is provided in Table 2.4S.12-1. The measurements were used to prepare potentiometric surface maps Figure 2.4S.12-19 for February, April, June, September, and December of 2007, and for March, June, September, and December of 2008 (Figure 2.4S.12-19). These maps indicate flow directions toward the southeast and southwest. The Upper Shallow Aquifer potentiometric surface map also shows seepage influence from the south, presumably from the MCR, and from the north, presumably from an irrigation water supply channel, the duck pond/marsh, or another source located to the north of observation well OW-954U. The potentiometric surface maps indicate hydraulic gradients of approximately 0.0007 ft/ft to 0.002 ft/ft for the southeast flow component and between approximately 0.0005 ft/ft and 0.0008 ft/ft for the southwest flow component. The Lower Shallow Aquifer hydraulic gradient is approximately 0.0004 to 0.0007 ft/ft.

As part of the subsurface investigation program, well pairs screened in the Upper and Lower zones of the Shallow Aquifer were installed. These well pairs were used to estimate the vertical hydraulic gradient in the Shallow Aquifer. The vertical flow path length is assumed to be from the midpoint elevation of the Upper zone observation well screen to the midpoint elevation of the Lower zone observation well screen. Figure 2.4S.12-20 shows a generalized hydrogeologic section through the STP 3 & 4 area. This section shows the relationship between the Upper and Lower Shallow Aquifer zones and the interconnection of sand layers in the Lower Shallow Aquifer. The head difference over the vertical flow path is the difference in water level elevations between the two paired wells. The hydraulic gradient is estimated by dividing the head difference by the length of the flow path. Table 2.4S.12-8 presents the estimated vertical hydraulic gradients. All well pairs except observation well pair OW-959 U/L and OW-961 U/L during September 2008 indicate a downward flow potential between the Upper and Lower zones in the Shallow Aquifer. The estimated vertical hydraulic gradients range from approximately 0.02 ft/ft at well pair OW-961U/L on December 15, 2008 to 0.29 ft/ft at well pair OW-929U/L on January 30, 2007 in a downward direction. The two upward gradients recorded on September 22, 2008 at well pair OW-959 U/L (0.004 ft/ft), located north of Kelly Lake, and OW-961 U/L (0.007 ft/ft), located south of Kelly Lake, were very slight compared to the range of documented downward vertical gradients at the site. This appears to have been a temporary, perhaps seasonal or weather-related occurrence, considering a downward gradient was recorded at these two locations in the next quarter. A third well pair (OW-960U/L), located immediately west of Kelly Lake, exhibited no upward gradient during either the September 2008 or the December 2008 groundwater level measurement events. Additional geologic and geotechnical cross-sections are provided in Section 2.5S.

A specific concern with respect to the groundwater flow direction in the Shallow Aquifer is the impact of the MCR on the groundwater system. The 7000-acre MCR is unlined and in places acts as a local recharge source to the Shallow Aquifer at the site. The normal maximum operating level elevation is 49 ft above MSL, imposing a hydraulic head of up to 20 ft above ground surface. The MCR embankment and associated drainage features are designed to lower the hydraulic gradient across the embankment

to the extent that the potentiometric level in the soil layers adjacent to the toe of the embankment stay below the ground surface. This objective is accomplished through the use of low permeability clay (compacted fill), relief wells, and an interconnected drainage system comprised of a sand chimney, sand drainage blanket and toe drain.

Discharge to the environment from the MCR occurs from seepage through the reservoir floor and embankments to the groundwater in the Upper Shallow Aquifer. Seepage from the MCR at the location of the embankment is intercepted in part by the relief well system installed into the sands of the Upper Shallow Aquifer and the drainage system comprised of sand chimney, sand drainage blanket and toe drain installed at the base of some sections of the embankment. The collected seepage is discharged from the passive relief wells and toe drains into drainage ditches around the periphery of the MCR embankment and then discharged to surface water features at various locations.

Table 2.4S.12-18 includes groundwater elevations for March 1, 2003 from piezometers distributed in sets of three around the perimeter of the MCR on a line perpendicular to the MCR embankment. The "A" position on this line is offset 11 feet landward from the centerline of the embankment. The "B" and "C" positions on the line are offset 98 and 260 feet landward from the centerline of the embankment, respectively.

Data summarized in Table 2.4S.12-18 indicate the water level in the "A" position in each piezometer set is highest, and those in the "B" and "C" positions are progressively lower. These data indicate that the hydraulic gradient in the Upper Shallow Aquifer beneath the entire length of the MCR embankment decreases in the landward direction, suggesting groundwater flow is outward from the MCR. This appears to cause groundwater flowing from upgradient regions of the Upper Shallow Aquifer to be diverted and flow around rather than beneath the MCR.

Figure 2.4S.12-33 is a contour map of water-level elevations in piezometers in the Upper Shallow Aquifer at the "A" position in each set around the MCR embankment, and in other available piezometers throughout the site. This map shows the piezometric surface in the Upper Shallow Aquifer beneath and in the vicinity of the MCR, and indicates that groundwater flow is outward from the MCR along the entire length of the embankment.

As discussed in FSAR Section 2.4S.12.1.3, the Lower Shallow Aquifer consists of inter-bedded sand and clay layers between depths of approximately 50 ft to 150 feet below ground surface. The sands within this unit are confined to semi-confined and FSAR Section 2.4S.12.2.5 states that the hydraulic separation between the Lower Shallow Aquifer and the Upper Shallow Aquifer may be discontinuous in places. However, the overall hydraulic separation between the two aquifers and the functioning relief well/sand blanket system is believed to limit the effect the hydrostatic head within the MCR has on the piezometric surface or flow direction in the Lower Shallow Aquifer.

Figure 2.4S.12-21 presents a conceptual hydrogeologic section extending from the MCR to the STP 3 & 4 area. This section suggests that the influence of the MCR is

restricted to the area immediately downgradient (outside) of the reservoir embankment. The combined effects of the relief wells and the toe drain act to reduce the head applied by the reservoir to the embankment. Further evidence of the effectiveness of this drainage system is provided by hydrogeochemical data.

Standard groundwater hydrogeochemical characteristics are discussed in FSAR 2.4S.12.2.5 and ER Subsection 2.3. FSAR Table 2.4S.12-15 lists regional hydrogeochemical data while Table 2.4S.12-16 lists the hydrogeochemical data from selected observation wells within the STP Units 3 & 4 area. A trilinear diagram of the hydrogeochemical data is presented in FSAR Figure 2.4S.12-30. A comparison of FSAR Table 2.4S.12-16 and ER Table 2.3.3-3 (MCR water quality data) suggests no strong geochemical correlation between the MCR waters and groundwater in the Shallow Aquifer north of the MCR. In addition, the potentiometric maps presented in FSAR Figure 2.4S.12-19 indicate little, if any, evidence of groundwater mounding north of the MCR. These data indicate that the relief wells are effective in reducing the aquifer head and minimizing the amount of seepage from the MCR to groundwater north of the MCR.

### **2.4S.12.2.3 Temporal Groundwater Trends**

The TWDB has collected groundwater level data in Matagorda County since the 1930s (Reference 2.4S.12-16). Two observation wells near the STP were selected to prepare the hydrographs in the vicinity of the site shown on Figure 2.4S.12-22. These wells monitor two different intervals in the Deep Aquifer. Well 8015402 monitors the heavy pumping interval at about 300 ft below ground surface. This well indicates that between 1957 and the early 1990s, a significant drop in groundwater level occurred. Since the early 1990s, the groundwater level has been recovering and has nearly returned to the 1957 level. The second well, 8015301, monitors the deeper zone of the Deep Aquifer, corresponding to the production zone in the STP onsite wells (well depths from 600 ft to 700 ft below ground surface). This well shows generally stable water levels over the period of record for the well. Due to the limited groundwater development potential in the Shallow Aquifer, regional temporal measurements of water levels have not been collected.

Groundwater levels are monitored in site observation wells as part of STP 1 & 2 operations. Selected observation wells in proximity to STP 3 & 4 were used to prepare hydrographs of the Shallow and Deep Aquifers, as shown on Figure 2.4S.12-23. The monitoring data set selected extends from March 1995 through May 2006. Upper Shallow Aquifer Wells 603B and 601 are located to the west and east, respectively, of STP 3 & 4, and well 602A is located immediately north of the STP 3 area. Well 603B shows variability of up to 5 ft over the duration of the record. Well 601 shows variability up to at least 9 ft from late 1994 to early 1997. Well 602A shows some seasonal variability, with a peak groundwater elevation over the period of record of 25.8 ft MSL and with a long term variability of approximately 4 ft.

Lower Shallow Aquifer wells 603A and 601A are located to the west and east, respectively, of STP 3 & 4. These wells show some seasonal variability with an overall decreasing trend in groundwater elevation. The elevation difference between the two wells suggests that they may be screened in different sand units within the Lower zone.

Deep Aquifer observation wells 613 and 605 are located to the southwest and north, respectively, of STP 3 & 4. These wells show a notable increase in water level elevation between 1996 and 1998. Water levels in Well 613 show a slight declining trend between 2004 and 2006. Well 613 is located within the influence of STP Production Well 6, which may be the cause of the slight decrease in groundwater levels.

The first 28 Shallow Aquifer observation wells installed as part of the STP 3 & 4 subsurface investigation program have been used for water level measurements since December of 2006. Monthly groundwater levels were collected through December 2007 from the STP 3 & 4 observation wells and quarterly groundwater level measurements were collected throughout 2008. During a subsequent phase of the subsurface investigation program 13 additional well pairs were installed in July and August 2008 and were monitored during the third and fourth quarters of 2008. Three well series designations represent the following location areas.

- OW-300 series wells are located in the proposed STP 3 facility area.
- OW-400 series wells are located in the proposed STP 4 facility area.
- OW-900 series wells include all of the wells located outside of the power block areas.

An "L" suffix on the well number indicates a Lower Shallow Aquifer well and a "U" suffix indicates an Upper Shallow Aquifer well.

Figure 2.4S.12-24 presents the hydrographs for these wells, which includes wells located within the STP 3 & 4 power block, upgradient and sidegradient of the power block, downgradient of the power block, and north of the MCR. The temporal variation for this entire set of wells is approximately 6 ft for the Upper Shallow Aquifer wells and approximately 4 ft for the Lower Shallow Aquifer wells. These hydrographs suggest short-term temporal variations in the Upper Shallow Aquifer on the order of 1 ft to 2 ft. The Upper Shallow Aquifer wells show consistently higher groundwater elevations than the adjacent Lower Shallow Aquifer wells. The groundwater levels recorded from the Upper Shallow Aquifer are generally steady from January 2007 to August 2007. Groundwater levels then decline from August 2007 to September 2008, increasing somewhat in December 2008. Over the same period, water levels recorded in the Lower Shallow Aquifer exhibit an increasing trend from January 2007 to August 2007, then a decreasing trend to December 2008, similar to the Upper Shallow Aquifer. These temporal trends are common to the power block and surrounding areas as well as north of the MCR.

Within the STP 3 & 4 power block area, the hydrographs for the OW-300 and OW-400 series wells are of interest, which are shown on Sheet 1 of Figure 2.4S.12-24. The maximum groundwater level observed in the Upper Shallow Aquifer within the STP 3 & 4 power block area is 25.94 ft MSL, which was recorded at OW-348U on July 30, 2007. In determining the maximum value, the two anomalous data points highlighted in Table 2.4S.12-7 and identified on Figure 2.4S.12-24 were excluded from consideration. The minimum groundwater level observed in the Upper Shallow Aquifer

is 21.23 ft MSL recorded at OW-332U on September 22, 2008. The temporal range in the Upper Shallow Aquifer, the difference between the maximum and minimum values, is therefore 4.71 ft. For the Lower Shallow Aquifer within the STP 3 & 4 power block area, the maximum groundwater level of 18.98 ft MSL was recorded at OW-349L on July 30, 2007, while the minimum groundwater level of 15.28 ft MSL was recorded at OW-348L on December 15, 2008, yielding a temporal range of 3.70 ft. Note that groundwater levels for the Upper Shallow Aquifer recorded at OW-408U and OW-420U on August 30, 2007 have been highlighted in Table 2.4S.12-7. Considering that the water levels in both aquifers across the power block area during this time all exhibited similar trends, with the exception of these two data points, the two measurements are considered anomalous and are not considered in the analysis discussed in Subsection 2.4S.12.5.

The 2008 quarterly groundwater level measurements indicate a steady decreasing trend across the site in both aquifers compared to the 2007 monthly groundwater level measurements. This trend likely reflects the effects of drought conditions recorded in Matagorda County since the spring of 2008. Consequently, the June through December 2008 data are considered to be below normal levels as represented by the 2007 data.

Based on the water level elevations collected from December 2006 to December 2007, the groundwater depth in both power block areas is below the maximum groundwater level of 61 cm (2 ft) below ground surface as specified in DCD/Tier 2 Table 2.0-1 for the ABWR. The plant ground floor grade elevation for safety-related structures is anticipated to be 35 ft MSL. Based on this observation, a permanent dewatering system will not be needed at STP 3 & 4.

#### **2.4S.12.2.4 Aquifer Properties**

Between 1951 and 1980 the average annual precipitation in the general area of STP was about 42 inches, and the corresponding average annual runoff is estimated as about 12 inches (Reference 2.4S.12-2). The difference of approximately 30 inches is either evaporated, consumed by plants, or percolates into the vadose zone to recharge the shallow aquifers. Much of the water is returned to the atmosphere by evapotranspiration (Reference 2.4S.12-2).

The vadose zone is considered to be relatively thin and limited at the site. The first saturated sand zone is encountered at a general depth of approximately 20 ft below ground surface, and it is classified as part of the Upper Shallow Aquifer. The aquifer zone exhibits semi-confined to confined conditions. The potentiometric head is under pressure, rising to within 5 ft to 10 ft of ground surface as measured in the onsite observation wells. The soils overlying the sand are generally described as clay (CL to CH, USCS Groups). From the geotechnical data listed in Subsection 2.5S.4 and summarized in Tables 2.5S.4-8, -10, and -12, measured natural moisture contents from samples collected to a depth of 20 ft ranged from approximately 5 percent to 29 percent. The majority of the values ranged between 15 percent and 25 percent. Dry unit weights for the materials sampled ranged from approximately 92 pounds per cubic foot (pcf) to 115 pcf. Wet densities, when measured, ranged from approximately 97 pcf to 133 pcf.

The properties of the aquifer materials at the STP site are divided into hydrogeological and geotechnical derived parameters. The hydrogeological parameters include transmissivity and storage coefficient measurements from aquifer pumping tests and hydraulic conductivity values determined from historical aquifer pumping tests and the slug tests performed in December 2006 as part of the STP 3 & 4 site subsurface investigation. The geotechnical parameters derived from laboratory testing include bulk density (or dry unit weight), porosity, effective porosity, and permeability from grain size.

The following are definitions of hydrogeological parameters adapted from Reference 2.4S.12-17:

- Transmissivity - The rate at which a fluid of a specified density and viscosity is transmitted through a unit width of an aquifer or confining bed under a unit hydraulic gradient and is a function of the properties of the fluid, the porous medium, and the thickness of the porous medium.
- Storativity (Storage Coefficient) - The volume of water released from or taken into storage per unit surface area of the aquifer per unit change in head.
- Hydraulic Conductivity (permeability) - A coefficient of proportionality describing flow per unit time under a unit hydraulic gradient through a unit area of a porous medium and is a function of the properties of the fluid and the porous medium.

#### **2.4S.12.2.4.1 Hydrogeological Parameters**

Regional aquifer properties have been collected by the TWDB (Reference 2.4S.12-6). Data for the area in proximity to the STP site is presented in Table 2.4S.12-9. Deep Aquifer transmissivity ranges from 10,500 gpd/ft to 195,300 gpd/ft and storage coefficient ranges from  $4.6 \times 10^{-5}$  to  $1.4 \times 10^{-3}$ . Although several of the wells in the table have screened intervals that encompass the depth interval associated with the Shallow Aquifer at the STP site, the screened intervals also extend into the Deep Aquifer, thus the test results cannot be applied to the Shallow Aquifer. Aquifer pumping tests have been performed on the STP site (Reference 2.4S.12-7 and Reference 2.4S.12-8) at three of the Deep Aquifer production wells and four test wells in the Shallow Aquifer in support of STP 1 & 2. The results of these tests are summarized in Table 2.4S.12-10. Transmissivity ranges from 1100 gpd/ft to 50,000 gpd/ft and the storage coefficient ranges from  $2.2 \times 10^{-4}$  to  $1.7 \times 10^{-3}$ .

Additionally, five short duration aquifer pumping tests (with a 6 to 8 hour pumping period) were conducted in the Upper Shallow Aquifer in five MCR relief wells during the construction and filling of the MCR. These tests, due to their short duration and the boundary influences of MCR filling, were not presented or used in the groundwater evaluations because they do not provide representative properties of the Upper Shallow Aquifer.

Figure 2.4S.12-25 presents a graphical comparison of regional and site-specific measurements using box and whisker plots. The box and whisker plot, also known as a boxplot, is a graphical representation of the data based on dividing the data set into

quartiles. The data range of the solid portion of the box encompasses 50 percent of the data and the data range of each whisker contains 25 percent of the data. The ends of the whiskers represent the minimum and maximum values in the data set.

Examination of the transmissivity plot indicates that the regional and STP deep values fall within the same data range, while the STP Shallow Aquifer data range falls below the regional range. This is caused by two Upper Shallow Aquifer tests that have transmissivity values of 1100 gpd/ft and 12,500 gpd/ft. The plot for storage coefficient indicates that the regional, STP Deep Aquifer, and STP Shallow Aquifer all fall within the same data range. The Shallow Aquifer values fall within the upper portion of the regional range of data. This may be a result of aquitard leakage influencing the Shallow Aquifer tests.

Hydraulic conductivity can be determined from aquifer pumping tests by dividing the transmissivity by the saturated thickness. There is uncertainty associated with this method, because assumptions are made regarding the amount of permeable material present within the screened interval of the test well. The pumping wells have screened intervals ranging from 16 ft to 819 ft in length, and the saturated thickness is apportioned across this screened interval (possibly underestimating the hydraulic conductivity for the more permeable sand units crossed by the well screen intervals). Hydraulic conductivity values from the aquifer pumping tests are included in Table 2.4S.12-9 and Table 2.4S.12-10.

Hydraulic conductivity can also be determined by the slug test method. This method measures the water level response in the test well to an instantaneous change in water level in the well. A disadvantage of this method is that it measures hydraulic conductivity only in the immediate vicinity of the test well. Generally, slug test results provide reasonable low-end values of the hydraulic conductivity of a given system. However, because the slug test requires minimal equipment and can be performed rapidly, slug tests can be performed in many wells, allowing a determination of spatial variability in hydraulic conductivity. Table 2.4S.12-11 presents a summary of slug tests performed in observation wells installed as part of the STP 3 & 4 subsurface investigation program.

The test results indicate a range of hydraulic conductivity from 7 gpd/ft<sup>2</sup> to 1,316 gpd/ft<sup>2</sup>. The slug test results for the Upper and Lower zones of the Shallow Aquifer were contoured, as shown on Figure 2.4S.12-26 to delineate spatial trends. The Upper Shallow Aquifer contour map indicates the area with the highest measured hydraulic conductivity is in the vicinity of STP 3. The surrounding measurements suggest these characteristics are localized to this area. The Lower Shallow Aquifer map indicates areas of higher hydraulic conductivity at and southeast of STP 3 & 4, and an isolated area south of Kelly Lake at observation well OW-961L.

Box and whisker plots comparing hydraulic conductivity from regional aquifer pumping tests, STP site aquifer pumping tests, STP site slug tests, and grain size data are shown on Figure 2.4S.12-27. The grain size derived hydraulic conductivity is discussed in Subsection 2.4S.12.2.4.2. The plots indicate that the regional aquifer pumping tests have the greatest range of hydraulic conductivity. However, the geometric means for the STP site aquifer pumping test derived hydraulic conductivity



values and the slug test results are not significantly different (337 gpd/ft<sup>2</sup> versus 126 gpd/ft<sup>2</sup>).

#### **2.4S.12.2.4.2 Geotechnical Parameters**

The geotechnical investigation component of the STP 3 & 4 subsurface investigation program included the collection of soil samples for laboratory determination of soil properties. These tests are discussed in Section 2.5S.4. A summary of the test results is presented in Table 2.4S.12-12. The results have been arranged to reflect the properties of the various hydrogeologic units present at the site. Basic soil properties are used to estimate the hydrogeologic properties of the materials such as porosity, effective porosity (specific yield), and permeability. Bulk density values were measured by the laboratory thus no further processing of the data was necessary.

Porosity is determined from a conversion of the void ratio to porosity. The effective porosity (or specific yield) is some fraction of porosity. In general terms, the effective porosity of sands or gravels approximates porosity, while the effective porosity of silts and clays is much less than their porosity. Figure 2.4S.12-28 (from Reference 2.4S.12-18) is a graph that shows the relationship between porosity, specific yield, and specific retention for various median grain sizes and sorting conditions. Interpolating from this graph for median grain sizes in the Shallow Aquifer and using the curve for average material, suggests that the specific yield is approximately 80 percent of the porosity of the Shallow Aquifer.

Permeability or hydraulic conductivity of sands with a D<sub>10</sub> grain size between 0.1 and 3.0 mm can be estimated using the Hazen approximation (Reference 2.4S.12-18). This formula was based on empirical studies for the design of sand filters for drinking water. The formula was developed for use in well-sorted sand and application to poorer-sorted materials would result in over-prediction of permeability. Figure 2.4S.12-27 includes the grain size derived hydraulic conductivity with aquifer pumping test and slug test derived hydraulic conductivity. Comparison of the boxplots suggests that the grain size derived hydraulic conductivity is within the range of regional hydraulic conductivity values, the STP aquifer test range, and the STP slug test range. Comparison of geometric means indicates the grain size derived hydraulic conductivity is similar but lower than the STP slug test results.

The hydraulic conductivity of the clay materials was measured in the STP 1 & 2 subsurface investigation (Reference 2.4S.12-9). Table 2.4S.12-13 summarizes the results of these tests. The geometric mean hydraulic conductivity of the clay samples is 0.004 gpd/ft<sup>2</sup> (1.72 x 10<sup>-7</sup> cm/sec). The clay samples were collected to a maximum depth of 39 ft below ground surface. The uniform depositional history and effects of consolidation and loading on clay hydraulic conductivity suggest that it would be a conservative assumption to apply these hydraulic conductivity values to deeper clays at the site.

#### **2.4S.12.2.4.3 Representative Properties of Hydrogeologic Units**

A simplified conceptual model of the STP site was developed to apply site parameters to the estimation of groundwater flow and contaminant transport. Figure 2.4S.12-29

presents a simplified hydrostratigraphic section of the site. The units presented on the section were used as a framework to relate measured or estimated properties to the groundwater system. A summary of important properties related to groundwater flow and contaminant transport is presented in Table 2.4S.12-14. The values for bulk density, total porosity, and effective porosity for the Deep Aquifer were taken from tests performed in the Lower Shallow Aquifer. The similarity of depositional environments and the observed grain size distributions suggest that an assumption of equivalence between the units is reasonable.

To assign representative values, the properties were divided into spatially and temporally variable data. Spatially variable data includes unit thickness, hydraulic conductivity, bulk density, porosity, and effective porosity. Representative values for the spatially variable data were assigned either an arithmetic mean (unit thickness, bulk density, porosity, and effective porosity) or a geometric mean (hydraulic conductivity) of the referenced data set. Temporally variable data are the hydraulic gradient measurements; the maximum value from each data set is assigned as the representative value.

#### **2.4S.12.2.5 Hydrogeochemical Characteristics**

Regional hydrogeochemical data were obtained from Reference 2.4S.12-6 and are presented in Table 2.4S.12-15. The data set includes ten wells in the Deep Aquifer and seven wells in the Shallow Aquifer. The analytical data was compared to EPA Primary and Secondary Drinking Water Standards (Reference 2.4S.12-19) and exceedances are identified on the table. The principal exceedances were for total dissolved solids and chloride (Secondary Drinking Water Standards). Examination of data suggests that the highest concentrations of total dissolved solids and chlorides are present in the Shallow Aquifer.

STP site-specific hydrogeochemical data are presented in Table 2.4S.12-16, which includes seven samples from the Deep Aquifer and 23 samples from the Shallow Aquifer. The analytical data were compared to EPA Primary and Secondary Drinking Water Standards and the exceedances are identified in the table. The principal exceedances were for total dissolved solids and chloride. The data indicate that the highest concentrations of total dissolved solids and chloride are present in the Shallow Aquifer.

The hydrogeochemical data can also be used as an indicator of flow patterns in the groundwater system. Variations in chemical composition can be used to define hydrochemical facies in the groundwater system. The hydrochemical facies are classified by the dominant cations and anions in the groundwater sample. These facies may be shown graphically on a trilinear diagram (Reference 2.4S.12-20). A trilinear diagram showing the regional and STP site-specific data is presented on Figure 2.4S.12-30. The predominant groundwater type for the Deep Aquifer regional groundwater data is sodium-bicarbonate, while for the Shallow Aquifer regional data the groundwater type varies from sodium-bicarbonate to sodium-chloride. The predominant STP site-specific groundwater type is sodium-bicarbonate in the Deep Aquifer, sodium-chloride in the Upper Shallow Aquifer, and sodium-bicarbonate in the Lower Shallow Aquifer. An exception to the Lower Shallow Aquifer hydrochemical

facies pattern is observed at observation wells OW-332L and OW-930L, where the water type is sodium-chloride. This facies change may indicate the proximity of a zone of vertical interconnection between the Upper and Lower Shallow Aquifers. This observation would be consistent with the findings of aquifer pumping test WW-4 (Reference 2.4S.12-7), which indicates a localized hydraulic connection between the Upper and Lower Shallow Aquifers. The conclusion that this is a localized connection is based on the absence of a hydraulic connection at the other three aquifer pumping test sites. The source of this interconnection may be either a natural feature, such as an incised channel or scour feature, or a man-made feature such as an excavation backfilled with pervious material or a leaking well seal. The manmade sources of interconnection are less probable, since the depth to the Lower Shallow Aquifer is on the order of 60 ft below ground surface, which would be below most site excavations, and leaky well seals also typically exhibit elevated pH associated with the impacts of cement grout, which is not observed at either of the wells.

Comparison of historical and more recent hydrogeochemical data indicates a general temporal consistency in groundwater chemistry for the individual aquifers present in the site area. This suggests that there are no long-term variations in groundwater chemistry occurring in the site area.

### **2.4S.12.3 Subsurface Pathways**

This section presents an evaluation of subsurface pathways for offsite exposure resulting from a liquid effluent release at STP 3 & 4. The section focuses on advective groundwater flow. Discussion of sorption and radioactive decay effects on offsite exposure is presented in Subsection 2.4S.13.

#### **2.4S.12.3.1 Exposure Point and Pathway Evaluation**

The site groundwater system consists of two aquifers; the Shallow Aquifer and the Deep Aquifer. The Shallow Aquifer extends from near ground surface and is approximately 100 ft to 150 ft thick. The Shallow Aquifer is separated from the Deep Aquifer by a 100 ft to 150 ft thick sequence of clay and silt. Potentiometric surface maps created from onsite groundwater level measurements indicate that flow in the Deep Aquifer is towards the onsite groundwater production wells located on the east and west sides of the STP site. The Deep Aquifer is greater than 500 ft thick and is the principal groundwater production interval in the site area.

The Shallow Aquifer is divided into the Upper Shallow Aquifer and Lower Shallow Aquifer that are separated by a clay and silt layer. Both zones are considered to be semi-confined to confined with a downward hydraulic gradient between the zones. The Upper Shallow aquifer is comprised of interbedded sand layers to depths of approximately 50 ft below ground surface. The Lower Shallow Aquifer consists of interbedded sand layers approximately 50 ft to 150 ft below ground surface. Site investigations indicate that this separation is not continuous and leakage between the two aquifers zones is occurring. The groundwater flow direction in both the Upper and Lower zones of the Shallow Aquifer is to the east-southeast, toward the Colorado River, with a minor flow component toward the southwest in the western portion of the

site. The Shallow Aquifer has limited production capability and is used for livestock watering and occasional domestic supply within Matagorda County.

Collector tanks inside the Radwaste Building are assumed to be the source of a hypothetical release to groundwater (FSAR 2.4S.13). The Radwaste Building basement floor is at a depth of approximately 45 ft below plant grade and the Radwaste Building foundation is at a depth of approximately 53 ft below plant grade. The excavation for the adjacent Reactor Building extends to a depth of approximately 94 ft below nominal post-construction plant grade, which would involve placement of structural fill beneath the Radwaste Building as part of backfilling around the Reactor Building. The Radwaste Building includes several levels of protection such as an alarmed tank level monitoring system and steel-lined compartments surrounding the radwaste tanks (FSAR 2.4S.13).

The excavation required for the construction of STP 3 & 4 penetrates into both the Upper and Lower Shallow Aquifer zones, but is above the thick sequence of clay and silt that separates the Shallow Aquifer from the more productive Deep Aquifer. Because there is a downward, vertical hydraulic gradient between the Upper and Lower Shallow Aquifer zones, and the backfilled excavation encounters both aquifer zones, the most likely groundwater pathway for an accidental release is the Lower Shallow Aquifer.

Figure 2.4S.12-31 presents the Blessing SE U.S. Geological Survey 7.5 minute quadrangle map of the site area (Reference 2.4S.12-21). This map shows onsite and offsite surface features considered in the evaluation. Review of regional groundwater use data presented in Subsection 2.4S.12.2.1 indicates that there is a credible Shallow Aquifer groundwater user exposure point in the vicinity of the STP site at Well 2004120846. This would be the most likely exposure point for the Shallow Aquifer groundwater. A second exposure pathway is via surface water, where the Shallow Aquifer discharges to local creeks or the Colorado River. The most likely exposure point for the Deep Aquifer would be the onsite groundwater production wells.

Off-site migration pathways were evaluated for the following hydrogeologic units:

- Upper Shallow Aquifer
- Lower Shallow Aquifer
- Deep Aquifer

The Shallow Aquifer is the most likely hydrogeologic unit to be impacted by an accidental liquid effluent release at Units 3 & 4. The Upper Shallow Aquifer has a flow direction toward the southeast, as discussed in Subsection 2.4S.12.2.2.

Figure 2.4S.12-31 indicates Pathway 1 - a potential Upper Shallow Aquifer groundwater exposure point - would be from Unit 3 to the eastern site boundary 7300 feet to the southeast. Pathway 1 can account for discharge from the Upper Shallow Aquifer to the unnamed tributary east of the site boundary and for a hypothetical

Shallow Aquifer domestic water well that could be installed in the Shallow Aquifer east and outside of the site boundary by a future land owner.

A second possible discharge area for both the Upper and Lower Shallow Aquifer is Pathway 2 from STP 3 to Well 2004120846, which is an 80 ft deep well, located about 1700 feet east of the east site boundary (Figure 2.4S.12-31), approximately 9000 ft from STP 3. Although the actual use of this well is believed to be as a livestock well; for the purpose of this exposure point and the pathway analysis, it has been assumed that water from this well could also be used for human consumption. Information from Appendix 2.4S.12-A3 indicates this well is estimated to produce 200,000 gallons per year.

A third possible discharge area for both Shallow Aquifer units would be the Colorado River, approximately 17,800 ft from STP 3. Pathway 3 represents a natural discharge pathway of groundwater from the Shallow Aquifer to surface water as it follows the southeast groundwater flow direction described in Subsection 2.4S.12.2.2.

A fourth possible pathway is a potential Upper Shallow Aquifer groundwater exposure point from the Unit 4 Radwaste Building to the western site boundary, approximately 6,000 feet to the southwest. This pathway would account for discharge from the Upper Shallow Aquifer to the unnamed headwater tributary of Little Robins Slough along the western site boundary or a hypothetical Shallow Aquifer domestic water well that could be installed offsite by a landowner. Site hydrogeologic data does not support a westward preferential pathway from Unit 4 in the Lower Shallow Aquifer (further discussed in Subsection 2.4S.13.1.2). Consequently, a southwest flow component similar to the one identified in the Upper Shallow Aquifer was not recognized for the Lower Shallow Aquifer.

Kelly Lake appears to be a plausible area of groundwater discharge for the Shallow Aquifer. However, Kelly Lake was not evaluated as an exposure point because the Pathway No. 1 point of exposure for Unit 3 is much closer than, and in the same direction as, Kelly Lake. Consequently, it is believed that the Pathway No. 1 point of exposure provides a more conservative analysis location than Kelly Lake considering that the lake is over 3,500 feet further to the southeast. The additional 3,500 feet of groundwater flow path for a postulated release of liquid effluent provides additional travel time during which radioactive decay can occur and additional distance over which adsorption and mechanical dispersion can occur. Additionally, while the September 2008 groundwater level data from well pairs OW-959U/L and OW-961U/L installed in the Shallow Aquifer near Kelly Lake indicate a slightly upward vertical gradient, the December 2008 data from these same well pairs exhibited a downward vertical gradient, and a third well pair (OW-960U/L) immediately west of the lake exhibited no upward gradient during either the September 2008 or the December 2008 well measurements. This suggests that Kelly Lake may only receive discharge from the Lower Shallow Aquifer on a seasonal basis from the north and south, but not from the west, which is in the direction of the power blocks.

Groundwater potentiometric surface maps (Figures 2.4S.12-17, 2.4S.12-19, and 2.4S.12-21) indicate the Shallow Aquifer groundwater flow is from, rather than

towards, the MCR in the vicinity of the MCR toe drain and relief wells. The MCR was formed by constructing an approximately 45-foot high embankment on top of the existing ground surface. The water level in the MCR is up to 20 feet above the original grade level. Because the MCR is unlined, this hydrostatic head induces seepage through its bottom, causing potentiometric levels in the underlying Upper Shallow Aquifer near the perimeter of the MCR to be higher than those farther outside the perimeter.

During the construction of the MCR, sets of piezometers were installed at locations along the MCR embankment to monitor the hydraulic head of the underflow through and beneath the MCR embankment structure. These sets of piezometers generally consist of three or more piezometers, aligned perpendicular from the top of the MCR embankment to the toe of the embankment. The piezometer sets are installed at various locations throughout the MCR embankment structure (Reference 2.4S.12-9).

Historical groundwater levels measured in these piezometers indicate that the hydraulic heads in the Upper Shallow Aquifer beneath the entire length of the MCR embankment decreases in the landward direction, inducing groundwater flow outward from the MCR and toward the relief wells in the Upper Shallow Aquifer. The relief wells are "flowing" wells because the hydraulic head imposed by the water level in the MCR induces potentiometric levels in the relief wells that are higher than the nearby ground surface elevation. The relief wells discharge to the toe ditches/streams near embankment toe. The relief well system was design to capture at least 50% of the seepage outwards from the MCR with the remaining seepage moving through the Upper Shallow Aquifer, beyond the relief wells system (Reference 2.4S.12-9). This condition causes groundwater flow in the Upper Shallow Aquifer from areas up-gradient in the power block of Units 3 & 4 to be diverted and flow around the MCR.

The Lower Shallow Aquifer is isolated over much of the site by the Lower Shallow Aquifer Confining Layer. However, aquifer pumping test data (Subsection 2.4S.12.2.4.1) and hydrogeochemical data (Subsection 2.4S.12.2.5) suggest that leakage through the less permeable confining layer is occurring. Additionally, excavations for the foundations of some of the deeper structures are projected to enter the Lower Shallow Aquifer. Subsection 2.4S.12.2.2 indicates that a consistent downward vertical hydraulic gradient exists between the Upper and Lower Shallow Aquifer, which would provide the driving force for movement of groundwater from the Upper to the Lower Shallow Aquifer in the Units 3 & 4 site and, therefore, a direct effluent release into the Lower Shallow Aquifer. Subsection 2.4S.12.2.2 indicates the Lower Shallow Aquifer has an east to southeast flow direction. Plausible discharge points from the Upper Shallow Aquifer could include the unnamed tributary and/or a hypothetical domestic well installed immediately outside the east site boundary 7,300 feet southeast of STP 3 & 4. Likely discharge points from the Lower Shallow Aquifer include the hypothetical well at the east site boundary, Well 2004120846, as discussed above, or the Colorado River alluvium, where the river channel has incised into the Lower Shallow Aquifer, approximately 17,800 ft from STP 3 & 4.

The Deep Aquifer is the least likely hydrogeologic unit to be impacted by an accidental liquid effluent release. The Deep Aquifer is separated from the Shallow Aquifer by a

100 ft to 150 ft thick clay and silt layer. Recent potentiometric surface maps for the Deep Aquifer (Subsection 2.4S.12.2.2) indicate that groundwater flow in the plant area is moving toward the production wells at the site, thus precluding the potential for offsite migration should the effluent pass through the clay layer. The additional groundwater needs for operation of STP 3 & 4 will further depress the potentiometric surface in the Deep Aquifer. The combined effects of horizontal flushing by flow in the Shallow Aquifer and radionuclide sorption as the effluent passes through the 100+ ft thick clay layer suggest that a completed pathway in the Deep Aquifer to off-site receptors is extremely unlikely. Under these conditions, there is no credible offsite release pathway for the Deep Aquifer.

### 2.4S.12.3.2 Advective Transport

Advective transport assumes that a accidental liquid effluent release travels at the same velocity as groundwater flow. The groundwater flow velocity or average linear velocity is estimated from the following equation (Reference 2.4S.12-17):

$$v = \frac{Ki}{n_e}$$

where:

$v$  = average linear velocity (ft/day)

$K$  = hydraulic conductivity (ft/day)

$i$  = hydraulic gradient (ft/ft)

$n_e$  = effective porosity (decimal)

The travel time from the effluent source to the receptor would be:

$$T = \frac{D}{v}$$

where:

$T$  = travel time (day)

$D$  = distance from source to receptor (ft)

$v$  = average linear groundwater velocity (ft/day)

Table 2.4S.12-17 presents average linear velocity and travel time estimates for the Shallow Aquifer using information from Table 2.4S.12-14. The table includes ranges of groundwater velocities and travel times for the data set. The average linear velocity in the Upper Shallow Aquifer is estimated to be 0.13 ft/d and in the Lower Shallow Aquifer to be 0.16 ft/d. In the Upper Shallow Aquifer, the estimated average travel time to the unnamed tributary or the hypothetical well at the east site boundary is about 154 years, to Well 2004120846 is about 190 years, and to the Colorado River is about 375

years. In the Lower Shallow Aquifer, the estimated average travel time to the hypothetical well at the east site boundary is about 125 years, to Well 2004120846 is about 154 years, and to the Colorado River is about 305 years. Table 2.4S.12-17 also includes groundwater velocity and travel time ranges for a southwest transport pathway in the Upper Shallow Aquifer from Unit 4 to the west property boundary. The average linear velocity and estimated average travel time for this pathway is estimated to be 0.05 ft/d and about 330 years, respectively.

### **2.4S.12.3.3 Plant Groundwater Use and Effects**

Groundwater is projected to be the main source of water for STP 3 & 4 plant construction and operation. During construction, groundwater use requirements will vary and will be used for the following activities: onsite personnel consumption and use; manufacturing of concrete, concrete curing, and clean-up; dust control; addition of moisture and placement of engineered backfill; and piping hydro tests and flushing. Based on the results of an operating plant (Units 3 and 4) water balance calculation (Reference 2.4S.12-26) and a site groundwater use calculation (Reference 2.4S.12-26), STPNOC has determined that the STP site groundwater operating permit limit provides adequate groundwater supply for water uses required for the operation of STP Units 1 and 2 and the construction, initial testing, and operation of STP Units 3 and 4.

The permit allows groundwater withdrawals from the five site production wells up to a limit of 9000 acre-feet over the permit term of approximately 3 years. For discussion purposes, this permit limit may be described herein as “approximately 3000 acre-feet/year,” recognizing that groundwater withdrawal in a single year may exceed 3000 acre-feet provided that total withdrawals over the permit term do not exceed 9000 acre-feet. As a point of reference, if the permit limit were exactly 3000 acre-feet/year (which is not necessarily the case due to slight variances in the permit term with each permit renewal), the equivalent “normalized” withdrawal rate assuming continuous pumping every minute of every day of each year would be approximately 1860 gpm.

Historical groundwater withdrawal rates associated with operation of Units 1 and 2 is provided in Table 2.4S.12-3. This data shows that from 2001 through 2006, annual groundwater use for operation of STP Units 1 and 2 averaged approximately 798 gpm (approximately 1288 acre-feet/year). A small but not insignificant portion of this amount has been diverted to the MCR as a result of manual operation of the groundwater well pump and header system. With the installation of appropriate automated groundwater well pump and header system controls, this diverted groundwater would be available for use by Units 3 and 4. However, as documented in the site groundwater use calculation (Reference 2.4S.12-26), it has been determined that even if this water were not available to Units 3 and 4, the existing STP site groundwater operating permit limit provides adequate groundwater supply for water uses required for the operation of STP Units 1 and 2 and the construction, initial testing, and operation of STP Units 3 and 4.

Water uses projected for the operation of STP Units 3 and 4 are derived from system design data as well as from operational water use data for specific systems for which such data is available (Reference 2.4S.12-25). Conservative water use projections for



simultaneous operation of both STP Units 3 and 4 include a total estimated normalized groundwater demand of approximately 975 gpm (approximately 1574 acre-feet/year), and approximately 3434 gpm for maximum short-term steady-state conditions.

Water uses for the construction (including concrete production) and initial testing of STP Units 3 and 4 were estimated for each month during the construction period through the commencement of unit operation (Reference 2.4S.12-26). As documented in the site groundwater use calculation (Reference 2.4S.12-26), monthly construction water uses are projected to range from a normalized rate of approximately 10 gpm to approximately 228 gpm. Similarly, monthly water uses associated with initial testing of STP Units 3 and 4 are projected to range from a normalized rate of approximately 47 gpm to approximately 491 gpm.

When evaluating whether the total site groundwater demand can be satisfied by the available groundwater supply, the site groundwater use calculation (Reference 2.4S.12-26) considers the schedule projected for each use, and evaluates the total site groundwater usage at each point in time from the commencement of STP Units 3 and 4 construction until both Units 3 and 4 are in operation (i.e., Units 1, 2, 3 and 4 are operating simultaneously). With consideration for the need to maintain water storage capacity to provide for peak site water demands, this evaluation confirms that total site groundwater demand remains below the existing site groundwater permit limit during construction, initial testing, and operation of STP Units 3 and 4. Notwithstanding, the MCR and Colorado River remain as alternative sources in the unlikely event that unanticipated peak site water demands would require additional water sources.

The design groundwater withdrawal capacity associated with the five site production wells covered by the existing site groundwater operational permit is approximately 1950 gpm. Of this design capacity, not more than approximately 1650 gpm is considered to be available based on operating experience and the fact that use of the NTF pump is limited to providing fire protection water for the NTF. Therefore, STPNOC intends to install at least one additional site groundwater well with a design capacity of 500 gpm. As with the existing five site production wells, any new well(s) would be installed to depths within the deep portion of the Chicot Aquifer. As documented in the site groundwater use calculation (Reference 2.4S.12-26), this additional capacity will allow for sufficient groundwater withdrawal to meet water uses required for: (1) operation of STP Units 1 and 2 and the construction, initial testing, and operation of STP Units 3 and 4; and (2) potential temporary capacity reduction as a result of equipment failure/unavailability.

As with STP 1 & 2, it is expected that no sustained pumping will be permitted within 4000 ft of the plant safety-related facility areas in order to minimize the potential for regional subsidence resulting from lowering of the Deep Aquifer zone potentiometric head. Based on this requirement, the additional groundwater well(s) would most likely be located in the west, northwestern or northeastern sections of the STP site or alternately in the southeastern and southwestern site areas adjacent to the MCR.

As stated in Subsection 2.4S.12.2.2, comparison of a regional potentiometric surface map for the Deep Aquifer in Matagorda County in 1967 (Figure 2.4S.12-15) and that

of a potentiometric surface map for the Gulf Coast Aquifer from data collected between 2001 and 2005 (Figure 2.4S.12-16) suggests that groundwater elevations have increased in some parts of Matagorda County. In 1967, groundwater elevations above mean sea level were primarily located in the northern portion of the county. In the 2001-2005 potentiometric surface map, groundwater elevations in the northern and central portions of the county were above mean sea level. Therefore, the regional impacts of groundwater production on the aquifer groundwater levels appear to be decreasing, thus minimizing impact to the regional aquifer as the result of STP plant expansion with the construction, initial testing, and operation of STP 3 & 4. Some additional aquifer drawdown would be expected near the STP site boundaries as the result of installing and operating any new groundwater well(s). Based on Figure 2.4S.12-18, it can be expected that the lowering of the potentiometric head in the Deep Aquifer at the existing STP production would expand over most of the northern portion of the site due to the installation of the new site production well(s). The decrease in head would be expected to extend beyond the site boundaries but the impact would be less than that beneath the site.

#### **2.4S.12.3.4 Three-Dimensional Numerical Groundwater Flow Model**

A three-dimensional, steady-state, numerical groundwater flow model was developed to better understand groundwater flow conditions at the north end of the site during pre-construction and post-construction of Units 3 & 4. This model is described in detail in Reference 2.4S.12-23. To assist in the modeling effort, 26 new observation wells were installed in pairs at 13 well clusters during July and August 2008, with one set within the Upper Shallow Aquifer and the other set within the Lower Shallow Aquifer. Each well was constructed and hydraulically tested similarly to the 28 observation wells that were installed during the 2006-2007 subsurface investigation. These new observation wells were installed along the north and northeast embankment of the MCR and toward the north and northeast property boundaries to obtain additional hydrogeologic information and reduce uncertainty associated with groundwater flow paths near the MCR, the proposed power block, and the east site boundary. Locations of the 26 new wells (OW-50U/L through OW-62U/L) are illustrated by Figure 9 presented in Reference 2.4S.12-23. Water levels were measured in the new and existing observation wells in September and December 2008. The numerical model was calibrated to the data collected in September 2008.

As described in Reference 2.4S.12-23, the groundwater model uses seven layers to explicitly simulate three-dimensional flow in the Upper Shallow Aquifer (Stratum C), Lower Shallow Aquifer (Strata E and H), and intervening confining clay units (Strata A/B, D and F). The Stratum A/B constitutes two model layers (one and two) to reproduce the various building foundation depths at STP Units 1 & 2 using inactive (no-flow) cells. The numerical code MODFLOW 2000 developed by the U.S. Geological Survey was used to build, execute, and calibrate the model as implemented in the user-interface software Visual MODFLOW developed by Waterloo Hydrogeologic, Inc. (now owned by Schlumberger Water Services). The model was developed using available historic data and data collected during the 2006 to 2008 subsurface investigations, and by using various boundary conditions to simulate local streams, surface water bodies, and recharge. The calibrated model was used to

simulate post-construction conditions that account for the presence of backfill material and slurry walls in the area of the new STP 3 & 4 structures. Within Visual MODFLOW, three-dimensional particle tracking flow paths were generated from the model output using MODPATH to simulate particle travel and groundwater pathways of potential liquid effluent releases from the power block area.

To simulate pre-construction groundwater flow conditions, particles were placed around the proposed locations for Unit 3 and Unit 4 within model layers 3, 5 and 7, which represent Strata C, E and H, respectively, of the Shallow Aquifer. The results of the pre-construction particle tracking simulations are shown in Figures 56 through 61 in Reference 2.4S.12-23. These results indicate that groundwater flow from Unit 3 in Stratum C of the Upper Shallow Aquifer flows eastward within Stratum C until Units 1 & 2 are encountered. At this location, flow is then down through the backfill at Units 1 and 2 to Stratum E of the Lower Shallow Aquifer where the groundwater discharges to the Colorado River. Additionally, the preconstruction results show that groundwater flow within the Upper Shallow Aquifer from Unit 4 is to the west and remains within Stratum C. The results for the Lower Shallow Aquifer indicate that groundwater flow from each release point within Stratum E is eastward through Stratum E until it discharges to the Colorado River, and that groundwater flow from each release point within Stratum H is southeastward toward the Colorado River.

Figures 62 through 67 in Reference 2.4S.12-23 illustrate a post-construction scenario with proposed building foundations and excavation backfill, slurry walls around the main construction excavation, a shallower slurry wall around the main circulating water lines, and two crane foundation retention walls, one adjacent to each proposed unit. To accommodate the varied keyed depths of these structures, the model layering was increased from seven to 10 layers by adding a layer to three of the intervening confining clay units. As in the pre-construction scenario, particles were placed around Units 3 & 4 within model layers 4, 7 and 10 now representing Stratum C, E and H, respectively, of the Shallow Aquifer. These particles represent locations for a postulated accidental release of liquid effluent to each of the three Shallow Aquifer layers. The post-construction particle tracking results indicate that the particle released within model layer 4 (Stratum C of the Upper Shallow Aquifer) would migrate downward from the release points through the backfill at Units 3 & 4 to Stratum E of the Lower Shallow Aquifer and flow eastward past the site boundary until groundwater flow discharges to the Colorado River from Stratum E. The post-construction scenario results are similar to the preconstruction results for Strata E and H of the Lower Shallow Aquifer.

#### **2.4S.12.4 Monitoring or Safeguard Requirements**

Groundwater level monitoring in the STP 3 & 4 area is currently being implemented through the use of the groundwater observation wells installed in 2006 for the site subsurface investigation and through the periodic review of water levels from selected wells in the vicinity of the site.

Some of the existing STP 3 & 4 area observation wells will be taken out of service prior to construction activities due to anticipated earth moving and construction requirements. Prior to construction activities, the observation well monitoring network

will be evaluated in the detailed design to determine groundwater data gaps and needs created by the abandonment of existing wells.

As part of the detailed design for STP 3 & 4, the current STP groundwater monitoring programs will be evaluated with respect to the addition of STP 3 & 4 to determine if any modification of the existing programs is required to adequately monitor plant effects on the groundwater. Considerations to revise the site groundwater monitoring program will include the following components:

- Deep Aquifer - Periodic water level measurements in deep observation wells and geochemical sampling and analysis of production wells would detect changes in the Deep Aquifer that may impact groundwater supply availability or the accident release analysis.
- Shallow Aquifer - Periodic water level measurements in the Upper and Lower zone observation wells and collection of geochemical samples and analysis will be performed in selected observation wells. The water level monitoring program objective is to detect changes in flow patterns in the Shallow Aquifer that might impact accident analysis and to track temporal trends in groundwater levels that might impact structural stability in the vicinity of STP 3 & 4. The geochemical monitoring would detect changes in groundwater geochemistry that would be deleterious to plant structures and subsurface components.
- Subsidence Monitoring - The current plant subsidence monitoring program will be expanded to include STP 3 & 4.
- Operational Accident Monitoring - In the unlikely event of an operational accident, site observation wells in the Shallow and Deep Aquifers and onsite groundwater production wells in the Deep Aquifer would be sampled for radionuclides associated with the plant. Additional monitoring locations may be added if onsite monitoring indicates the potential for offsite exposure.

Groundwater level measurement collection would begin in the Deep and Shallow Aquifers would be collected starting during construction and continue for a period following plant startup. Selection of observation wells to be included in the program will be made prior to the start of operation based on well condition, position relative to plant site and other observation wells (provide optimal spatial distribution for potentiometric map preparation and vertical hydraulic gradient assessment), and long-term viability of the observation well (likelihood well will survive construction).

Geochemical sampling and analysis in the Deep and Shallow Aquifers would be performed during construction and after startup. Analysis will include field parameters (pH, temperature, specific conductance, oxidation-reduction potential, and dissolved oxygen), major cations, major anions, total dissolved solids, and silica. Sampling would be performed in site production wells, any new production wells installed to support STP 3 & 4 operation, and selected observation wells in the Shallow Aquifer. Observation wells would be selected during detailed design.

Additional near-surface subsidence monuments would be installed around STP 3 & 4 structures. The onsite subsidence monitoring frequency would increase during construction and after startup.

Operational accident monitoring would be triggered in the unlikely event of a release of liquid effluent from the plant. Trigger mechanisms may include, but not be limited to, observations and notification of acute releases through plant procedures and processes implemented during plant operations, and detection of elevated levels of potential contaminants or indicator parameters from routine plant environmental monitoring activities, including groundwater monitoring. Quarterly groundwater samples would be collected from site production wells and downgradient Shallow Aquifer observation wells. Selection of downgradient observation wells would be based on flow directions determined from the most recent groundwater level measurements. Additional monitoring, subsurface investigations or remedial action may be required based on the triggers and situation encountered.

Safeguards will be used to minimize the potential of adverse impacts to the groundwater by construction and operation of the new units. These safeguards would include the use of lined containment structures around storage tanks (where appropriate), hazardous materials storage areas, emergency cleanup procedures to capture and remove surface contaminants, and other measures deemed necessary to prevent or minimize adverse impacts to the groundwater beneath the STP 3 & 4 site.

#### **2.4S.12.5 Site Characteristics for Subsurface Hydrostatic Loading**

Subsurface hydrostatic loading estimates for structures at STP 3 & 4 were evaluated using two approaches. First, the evaluation was performed by conservatively assuming that groundwater level is at the maximum groundwater level of 61 cm (2 ft) below ground surface as specified in ABWR DCD (Tier 1) Table 5.0 and ABWR DCD (Tier 2) Table 2.0-1. The nominal post-construction plant grade elevation in the power block area will be approximately 34 ft MSL. Thus, the assumed groundwater elevation for the evaluation using the first approach would be 32 ft MSL. For the evaluation using the second approach, it was assumed that groundwater level in the power block area is at the “site characteristic” maximum groundwater level of 28 ft MSL as specified in Table 2.0-2. The maximum hydrostatic loading is estimated using the following formula:

$$\rho_w = z_w \times \gamma_w$$

where:

$\rho_w$  = hydrostatic pressure (psf)

$z_w$  = depth below groundwater level (ft)

$\gamma_w$  = unit weight of water (62.4 pcf)

Figure 2.4S.12-32 presents a graph of building elevation versus hydrostatic pressure. Two lines are provided on the graph, one representing the upper bound condition using

the DCD maximum groundwater level and the second using the site characteristic maximum groundwater level of 28 ft MSL in the power block area.

Excavations for the construction of STP 3 & 4 are preliminarily planned to depths of about 94 ft below nominal post-construction plant grade (34 ft MSL). The reactor building mat is expected to be placed at a depth of approximately 84 ft with the control building at a depth of approximately 76 ft, the UHS at a depth of approximately 30 ft, and the turbine building at a depth of approximately 73 ft. Perimeter dewatering will be required to a depth of at least 35 ft with deeper excavation dewatering to a depth of at least 100 ft. The excavation design may require the use of slope stability structures. The actual excavation design will be refined as part of the detailed design.

During excavation and construction of STP 3 & 4, the hydrostatic loading on the excavation and structures will be controlled by a temporary construction dewatering system. Typical dewatering systems for this type of cut and fill excavation would consist of a combination of perimeter dewatering wells and open pumping from sumps within the excavation. The perimeter dewatering wells would control lateral inflow and assist in removing water stored within the excavation. The open pumping system would control precipitation run-off, assist in water storage removal, and removal of any inflow to the excavation.

To prevent uplift of foundation soils, groundwater levels will be maintained a minimum of 5 ft below the bottom of the deepest excavation. The STP 3 & 4 excavation is deeper than the excavation for STP 1 & 2 (Reference 2.4S.12-9). The hydrogeologic conditions encountered beneath the proposed STP 3 & 4 are, in general, similar to those beneath STP 1 & 2. A long-term, steady state dewatering flow rate is estimated to be between 1800 and 4200 gpm. The range in pumping rates is dependent on the hydraulic conductivity used in the analysis (low range or geometric mean of the pumping test hydraulic conductivity values) and on the excavation plan. Because the excavation required for the construction of STP 3 & 4 is estimated to be deeper than that for STP 1 & 2, the flow rates estimated for STP 3 & 4 are considered to be within reason in comparison to actual flow rates measured at STP 1 & 2 (between 1300 gpm to 2900 gpm). Alternatives that could reduce the amount of water to be removed include various types of cut-off walls. The cut-off walls could include a slurry wall, grout curtain, or freeze-wall. The slurry wall and grout curtain are permanent features, while the freezeway can be temporary. Some dewatering would still have to be performed to remove storage, precipitation run-off, and vertical inflow. Methods to mitigate the subsidence beneath existing structures include cut-off walls, injection wells, and infiltration trenches. The dewatering system design will be refined as part of the detailed design.

Another concern is rewatering after completion of excavation and backfill around structures. Groundwater levels will be raised in a controlled manner to prevent rapid hydrostatic pressure build-up or damage to the subsurface backfill materials. Prior to the start of excavation, a dewatering and rewatering plan will be prepared to document the construction dewatering system design and groundwater control criteria.

In summary, based on measured groundwater levels in observation wells and modeled post-construction groundwater levels, the maximum post-construction groundwater elevation at the STP Units 3 and 4 site is estimated to be 28 ft MSL, as reflected in Table 2.0-2. The nominal finished plant grade in the power block area is approximately 34 ft MSL, six feet higher than the site characteristic maximum groundwater level. Therefore, the STP Units 3 and 4 site characteristic of 28 ft MSL for maximum groundwater level is well bounded by the maximum groundwater level plant parameter "61.0 cm [2 ft] below grade" that is specified for the standard plant site in ABWR DCD (Tier 1) Table 5.0 and ABWR DCD (Tier 2) Table 2.0-1. Based on this observation, a permanent dewatering system is not anticipated to be a design feature for the STP 3 & 4 facility. Most of the power block will be occupied by buildings and structures. Roof drains for the buildings and structures will be directed to storm drains. Storm water collected in these drains will be conveyed to surface water outfalls. Most of the remaining area within the power block will be covered by a relatively low permeability material. Grading within the power block will be designed to direct precipitation falling on the surfaces to storm drains, which will then convey the storm water to surface water outfalls, minimizing precipitation infiltrating into the backfill within the power block area. Post-construction groundwater conditions are anticipated to have some localized changes resulting from excavation and backfilling, however, based on observations of STP 1 & 2 post-construction groundwater conditions, the effects would be minimal and may include localized communication between the Upper and Lower Shallow Aquifers and an increased cone of depression in the Deep Aquifer resulting from increased groundwater use for STP 3 & 4. The groundwater supply wells to be installed for STP 3 & 4 are not a safety-related source of water because the UHS has a 30-day supply of water, which is sufficient for plant shutdown without a supplementary water source.

#### **2.4S.12.5.1 Effect of Design Basis Flood due to MCR Breach on the Design Groundwater Level**

The existing site has a clay layer extending 20 feet below the existing grade elevation of approximately 30 feet (Figures 2.4S.12-20 and 2.4S.12-29). This clay layer will be removed during the excavation for the power block structures.

The power block island will be built up to a plant grade elevation of 34 feet. Once the power block structures are constructed the area adjacent to the structures will be backfilled with granular structural fill. After placement of the structural backfill a minimum of 2-foot thick clay layer will be provided as a cap as part of the backfill in the power block island around the buildings to prevent flood water infiltration into the groundwater table. Conservatively, assuming the permeability of the clay layer as  $5 \times 10^{-6}$  cm/sec, the water would penetrate approximately 0.108 cm per hour with approximately 6 feet of depth of water during the design basis flood. During the design basis flood the period of inundation of the power block is approximately 20.5 hours and therefore the maximum infiltration will be of the order of 2.22 cm (0.9 inches). Due to this insignificant infiltration, the flood water will not affect the groundwater table.

Minor excavations into the clay cap that could occur over the life of the plant will not affect the ground water table during short term flooding events. Given the large extent

of the aquifer, the amount of infiltration that could enter the aquifer through a limited extent of the excavation will not affect the ground water table.

The plant buildings and concrete and asphalt paved areas and roads will occupy approximately 40 percent of the total surface area of the power block island. The rest of the power block island will have compacted crushed stone surfacing. This surfacing will allow for the normal plant traffic and will withstand erosion. This stone surfacing will normally be maintained by the plant personnel during the plant operation.

The crushed stone surfacing will be able to withstand the flow due to the MCR dike breach flooding with low potential for scour or degradation.

#### **2.4S.12.6 References**

- 2.4S.12-1 "Physiographic Map of Texas," Bureau of Economic Geology, The University of Texas at Austin, 1996. Available at <http://www.lib.utexas.edu/geo/maps.html>.
- 2.4S.12-2 "Ground Water Atlas of the United States: Oklahoma, Texas, HA 730-E," Ryder, P. D., United States Geological Survey, 1996. Available at [http://capp.water.usgs.gov/gwa/ch\\_e/index.html](http://capp.water.usgs.gov/gwa/ch_e/index.html).
- 2.4S.12-3 "Major Aquifers of Texas," 2000. Available at <http://www.twdb.state.tx.us/mapping/index.asp>.
- 2.4S.12-4 "Region VI Sole Source Aquifer Map," United States Environmental Protection Agency. Available at <http://www.epa.gov/region6/6wq/swp/ssa/maps.htm>, accessed March 2, 2007.
- 2.4S.12-5 "Stratigraphic and Hydrogeologic Framework of Part of the Coastal Plain of Texas, Report 236," Baker, E.T., Texas Department of Water Resources, 1979. Available at <http://www.twdb.state.tx.us/publications/reports/GroundWaterReports/GWReports/Individual%20Report%20htm%20files/Report%20236.htm>.
- 2.4S.12-6 "Ground-Water Resources of Matagorda County, Texas, Texas Water Development Board Report 91," Hammond Jr., W., Cooperative study by the Texas Water Development Board, Lower Colorado River Authority, and Matagorda County Commissioners Court, 1969. Available at <http://www.twdb.state.tx.us/publications/reports/GroundWaterReports/GWReports/Individual%20Report%20htm%20files/Report%2091.htm>.
- 2.4S.12-7 "Basic Data Report - Ground Water South Texas Project, submitted to Brown and Root, Inc.," Woodward-Clyde Consultants, August 29, 1975.
- 2.4S.12-8 "Deep Aquifer Ground-Water Evaluation and Pump Test Results, report Y180XR042-WL, prepared for Brown & Root, Inc.," Woodward-Clyde Consultants, July 9, 1975.
- 2.4S.12-9 "STPEGS Updated Final Safety Analysis Report Units 1 and 2," Revision 13.



- 2.4S.12-10 "United States Environmental Protection Agency Safe Drinking Water Information System (SDWIS)." Available at [http://oaspub.epa.gov/enviro/sdw\\_query\\_v2.get\\_list?wsys\\_name=&fac\\_search=fac\\_beginning&fac\\_county=MATAGORDA&pop\\_serv=500&pop\\_serv=3300&pop\\_serv=10000&pop\\_serv=100000&pop\\_serv=100001&sys\\_status=active&pop\\_serv=&wsys\\_id=&fac\\_state=TX&last\\_fac\\_name=&page=1&query\\_results=&total\\_rows\\_found=](http://oaspub.epa.gov/enviro/sdw_query_v2.get_list?wsys_name=&fac_search=fac_beginning&fac_county=MATAGORDA&pop_serv=500&pop_serv=3300&pop_serv=10000&pop_serv=100000&pop_serv=100001&sys_status=active&pop_serv=&wsys_id=&fac_state=TX&last_fac_name=&page=1&query_results=&total_rows_found=), accessed March 15, 2007.
- 2.4S.12-11 "Texas Water Development Board Water Information Integration and Dissemination (WIID) System." Available at <http://wiid.twdb.state.tx.us/>, accessed March 15, 2007.
- 2.4S.12-12 "Coastal Plain/Coastal Bend Groundwater Conservation Districts Database." Available at <http://www.gis.aecom.com/cbcpgcd/>, accessed March 20, 2007.
- 2.4S.12-13 "Texas Water Development Board historical water use information." Available at: <http://www.twdb.state.tx.us/wushistorical/>, accessed March 12, 2007.
- 2.4S.12-14 "Texas Water Development Board water use projections." Available at <http://www.twdb.state.tx.us/DATA/db07/defaultReadOnly.asp>, accessed March 12, 2007.
- 2.4S.12-15 "Hydrogeochemistry, Salinity Distribution, and Trace Constituents: Implications for Salinity Sources, Geochemical Evolution, and Flow Systems Characterization, Gulf Coast Aquifer, Texas" Chapter 5 in 'Aquifers of the Gulf Coast of Texas,' Texas Water Development Board Report 365," Chowdhury, A., Boghici, R., and Hopkins, J., 2006. Available at <http://www.twdb.state.tx.us/publications/reports/GroundWaterReports/GWReports/R365/AGCindex.htm>.
- 2.4S.12-16 "Texas Water Development Board Well Database Information." Available at <http://www.twdb.state.tx.us/publications/reports/GroundWaterReports/GWDatabaseReports/Database%20in%20ASCII/Matagorda/wlevels.txt>, accessed March 14, 2007.
- 2.4S.12-17 "Applied Hydrogeology, second edition," Fetter, C.W., 1988.
- 2.4S.12-18 "Hydrogeology," Davis, S.N, and DeWiest, R.J.M., 1966.
- 2.4S.12-19 "Drinking Water Contaminants," United States Environmental Protection Agency. Available at <http://www.epa.gov/safewater/contaminants/index.html>, accessed April 19, 2007.
- 2.4S.12-20 "A Graphic Procedure in the Geochemical Interpretation of Water Analyses 'Transactions, American Geophysical Union', 25, 914-923," Piper, A.M., 2006.
- 2.4S.12-21 "Blessing SE, Texas, 28096-G1-TF-024, DMA 6741 1 SE-SERIES V882," United States Geological Survey, 1995. Available at <http://www.tnris.org/datadownload/quad.jsp?Quad=Blessing%20SE&num=28096-G1>.
- 2.4S.12-22 "Climate Division: Temperature-Precipitation-Drought Data," National Climatic Data Center (NCDC), 2007. Available at <http://www.ncdc.noaa.gov/oa/climate/onlineprod/drought/ftppage.html>, accessed April 13, 2007.

- 2.4S.12-23 "Groundwater Model Development and Analysis for STP Units 3 & 4," Bechtel Power Corporation, December 2008, Revised November 2009 and January 2011.
- 2.4S.12-24 "Groundwater Management Plan, Prepared for: Coast Plains Groundwater Conservation District," Turner Collie & Braden, Inc., May 2004.
- 2.4S.12-25 "Plant Water Balance," Fluor Nuclear Power Calculation No. U7-SITE-G-CALC-DESN-2001.
- 2.4S.12-26 "Site Groundwater Use for Construction, Initial Testing, Startup, and Operations," Fluor Nuclear Power Calculation No. U7-SITE-G-CALC-DESN-2002.

Table 2.4S.12-1 Observation Well Construction Details

Well Number [2]	Northing (ft) [3]	Easting (ft) [3]	Well Pad Elevation	Reference Elevation	Borehole Diameter (in)	Well Depth	Screen Interval Depth [4]		Screen Interval Elevation [4]		Filter Pack Interval Depth	
			(ft MSL) [3]	(ft MSL) [3]		(ft bgs)	Top (ft bgs)	Bottom (ft bgs)	Top (ft MSL)	Bottom (ft MSL)	Top (ft bgs)	Bottom (ft bgs)
OW-308L	363196.43	2943374.36	29.87	31.78	8	97.1	86	96	-56.13	-66.13	82	97.1
OW-308U	363195.64	2943354.04	29.88	31.80	8	47.1	36	46	-6.12	-16.12	32	47.1
OW-332L[1]	363739.87	2943610.91	30.24	31.85	8	103.2	92.1	102.1	-61.86	-71.86	88	103.2
OW-332L(R)	363729.36	2943608.74	30.01	32.08	8	103.1	92	102	-61.99	-71.99	87	103.1
OW-332U	363739.21	2943591.02	30.24	32.10	8	46.1	35	45	-4.76	-14.76	31	46.1
OW-348L	362685.92	2943014.48	30.08	31.86	8	79.1	68.2	78.2	-38.12	-48.12	64	79.1
OW-348U	362685.23	2942994.44	30.51	32.28	8	39.1	28	38	2.51	-7.49	24	39.1
OW-349L	362901.84	2943602.97	29.41	31.03	8	81.1	70	80	-40.59	-50.59	65	81.1
OW-349U	362902.40	2943582.28	29.4	31.29	8	46.1	35	45	-5.6	-15.6	31	46.1
OW-408L	363196.18	2942472.54	31.73	33.76	8	81.3	70.2	80.2	-38.47	-48.47	66	81.3
OW-408U	363194.01	2942456.01	31.5	33.57	8	43.1	32	42	-0.5	-10.5	28	43.1
OW-420U	362902.15	2942018.94	32.25	33.79	8	49.1	38	48	-5.75	-15.75	34	49.1
OW-438L	363790.77	2942045.09	30.11	31.57	8	104.1	93	103	-62.89	-72.89	89	104.1
OW-438U	363792.04	2942025.17	30.53	32.18	8	41.0	30	40	0.53	-9.47	26	41
OW-910L	363363.45	2941266.45	30.75	32.48	8	92.1	81	91	-50.25	-60.25	77	92.1
OW-910U	363362.02	2941246.57	30.69	32.32	8	36.1	25	35	5.69	-4.31	21	36.1
OW-928L	364932.30	2940376.21	29.81	31.56	8	121.1	110	120	-80.19	-90.19	106	121.1
OW-928U	364933.86	2940356.48	30.02	31.69	8	39.6	28.5	38.5	1.52	-8.48	24.5	39.6
OW-929L	364671.50	2945497.78	36.93	38.63	8	98.1	87	97	-50.07	-60.07	83	98.1
OW-929U	364672.34	2945477.58	36.91	38.71	8	60.1	49	59	-12.09	-22.09	45	60.1
OW-930L	360214.45	2949525.96	26.21	27.98	8	106.5	95	105	-68.79	-78.79	91	106.5
OW-930U	360209.72	2949506.58	25.62	27.33	8	36.1	25	35	0.62	-9.38	21	36.1
OW-931U	361979.42	2939520.36	30.53	32.10	7	36.0	25	35	5.53	-4.47	21	36
OW-932L	361899.37	2942115.90	31.09	32.79	8	79.6	68.5	78.5	-37.41	-47.41	64.5	79.6
OW-932U	361898.53	2942097.29	31.35	32.83	8	39.6	28.5	38.5	2.85	-7.15	24.5	39.6
OW-933L	361898.05	2943515.01	28.74	30.45	8	87.1	76	86	-47.26	-57.26	72	87.1

Table 2.4S.12-1 Observation Well Construction Details (Continued)

Well Number [2]	Northing (ft) [3]	Easting (ft) [3]	Well Pad Elevation	Reference Elevation	Borehole Diameter (in)	Well Depth	Screen Interval Depth [4]		Screen Interval Elevation [4]		Filter Pack Interval Depth	
			(ft MSL) [3]	(ft MSL) [3]		(ft bgs)	Top (ft bgs)	Bottom (ft bgs)	Top (ft MSL)	Bottom (ft MSL)	Top (ft bgs)	Bottom (ft bgs)
OW-933U	361897.65	2943494.66	28.87	30.62	8	37.1	26	36	2.87	-7.13	23	37.1
OW-934L	362082.08	2948254.12	29.04	30.94	7	100.0	89	99	-59.96	-69.96	85	100
OW-934U	362079.87	2948234.20	28.54	30.39	8	41.1	30	40	-1.46	-11.46	26	41.1
OW-950L	360135.01	2939595.22	27.94	29.03	8	132.0	121	131	-93.06	-103.06	119	133.6
OW-950U	360120.40	2939584.26	28.04	29.33	8	42.0	31	41	-2.96	-12.96	29	43.5
OW-951L	361191.53	2941355.46	29.87	30.96	8	128.0	117	127	-87.13	-97.13	113	130
OW-951U	361188.28	2941337.00	30.05	31.39	8	30.0	19	29	11.05	1.05	17	32.6
OW-952L	361192.61	2942777.44	29.45	30.71	8	80.0	69	79	-39.55	-49.55	66	82.6
OW-952U	361194.86	2942756.10	29.39	30.38	8	45.0	34	44	-4.61	-14.61	32	47.3
OW-953L	362743.19	2944472.61	29.15	30.07	8	82.0	71	81	-41.85	-51.85	68	84.3
OW-953U	362763.23	2944471.73	28.92	29.85	8	46.0	35	45	-6.08	-16.08	33	48.3
OW-954L	366205.82	2943894.23	35.04	36.00	8	99.0	88	98	-52.96	-62.96	85.5	101
OW-954U	366226.26	2943893.54	34.93	35.76	8	46.0	35	45	-0.07	-10.07	31.6	48
OW-955L	360460.40	2947404.98	31.04	32.13	8	81.0	70	80	-38.96	-48.96	68	82.6
OW-955U	360480.39	2947416.47	31.47	32.46	8	40.0	34	39	-2.53	-7.53	28.8	42
OW-956L	362511.04	2950303.01	28.44	29.46	8	109.0	98	108	-69.56	-79.56	96	111
OW-956U	362530.03	2950299.85	28.30	29.38	8	29.0	18	28	10.30	0.30	16	31.1
OW-957L	359306.58	2949329.92	26.03	27.11	8	114.0	103	113	-76.97	-86.97	99	116
OW-957U	359317.03	2949312.63	26.04	27.15	8	34.0	23	33	3.04	-6.96	19.1	36
OW-958L	358670.38	2951490.10	25.45	26.45	8	107.9	96.9	106.9	-71.45	-81.45	95	110.3
OW-958U	358680.12	2951469.62	25.53	26.71	8	34.0	23	33	2.53	-7.47	20.5	36.5
OW-959L	358450.62	2953295.27	25.71	26.62	8	83.0	72	82	-46.29	-56.29	70	85
OW-959U	358471.62	2953293.97	25.85	26.56	8	36.0	25	35	0.85	-9.15	23	38.4
OW-960L	357243.33	2953301.59	19.57	20.62	8	102.5	91.5	101.5	-71.93	-81.93	89.5	106
OW-960U	357252.83	2953287.27	19.56	20.50	8	39.0	28	38	-8.44	-18.44	23.5	41.8
OW-961L	356174.13	2955403.42	14.40	15.45	8	105.0	94	104	-79.60	-89.60	91	107.2
OW-961U	356192.25	2955405.53	13.90	15.14	8	25.0	14	24	-0.10	-10.10	12	29.3

Table 2.4S.12-1 Observation Well Construction Details (Continued)

Well Number [2]	Northing (ft) [3]	Easting (ft) [3]	Well Pad Elevation	Reference Elevation	Borehole Diameter (in)	Well Depth	Screen Interval Depth [4]		Screen Interval Elevation [4]		Filter Pack Interval Depth	
			(ft MSL) [3]	(ft MSL) [3]		(ft bgs)	Top (ft bgs)	Bottom (ft bgs)	Top (ft MSL)	Bottom (ft MSL)	Top (ft bgs)	Bottom (ft bgs)
OW-962L	365206.43	2948585.95	32.15	33.17	8	116.0	105	115	-72.85	-82.85	103	118.1
OW-962U	365225.67	2948584.56	32.20	33.14	8	43.0	32	42	0.20	-9.80	30	45.1

Abbreviations: ft MSL = feet mean sea level, ft bgs = feet below ground surface, and in = inches.

- [1] Well collapsed and was abandoned 02/07/07 following installation of replacement well OW-332L(R).  
[2] "L" suffix wells installed in Lower Shallow Aquifer and "U" suffix wells installed in Upper Shallow Aquifer.  
[3] Coordinates based on the North American Datum of 1927 (NAD27) and elevations based on National Geodetic Vertical Datum of 1929 (NGVD29).  
[4] Observation well screens are 2 in diameter, 0.020 in slot width, 10 ft in length (except OW-955U, which is 5 ft in length).

Table 2.4S.12-2 STP Production Well Information

Well No.	Year Drilled	Depth (ft)	Capacity (gpm)	Potable Water Source (Yes/No)	Casing Diameter (in)	Discharge Diameter (in)	Location	
							Latitude	Longitude
5	1975	700	500	Yes	10.02	6.065	28° 47' 08.215"	96° 01' 52.731"
6	1977	700	500	Yes	10.02	6.065	28° 47' 08.340"	96° 04' 17.906"
7	1977	700	500	Yes	10.02	6.065	28° 46' 42.08"	96° 00' 57.257"
8	1991	600	250	Yes	10.75	4	28° 48' 01.24"	96° 01' 54.36"
Nuclear Training Facility	1985	600	200	No	8	3	28° 47.38'	96° 02.13'

Table 2.4S.12-3 STP Groundwater Withdrawals 1995-2006

Month	1995 (gallons)	1996 (gallons)	1997 (gallons)	1998 (gallons)	1999 (gallons)	2000 (gallons)	2001 (gallons)	2002 (gallons)	2003 (gallons)	2004 (gallons)	2005 (gallons)	2006 (gallons)
January	7,765,025	41,812,919	39,525,831	36,128,090	34,041,991	35,446,250	44,476,292	31,115,804	36,279,188	28,909,250	40,797,000	37,189,345
February	12,521,357	37,551,891	36,180,612	29,461,480	32,117,186	30,568,014	42,574,575	36,198,000	31,944,711	33,323,394	37,531,591	34,819,000
March	22,598,920	41,169,835	38,532,459	36,223,601	29,792,357	32,643,753	48,053,000	33,244,000	28,020,000	38,458,117	32,713,000	35,201,420
April	24,601,783	43,177,241	35,683,774	33,649,929	27,093,385	35,652,764	40,828,467	29,628,405	28,524,378	36,309,169	31,956,336	34,964,690
May	25,618,936	45,752,274	38,428,753	38,956,861	35,593,523	36,847,100	35,327,680	37,118,205	43,365,000	27,088,736	36,310,300	37,782,730
June	19,654,117	41,995,128	35,811,044	42,057,320	31,347,265	40,259,759	35,534,592	36,604,000	29,816,000	28,819,186	37,885,740	33,220,900
July	31,055,407	35,369,911	43,862,008	41,054,570	37,595,060	43,141,872	35,660,218	30,254,000	36,912,782	31,785,000	40,315,960	33,538,680
August	33,187,388	32,728,731	42,628,395	36,127,366	36,092,764	43,008,513	38,193,859	29,863,036	45,828,000	30,803,058	38,457,620	32,946,400
Sept.	24,719,646	33,787,725	37,324,840	34,910,719	36,325,308	40,309,148	31,716,791	33,151,000	39,865,019	41,838,634	31,230,060	36,836,000
October	25,744,319	42,742,696	34,426,989	38,050,780	30,770,476	38,460,958	37,052,232	25,675,791	37,863,296	31,538,000	36,540,206	29,407,550
November	22,606,096	38,944,140	35,413,702	32,764,920	36,391,863	31,657,842	30,886,310	33,875,759	37,353,000	28,499,573	34,429,744	38,474,080
December	21,338,258	39,694,275	33,674,338	34,950,153	36,841,789	29,493,213	33,436,651	34,751,855	30,409,159	41,168,000	24,196,105	39,554,770
<b>Total (gallons)</b>	<b>271,411,252</b>	<b>474,726,766</b>	<b>451,492,745</b>	<b>434,335,789</b>	<b>404,002,967</b>	<b>437,489,186</b>	<b>453,740,667</b>	<b>391,479,855</b>	<b>426,180,533</b>	<b>398,540,117</b>	<b>422,333,662</b>	<b>423,935,565</b>
<b>Total (acre-feet)</b>	<b>833</b>	<b>1,457</b>	<b>1,386</b>	<b>1,333</b>	<b>1,240</b>	<b>1,343</b>	<b>1,392</b>	<b>1,201</b>	<b>1,308</b>	<b>1,223</b>	<b>1,296</b>	<b>1,301</b>

**Table 2.4S.12-4 Listing of U.S. Environmental Protection Agency (EPA) Safe Drinking Water Information System (SDWIS) Community and Non-Community Groundwater Systems in Matagorda County, Texas**

<b>Community Water Systems:</b> Water Systems that serve the same people year-round (e.g. in homes or businesses)					
<b>Water System Name</b>	<b>County(s) Served</b>	<b>Population Served</b>	<b>Primary Water Source Type</b>	<b>System Status</b>	<b>Water System ID</b>
Camelot Forest Water System	Matagorda	309	Groundwater	Active	TX1610058
Caney Creek Haven Club Water System	Matagorda	348	Groundwater	Active	TX1610049
Caney Creek Mud of Matagorda County	Matagorda	3000	Groundwater	Active	TX1610087
City Of Bay City	Matagorda	19000	Groundwater	Active	TX1610001
City Of Palacios	Matagorda	5100	Groundwater	Active	TX1610004
Eldorado Water Co	Matagorda	270	Groundwater	Active	TX1610024
Frost Mobile Home Park	Matagorda	90	Groundwater	Active	TX1610097
Hubert Watson Subdivision Water System I	Matagorda	90	Groundwater	Active	TX1610114
LCRA Matagorda Dunes Subdivision	Matagorda	381	Groundwater	Active	TX1610052
Live Oak Bend WSC	Matagorda	369	Groundwater	Active	TX1610012
Markham Mud	Matagorda	1200	Groundwater	Active	TX1610006
Matagorda County WCID 2	Matagorda	50	Groundwater	Active	TX1610016
Matagorda County WCID 5	Matagorda	990	Groundwater	Active	TX1610002
Matagorda County WCID 6	Matagorda	1173	Groundwater	Active	TX1610007
Matagorda WSC	Matagorda	975	Groundwater	Active	TX1610013
Midfield WSC	Matagorda	300	Groundwater	Active	TX1610086
Oak Hollow Subdivision	Matagorda	63	Groundwater	Active	TX1610031
Pecan Shadows Water Supply Company	Matagorda	100	Groundwater	Active	TX1610014
River Oaks WSC	Matagorda	384	Groundwater	Active	TX1610018
Selkirk Water	Matagorda	540	Groundwater	Active	TX1610027
Tidewater Oaks Subdivision	Matagorda	165	Groundwater	Active	TX1610033
Tres Palacios Oaks Subdivision	Matagorda	426	Groundwater	Active	TX1610017
Wadsworth WSC	Matagorda	450	Groundwater	Active	TX1610015



**Table 2.4S.12-4 Listing of U.S. Environmental Protection Agency (EPA) Safe Drinking Water Information System (SDWIS) Community and Non-Community Groundwater Systems in Matagorda County, Texas (Continued)**

<b>Non-Transient Non-Community Water Systems:</b> Water Systems that serve the same people, but not year-round (e.g. schools that have their own water system)					
<b>Water System Name</b>	<b>County(s) Served</b>	<b>Population Served</b>	<b>Primary Water Source Type</b>	<b>System Status</b>	<b>Water System ID</b>
Celanese Ltd Bay City Plant	Matagorda	200	Groundwater	Active	TX1610055
Equistar Chemical LP	Matagorda	254	Groundwater	Active	TX1610089
Main Potable Water System	Matagorda	1300	Groundwater	Active	TX1610051
NSC NTF Potable Water System	Matagorda	1300	Groundwater	Active	TX1610103
Tidehaven High School TISD	Matagorda	291	Groundwater	Active	TX1610056
Tidehaven Intermediate School TISD	Matagorda	221	Groundwater	Active	TX1610057
Berts RV Park	Matagorda	50	Groundwater	Active	TX1610065
City of Letulle Park Bay City	Matagorda	75	Groundwater	Active	TX1610047
Letulle Estates Chinquapin 1	Matagorda	52	Groundwater	Active	TX1610005
Matagorda County Nature Center Inc	Matagorda	50	Groundwater	Active	TX1610124
Pier 57	Matagorda	25	Groundwater	Active	TX1610042
Rio Colorado Golf Course	Matagorda	35	Groundwater	Active	TX1610119
Riverside Park Water Bay City	Matagorda	200	Groundwater	Active	TX1610118
T W E Enterprises Inc	Matagorda	25	Groundwater	Active	TX1610125
Texas Aquaculture	Matagorda	25	Groundwater	Active	TX1610127
Texas State Marine Education Center	Matagorda	50	Groundwater	Active	TX1610117
VFW Post 2438	Matagorda	100	Groundwater	Active	TX1610081

Source: Reference 2.4S.12-10

**Table 2.4S.12-5 Matagorda County Historical Water Use**

<b>Historical Water Use Summary by Groundwater (GW) and Surface Water (SW)</b>								
<b>Unit: Acre Feet</b>								
<b>Year</b>	<b>Source</b>	<b>Municipal</b>	<b>Manufacturing</b>	<b>Steam Electric</b>	<b>Irrigation</b>	<b>Mining</b>	<b>Livestock</b>	<b>Total</b>
1974	GW	3,818	280	0	36,615	288	158	41,159
1974	SW	0	5,568	0	172,244	0	1,373	179,185
<b>Total</b>		3,818	5,848	0	208,859	288	1,531	220,344
1980	GW	5,912	1,688	0	29,997	357	600	38,554
1980	SW	0	4,238	0	269,616	0	400	274,254
<b>Total</b>		5,912	5,926	0	299,613	357	1,000	312,808
1984	GW	5,887	2,025	0	30,639	172	833	39,556
1984	SW	0	2,509	0	237,151	77	554	240,291
<b>Total</b>		5,887	4,534	0	267,790	249	1,387	279,847
1985	GW	5,729	2,367	0	24,666	119	823	33,704
1985	SW	0	2,958	0	195,594	68	547	199,167
<b>Total</b>		5,729	5,325	0	220,260	187	1,370	232,871
1986	GW	5,593	2,213	1,351	25,127	235	550	35,069
1986	SW	0	3,435	3,989	186,122	71	367	193,984
<b>Total</b>		5,593	5,648	5,340	211,249	306	917	229,053
1987	GW	5,830	974	1,296	21,934	266	611	30,911
1987	SW	0	3,012	0	162,468	65	406	165,951
<b>Total</b>		5,830	3,986	1,296	184,402	331	1,017	196,862
1988	GW	5,381	1,975	1,451	34,054	185	652	43,698
1988	SW	0	2,758	30,613	252,246	69	434	286,120
<b>Total</b>		5,381	4,733	32,064	286,300	254	1,086	329,818
1989	GW	5,172	2,966	1,462	8,901	250	683	19,434
1989	SW	0	3,581	32,349	204,859	0	454	241,243
<b>Total</b>		5,172	6,547	33,811	213,760	250	1,137	260,677
1990	GW	5,225	3,514	1,158	26,717	250	673	37,537
1990	SW	0	3,293	34,757	168,825	0	447	207,322
<b>Total</b>		5,225	6,807	35,915	195,542	250	1,120	244,859
1991	GW	4,906	4,028	879	26,172	295	687	36,967
1991	SW	0	2,686	13,031	166,168	0	458	182,343
<b>Total</b>		4,906	6,714	13,910	192,340	295	1,145	219,310
1992	GW	4,982	4,037	1,036	18,086	266	614	29,021
1992	SW	0	4,882	28,380	162,680	0	409	196,351
<b>Total</b>		4,982	8,919	29,416	180,766	266	1,023	225,372
1993	GW	5,190	4,834	776	16,827	266	634	28,527
1993	SW	0	4,346	6,918	195,879	0	423	207,566
<b>Total</b>		5,190	9,180	7,694	212,706	266	1,057	236,093

**Table 2.4S.12-5 Matagorda County Historical Water Use (Continued)**

<b>Historical Water Use Summary by Groundwater (GW) and Surface Water (SW)</b>								
<b>Unit: Acre Feet</b>								
<b>Year</b>	<b>Source</b>	<b>Municipal</b>	<b>Manufacturing</b>	<b>Steam Electric</b>	<b>Irrigation</b>	<b>Mining</b>	<b>Livestock</b>	<b>Total</b>
1994	GW	4,902	6,560	833	12,382	273	694	25,644
1994	SW	0	3,360	23,330	241,826	0	463	268,979
	<b>Total</b>	4,902	9,920	24,163	254,208	273	1,157	294,623
1995	GW	4,977	6,579	1,201	22,481	277	604	36,119
1995	SW	0	5,991	37,392	261,684	0	402	305,469
	<b>Total</b>	4,977	12,570	38,593	284,165	277	1,006	341,588
1996	GW	5,460	7,534	1,457	21,781	277	1,048	37,557
1996	SW	0	3,002	38,905	253,533	0	698	296,138
	<b>Total</b>	5,460	10,536	40,362	275,314	277	1,746	333,695
1997	GW	4,867	5,764	1,386	1,581	251	564	14,413
1997	SW	0	2,846	12,156	122,924	0	376	138,302
	<b>Total</b>	4,867	8,610	13,542	124,505	251	940	152,715
1998	GW	5,137	4,733	1,333	2,249	196	676	14,324
1998	SW	0	2,933	20,924	174,951	0	452	199,260
	<b>Total</b>	5,137	7,666	22,257	177,200	196	1,128	213,584
1999	GW	5,170	4,686	1,240	3,119	196	676	15,087
1999	SW	0	3,656	25,217	242,648	0	452	271,973
	<b>Total</b>	5,170	8,342	26,457	245,767	196	1,128	287,060
2000	GW	5,502	2,649	1,313	17,283	481	943	28,171
2000	SW	0	7,706	59,712	140,603	0	628	208,649
	<b>Total</b>	5,502	10,355	61,025	157,886	481	1,571	236,820
2001	GW	2,499	3,210	4,965	13,794	131	710	25,309
2001	SW	0	6,019	43,547	177,159	0	474	227,199
	<b>Total</b>	2,499	9,229	48,512	190,953	131	1,184	252,508
2002	GW	2,290	3,488	4,439	13,751	131	690	24,789
2002	SW	0	6,541	38,930	111,261	0	459	157,191
	<b>Total</b>	2,290	10,029	43,369	125,012	131	1,149	181,980
2003	GW	3,160	3,490	4,439	41,954	131	912	54,086
2003	SW	0	6,545	38,930	151,200	0	490	197,165
	<b>Total</b>	3,160	10,035	43,369	193,154	131	1,402	251,251
2004	GW	2,753	4,979	4,656	32,196	131	978	45,693
2004	SW	0	9,335	40,836	154,625	0	526	205,322
	<b>Total</b>	2,753	14,314	45,492	186,821	131	1,504	251,015

Source: Reference 2.4S.12-13

**Table 2.4S.12-6 Matagorda County Projected Water Use**

<b>Category</b>	<b>Acre-Feet</b>					
	<b>2010</b>	<b>2020</b>	<b>2030</b>	<b>2040</b>	<b>2050</b>	<b>2060</b>
Municipal	5590	5830	5906	5883	5815	5762
Manufacturing	12180	13253	13991	14686	15259	16267
Steam Electric	80000	80000	102000	102000	102000	102000
Irrigation	193048	186072	179353	172916	166722	160750
Mining	177	172	169	167	165	163
Livestock	1151	1151	1151	1151	1151	1151
<b>Total</b>	<b>292146</b>	<b>286478</b>	<b>302570</b>	<b>296803</b>	<b>291112</b>	<b>286093</b>

Source: Reference 2.4S.12-14

Table 2.4S.12-7 STP 3 &amp; 4 Area Monthly Groundwater Levels

WELL ID	WELL DEPTH	BOTTOM OF SCREEN	REFERENCE POINT ELEVATION	December 28, 2006		January 30, 2007		February 22, 2007		March 29, 2007		April 27, 2007		May 25, 2007		June 27, 2007		July 30, 2007		August 30, 2007 <sup>(a)</sup>		September 26, 2007		October 30, 2007		November 19, 2007		December 17, 2007		March 28, 2008		June 29, 2008		September 22, 2008		December 15, 2008			
				Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)	Depth to Water (ft)	Elevation (ft msl)		
<b>Shallow Aquifer - Upper Zone</b>																																							
OW-332 U	46.1	45.0	32.10	7.70	24.09	6.40	25.54	7.40	24.54	7.41	24.53	7.70	24.48	8.30	24.44	7.30	24.50	7.70	24.48	8.30	24.45	8.00	23.71	8.40	23.40	8.20	23.51	7.90	24.11	8.90	22.50	10.11	21.00	9.20	22.51				
OW-332 U	46.1	45.0	32.10	8.00	24.09	6.50	25.53	7.40	24.44	7.30	24.51	7.50	24.50	8.30	24.45	7.40	24.49	7.70	24.44	8.30	24.40	8.00	23.71	8.40	23.40	8.20	23.51	7.90	24.11	8.90	22.50	10.11	21.00	9.20	22.51				
OW-348 U	39.1	39.0	32.28	8.00	24.19	6.50	25.76	7.70	24.57	7.66	24.67	7.34	24.94	7.25	25.03	7.35	24.93	8.34	24.04	7.20	25.51																		
OW-349 U	46.1	45.0	31.29	7.70	24.01	6.50	25.41	6.90	24.32	6.91	24.30	6.50	24.70	6.70	24.50	6.80	24.31	7.60	23.81	7.30	24.70																		
OW-400 U	43.1	42.0	31.57	9.10	23.98	8.50	23.21	9.10	24.44	9.00	24.47	8.95	24.52	8.94	24.51	8.10	24.29	9.00	23.70	10.20	23.34	10.20	23.34	10.20	23.34	10.20	23.34	10.20	23.34	10.20	23.34	10.20	23.34	10.20	23.34	10.20	23.34		
OW-400 U	49.1	48.0	33.79	8.30	23.81	6.42	25.33	9.32	24.47	9.20	24.53	9.08	24.71	8.90	24.83	9.50	24.20	8.20	25.59	8.10	27.10																		
OW-400 U	41.0	40.0	32.18	8.40	23.78	6.50	25.40	7.20	24.20	7.14	24.26	7.00	24.36	6.30	24.86	7.40	24.16	7.50	24.63	8.40	22.70																		
OW-400 U	38.1	37.0	33.32	8.10	23.21	7.60	24.70	8.30	24.00	8.20	24.08	8.10	24.32	7.50	24.74	8.40	23.92	8.30	23.83	9.20	23.10																		
OW-400 U	39.1	38.0	31.69	8.10	23.51	6.41	25.40	8.05	24.64	8.12	24.47	8.09	25.00	8.50	25.10	7.30	24.36	8.00	25.05	6.90	24.74																		
OW-400 U	36.1	35.0	32.71	9.10	23.21	7.50	24.70	8.30	24.00	8.20	24.08	8.10	24.32	7.50	24.74	8.40	23.92	8.30	23.83	9.20	23.10																		
OW-400 U	38.1	37.0	27.31	7.50	19.41	5.10	21.54	7.00	20.20	6.88	20.33	6.45	20.88	5.80	21.08	6.00	21.24	7.10	20.21	8.00	19.30																		
OW-400 U	36.0	35.0	33.10	8.50	22.28	6.81	23.29	8.43	22.67	8.34	22.70	8.19	22.91	8.25	22.85	8.33	22.77	9.00	23.10	8.30	22.80																		
OW-400 U	39.5	38.5	32.63	8.50	24.31	7.00	25.00	8.40	24.72	7.86	24.87	7.77	25.05	7.69	25.15	8.21	24.56	6.94	25.59	7.04	24.50																		
OW-400 U	37.1	36.0	30.82	8.44	24.70	4.90	23.05	8.50	24.67	8.01	24.71	8.57	25.02	8.50	25.13	8.07	24.75	4.61	25.01	5.40	25.20																		
OW-400 U	41.1	40.0	30.39	10.20	20.17	9.54	20.89	10.04	20.32	10.08	20.31	9.81	20.43	10.00	20.30	10.30	20.03	9.50	20.83	10.00	20.30																		
OW-400 U	42.0	41.0	29.33																																				
OW-400 U	30.0	29.0	31.30																																				
OW-400 U	45.0	44.0	30.38																																				
OW-400 U	46.0	45.0	29.85																																				
OW-400 U	46.0	45.0	35.76																																				
OW-400 U	40.0	39.0	32.46																																				
OW-400 U	39.0	38.0	32.38																																				
OW-400 U	34.0	33.0	27.15																																				
OW-400 U	34.0	33.0	26.71																																				
OW-400 U	36.0	35.0	20.58																																				
OW-400 U	39.0	38.0	20.50																																				
OW-400 U	25.0	24.0	15.14																																				
OW-400 U	43.0	42.0	33.14																																				
<b>Shallow Aquifer - Lower Zone</b>																																							
OW-332 L <sup>(b)</sup>	97.1	96.0	31.78	16.00	15.70	15.00	16.70	14.91	16.81	14.01	17.11	14.21	17.31	14.32	17.40	14.30	17.40	12.90	18.30	13.40	18.30	13.40	18.30	13.40	18.30	13.40	18.30	13.40	18.30	13.40	18.30	13.40	18.30	13.40	18.30	13.40	18.30		
OW-332 L <sup>(b)</sup>	103.2	102.1	31.85	15.22	16.63																																		
OW-333 L <sup>(b)</sup>	103.0	102.0	32.08																																				
OW-348 L	79.1	78.2	31.88	18.10	15.70	15.00	16.70	14.94	16.82	14.73	17.10	14.20	17.31	14.40	17.30	13.02	18.30	13.00	18.20	13.60	18.10																		
OW-349 L	81.1	80.0	31.03	15.22	16.91	14.19	16.84	14.50	17.01	13.80	17.23	13.35	17.80	13.40	17.55	13.42	17.61	12.02	19.38	12.50	18.50																		
OW-400 L	81.3	80.2	33.76	18.00	15.71	15.00	16.71	14.88	16.62	16.64	17.12	14.20	17.50	14.32	17.44	14.60	17.30	15.40	18.30	15.50	18.10																		
OW-400 L	104.1	103.0	31.57	15.80	16.72	14.88	16.41	14.75	16.83	14.40	17.00	14.00	17.50	14.12	17.43	14.10	17.41	12.70	18.70	13.30	18.10																		
OW-400 L	92.1	91.0	32.48	18.60	15.68	16.22	16.20	15.71	16.71	15.40	16.84	15.21	17.11	15.22	17.40	15.10	17.40	14.40	17.50	14.40	17.40																		
OW-400 L	121.1	120.0	31.56	15.70	16.81	15.00	16.50	14.75	16.81	14.50	17.00	14.00	17.50	14.00	17.40	13.20	18.60	13.20	18.30	13.30	18.10																		
OW-400 L	88.1	87.0	30.63	22.40	15.10	22.41	16.24	22.20	16.20	22.00	16.60	21.51	17.12	21.70	16.60	21.61	16.00	20.10	17.60	20.40	16.70																		
OW-400 L	108.5	107.0	29.88	14.50	17.08	13.41	14.51	13.30	14.60	13.21	14.71	13.11	15.00	14.80	15.00	14.60	14.90	13.20	15.10	14.40	14.40																		
OW-400 L	79.9	78.5	32.79	17.20	15.59	16.01	16.73	15.30	16.80	15.73	17.00	15.35	17.44	15.48	17.31	15.50	17.41	14.14	18.00	14.50	17.40																		
OW-400 L	87.1	86.0	30.45	14.60	16.95	13.37	17.00	13.20	17.10	13.11	17.34	12.71	17.15	12.84	17.01	12.71	17.10	11.42	18.00	11.80	17.60																		
OW-400 L	100.0	99.0	30.94	17.00	15.87	15.83	15.11	15.71	15.21	15.51	15.43	15.00	15.85	15.33	15.61	15.20	15.71	13.70	17.10	14.40	16.50																		
OW-400 L	132.0	131.0	29.03																																				
OW-400 L	128.0	127.0	30.86																																				
OW-400 L	80.0	79.0	30.71																																				
OW-400 L	82.0	81.0	30.07																																				
OW-400 L	69.0	68.0	30.00																																				
OW-400 L	81.0	80.0	32.13																																				

Notes:

(1) OW-392 L was hit or broken in January 2007. The well was plugged & abandoned and a replacement well, OW-392 L (R) was installed and developed in February 2007 prior to the February 2007 monthly water level measurement round.

(2) The August 2007 depth to groundwater readings for observation wells OW-400 L & OW-420 L are considered to be anomalous as discussed in Subsection 2.4S.12.3.3.

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
12/28/2006	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.02	15.70	8.32	0.166
01/30/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	25.34	16.70	8.64	0.173
02/22/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.34	16.87	7.47	0.149
03/29/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.39	17.11	7.28	0.146
04/27/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.63	17.57	7.06	0.141
05/25/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.73	17.46	7.27	0.145
06/27/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.08	17.48	6.60	0.132
07/30/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	25.44	18.83	6.61	0.132
08/30/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.50	18.38	6.12	0.122
09/26/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.30	18.18	6.12	0.122
10/30/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	23.71	17.58	6.13	0.123
11/19/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	23.40	17.18	6.22	0.124
12/17/2007	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	23.57	16.98	6.59	0.132
03/28/2008	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	24.11	17.22	6.89	0.138
06/29/2008	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	22.84	16.10	6.74	0.135
09/22/2008	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	21.68	15.39	6.29	0.126
12/15/2008	OW-308 U/L	29.88	36	46	41	-11.12	29.87	86	96	91	-61.13	50	22.51	15.36	7.15	0.143
12/28/2006	OW-332 U/L	30.24	35	45	40	-9.76	30.24	92.1	102.1	97.1	-66.86	57.1	24.09	16.63	7.46	0.131
02/22/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	24.64	16.79	7.85	0.137
03/29/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	24.71	17.03	7.68	0.134
04/27/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	25.85	17.49	8.36	0.146
05/25/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	25.01	17.37	7.64	0.134
06/27/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	24.05	17.40	6.65	0.116
07/30/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	25.60	18.76	6.84	0.120
08/30/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	24.70	18.28	6.42	0.112
09/26/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	24.45	18.13	6.32	0.110
10/30/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	23.67	17.50	6.17	0.108

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
11/19/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	23.30	17.09	6.21	0.109
12/17/2007	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	23.50	16.91	6.59	0.115
03/28/2008	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	24.43	17.15	7.28	0.127
06/29/2008	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	22.59	16.03	6.56	0.115
09/22/2008	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	21.23	15.32	5.91	0.103
12/15/2008	OW-332 U/L(R)	30.24	35	45	40	-9.76	30.01	92	102	97	-66.99	57.2	22.49	15.30	7.19	0.126
12/28/2006	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.19	15.70	8.49	0.209
01/30/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	25.76	16.78	8.98	0.221
02/22/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.57	16.92	7.65	0.188
03/29/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.62	17.15	7.47	0.184
04/27/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.94	17.57	7.37	0.182
05/25/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	25.03	17.46	7.57	0.186
06/27/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.33	17.50	6.83	0.168
07/30/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	25.94	18.81	7.13	0.176
08/30/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.78	18.36	6.42	0.158
09/26/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.50	18.21	6.29	0.155
10/30/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	23.86	17.61	6.25	0.154
11/19/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	23.49	17.19	6.30	0.155
12/17/2007	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	23.72	16.99	6.73	0.166
03/28/2008	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	24.28	17.20	7.08	0.174
06/29/2008	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	22.98	16.07	6.91	0.170
09/22/2008	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	21.88	15.32	6.56	0.162
12/15/2008	OW-348 U/L	30.51	28	38	33	-2.49	30.08	68.2	78.2	73.2	-43.12	40.6	22.57	15.28	7.29	0.180
12/28/2006	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.01	15.81	8.20	0.234
01/30/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	25.47	16.84	8.63	0.247
02/22/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.32	17.01	7.31	0.209
03/29/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.38	17.23	7.15	0.204

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
04/27/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.73	17.68	7.05	0.201
05/25/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.79	17.55	7.24	0.207
06/27/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.10	17.61	6.49	0.185
07/30/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	25.67	18.98	6.69	0.191
08/30/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.59	18.53	6.06	0.173
09/26/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.31	18.31	6.00	0.171
10/30/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	23.68	17.71	5.97	0.171
11/19/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	23.32	17.29	6.03	0.172
12/17/2007	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	23.54	17.09	6.45	0.184
03/28/2008	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	24.07	17.32	6.75	0.193
06/29/2008	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	22.74	16.19	6.55	0.187
09/22/2008	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	21.56	15.45	6.11	0.175
12/15/2008	OW-349 U/L	29.40	35	45	40	-10.6	29.41	70	80	75	-45.59	35	22.34	15.41	6.93	0.198
12/28/2006	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	23.86	15.71	8.15	0.214
01/30/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	25.27	16.71	8.56	0.225
02/22/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.44	16.90	7.54	0.198
03/29/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.49	17.12	7.37	0.194
04/27/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.62	17.56	7.06	0.186
05/25/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.63	17.44	7.19	0.189
06/27/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.10	17.48	6.62	0.174
07/30/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	25.38	18.80	6.58	0.173
08/30/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	27.47	18.36	9.11	0.240
09/26/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.29	18.18	6.11	0.161
10/30/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	23.76	17.59	6.17	0.162
11/19/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	23.34	17.18	6.16	0.162
12/17/2007	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	23.45	16.99	6.46	0.170
03/28/2008	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	24.17	17.22	6.95	0.183



Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
06/29/2008	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	22.86	16.11	6.75	0.178
09/22/2008	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	21.72	15.38	6.34	0.167
12/15/2008	OW-408 U/L	31.50	32	42	37	-5.5	31.73	70.2	80.2	75.2	-43.47	38	22.52	15.35	7.17	0.189
12/28/2006	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	23.73	15.72	8.01	0.126
01/30/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	25.63	16.61	9.02	0.142
02/22/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	24.97	16.82	8.15	0.129
03/29/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	25.04	17.08	7.96	0.126
04/27/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	25.01	17.55	7.46	0.118
05/25/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	25.18	17.45	7.73	0.122
06/27/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	24.21	17.47	6.74	0.106
07/30/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	25.86	18.78	7.08	0.112
08/30/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	24.78	18.37	6.41	0.101
09/26/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	24.63	18.17	6.46	0.102
10/30/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	23.64	17.59	6.05	0.095
11/19/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	23.20	17.20	6.00	0.095
12/17/2007	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	23.30	17.02	6.28	0.099
03/28/2008	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	24.63	17.25	7.38	0.116
06/29/2008	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	22.71	16.19	6.52	0.103
09/22/2008	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	21.43	15.50	5.93	0.094
12/15/2008	OW-438 U/L	30.53	30	40	35	-4.47	30.11	93	103	98	-67.89	63.4	22.42	15.46	6.96	0.110
12/28/2006	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	23.21	15.86	7.35	0.131
01/30/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	24.75	16.26	8.49	0.152
02/22/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	24.02	16.71	7.31	0.131
03/29/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	24.09	16.89	7.20	0.129
04/27/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	24.22	17.21	7.01	0.125
05/25/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	24.32	17.26	7.06	0.126
06/27/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	23.83	17.35	6.48	0.116

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
07/30/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	24.79	17.99	6.80	0.122
08/30/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	23.92	18.03	5.89	0.105
09/26/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	23.82	17.98	5.84	0.104
10/30/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	23.03	17.72	5.31	0.095
11/19/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	22.80	17.49	5.31	0.095
12/17/2007	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	22.91	17.31	5.60	0.100
03/28/2008	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	23.89	17.14	6.75	0.121
06/29/2008	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	22.29	16.34	5.95	0.106
09/22/2008	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	21.26	15.46	5.80	0.104
12/15/2008	OW-910 U/L	30.69	25	35	30	0.69	30.75	81	91	86	-55.25	55.9	21.97	15.26	6.71	0.120
12/28/2006	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	23.51	15.81	7.70	0.094
01/30/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	25.48	16.56	8.92	0.109
02/22/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	24.84	16.81	8.03	0.098
03/29/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	24.97	17.06	7.91	0.097
04/27/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	25.00	17.53	7.47	0.091
05/25/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	25.10	17.43	7.67	0.094
06/27/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	24.36	17.50	6.86	0.084
07/30/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	25.60	18.66	6.94	0.085
08/30/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	24.74	18.31	6.43	0.079
09/26/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	24.47	18.21	6.26	0.077
10/30/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	23.38	17.66	5.72	0.070
11/19/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	23.05	17.31	5.74	0.070
12/17/2007	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	23.17	17.15	6.02	0.074
03/28/2008	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	24.55	17.31	7.24	0.089
06/29/2008	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	22.37	15.65	6.72	0.082
09/22/2008	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	21.21	15.64	5.57	0.068
12/15/2008	OW-928 U/L	30.02	28.5	38.5	33.5	-3.48	29.81	110	120	115	-85.19	81.7	21.70	15.53	6.17	0.076

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
12/28/2006	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	25.79	15.16	10.63	0.280
01/30/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	27.38	16.22	11.16	0.294
02/22/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	27.03	16.37	10.66	0.281
03/29/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	26.96	16.63	10.33	0.272
04/27/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	26.94	17.12	9.82	0.258
05/25/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	26.90	16.93	9.97	0.262
06/27/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	25.54	16.96	8.58	0.226
07/30/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	27.49	18.45	9.04	0.238
08/30/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	26.56	17.88	8.68	0.228
09/26/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	26.51	17.68	8.83	0.232
10/30/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	24.98	17.00	7.98	0.210
11/19/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	23.98	16.59	7.39	0.194
12/17/2007	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	24.52	16.42	8.10	0.213
03/28/2008	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	26.39	16.73	9.66	0.254
06/29/2008	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	21.60	15.50	6.10	0.161
09/22/2008	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	21.08	14.80	6.28	0.165
12/15/2008	OW-929 U/L	36.91	49	59	54	-17.09	36.93	87	97	92	-55.07	38	24.26	14.82	9.44	0.248
12/28/2006	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	19.41	13.08	6.33	0.091
01/30/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	21.54	14.57	6.97	0.100
02/22/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	20.28	14.63	5.65	0.081
03/29/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	20.35	14.77	5.58	0.080
04/27/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	20.88	15.17	5.71	0.082
05/25/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	20.02	14.89	5.13	0.074
06/27/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	19.36	14.99	4.37	0.063
07/30/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	21.24	16.35	4.89	0.070
08/30/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	20.23	15.78	4.45	0.064
09/26/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	19.28	15.48	3.80	0.055

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
10/30/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	18.71	15.04	3.67	0.053
11/19/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	18.94	14.64	4.30	0.062
12/17/2007	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	18.98	14.44	4.54	0.065
03/28/2008	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	19.65	14.67	4.98	0.072
06/29/2008	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	17.57	13.23	4.34	0.063
09/22/2008	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	16.49	12.33	4.16	0.060
12/15/2008	OW-930 U/L	25.62	25	35	30	-4.38	26.21	95	105	100	-73.79	69.4	17.84	12.32	5.52	0.080
12/28/2006	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.31	15.56	8.75	0.217
01/30/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	25.80	16.78	9.02	0.224
02/22/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.79	16.89	7.90	0.196
03/29/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.87	17.06	7.81	0.194
04/27/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	25.06	17.44	7.62	0.189
05/25/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	25.15	17.31	7.84	0.195
06/27/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.56	17.41	7.15	0.177
07/30/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	25.89	18.65	7.24	0.180
08/30/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.93	18.24	6.69	0.166
09/26/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.63	18.04	6.59	0.164
10/30/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.07	17.52	6.55	0.163
11/19/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	23.79	17.09	6.70	0.166
12/17/2007	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.00	16.88	7.12	0.177
03/28/2008	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	24.53	17.03	7.50	0.186
06/29/2008	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	23.29	15.89	7.40	0.184
09/22/2008	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	22.28	15.06	7.22	0.179
12/15/2008	OW-932 U/L	31.35	28.5	38.5	33.5	-2.15	31.09	68.5	78.5	73.5	-42.41	40.3	22.88	15.00	7.88	0.196
12/28/2006	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.18	15.85	8.33	0.166
01/30/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	25.65	17.08	8.57	0.171
02/22/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.67	17.16	7.51	0.150

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
03/29/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.71	17.34	7.37	0.147
04/27/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	25.05	17.74	7.31	0.146
05/25/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	25.12	17.61	7.51	0.150
06/27/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.75	17.73	7.02	0.140
07/30/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	26.01	19.03	6.98	0.139
08/30/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	25.22	18.60	6.62	0.132
09/26/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.82	18.40	6.42	0.128
10/30/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.20	17.84	6.36	0.127
11/19/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	23.84	17.38	6.46	0.129
12/17/2007	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.02	17.15	6.87	0.137
03/28/2008	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	24.30	17.30	7.00	0.140
06/29/2008	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	23.36	16.15	7.21	0.144
09/22/2008	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	22.33	15.33	7.00	0.140
12/15/2008	OW-933 U/L	28.87	26	36	31	-2.13	28.74	76	86	81	-52.26	50.1	22.62	15.26	7.36	0.147
12/28/2006	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.17	13.87	6.30	0.108
01/30/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.85	15.11	5.74	0.098
02/22/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.35	15.21	5.14	0.088
03/29/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.31	15.43	4.88	0.083
04/27/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.48	15.85	4.63	0.079
05/25/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.39	15.61	4.78	0.082
06/27/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.03	15.71	4.32	0.074
07/30/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.83	17.16	3.67	0.063
08/30/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.39	16.54	3.85	0.066
09/26/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.24	16.29	3.95	0.068
10/30/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	19.79	15.71	4.08	0.070
11/19/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	19.84	15.31	4.53	0.077
12/17/2007	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	19.84	15.12	4.72	0.081

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
03/28/2008	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	20.12	15.38	4.74	0.081
06/29/2008	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	19.13	13.97	5.16	0.088
09/22/2008	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	18.02	13.13	4.89	0.084
12/15/2008	OW-934 U/L	28.54	30	40	35	-6.46	29.04	89	99	94	-64.96	58.5	19.29	13.13	6.16	0.105
09/22/2008	OW-950 U/L	28.04	31	41	36	-7.96	27.94	121	131	126	-98.06	90.1	23.68	14.47	9.21	0.102
12/15/2008	OW-950 U/L	28.04	31	41	36	-7.96	27.94	121	131	126	-98.06	90.1	24.17	14.12	10.05	0.112
09/22/2008	OW-951 U/L	30.05	19	29	24	6.05	29.87	117	127	122	-92.13	98.18	22.99	14.85	8.14	0.083
12/15/2008	OW-951 U/L	30.05	19	29	24	6.05	29.87	117	127	122	-92.13	98.18	23.35	14.06	9.29	0.095
09/22/2008	OW-952 U/L	29.39	34	44	39	-9.61	29.45	69	79	74	-44.55	34.94	23.74	14.90	8.84	0.253
12/15/2008	OW-952 U/L	29.39	34	44	39	-9.61	29.45	69	79	74	-44.55	34.94	24.07	14.83	9.24	0.264
09/22/2008	OW-953 U/L	28.92	35	45	40	-11.08	29.15	71	81	76	-46.85	35.77	20.60	15.50	5.10	0.143
12/15/2008	OW-953 U/L	28.92	35	45	40	-11.08	29.15	71	81	76	-46.85	35.77	21.47	15.40	6.07	0.170
09/22/2008	OW-954 U/L	34.93	35	45	40	-5.07	35.04	88	98	93	-57.96	52.89	24.76	15.46	9.30	0.176
12/15/2008	OW-954 U/L	34.93	35	45	40	-5.07	35.04	88	98	93	-57.96	52.89	25.12	15.41	9.71	0.184
09/22/2008	OW-955 U/L	31.47	34	39	36.5	-5.03	31.04	70	80	75	-43.96	38.93	18.88	13.32	5.56	0.143
12/15/2008	OW-955 U/L	31.47	34	39	36.5	-5.03	31.04	70	80	75	-43.96	38.93	18.89	13.29	5.60	0.144
09/22/2008	OW-956 U/L	28.30	18	28	23	5.3	28.44	98	108	103	-74.56	79.86	17.45	12.56	4.89	0.061
12/15/2008	OW-956 U/L	28.30	18	28	23	5.3	28.44	98	108	103	-74.56	79.86	19.17	12.58	6.59	0.083
09/22/2008	OW-957 U/L	26.04	23	33	28	-1.96	26.03	103	113	108	-81.97	80.01	18.43	12.29	6.14	0.077
12/15/2008	OW-957 U/L	26.04	23	33	28	-1.96	26.03	103	113	108	-81.97	80.01	18.41	12.27	6.14	0.077
09/22/2008	OW-958 U/L	25.53	23	33	28	-2.47	25.45	96.9	106.9	101.9	-76.45	73.98	16.57	11.80	4.77	0.064
12/15/2008	OW-958 U/L	25.53	23	33	28	-2.47	25.45	96.9	106.9	101.9	-76.45	73.98	17.55	11.79	5.76	0.078
09/22/2008	OW-959 U/L	25.85	25	35	30	-4.15	25.71	72	82	77	-51.29	47.14	11.14	11.35	0.21	0.004 [3]
12/15/2008	OW-959 U/L	25.85	25	35	30	-4.15	25.71	72	82	77	-51.29	47.14	13.43	11.35	2.08	0.044
09/22/2008	OW-960 U/L	19.56	28	38	33	-13.44	19.57	91.5	101.5	96.5	-76.93	63.49	14.18	11.27	2.91	0.046
12/15/2008	OW-960 U/L	19.56	28	38	33	-13.44	19.57	91.5	101.5	96.5	-76.93	63.49	15.06	11.29	3.77	0.059
09/22/2008	OW-961 U/L	13.90	14	24	19	-5.1	14.40	94	104	99	-84.6	79.5	10.34	10.90	0.56	0.007 [3]

Figure 2.4S.12-8 Estimated Vertical Hydraulic Gradients in the STP 3 &amp; 4 Area (Continued)

Measurement Date	Well Pair	Upper Well Screen [1]					Lower Well Screen [1]					dx	Groundwater Elev. [2]		dh	i
		Ground El	Top	Bottom	Midpoint	Elevation	Ground El	Top	Bottom	Midpoint	Elevation		Upper	Lower		
12/15/2008	OW-961 U/L	13.90	14	24	19	-5.1	14.40	94	104	99	-84.6	79.5	12.68	10.96	1.72	0.022
09/22/2008	OW-962 U/L	32.20	32	42	37	-4.8	32.15	105	115	110	-77.85	73.05	21.57	13.56	8.01	0.110
12/15/2008	OW-962 U/L	32.20	32	42	37	-4.8	32.15	105	115	110	-77.85	73.05	23.36	13.61	9.75	0.133
<p>[1] From Table 2.4S.12-1            [2] From Table 2.4S.12-7            [3] Denotes upward gradient.</p> <p>Observation well OW-332L was damaged in January of 2007, a replacement well, OW-332L(R) was installed and developed in February of 2007 prior to the February monthly water level measurement. Therefore, no data is available from January 30, 2007 for well OW-332 U/L.</p> <p>ft MSL = feet mean sea level            i = Hydraulic gradient (<math>dh/dx</math>)  <math>dh</math> = Change in hydraulic head (ft)  <math>dx</math> = Change in distance (ft)            ft bgs = feet below ground surface</p>																

Table 2.4S.12-9 Regional Aquifer Properties from Aquifer Pumping Tests

Well Number	Test Date	Screened Interval (ft bgs)	Hydraulic Conductivity (gpd/ft <sup>2</sup> )	Transmissivity (gpd/ft)	Storage Coefficient (unitless)	Yield (gpm)	Drawdown or Recovery (ft)	1-Hour Specific Capacity (gpm/ft)	Test Type
TA-65-49-901	3/8/1966	300-355	658	26,300	ND	91.5	10.1	9	Recovery
TA-65-57-702	3/14/1966	331-553	512	25,600	ND	252	36.1	7	Drawdown
TA-65-57-801	7/28/1955	150-530	812	160,000	ND	2,530	ND	ND	Recovery
TA-65-58-107	10/4/1966	75-202	ND	176,000	$1.1 \times 10^{-3}$	NA	NA	NA	Observation well for TA-65-58-108 drawdown test
TA-65-58-108	10/4/1966	150-275	693	86,600	ND	2,378	40.7	58	Drawdown
TA-65-58-803	7/1/1966	91-215	3,950	399,000	ND	1,354	34.2	40	Drawdown
TA-66-63-802	5/25/1966	240-760	582	154,100	ND	2,692	55.9	48	Drawdown
TA-66-63-902	5/26/1966	unknown	753	82,800	$9.1 \times 10^{-4}$	NA	NA	NA	Observation well for TA-66-63-903 drawdown test
TA-66-63-903	5/26/1966	63-240	ND	ND	ND	1,020	ND	ND	Unknown
TA-66-64-401	5/18/1966	317-1,042	386	162,000	ND	3,417	61.6	55	Drawdown
TA-66-64-702	3/14/1966	unknown	223	64,600	ND	2,005	114	18	Recovery
TA-80-07-501	7/13/1955	220-820	403	120,000	ND	1,760	21.3	83	Recovery
TA-80-08-302	10/28/1966	530-630	355	35,500	ND	413	85	5	Recovery
TA-80-08-701	9/23/1966	300-600	212	19,700	ND	805	51.8	16	Recovery
TA-80-15-102	3/9/1967	506-634	458	45,800	ND	408	47.4	9	Recovery
TA-80-15-201	5/15/1955	353-878	420	107,000	ND	2,630	53	50	Drawdown, specific capacity calculated from recovery test
TA-80-15-301	6/10/1966	unknown	413	67,700	ND	1,026	49.3	21	Drawdown
TA-80-15-401	7/13/1955	225-1,044	177	63,000	ND	2,000	47.4	42	Recovery
TA-80-15-502	9/19/1966	244-776	103	31,300	ND	2,020	ND	ND	Recovery
TA-80-16-301	3/10/1967	615-800	505	40,400	ND	158.4	31.6	5	Recovery
TA-80-23-101	7/19/1955	190-776	344	82,500	ND	1,560	34.1	46	Recovery
TA-80-23-301	7/19/1955	200-770	139	51,500	ND	1,535	50.5	30	Recovery
TA-80-23-402	3/17/1967	544-586	ND	44,800	ND	388.5	ND	ND	Recovery
TA-80-23-403	3/17/1967	542-578	ND	42,500	$4.6 \times 10^{-5}$	NA	NA	NA	Observation well for TA-80-23-402 recovery test
TA-81-01-101	10/13/1955	565-760	489	68,500	ND	1,000	NA	NA	Recovery
TA-81-01-102	10/13/1955	777-1,020	214	30,000	ND	915	50	18	Recovery
TA-81-01-601	3/13/1967	218-660	379	42,800	ND	1,290	45.8	28	Recovery
TA-81-01-802	7/18/1955	150-250	269	35,000	ND	1,075	73.2	15	Recovery
TA-81-09-401	3/24/1966	unknown	250	44,300	ND	1,182	83.3	14	Specific capacity calculated from drawdown, permeability and transmissivity from recovery
TA-81-09-504	7/19/1955	150-721	306	53,000	ND	2,000	52.4	38	Recovery
TA-81-09-904	3/16/1967	361-482	717	43,000	$1.27 \times 10^{-3}$	NA	NA	NA	Observation well for TA-81-09-905 recovery test



Table 2.4S.12-9 Regional Aquifer Properties from Aquifer Pumping Tests (Continued)

Well Number	Test Date	Screened Interval (ft bgs)	Hydraulic Conductivity (gpd/ft <sup>2</sup> )	Transmissivity (gpd/ft)	Storage Coefficient (unitless)	Yield (gpm)	Drawdown or Recovery (ft)	1-Hour Specific Capacity (gpm/ft)	Test Type
TA-81-09-905	3/16/1967	364-491	454	29,500	ND	338	27.3	12	Recovery
TA-81-10-901	4/28/1966	280-296	ND	ND	ND	6.4	ND	ND	Unknown
TA-81-10-902	4/28/1966	unknown	ND	10,500	$1.36 \times 10^{-4}$	NA	NA	NA	Observation well for TA-81-10-901 drawdown test
PP-80-06-101	7/8/1955	85-550	727	189,000	ND	1,485	ND	NA	Recovery
PP-80-06-102	9/9/1963	104-364	790	124,000	ND	1,690	29.9	57	Drawdown
PP-80-06-104	9/9/1963	50-215	ND	119,000	$1.4 \times 10^{-3}$	NA	NA	NA	Observation well for PP-80-06-102 drawdown test
PP-80-06-703	7/8/1955	154-590	359	79,000	ND	1,450	36.1	40	Recovery
PP-80-06-704	8/21/1963	146-430	616	104,800	ND	1,500	19.6	77	Recovery
PP-80-22-501	9/5/1963	288-370	361	20,600	ND	540	33.2	16	Recovery
ZA-66-62-904	7/18/1955	162-573	382	102,000	ND	1,430	21	68	Recovery
ZA-66-63-504	3/15/1967	167-682	475	195,300	ND	2,508	37.7	67	Recovery
<b>Geometric Mean</b>			420	63,640	$4.7 \times 10^{-4}$	-	-	-	-

Source: Reference 2.4.12-6

Well County codes:

TA = Matagorda County

PP = Jackson County

ZA = Wharton County

NA = Not applicable to test performed

ND = Not Determined

gpd/ft<sup>2</sup> = gallons per day/square foot  
ft bgs = feet below ground surface  
gpm = gallons per minute  
gpm/ft = gallons per minute/foot

Table 2.4S.12-10 STP Aquifer Pumping Test Results Summary

Well	Screened Interval (ft bgs)	Aquifer	Test Start Date	Pumping Rate (gpm)	Pumping Duration (hrs)	Hydraulic Conductivity (gpd/ft <sup>2</sup> )	Transmissivity (gpd/ft)	Storage Coefficient (unitless)	Data Source
Production Well 5	290-670	Deep	1/27/1975	300/600	8/72	ND	50,000	$2.2 \times 10^{-4}$ to $7.6 \times 10^{-4}$	1
Production Well 6	340-685	Deep	10/31/1977	320/614	8/72	ND	24,201	ND	2
Production Well 7	302-702	Deep	1/13/1978	316/614	8/72	ND	25,533	ND	2
WW-1	60-140	Lower Shallow	unknown	200/300	67/24	410	33,150	$7.1 \times 10^{-4}$	3
WW-2	59-83	Lower Shallow	11/21/1973	140	120	600	13,000	$4.5 \times 10^{-4}$	3
WW-2 Long Term	59-83	Lower Shallow	12/14/1973	140	288	651	14,000	ND	3
WW-3	20-43	Upper Shallow	11/28/1973	10	48	65	1,100	$1.7 \times 10^{-3}$	3
WW-4	30-45	Upper Shallow	1/4/1974	50	46	420	12,500	$7 \times 10^{-4}$	3
Geometric Mean All Tests						337	15,000	$6.3 \times 10^{-4}$	
Geometric Mean Lower Shallow Aquifer						543	18,209	$5.6 \times 10^{-4}$	
Geometric Mean Upper Shallow Aquifer						165	3,708	$1.1 \times 10^{-3}$	
Geometric Mean Deep Aquifer						ND	31,379	$4.1 \times 10^{-4}$	

Data Source

[1] Reference 2.4S.12-8

[2] Pumping test data interpretation

[3] Reference 2.4S.12-7

ND = Not Determined

**Table 2.4S.12-11 STP Slug Test Results**

Well	Test Type								Arithmetic Mean of Tests		
	Rising Head Test Method					Falling Head Test Method					
	Butler	KGS	B-R	M-Z	S-G	Butler	KGS	B-R	ft/d	gpd/ft <sup>2</sup>	cm/s
OW-308L	64	67	65	NA	NA	72	73	56	66	495	2.33E-02
OW-308U	70	64	63	NA	NA	64	62	68	65	487	2.30E-02
OW-332L	53	54	P	NA	NA	49	49	55	52	389	1.83E-02
OW-332U	37	36	27	NA	NA	19	18	11	25	185	8.70E-03
OW-348L	58	46	44	NA	NA	76	61	39	54	404	1.91E-02
OW-348U	P	83	88	NA	NA	68	71	65	75	561	2.65E-02
OW-349L	63	51	35	NA	NA	43	40	52	47	354	1.67E-02
OW-349U	P	P	43	NA	NA	P	P	53	48	359	1.69E-02
OW-408L	P	72	P	NA	NA	70	68	50	65	486	2.29E-02
OW-408U	17	11	11	NA	NA	22	32	28	20	151	7.11E-03
OW-420U	P	33	45	NA	NA	ND	ND	ND	39	292	1.38E-02
OW-438L	17	27	10	NA	NA	15	28	14	19	138	6.53E-03
OW-438U	38	39	26	NA	NA	P	P	24	32	238	1.12E-02
OW-910L	3	0.3	0.6	NA	NA	2	0.9	0.5	1	9	4.29E-04
OW-910U	26	29	21	NA	NA	P	P	P	25	190	8.94E-03
OW-928L	19	11	7	NA	NA	P	24	21	16	123	5.79E-03
OW-928U	19	P	8	NA	NA	19	16	16	16	117	5.50E-03
OW-929L	56	54	29	NA	NA	59	P	59	51	384	1.81E-02
OW-929U	P	3	4	NA	NA	P	12	2	5	39	1.85E-03
OW-930L	40	37	27	NA	NA	24	15	19	27	202	9.53E-03
OW-930U	P	23	32	NA	NA	P	47	48	38	281	1.32E-02
OW-931U	34	23	20	NA	NA	P	P	49	32	236	1.11E-02
OW-932L	24	23	18	NA	NA	22	22	25	22	167	7.88E-03
OW-932U	21	13	14	NA	NA	P	16	22	17	129	6.07E-03
OW-933L	P	51	63	NA	NA	P	P	64	59	444	2.09E-02
OW-933U	P	10	3	NA	NA	8	5	3	6	43	2.05E-03
OW-934L	P	P	35	NA	NA	P	P	32	34	251	1.18E-02
OW-934U	P	32	33	NA	NA	49	P	40	39	288	1.36E-02
OW-950L	2	3	NA	2	NA	NA	NA	NA	2	16	7.66E-04

Table 2.4S.12-11 STP Slug Test Results (Continued)

Well	Test Type								Arithmetic Mean of Tests		
	Rising Head Test Method					Falling Head Test Method					
	Butler	KGS	B-R	M-Z	S-G	Butler	KGS	B-R	ft/d	gpd/ft <sup>2</sup>	cm/s
OW-950U	P	3	NA	P	NA	NA	NA	NA	3	20	9.53E-04
OW-951L	4	11	NA	4	NA	NA	NA	NA	6	47	2.20E-03
OW-951U	8	16	NA	8	NA	NA	NA	NA	11	80	3.76E-03
OW-952L	14	23	NA	14	NA	NA	NA	NA	17	127	6.00E-03
OW-952U	7	6	NA	7	NA	NA	NA	NA	7	52	2.45E-03
OW-953L	P	39	NA	P	NA	NA	NA	NA	39	292	1.38E-02
OW-953U	P	29	NA	P	NA	NA	NA	NA	29	215	1.02E-02
OW-954L	3	3	NA	3	NA	NA	NA	NA	3	23	1.08E-03
OW-954U	12	15	NA	12	NA	NA	NA	NA	13	97	4.57E-03
OW-955L	24	23	NA	24	NA	NA	NA	NA	24	177	8.35E-03
OW-955U	P	4	NA	P	NA	NA	NA	NA	4	29	1.37E-03
OW-956L	P	P	NA	96	NA	NA	NA	NA	96	715	3.37E-02
OW-956U	6	11	NA	6	NA	NA	NA	NA	8	57	2.68E-03
OW-957L	P	1	NA	P	NA	NA	NA	NA	1	7	3.28E-04
OW-957U	P	2	NA	NA	P	NA	NA	NA	2	14	6.48E-04
OW-958La	P	P	NA	P	NA	NA	NA	NA	NR	NR	NR
OW-958U	NA	47	NA	NA	P	NA	NA	NA	47	349	1.65E-02
OW-959L	19	P	NA	19	NA	NA	NA	NA	19	139	6.58E-03
OW-959U	NA	16	NA	NA	17	NA	NA	NA	16	123	5.81E-03
OW-960L	P	P	NA	P	NA	NA	NA	NA	NR	NR	NR
OW-960U	NA	1	NA	NA	P	NA	NA	NA	1	8	3.84E-04
OW-961L	179	P	NA	173	NA	NA	NA	NA	176	1316	6.21E-02
OW-961U	3	6	NA	3	NA	NA	NA	NA	4	31	1.46E-03
OW-962L	9	11	NA	9	NA	NA	NA	NA	10	72	3.39E-03
OW-962U	13	9	NA	13	NA	NA	NA	NA	12	86	4.06E-03
Geometric Mean all tests									17	126	5.93E-03
Geometric Mean Upper Shallow Aquifer									14	107	5.04E-03
Geometric Mean Lower Shallow Aquifer									20	152	7.16E-03

**Table 2.4S.12-11 STP Slug Test Results (Continued)**

Well	Test Type								Arithmetic Mean of Tests		
	Rising Head Test Method					Falling Head Test Method					
	Butler	KGS	B-R	M-Z	S-G	Butler	KGS	B-R	ft/d	gpd/ft <sup>2</sup>	cm/s
P = Poor curve match or questionable data Test Methods: KGS = Kansas Geological Survey, B-R = Bouwer and Rice, M-Z = McElwee-Zenner, S-G = Springer-Gelhar ND = No Data - data not recovered from data logger NA = Method Not Analyzed NR = No Result											

Table 2.4S.12-12 Summary of STP Aquifer Properties from Laboratory Analyses

Hydrogeologic Unit	Parameter	Bulk Density	Porosity	Effective Porosity or Specific Yield	Grain Size Permeability
Upper Shallow Aquifer Confining Layer	Number of Tests	11	11	NA	NA
	Mean or Geometric mean	101 pcf	40%	NA	NA
	Range	96.4 – 114.9 pcf	31.8 – 42.8%	NA	NA
Upper Shallow Aquifer	Number of Tests	4	4	4	1
	Mean or Geometric mean	99 pcf	41%	33%	NA
	Range	97.2 – 100.2 pcf	39.5 – 41.7%	31.6 – 33.4%	$4.11 \times 10^{-3}$ cm/s
Lower Shallow Aquifer Confining Layer	Number of Tests	11	11	NA	NA
	Mean or Geometric mean	99 pcf	42%	NA	NA
	Range	87.3 – 107.7 pcf	36.1 – 47.2%	NA	NA
Lower Shallow Aquifer	Number of Tests	9	9	9	11
	Mean or Geometric mean	102 pcf	39%	31%	$6.05 \times 10^{-3}$ cm/s
	Range	94.5 – 120.0 pcf	28.8 – 43.9%	23.0 – 35.1%	$4.60 \times 10^{-3}$ – $1.02 \times 10^{-2}$ cm/s
Deep Aquifer Confining Layer	Number of Tests	23	23	NA	NA
	Mean or Geometric mean	101 pcf	41%	NA	NA
	Range	82.1 – 111.4 pcf	33.4 – 51.8%	NA	NA
Deep Aquifer	Number of Tests	1	1	1	NA
	Mean or Geometric Mean	NA	NA	NA	NA
	Range	103.1	38.8%	31.0%	NA

NA- parameter not applicable or insufficient data to compute statistic

**Table 2.4S.12-13 Hydraulic Conductivity of Clay**

<b>Soil Boring/Sample</b>	<b>Depth (ft)</b>	<b>Hydraulic Conductivity (cm/s)</b>	<b>Hydraulic Conductivity (gpd/ft<sup>2</sup>)</b>
B-601 S2	3	$3.6 \times 10^{-7}$	0.0076
B-241 T3	9	$2.4 \times 10^{-6}$	0.051
B-242 T3	9	$1.2 \times 10^{-6}$	0.025
B-601 T5	9	$2.4 \times 10^{-8}$	0.00051
B-601 T9	29	$2.6 \times 10^{-8}$	0.00055
B-400 T11	39	$4.0 \times 10^{-8}$	0.00085
<b>Geometric Mean</b>		$1.72 \times 10^{-7}$	0.0036

Source: Reference 2.4S.12-9, Section 2.5.4.2.6.1

Table 2.4S.12-14 Representative Properties of Hydrogeologic Units

Hydrogeologic Unit	Property	Units	Representative Value	Range	Source
Upper Shallow Aquifer Confining Layer	Thickness	ft	20	10-30	Figure 2.4S.12-20
	Vertical Hydraulic Conductivity	gpd/ft <sup>2</sup>	0.004	0.05-0.0005	Table 2.4S.12-13
	Bulk (dry) Density	pcf	101	96.4 - 114.9	Table 2.4S.12-12
	Total Porosity	%	40	31.8-42.8	Table 2.4S.12-12
Upper Shallow Aquifer	Thickness	ft	25	20-30	Figure 2.4S.12-20
	Horizontal Hydraulic Conductivity	gpd/ft <sup>2</sup>	165	65-420	Table 2.4S.12-10
	Horizontal Hydraulic Gradient	ft/ft	0.002	0.0005-0.002	Section 2.4S.12.2.2
	Bulk (dry) Density	pcf	99	97.2 - 100.2	Table 2.4S.12-12
	Total Porosity	%	41	39.5-41.7	Table 2.4S.12-12
	Effective Porosity	%	33	31.6-33.4	Table 2.4S.12-12
Lower Shallow Aquifer Confining Layer	Thickness	ft	20	15-25	Figure 2.4S.12-20
	Vertical Hydraulic Gradient (downward)	ft/ft	0.29	0.02-0.29	Table 2.4S.12-8
	Vertical Hydraulic Conductivity	gpd/ft <sup>2</sup>	0.004	0.05-0.0005	Table 2.4S.12-13
	Bulk (dry) Density	pcf	99	87.3 - 107.7	Table 2.4S.12-12
	Total Porosity	%	42	36.1-47.2	Table 2.4S.12-12
Lower Shallow Aquifer	Thickness	ft	40	25-50	Figure 2.4S.12-20
	Horizontal Hydraulic Conductivity	gpd/ft <sup>2</sup>	543	410-651	Table 2.4S.12-10
	Horizontal Hydraulic Gradient	ft/ft	0.0007	0.0004-0.0007	Section 2.4S.12.2.2
	Bulk (dry) Density	pcf	102	94.5 - 120.0	Table 2.4S.12-12
	Total Porosity	%	39	28.8-43.9	Table 2.4S.12-12
	Effective Porosity	%	31	23.0-35.1	Table 2.4S.12-12
Deep Aquifer Confining Layer	Thickness	ft	100	100-150	Section 2.4S.12.3.1
	Vertical Hydraulic Conductivity	gpd/ft <sup>2</sup>	0.004	0.05-0.0005	Table 2.4S.12-13
	Bulk (dry) Density	pcf	101	82.1 - 111.4	Table 2.4S.12-12
	Total Porosity	%	41	33.4 - 51.8	Table 2.4S.12-12
Deep Aquifer	Horizontal Hydraulic Conductivity	gpd/ft <sup>2</sup>	420	103-3,950	Table 2.4S.12-9
	Horizontal Hydraulic Gradient	ft/ft	0.002	0.0006-0.002	Section 2.4S.12.2.2
	Bulk (dry) Density	pcf	102	94.5 - 120.0	Lower Shallow Aquifer
	Total Porosity	%	39	28.8-43.9	Lower Shallow Aquifer
	Effective Porosity	%	31	23.0-35.1	Lower Shallow Aquifer



Table 2.4S.12-15 Regional Hydrogeochemical Data

Well	Sample Date	Sample Depth (ft bgs)	pH (standard units)	Specific Conductance (µmhos/cm)	Total Dissolved Solids (mg/L)	Total Hardness (mg/L as CaCO3)	Silica (mg/L)	Cations				Anions				
								Calcium (mg/L)	Magnesium (mg/L)	Sodium (mg/L)	Potassium (mg/L)	Bicarbonate (mg/L)	Chloride (mg/L)	Sulfate (mg/L)	Fluoride (mg/L)	Nitrate (mg/L)
TA-80-15-301	6/10/1966	570	7.7	1,550	880	348	22	82	35	195	3	382	302	47	0.7	BDL
TA-80-15-502	9/2/1966	776	7.9	732	430	77	18	17	8	143	BDL	306	79	14	0.6	BDL
TA-80-15-901	12/2/1966	38	7.7	1,840	1,060	314	24	60	40	285	8	520	333	66	0.8	BDL
TA-80-15-902	12/2/1966	20	7.4	884	530	403	28	98	39	33	BDL	411	54	9	0.8	70
TA-80-16-101	6/12/1967	93	8.1	1,200	710	295	25	65	32	160	3	489	153	33	0.8	BDL
TA-80-16-201	9/19/1966	100	7.6	746	437	216	20	53	20	87	BDL	349	73	11	0.7	BDL
TA-80-16-301	7/11/1964	823	8.0	720	570	46	10	11	5	150	ND	309	74	14	ND	ND
TA-80-16-302	7/31/1964	835	7.9	676	554	47	9	12	4	143	ND	312	62	14	ND	ND
TA-80-16-303	9/19/1966	98	7.8	1,051	620	353	20	79	38	110	ND	530	111	3	0.6	BDL
TA-80-16-801	12/8/1966	130	7.5	1,760	1,000	355	22	73	42	245	ND	453	341	52	0.7	BDL
TA-80-23-301	7/19/1955	770	8.3	846	488	42	17	9.9	4.3	177	ND	344	94	11	ND	BDL
TA-80-23-302	6/12/1967	331	8.0	674	403	55	15	14	5	141	ND	334	51	12	0.7	BDL
TA-80-23-501	11/22/1966	68	7.5	2,800	1,570	730	25	191	62	297	6	375	760	41	0.4	BDL
TA-80-24-202	11/3/1966	411	8.0	811	475	36	10	7	5	182	2	367	79	9	1	BDL
TA-81-09-401	3/24/1966	360	7.8	1,290	730	361	25	79	39	138	3	368	240	25	0.5	BDL
TA-81-09-504	7/19/1955	721	8.0	849	498	128	21	37	8.8	143	ND	366	90	11	ND	0.2
TA-81-09-802	9/30/1966	828	8.3	1,600	910	18	15	5	1	367	BDL	550	253	BDL	3.1	BDL

BDL = Below analytical detection limit

ND = Not Determined

National Secondary Drinking Water Standard Exceeded

National Primary Drinking Water Standard Exceeded

Source: Reference 2.4S.12-6

Table 2.4S.12-16 STP Hydrogeochemical Data

Well	Sample Date	Sample Depth (ft bgs)	pH (standard units)	Specific Conductance (µmhos/cm)	Temperature (°C)	Total Dissolved Solids (mg/L)	Total Alkalinity (mg/L as CaCO <sub>3</sub> )	Total Hardness (mg/L as CaCO <sub>3</sub> )	Silica (mg/L)	Cations						Anions				
										Calcium (mg/L)	Magnesium (mg/L)	Sodium (mg/L)	Potassium (mg/L)	Iron (mg/L)	Manganese (mg/L)	Bicarbonate (mg/L)	Chloride (mg/L)	Sulfate (mg/L)	Fluoride (mg/L)	Nitrate (mg/L)
Shallow Aquifer at Prod. Well 5	12/17/1974	105	7.84	1,480	ND	1,095	390	324	18	74	34	211	ND	BDL	0.2	476	245	42	0.8	0.8
Prod. Well 5	1/29/1975	290-670	7.95	863	ND	642	284	37	14	10	3	176	1.3	BDL	BDL	346	87	11	0.9	ND
Prod. Well 5	1/30/1975	290-670	8.25	863	ND	623	286	38	13	10	3	177	1.3	BDL	BDL	320	87	12	0.9	ND
Prod. Well 5	1/31/1975	290-670	8.25	863	ND	626	284	37	13	10	3	176	1.3	BDL	BDL	317	87	11	0.9	ND
Prod. Well 5	12/16/1982	290-670	7.90	818	ND	648	289	42	14	10	4	ND	ND	BDL	0.13	353	79	10	ND	0.36
Prod. Well 6	12/7/1982	330-670	7.65	809	ND	635	298	49	15	12	5	ND	ND	BDL	BDL	364	69	14	ND	BDL
Prod. Well 7	2/9/1983	302-682	7.83	831	ND	628	288	38	13	10	3	168	1.4	BDL	BDL	351	74	8	0.8	0.3
Prod. Well 8	5/15/1991	449-552	8.20	ND	ND	256	197	89	ND	28.2	4.28	70.8	ND	0.06	BDL	216	33	12	0.37	0.3
WW-2	12/20/1973	59-83	7.7	1,490	ND	1,044	ND	320	ND	65	38	192	ND	ND	ND	464	242	42	ND	1
WW-3	11/30/1973	20-43	ND	4,750	ND	2,618	ND	672	ND	125	88	680	ND	ND	ND	458	1180	86	ND	1
WW-4	11/4/1974	30-45	ND	1,610	ND	1,103	ND	430	ND	118	33	191	ND	ND	ND	421	304	36	ND	BDL
Piezometer 115-A	12/21/1973	79	7.6	6,100	ND	3,316	ND	712	ND	130	95	920	ND	ND	ND	427	1610	134	ND	BDL
Piezometer 115-B	12/21/1973	40	7.5	4,020	ND	2,326	ND	688	ND	128	90	548	ND	ND	ND	458	1010	91	ND	1
Piezometer 415	12/14/1973	40	7.8	2,050	ND	1,315	ND	435	ND	93	49	265	ND	ND	ND	415	452	41	ND	BDL
Piezometer 417	12/14/1973	100	7.7	1,930	ND	1,257	ND	445	ND	104	45	238	ND	ND	ND	396	436	38	ND	BDL
OW-308L	12/30/2006	97.8	7.11	1,240	23.1	661	347	ND	ND	62.7	34.2	149	5.47	ND	ND	423	199	24.4	0.8	0.136
OW-308U	12/30/2006	48.9	6.93	2,348	23.7	1,240	367	ND	ND	97.1	55.6	298	2.53	ND	ND	447	558	76.6	1.4	0.149
OW-332L	12/29/2006	104.6	7.07	1,298	22.9	1,020	351	ND	ND	98.3	53.5	208	2.98	ND	ND	428	439	43.9	0.77	0.52
OW-332U	12/29/2006	47.6	7.03	1,582	22.7	870	383	ND	ND	70.2	35.9	213	BDL	ND	ND	467	240	104	1.4	0.39
OW-408L	12/30/2006	83.2	7.07	1,242	23.4	650	349	ND	ND	66	32.5	145	1.97	ND	ND	426	195	21.6	0.97	0.05
OW-408U	12/30/2006	44.3	6.99	1,764	23.4	913	385	ND	ND	74.5	38.6	240	1.64	ND	ND	469	344	29.5	1.1	0.053
OW-420U	12/30/2006	50.5	6.94	2,114	22.9	1,120	320	ND	ND	101	46.8	259	1.79	ND	ND	390	505	44.9	0.85	0.383
OW-928L	12/29/2006	124	6.99	1,168	22.5	643	284	ND	ND	74	36.2	110	2.37	ND	ND	346	197	17.1	0.67	BDL
OW-928U	12/29/2006	41.1	6.82	2,885	22.3	1,560	296	ND	ND	156	51.6	315	2.03	ND	ND	361	815	132	0.75	BDL
OW-930L	12/28/2006	104.6	7.06	1,506	22.3	726	360	ND	ND	65.5	34.7	200	2.66	ND	ND	439	260	28.2	0.83	BDL
OW-930U	12/28/2006	34.7	6.87	1,152	22.4	623	358	ND	ND	95.6	31.5	89.7	BDL	ND	ND	436	175	16.8	0.66	0.16
OW-933L	12/29/2006	88.8	6.93	1,936	23.5	713	392	ND	ND	63.4	33.6	149	2.93	ND	ND	478	197	25.6	0.77	0.069
OW-933U	12/29/2006	38.8	7.28	1,658	24.2	908	367	ND	ND	39.2	25.8	273	1.9	ND	ND	447	294	70.9	2.1	BDL
OW-934L	12/31/2006	100.3	7.10	1,359	22.6	731	380	ND	ND	62	35.4	185	2.3	ND	ND	463	189	24.5	0.78	BDL
OW-934U	12/31/2006	42.4	6.91	1,891	22.7	1,020	378	ND	ND	87.8	56.2	218	BDL	ND	ND	461	412	47.3	1.4	0.163

BDL = Below analytical detection limit

ND = Not Determined

National Secondary Drinking Water Standard Exceeded

Table 2.4S.12-17 Estimated Average Linear Velocity and Travel Time

Property		Hydrogeologic Unit/Pathway						
		Pathway 1		Pathway 2		Pathway 3		Pathway 4
		Upper Shallow Aquifer Discharge at east site boundary	Lower Shallow Aquifer at east site boundary	Upper Shallow Aquifer Discharge at Well 2004120846	Lower Shallow Aquifer Discharge at Well 2004120846	Upper Shallow Aquifer Discharge at Colorado River	Lower Shallow Aquifer Discharge at Colorado River	Upper Shallow Aquifer Discharge at west site boundary
Hydraulic Conductivity	Representative Value (gpd/ft <sup>2</sup> )	165	543	165	543	165	543	165
	Range (gpd/ft <sup>2</sup> )	65 - 420	410 - 651	65 - 420	410 - 651	65 - 420	410 - 651	65 - 420
	Representative Value (ft/day)	22	72	22	72	22	72	22
	Range (ft/day)	9 - 56	55 - 87	9 - 56	55 - 87	9 - 56	55 - 87	9 - 56
Hydraulic Gradient	Representative Value (ft/ft)	0.002	0.0007	0.002	0.0007	0.002	0.0007	0.0008
	Range (ft/ft)	0.0007 - 0.002	0.0004 - 0.0007	0.0007-0.002	0.0004-0.00057	0.0007 - 0.002	0.0004 - 0.0007	0.0005 - 0.0008
Effective Porosity	Representative Value (decimal)	0.33	0.31	0.33	0.31	0.33	0.31	0.33
	Range (decimal)	0.316 - 0.334	0.23 - 0.351	0.316 - 0.334	0.23 - 0.351	0.316 - 0.334	0.23 - 0.351	0.316 - 0.334
Average Linear Velocity	Representative Value (ft/day)	0.13	0.16	0.13	0.16	0.13	0.16	0.05
	Range (ft/day)	0.05 - 0.35	0.11 - 0.26	0.05 - 0.35	0.11 - 0.26	0.05 - 0.35	0.11 - 0.26	0.02 - 0.14
Distance	Distance to Receptor (ft)	7,300	7,300	9,000	9,000	17,800	17,800	6,000
Travel Time	Representative Value (day)	56,154	45,625	69,231	56,250	136,923	111,250	120,000
	Range (day)	20,857 - 146,000	28,077 - 66,364	25,714 - 180,000	34,615 - 81,818	50,857 - 356,000	68,462 - 161,818	42,857 - 300,000

**Table 2.4S.12-18 Summary of Water Levels in the Upper Shallow Aquifer on March 1, 2003**

<b>Piezometers Around the Perimeter of the MCR</b>				
<b>Piezometer No.</b>	<b>Embankment Station</b>	<b>Bottom Elevation (ft, MSL)</b>	<b>Location on Embankment</b>	<b>Water-Level Elevation on 3/1/2003 (ft, MSL)</b>
P5	7+00	-6.0	A	29.00 <sup>a</sup>
P6	7+00	-6.0	B	-
P7	7+00	-6.0	C	21.40
P9	11+00	-1.0	A	27.90 <sup>a</sup>
P10	11+00	-1.0	B	22.90 <sup>a</sup>
P11	11+00	-1.0	C	22.10
P13	20+00	-15.0	A	26.30 <sup>a</sup>
P14	20+00	-15.0	B	22.60
P15	20+00	-15.0	C	24.50
P17	40+20	-10.0	A	23.30 <sup>a</sup>
P18	40+20	-10.0	B	21.70
P19	40+20	-10.0	C	20.80
P21	59+60	-9.0	A	24.10 <sup>a</sup>
P22	59+60	-9.0	B	21.60
P23	59+60	-9.0	C	-
P25	79+80	-15.0	A	23.70 <sup>a</sup>
P26	79+80	-15.0	B	22.60
P27	79+80	-15.0	C	21.00
P29	100+20	-5.0	A	32.70 <sup>a</sup>
P30	100+20	-5.0	B	30.00
P31	100+20	-5.0	D	17.30
P34	130+40	-7.0	A	29.20 <sup>a</sup>
P35	130+40	-7.0	B	24.70
P36	130+40	-7.0	C	-
P38	160+00	0.0	A	38.60 <sup>a</sup>
P39	160+00	0.0	B	20.30
P40	160+00	0.0	C	16.40
P42	180+25	-1.0	A	-
P43	180+25	-1.0	B	24.20
P44	180+25	-1.0	C	13.10

**Table 2.4S.12-18 Summary of Water Levels in the Upper Shallow Aquifer on March 1, 2003  
(Continued)**

Piezometers Around the Perimeter of the MCR				
Piezometer No.	Embankment Station	Bottom Elevation (ft, MSL)	Location on Embankment	Water-Level Elevation on 3/1/2003 (ft, MSL)
P46	200+20	-7.0	A	24.50 <sup>a</sup>
P47	200+20	-7.0	B	21.60
P48	200+20	-7.0	C	17.60
P50	219+80	-25.0	A	-
P51	219+80	-25.0	B	17.90
P52	219+80	-25.0	C	16.60
P53	226+40	-20.0	A	16.40 <sup>a</sup>
P54	226+40	-20.0	B	15.00
P55	226+40	-20.0	C	12.00
P57	240+00	-23.0	A	19.20 <sup>a</sup>
P58	240+00	-23.0	B	17.40
P59	240+00	-23.0	C	14.90
P61	260+25	-13.0	A	17.40 <sup>a</sup>
P62	260+25	-13.0	B	15.30
P63	260+25	-13.0	C	14.00
P64	283+00	-9.0	A	18.90 <sup>a</sup>
P65	283+00	-9.0	B	14.40
P66	283+00	-9.0	C	13.10
P68	300+00	-19.0	A	19.30 <sup>a</sup>
P69	300+00	-19.0	B	16.90
P70	300+00	-19.0	C	13.80
P72	320+00	-8.0	A	16.80 <sup>a</sup>
P73	320+00	-8.0	B	14.40
P74	320+00	-8.0	C	12.40
P77	359+60	0.0	A	22.60 <sup>a</sup>
P78	359+60	0.0	B	20.40
P79	359+60	0.0	C	15.20
P81	380+00	-24.0	A	21.60 <sup>a</sup>
P82	380+00	-24.0	B	19.80
P83	380+00	-24.0	C	17.30

**Table 2.4S.12-18 Summary of Water Levels in the Upper Shallow Aquifer on March 1, 2003  
(Continued)**

Piezometers Around the Perimeter of the MCR				
Piezometer No.	Embankment Station	Bottom Elevation (ft, MSL)	Location on Embankment	Water-Level Elevation on 3/1/2003 (ft, MSL)
P85	400+50	-22.0	A	24.70 <sup>a</sup>
P86	400+50	-22.0	B	23.30
P87	400+50	-22.0	C	16.80
P89	420+00	-22.0	A	20.30 <sup>a</sup>
P90	420+00	-22.0	B	18.70
P91	420+00	-22.0	C	16.00
P93	440+20	-4.0	A	21.60 <sup>a</sup>
P94	440+20	-4.0	B	19.20
P95	440+20	-4.0	C	16.20
P97	460+10	-22.0	A	-
P98	460+10	-22.0	B	19.20
P99	460+10	-22.0	C	16.40
P101	491+00	-22.0	A	26.50 <sup>a</sup>
P102	491+00	-22.0	B	25.20
P103	491+00	-22.0	C	22.80
P105	511+00	-22.0	A	28.30 <sup>a</sup>
P106	511+00	-22.0	B	28.10
P107	511+00	-22.0	C	23.80
P109	531+00	-13.0	A	32.80 <sup>a</sup>
P110	531+00	-13.0	B	30.40
P111	531+00	-13.0	C	27.50
P113	550+50	-3.0	A	27.70 <sup>a</sup>
P114	550+50	-3.0	B	25.60
P115	550+50	-3.0	C	23.00
P116	570+35	-11.0	A	27.50 <sup>a</sup>
P117	570+35	-11.0	B	25.59
P118	570+35	-11.0	C	23.90
P120	590+40	+4	A	35.50 <sup>a</sup>
P121	590+40	+4	B	30.90
P122	590+40	+4	C	25.80

**Table 2.4S.12-18 Summary of Water Levels in the Upper Shallow Aquifer on March 1, 2003  
(Continued)**

<b>Piezometers Around the Perimeter of the MCR</b>				
<b>Piezometer No.</b>	<b>Embankment Station</b>	<b>Bottom Elevation (ft, MSL)</b>	<b>Location on Embankment</b>	<b>Water-Level Elevation on 3/1/2003 (ft, MSL)</b>
P124	610+00	-12.0	A	30.70 <sup>a</sup>
P125	610+00	-12.0	B	28.50
P126	610+00	-6.0	C	26.80
P128	629+00	-13.0	A	32.30 <sup>a</sup>
P129	629+00	-13.0	B	28.80
P130	629+00	-13.0	C	26.00
P132	652+20	-16.0	A	-
P133	652+00	-16.0	B	-
P134	652+00	-16.0	C	25.50
<b>Site Piezometers</b>				
225A-02	-	-	-	19.27 <sup>b</sup>
274C	-	-20.7	-	19.98 <sup>b</sup>
435	-	-31.2	-	19.97 <sup>b</sup>
446A	-	-39.8	-	0.83 <sup>b</sup>
447A	-	-38.6	-	8.05 <sup>b</sup>
601	-	-14.1	-	23.36 <sup>b</sup>
602A	-	-16.7	-	23.40 <sup>b</sup>
603B	-	-12.3	-	24.49 <sup>b</sup>
MCR	-	~+20	-	~47 <sup>a</sup>

**Notes:**

- "A" piezometer offset 11 feet landward from centerline of embankment.
- "B" piezometer offset 98 feet landward from centerline of embankment.
- "C" piezometer offset 260 feet landward from centerline of embankment.
- <sup>a</sup> measurement on 3/10/2003.
- <sup>b</sup> measurement on 2/1/2003.

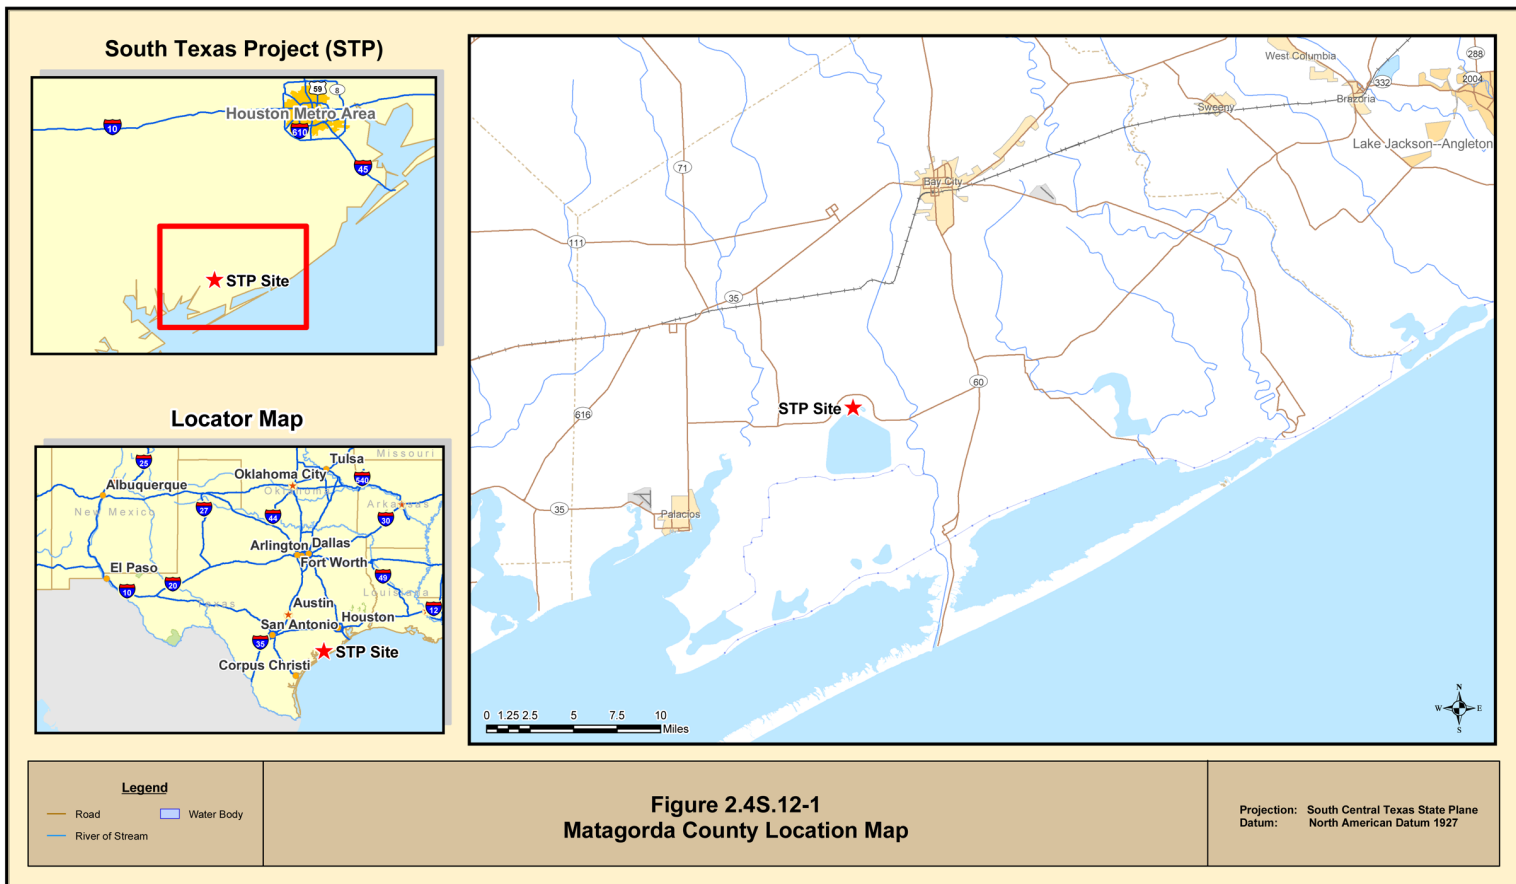


Figure 2.4S.12-1 Matagorda County Location Map



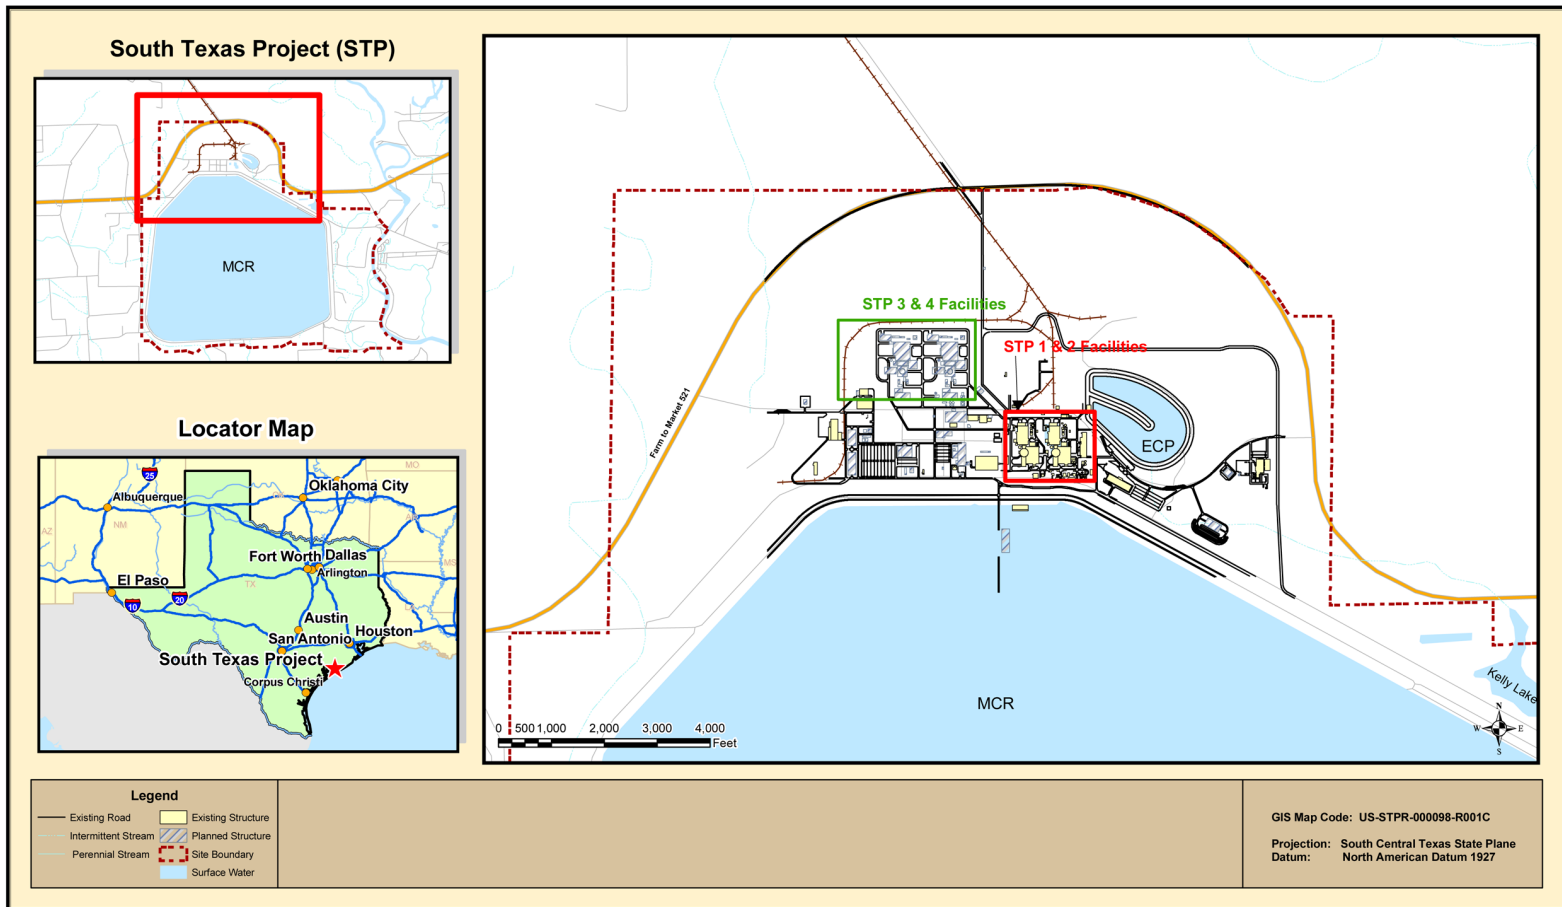


Figure 2.4S.12-2 STP Facility Location Map

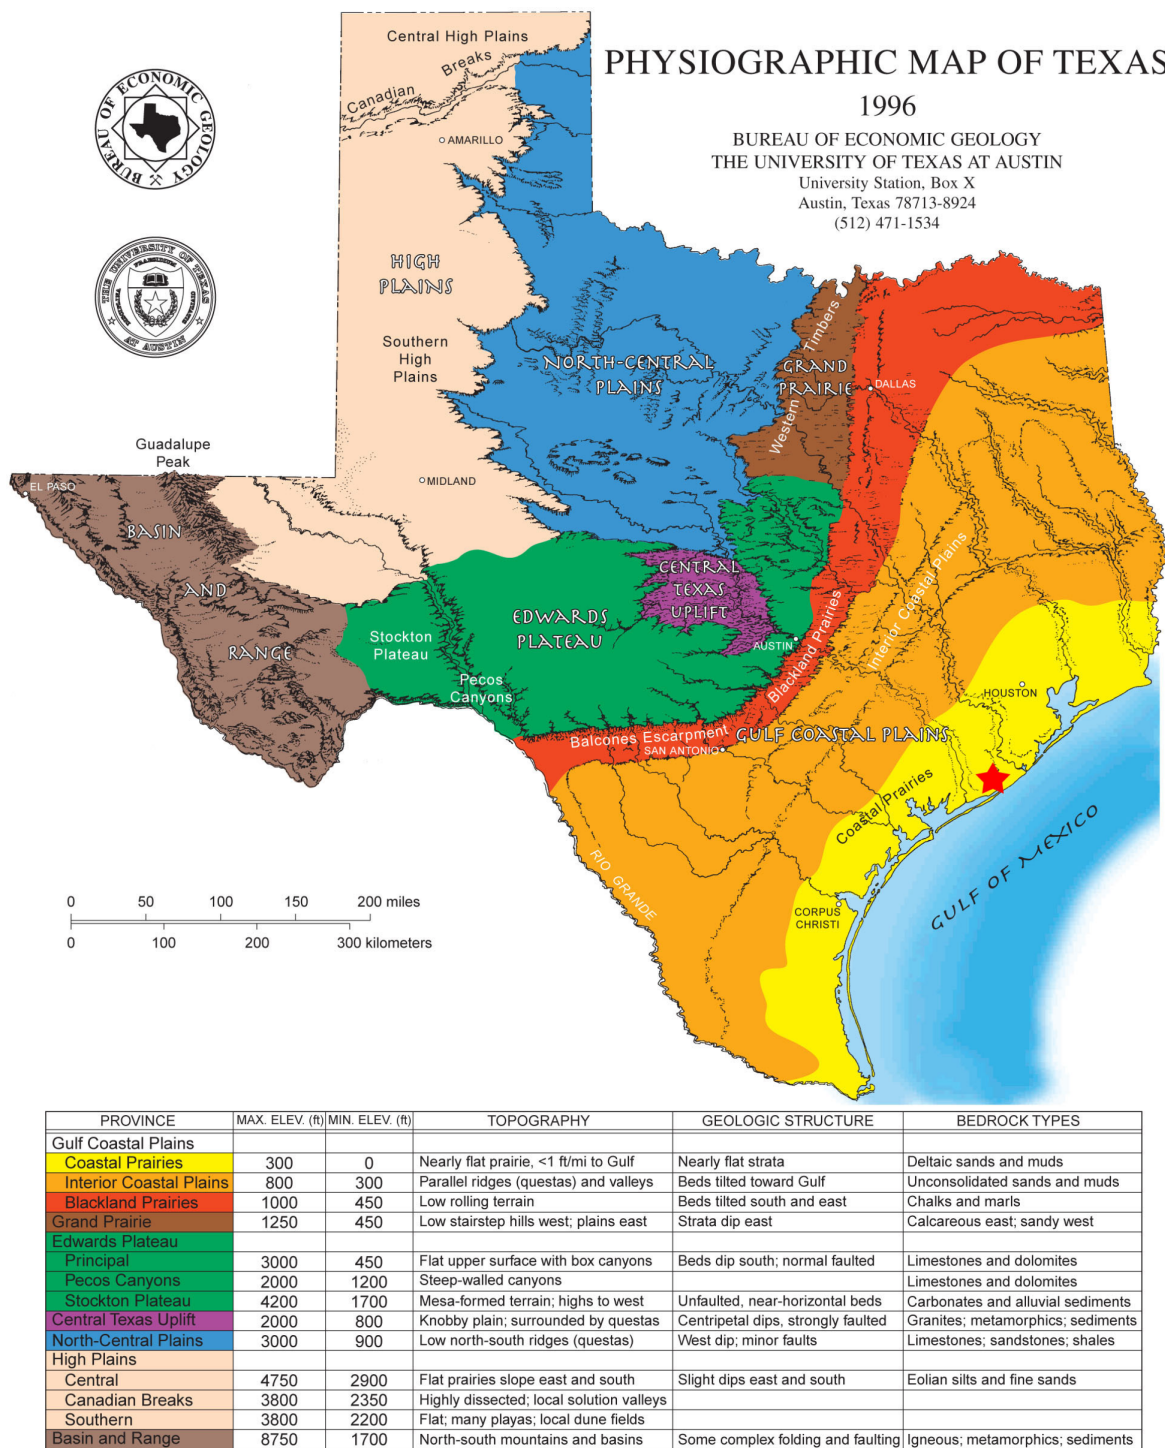


Figure 2.4S.12-3 Physiographic Map of Texas (modified from Reference 2.4S.12-1)

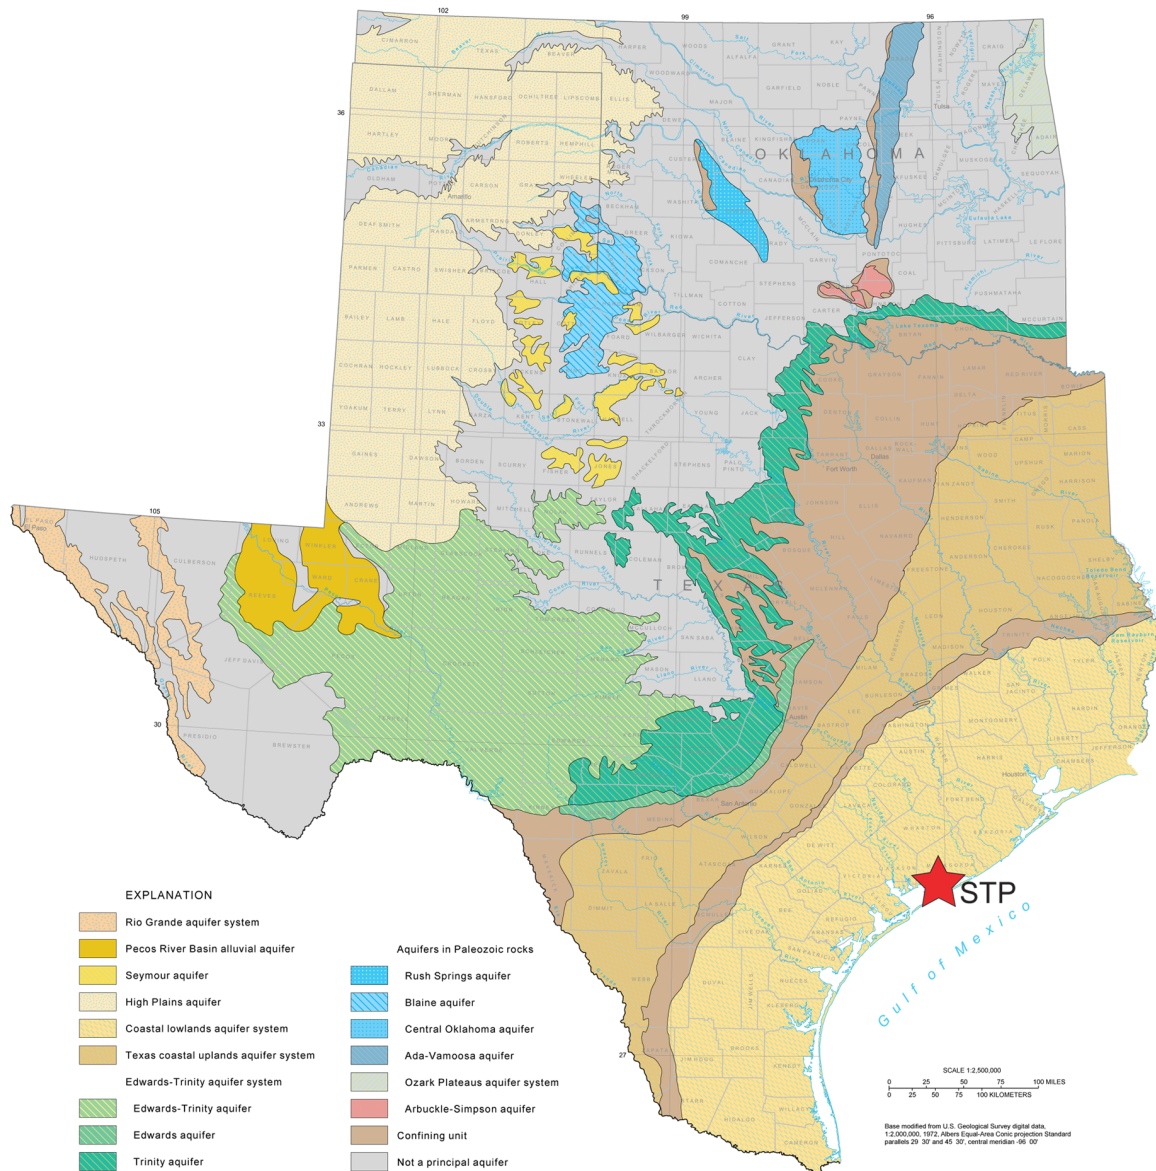


Figure 2.4S.12-4 Aquifers of Texas (modified from Reference 2.4S.12-2)


Era	System	Series	Stratigraphic unit Modified from Baker, 1979	Lithology	Hydrogeologic unit commonly used in Texas Modified from Baker, 1979	Hydrogeologic nomenclature used by USGS Modified from Weiss, 1992
Cenozoic	Quaternary	Holocene	Alluvium	Sand, silt, and clay	Chicot aquifer	Permeable zone A
		Pleistocene	Beaumont Formation Montgomery Formation Bentley Formation Willis Sand			Permeable zone B
				Sand, silt, and clay		
	Tertiary	Pliocene	Goliad Sand	Sand, silt, and clay	Evangeline aquifer	Permeable zone C
		Miocene	Fleming Formation	Clay, silt and sand	Burkeville confining unit	Zone D confining unit [1]
			Oakville Sandstone	Sand, silt, and clay	Catahoula confining unit (restricted)	Permeable zone D
			Catahoula Sandstone or Tuff [2]			
			Anahuac Formation [1]	Clay, silt and sand		Zone E confining unit [1]
			Frio Formation [1]	Sand, silt, and clay		Permeable zone E
		Oligocene	Frio Clay [3]	Clay and silt	Vicksburg-Jackson confining unit	Vicksburg-Jackson confining unit
			Vicksburg Formation [1]			
		Eocene	Jackson Group Whitsett Formation Manning Clay Wellborn Sandstone Caddell Formation			

[1] Present only in the subsurface

[2] Called Catahoula Tuff west of Lavaca County

[3] Not recognized at surface east of Live Oak County

Figure 2.4S.12-5 Correlation of USGS and Texas Nomenclature (modified from Reference 2.4S.12-2)

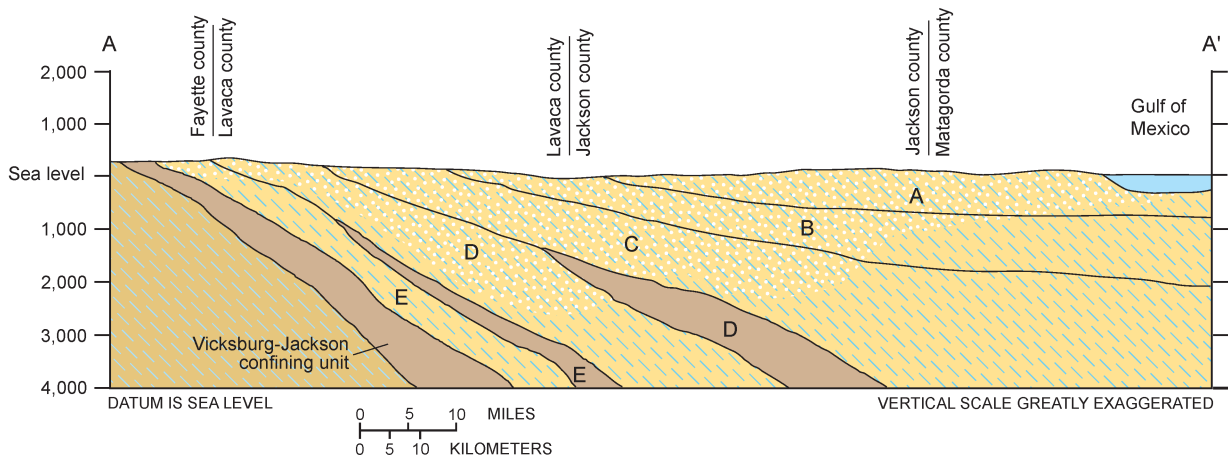

Notes:





-  Coastal lowlands aquifer system—Dot patterned area indicates freshwater
-  Texas coastal uplands aquifer system
-  Confining unit
-  D Hydrogeologic unit—See figure 2.4S.12-5

Figure 2.4S.12-6 Generalized Cross Section through the Coastal Lowlands/Coastal Uplands Aquifer Systems (modified from Reference 2.4S.12-2)



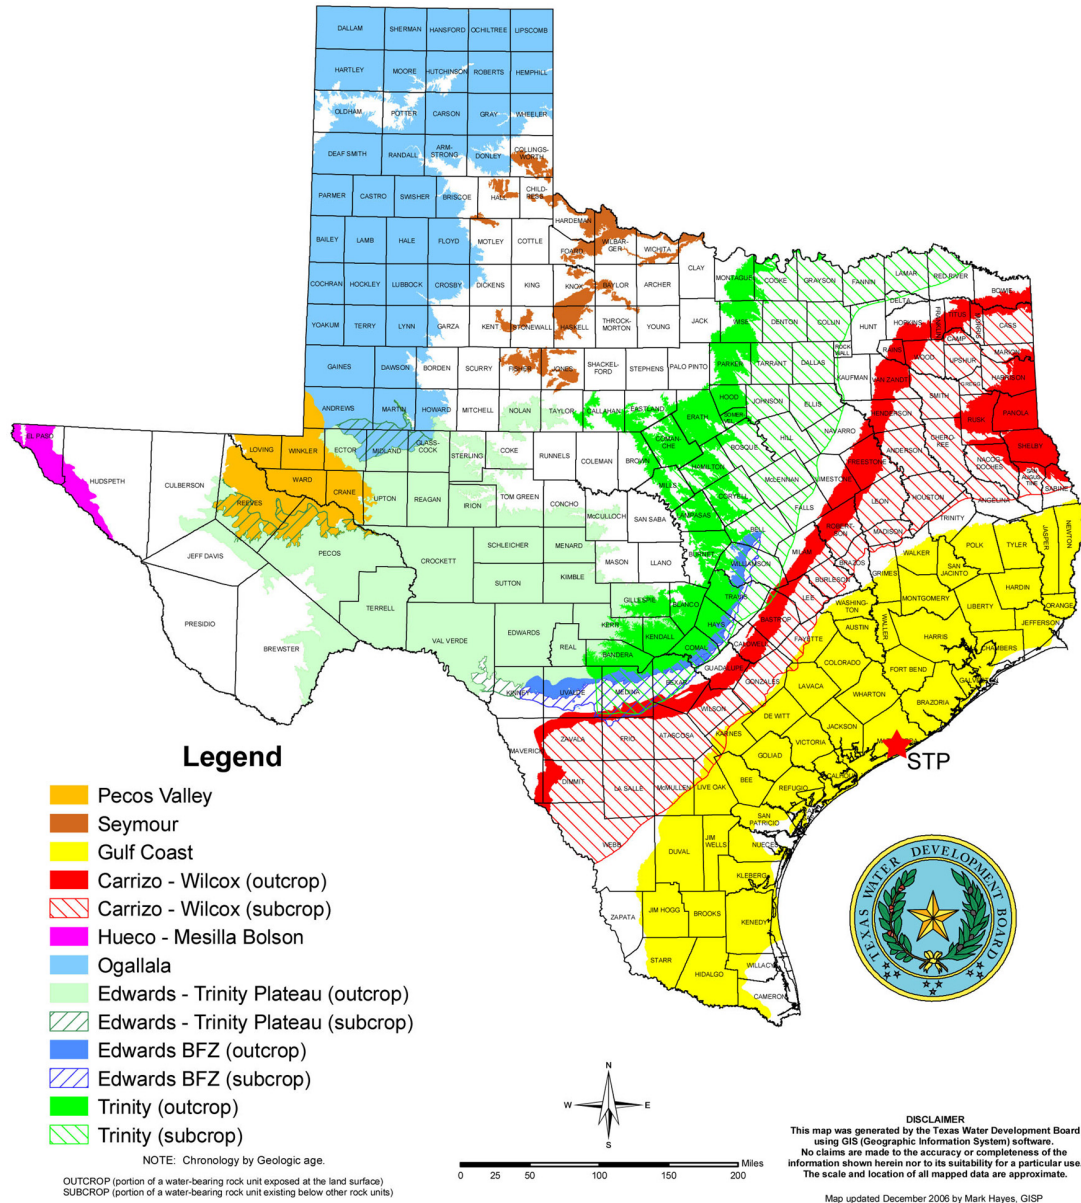


Figure 2.4S.12-7 Major Aquifers of Texas (Reference 2.4S.12-3)

## REGION 6 SOLE SOURCE AQUIFERS



**Figure 2.4S.12-8 Sole Source Aquifers in EPA Region VI (Reference 2.4S.12-4)**

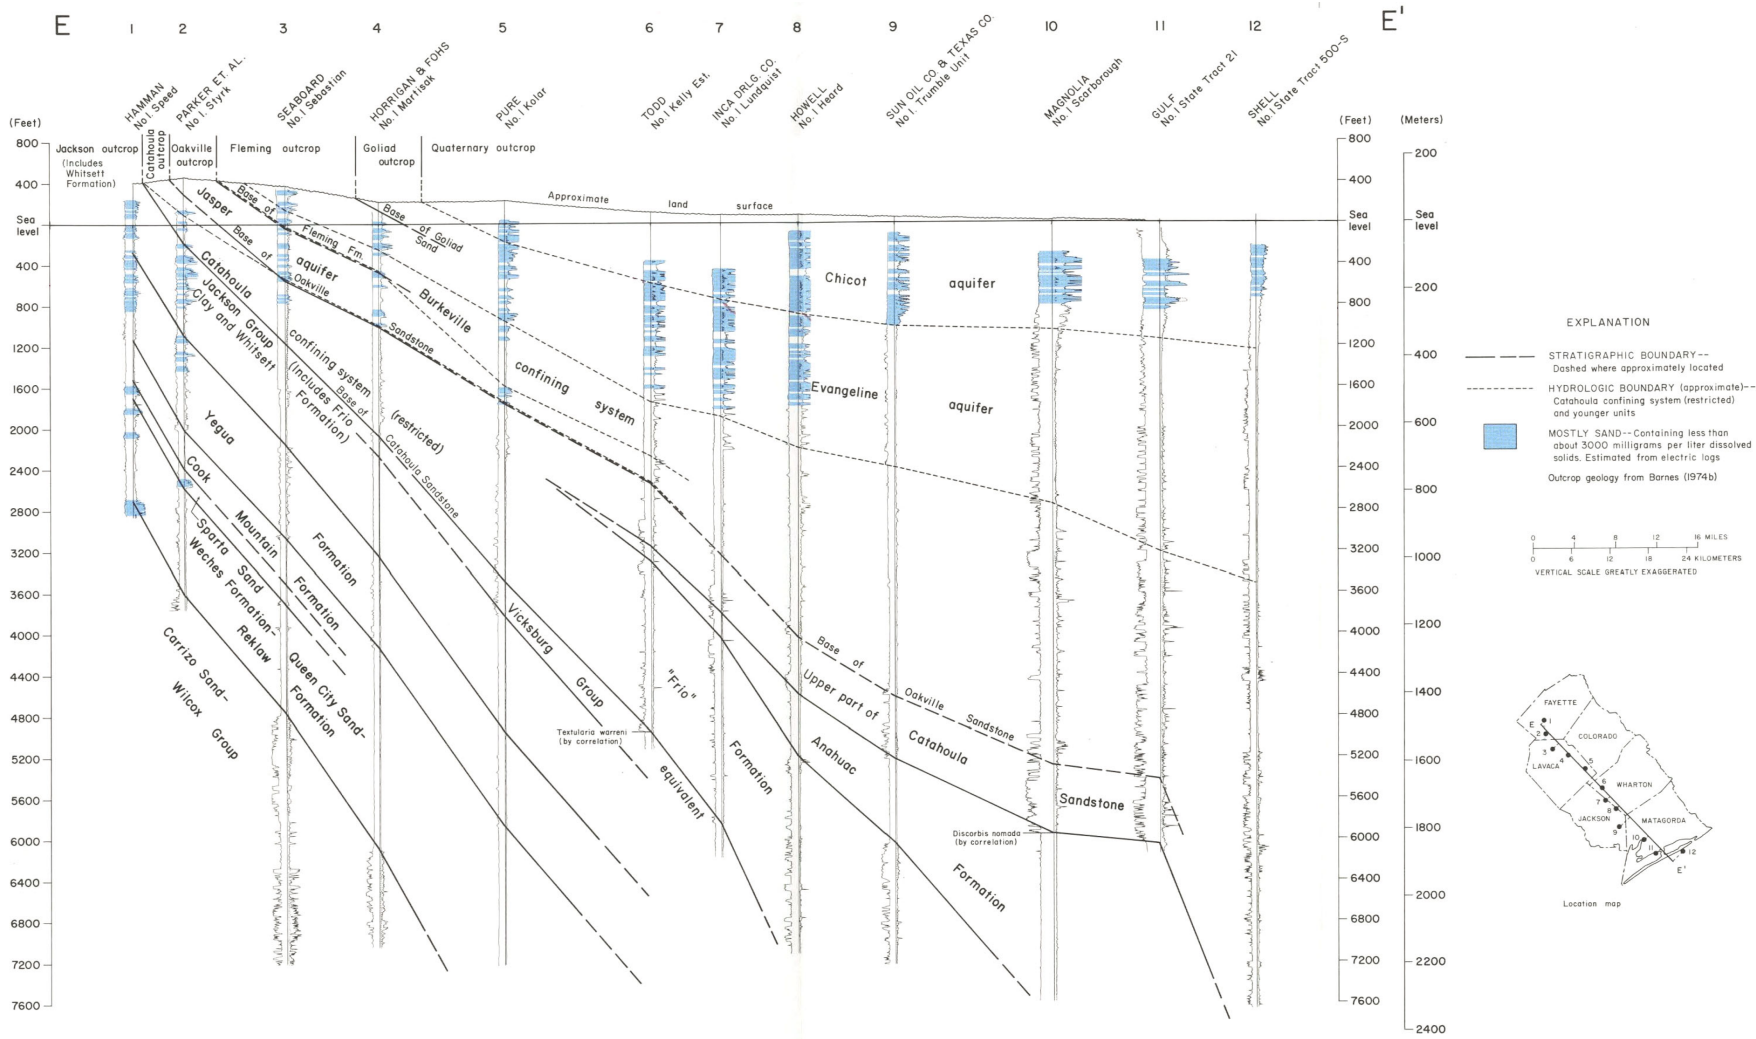
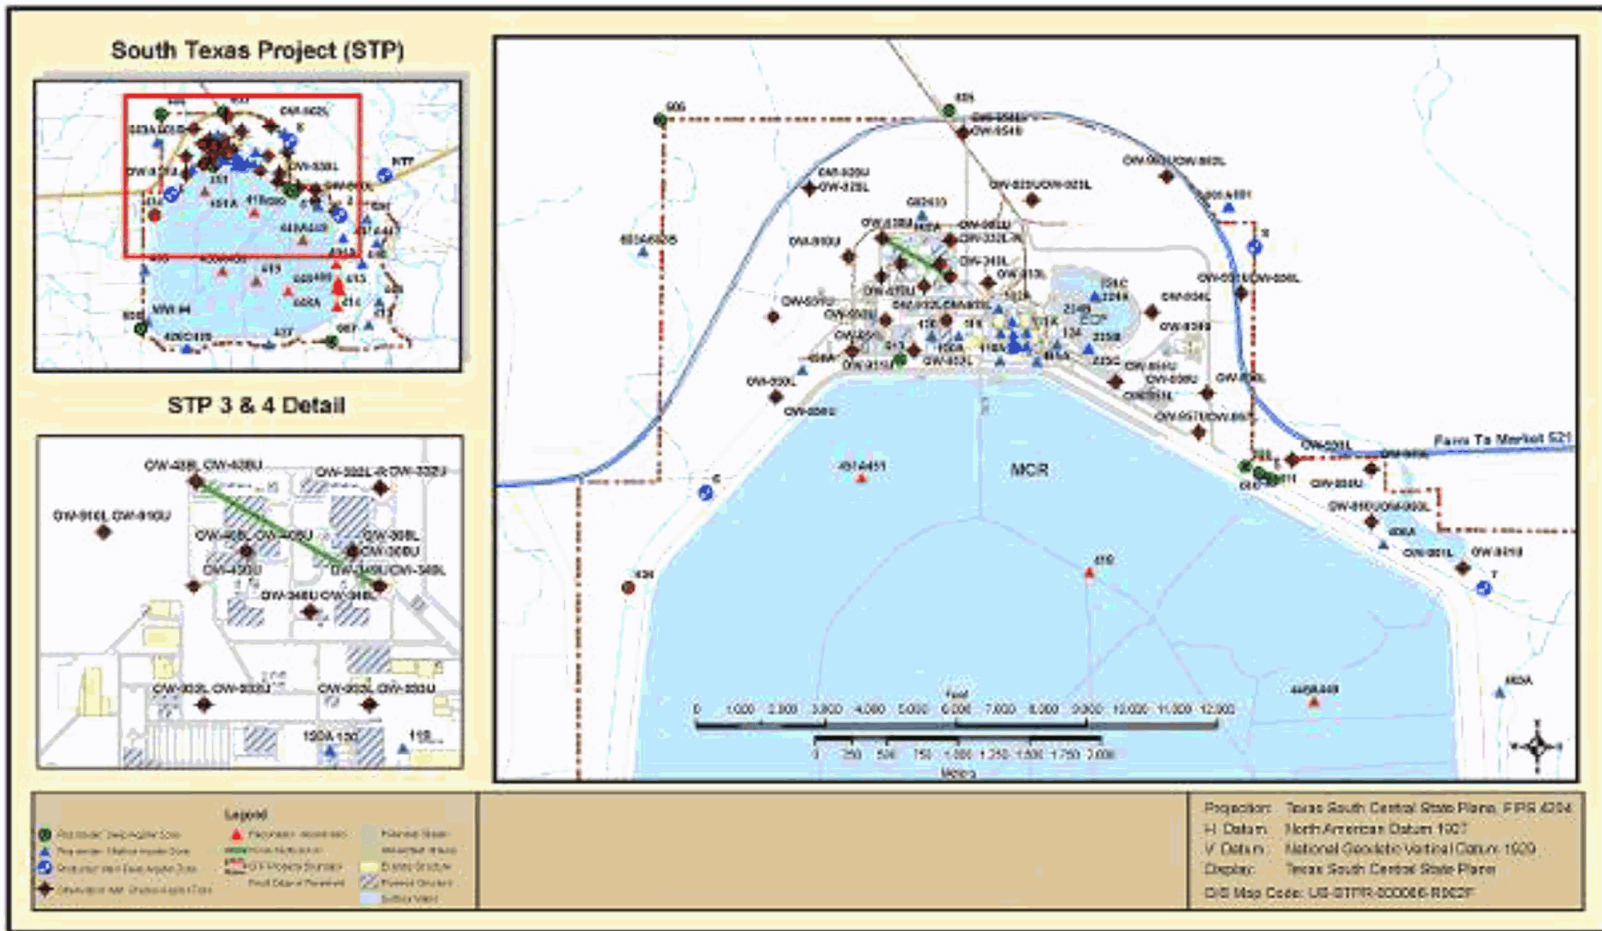


Figure 2.4S.12-9 Regional Hydrogeologic Cross Section through the Gulf Coast Aquifer System (Reference 2.4S.12-5)





**Figure 2.4S.12-10 STP Site Well Locations**

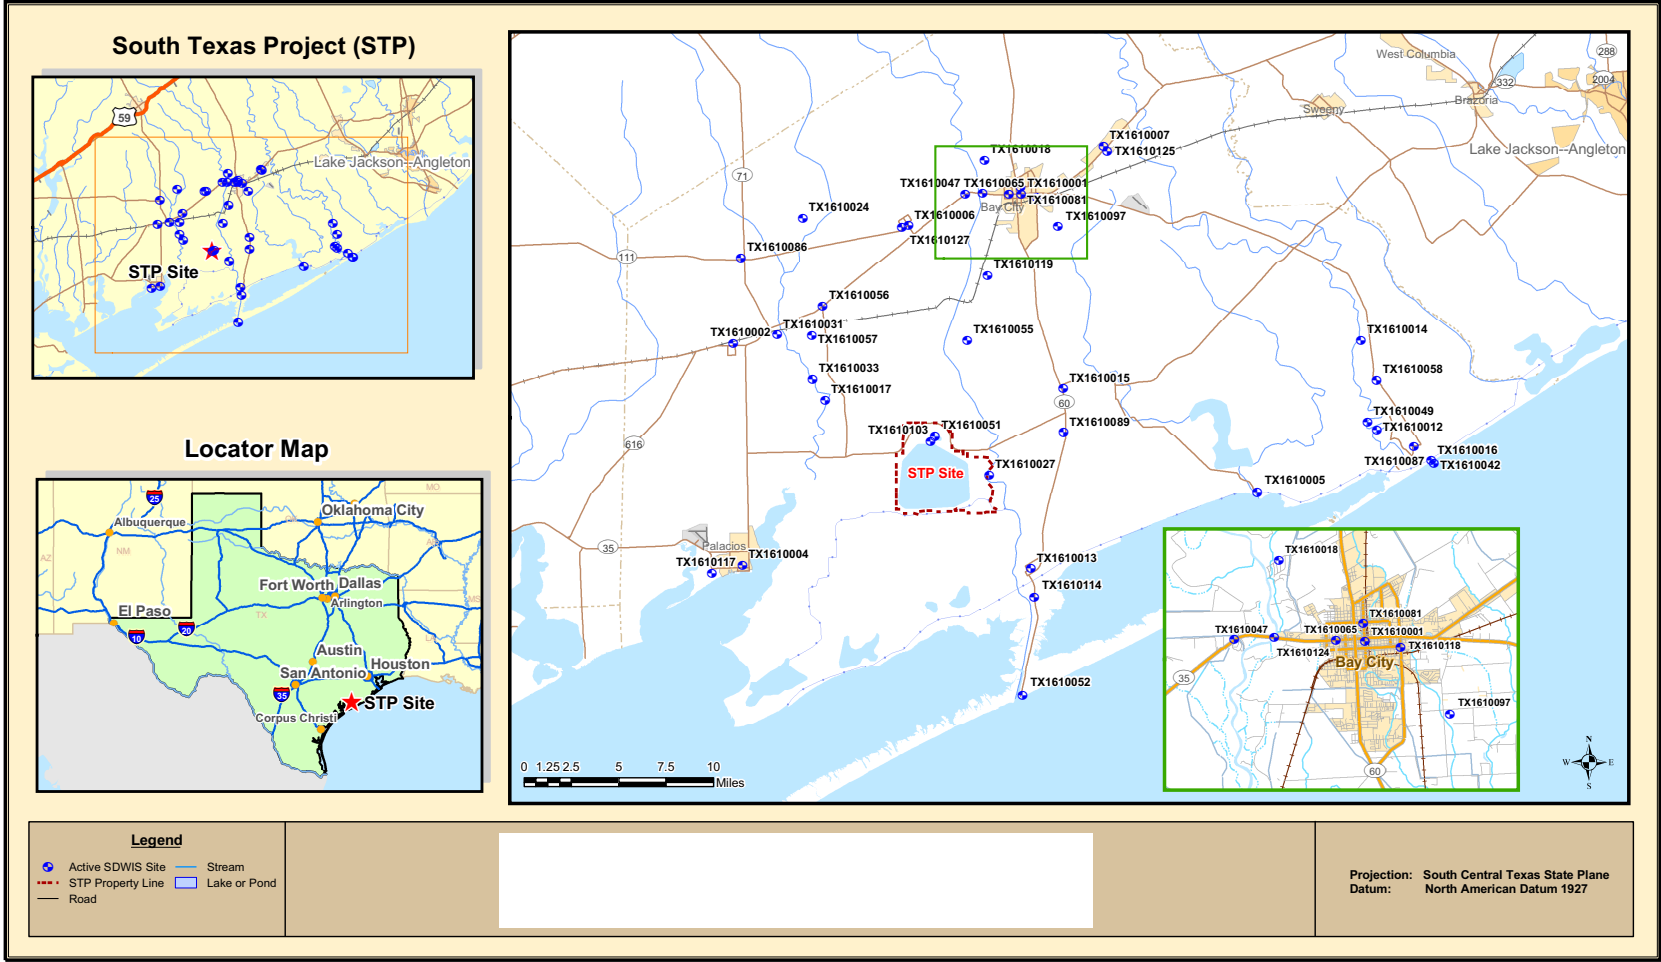


Figure 2.4S.12-11 Safe Drinking Water Information System (SDWIS) Water Supply Systems in Matagorda County

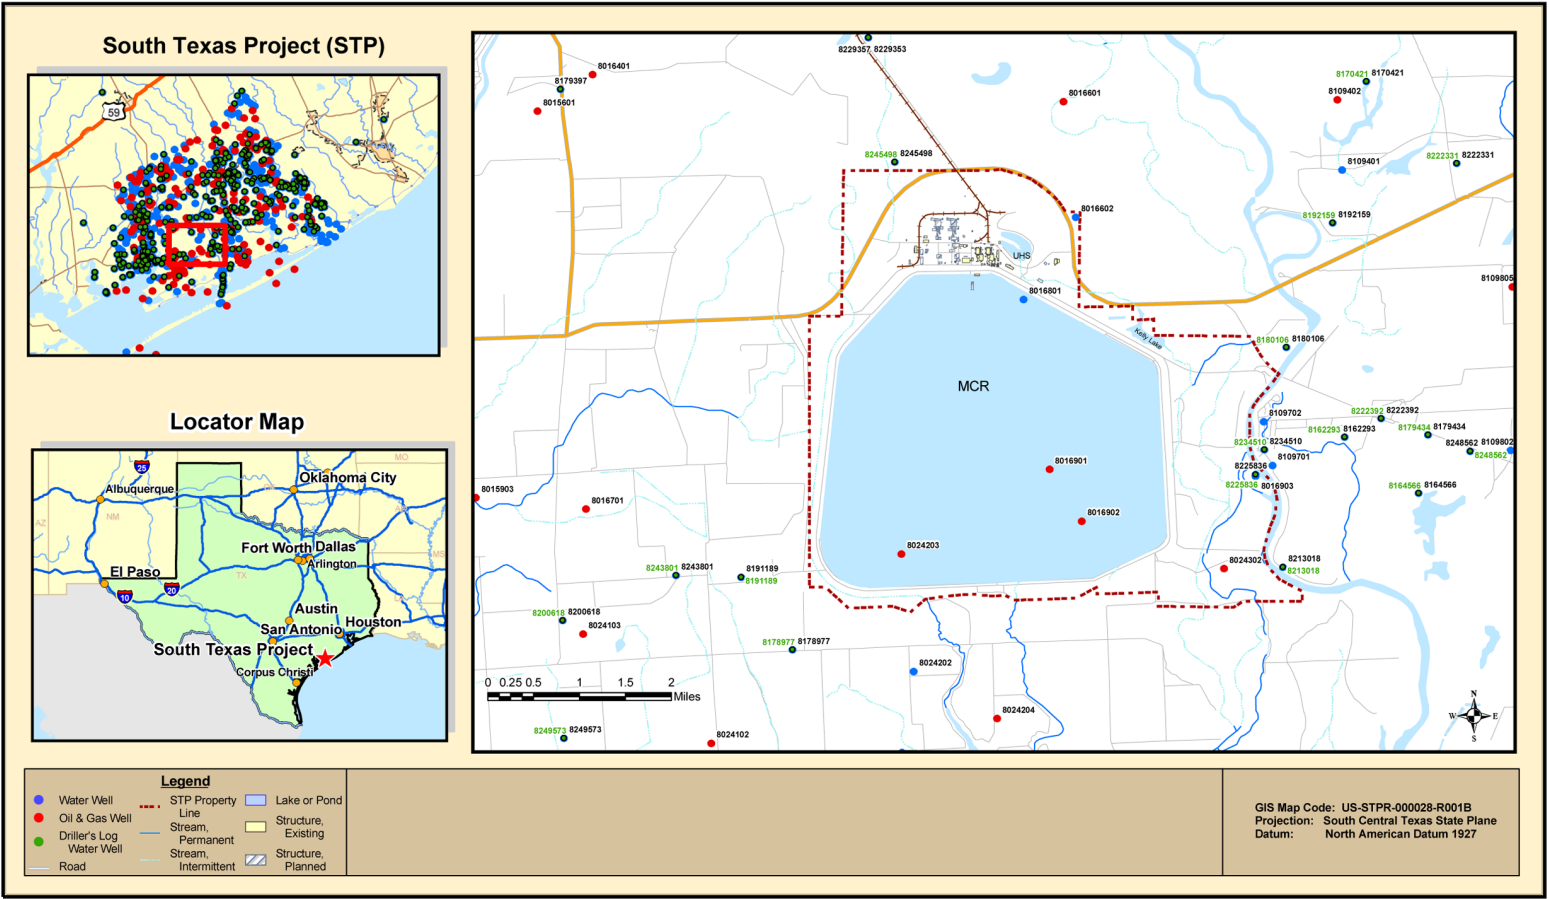
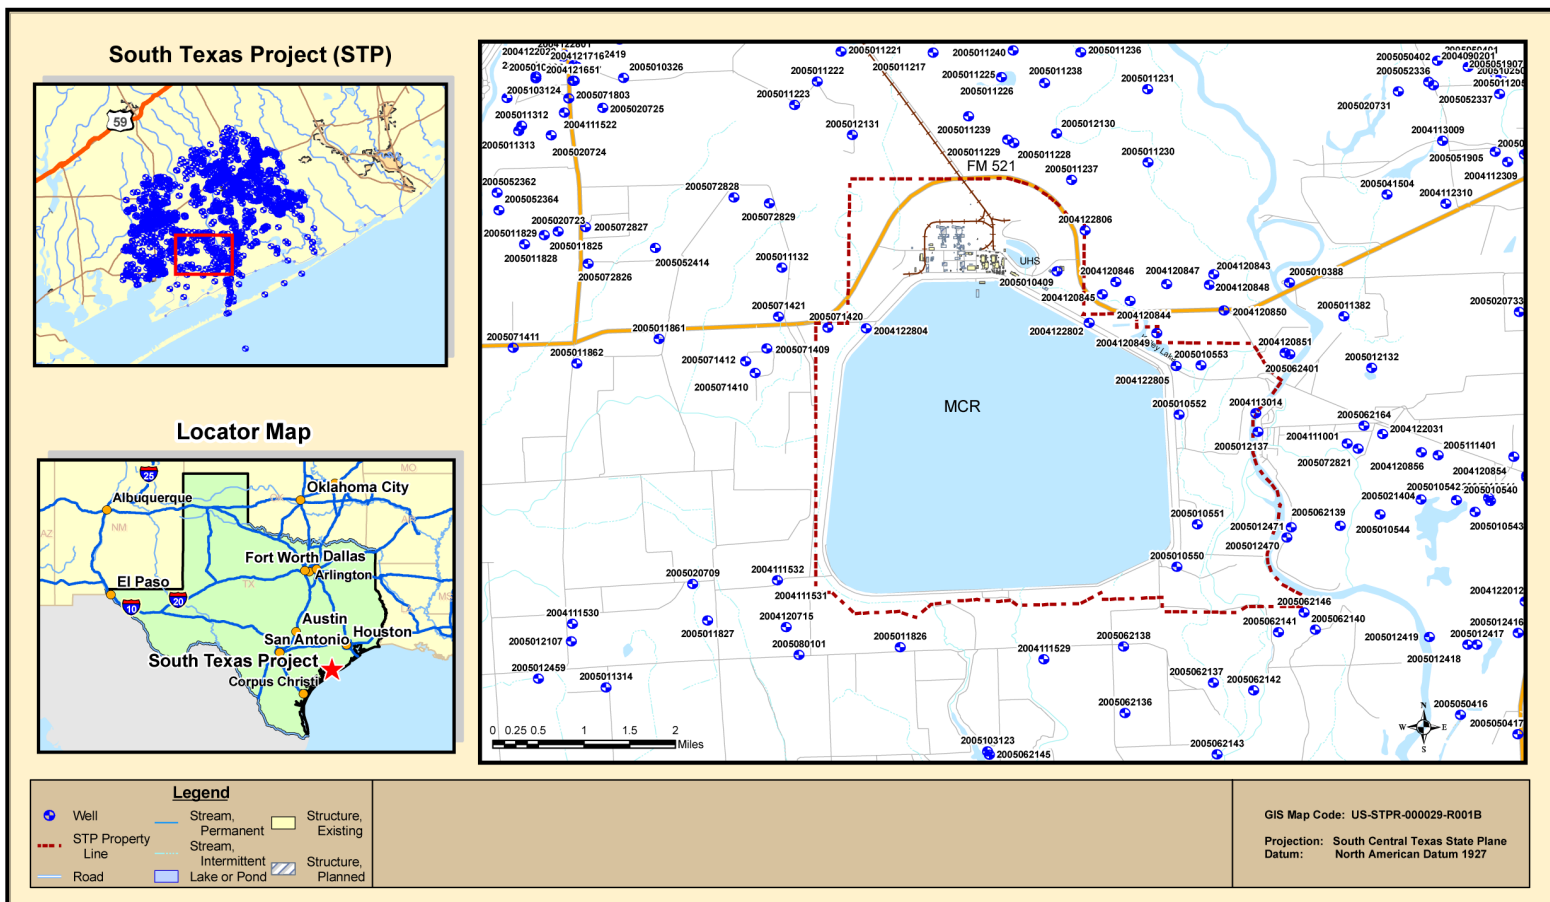


Figure 2.4S.12-12 Well Locations in Matagorda County and Adjacent areas from the TWDB Database (See Plate I of Appendix 2.4S.12-A for clarity)



**Figure 2.4S.12-13 Coastal Plains Groundwater Conservation District Well Locations (See Plate II of Appendix 2.4S.12-A for clarity)**

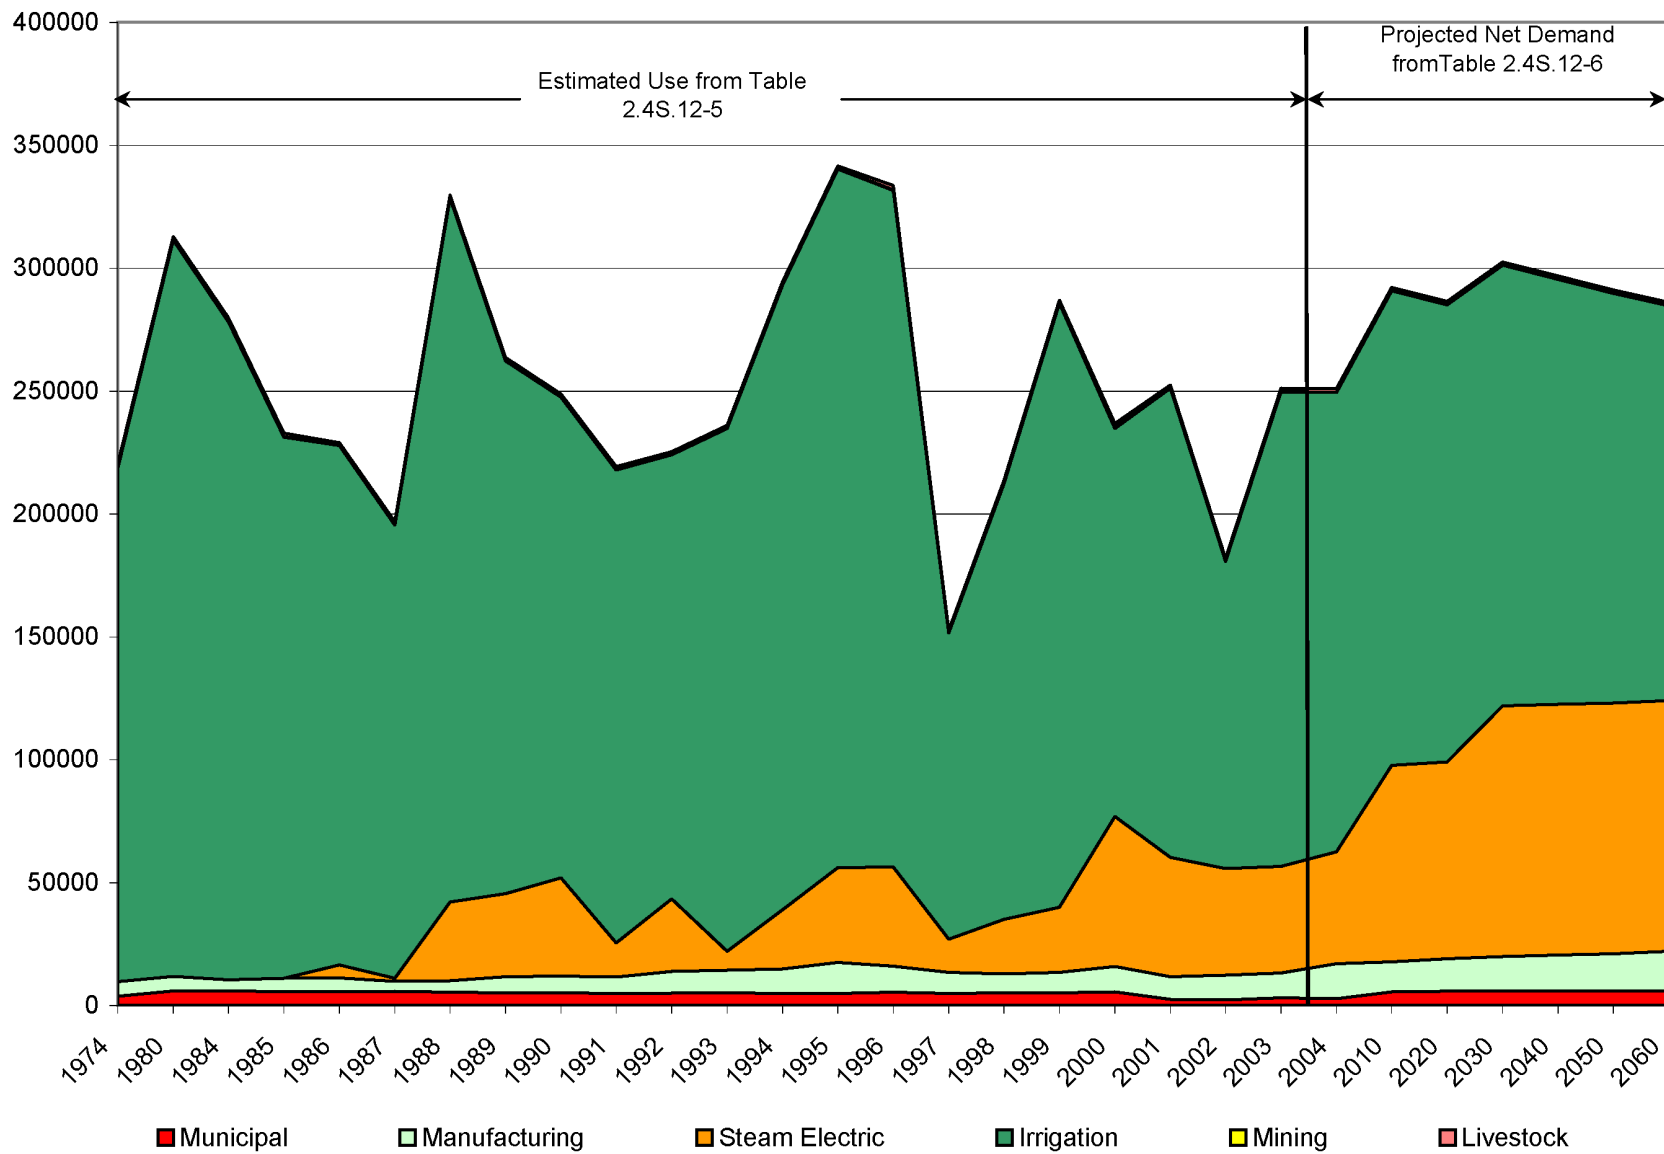


Figure 2.4S.12-14 Water Use Estimates



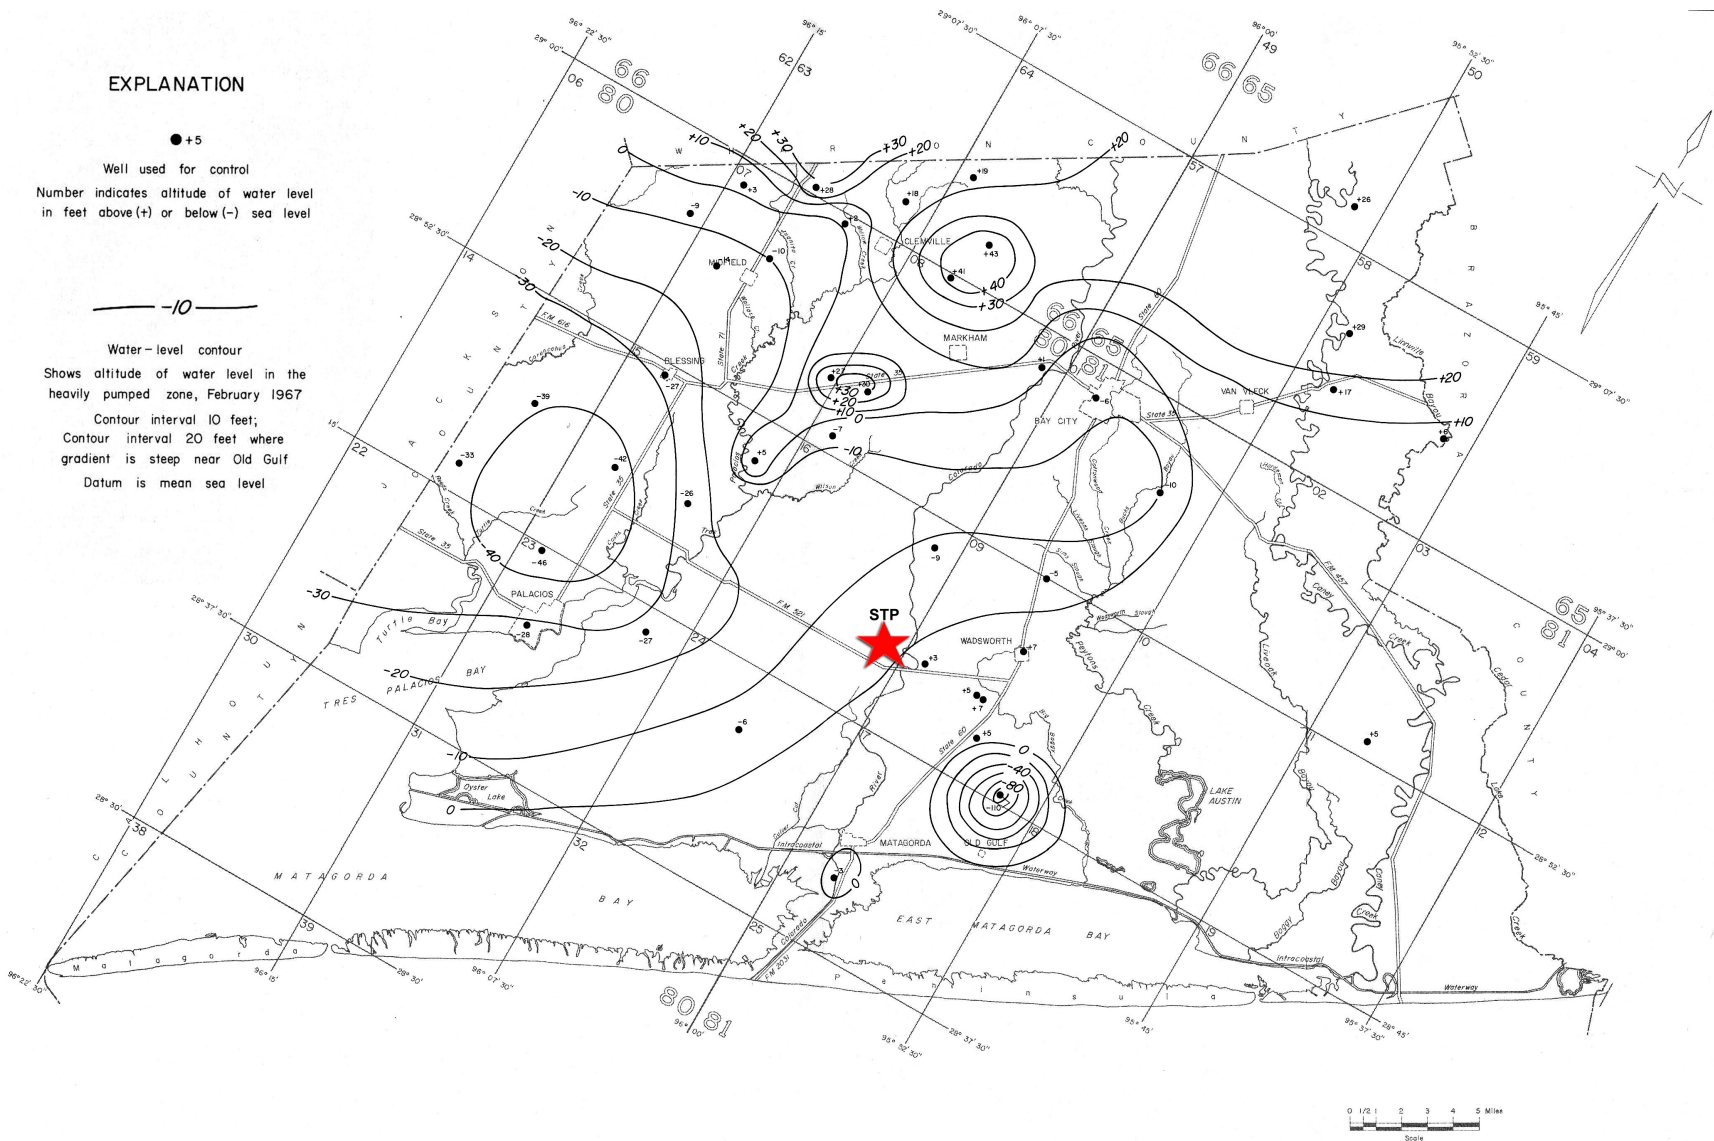
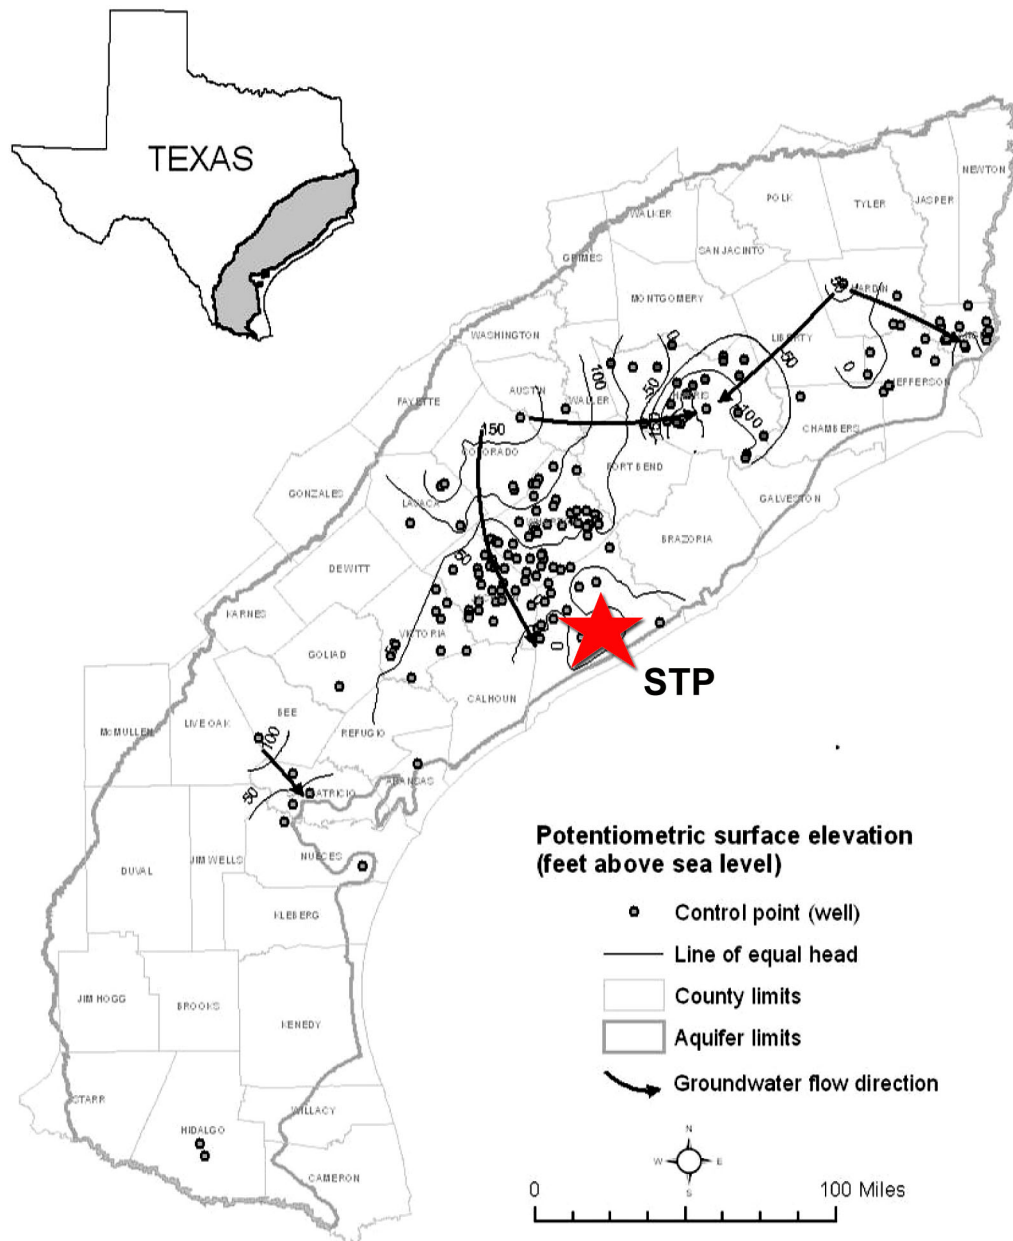
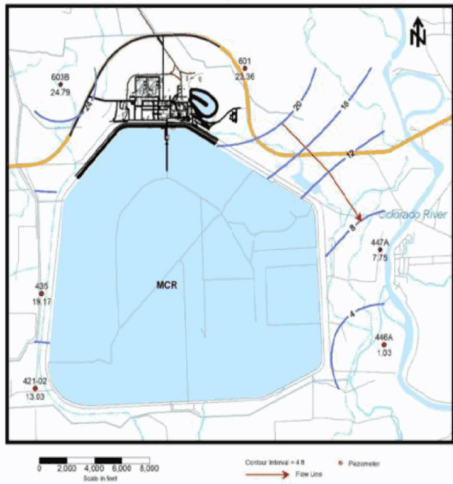


Figure 2.4S.12-15 Potentiometric Surface in the Deep Aquifer in Matagorda County in 1967 (modified from Reference 2.4S.12-6)

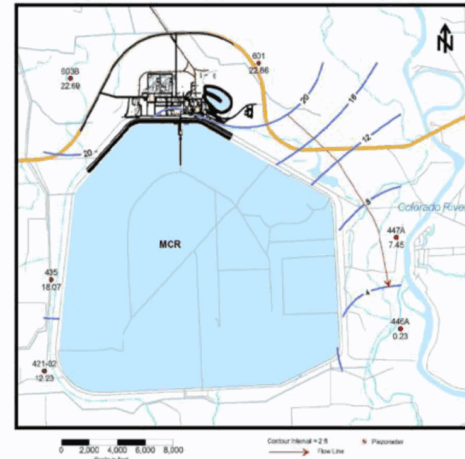


**Figure 2.4S.12-16 Regional Potentiometric Surface Map including water level measurements from 2001 to 2005 (Reference 2.4S.12-15)**


November 1, 2005 Upper Shallow Aquifer



May 1, 2006 Upper Shallow Aquifer



November 1, 2005 Lower Shallow Aquifer

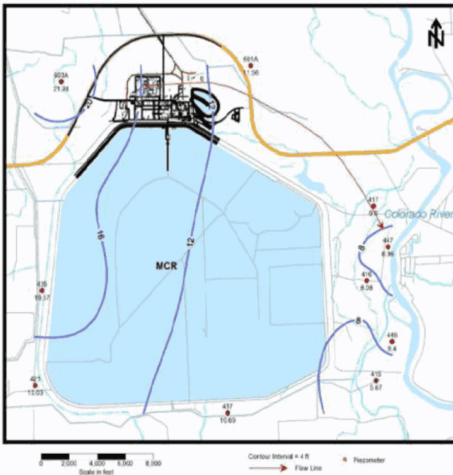

May 1, 2006 Lower Shallow Aquifer

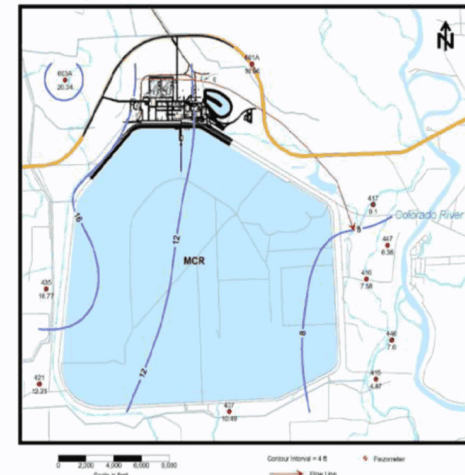


Figure 2.4S.12-17 Shallow Aquifer Potentiometric Surface Maps



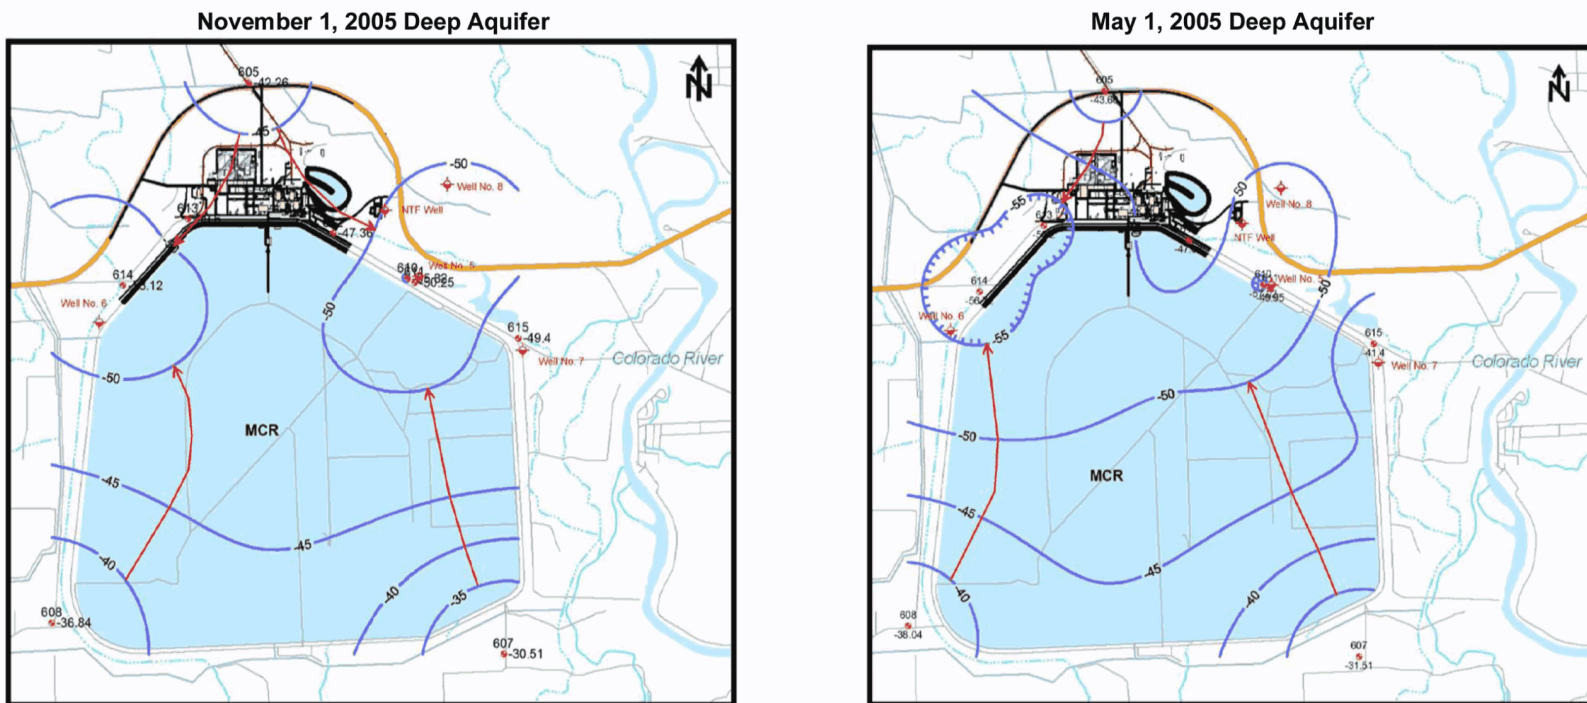
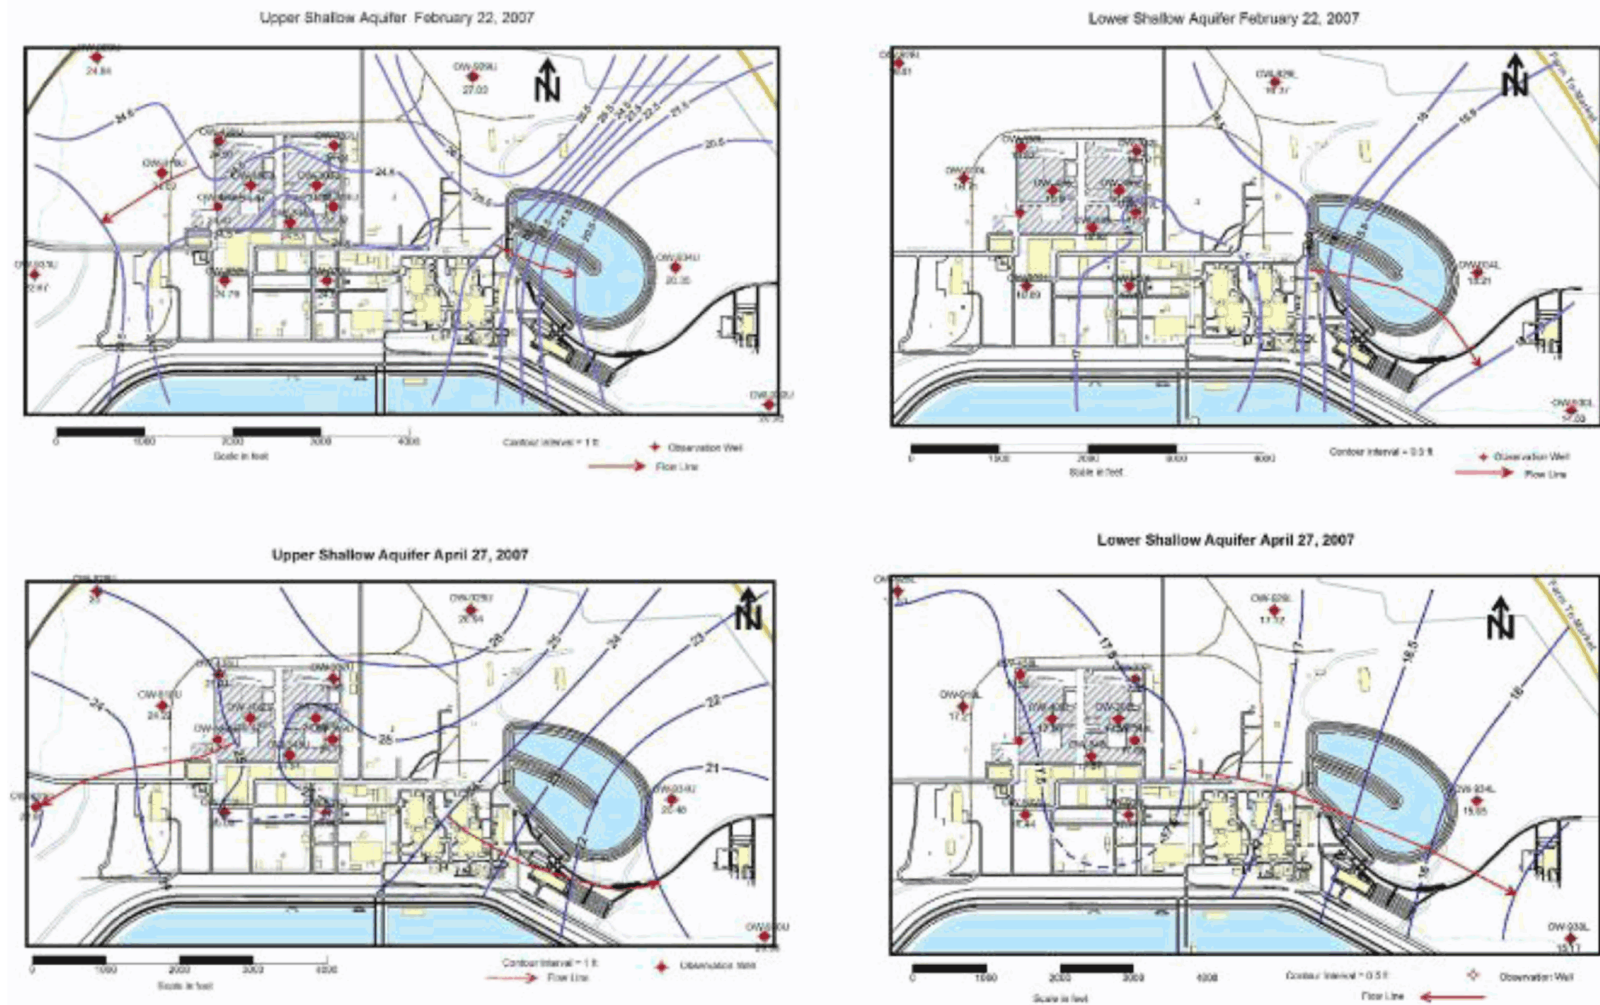


Figure 2.4S.12-18 Deep Aquifer Potentiometric Surface Maps



**Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 1 of 11)**

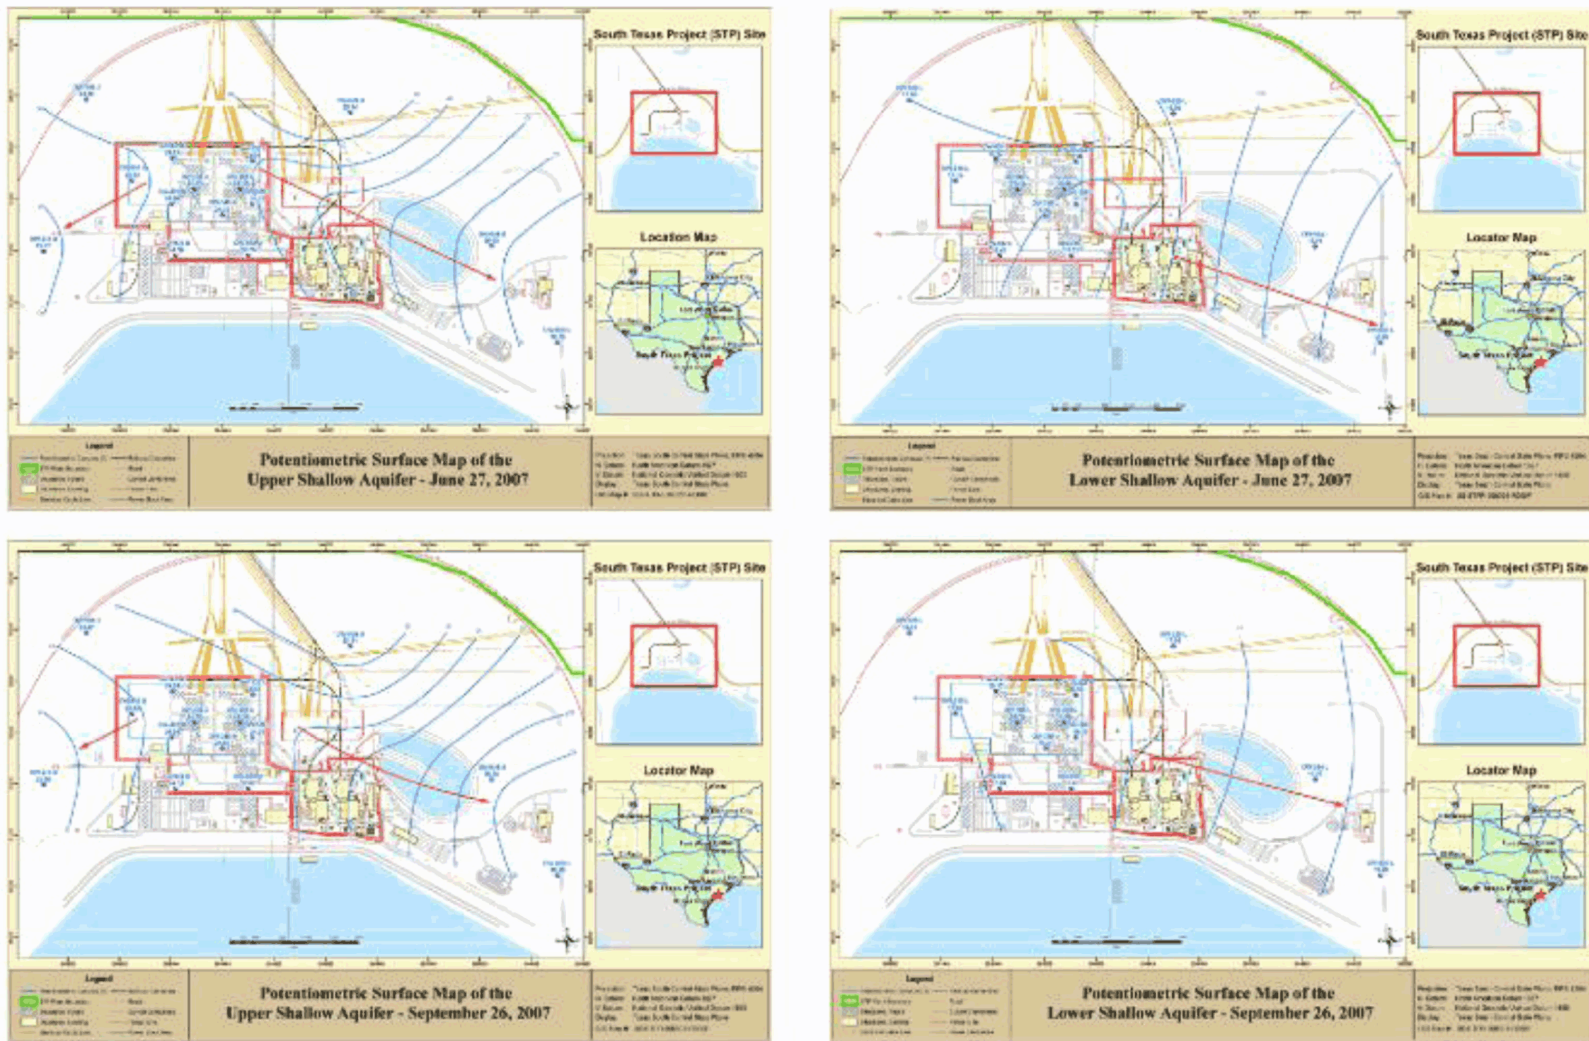
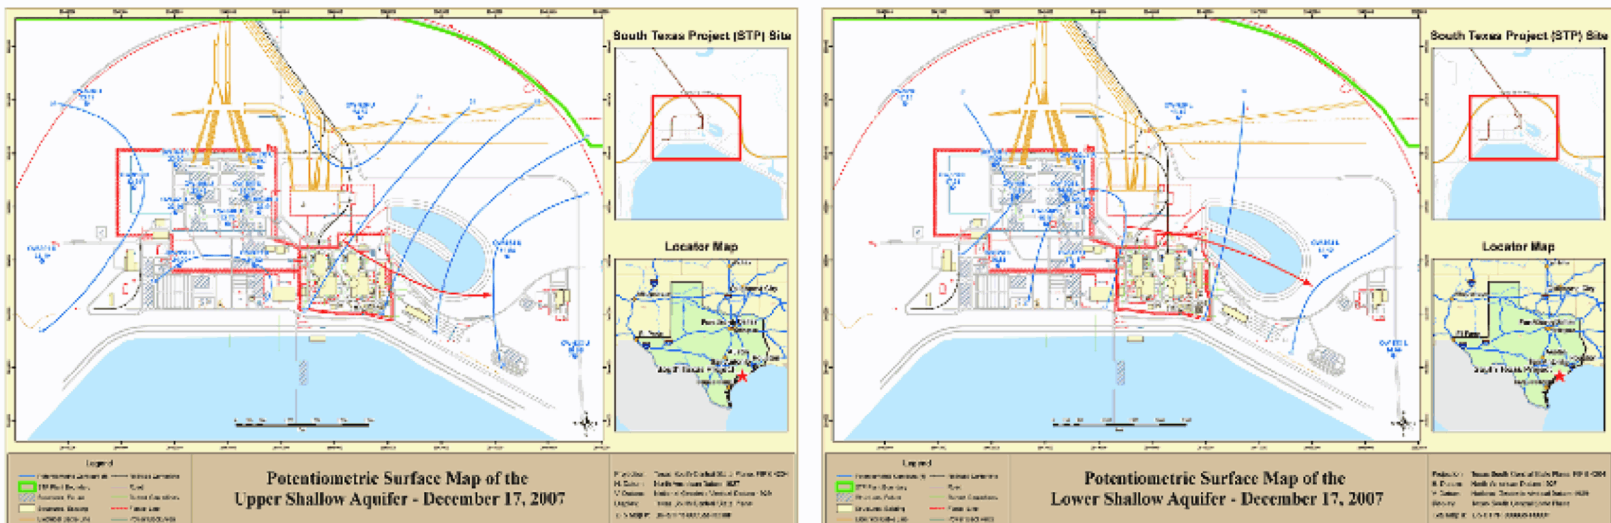


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 2 of 11)





**Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 3 of 11)**

**Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 4 of 11)**

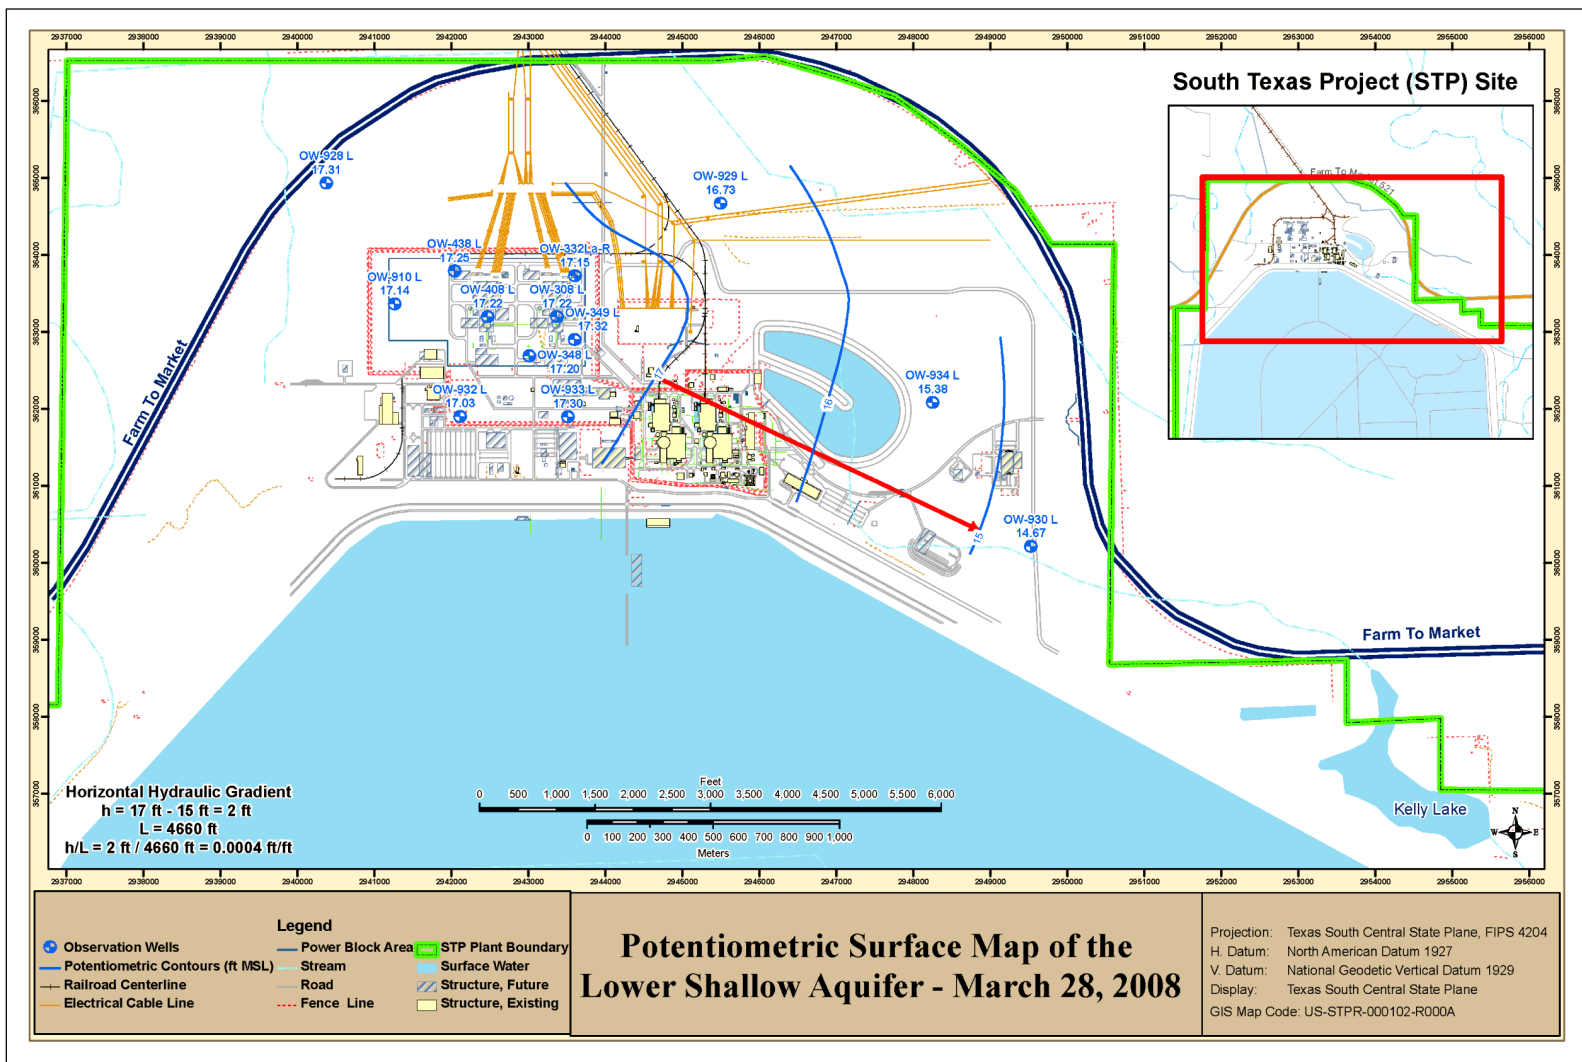


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 5 of 11)

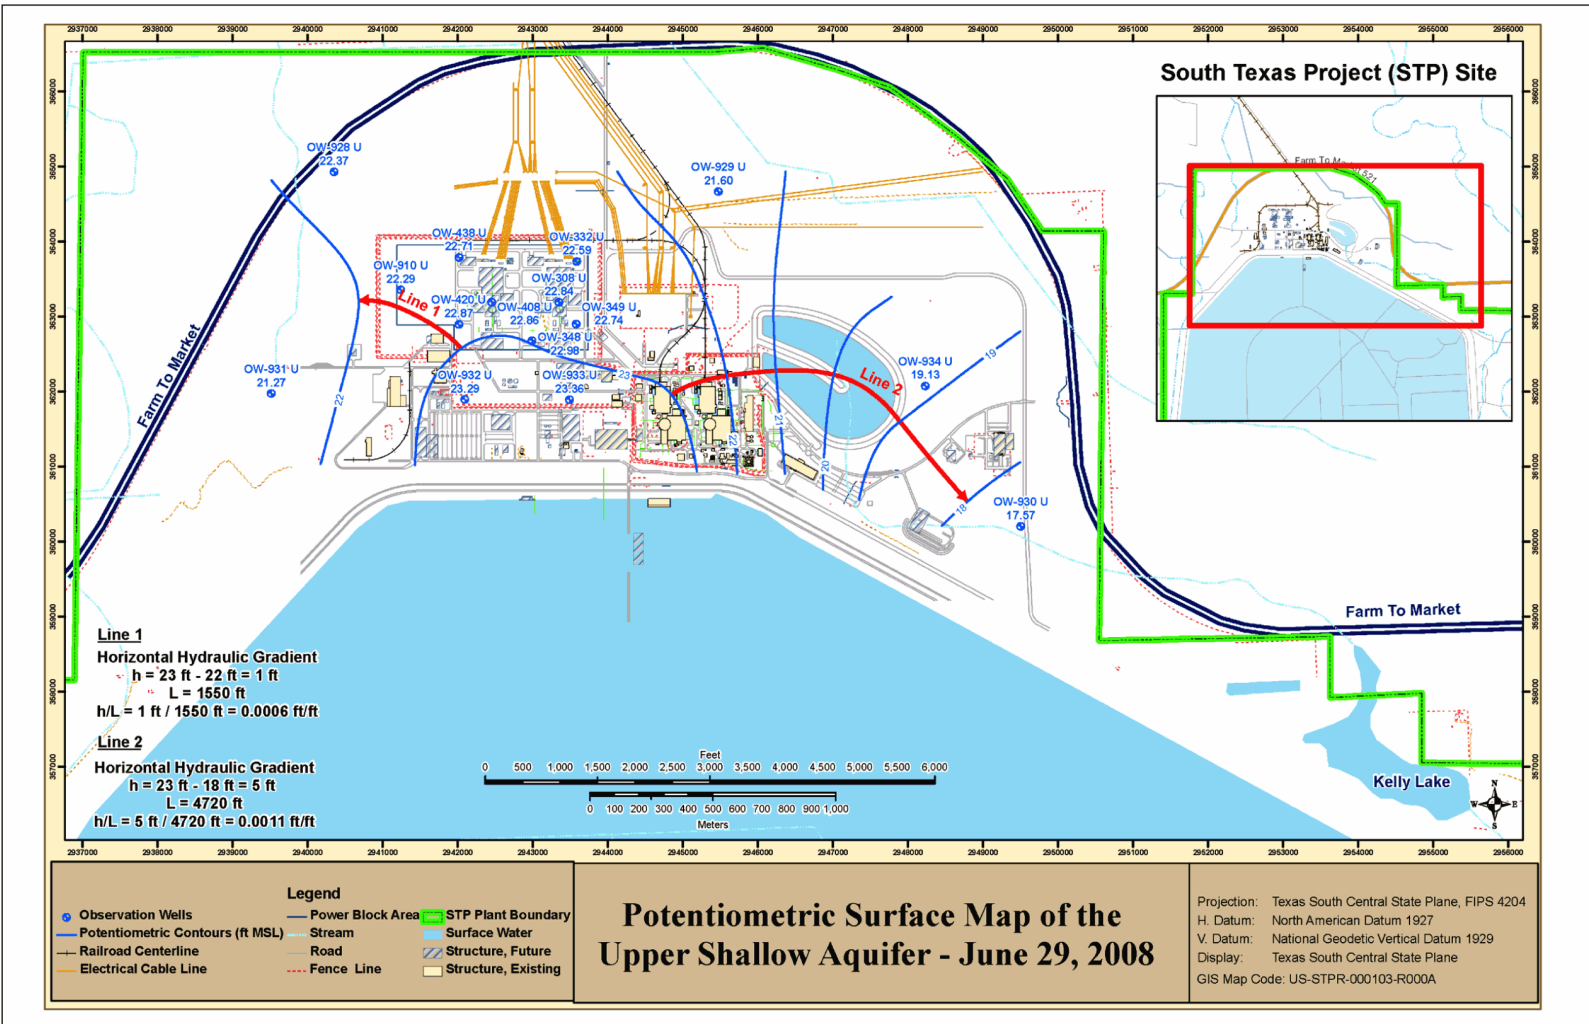


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 6 of 11)

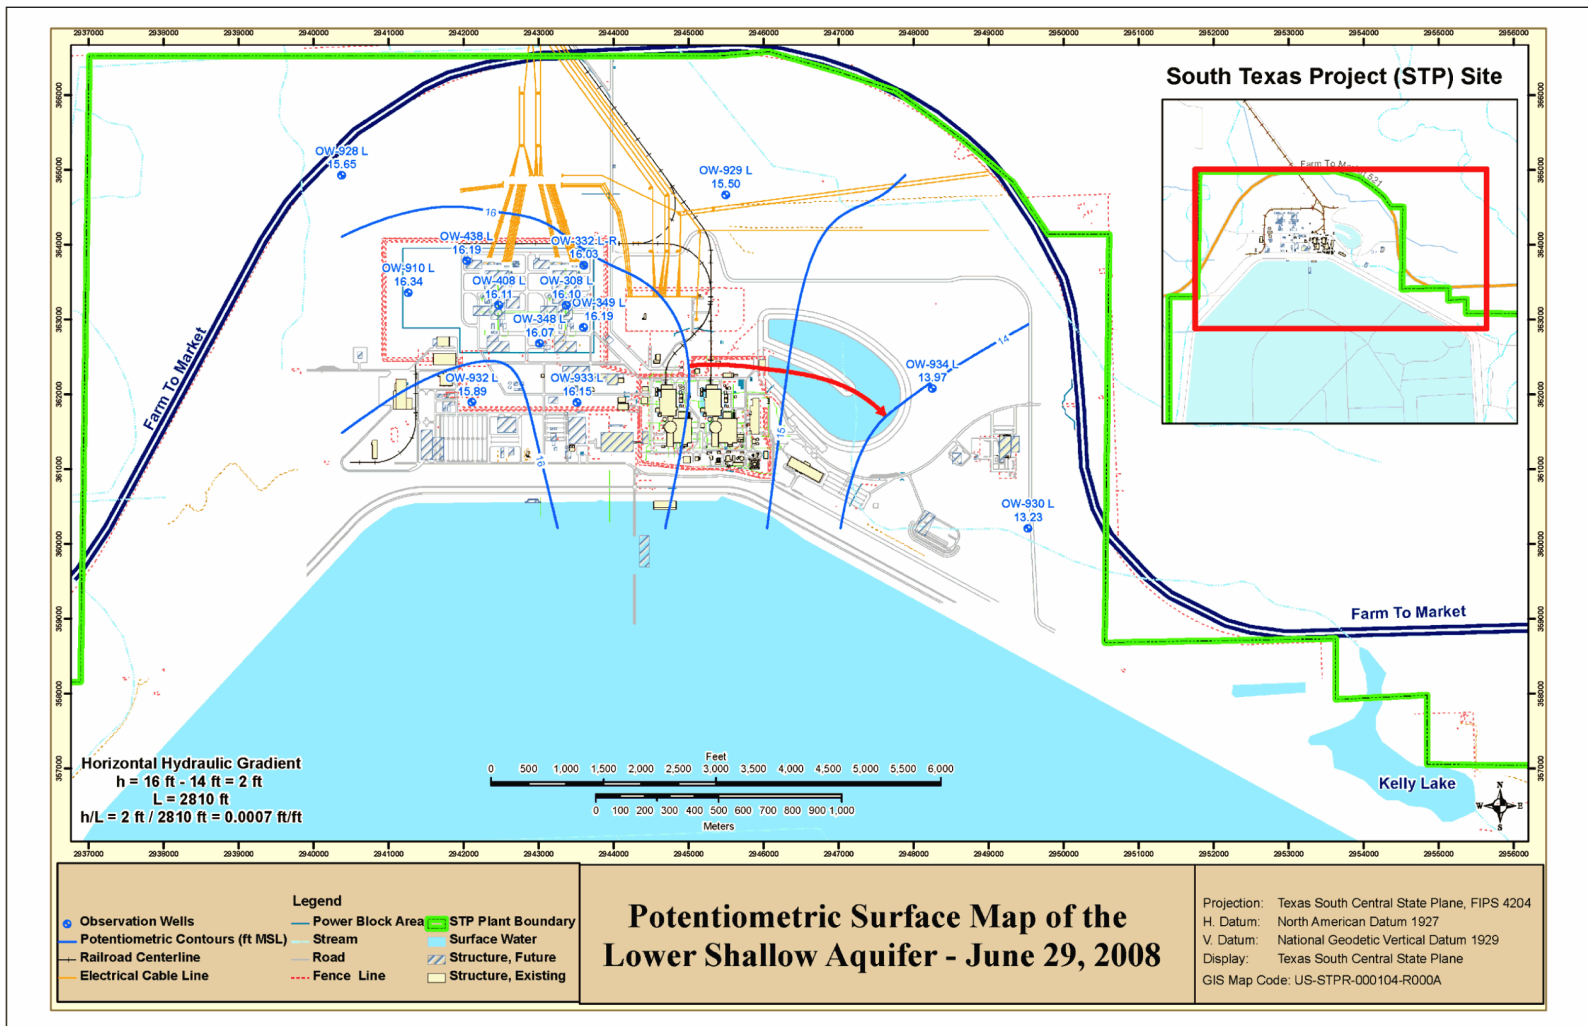
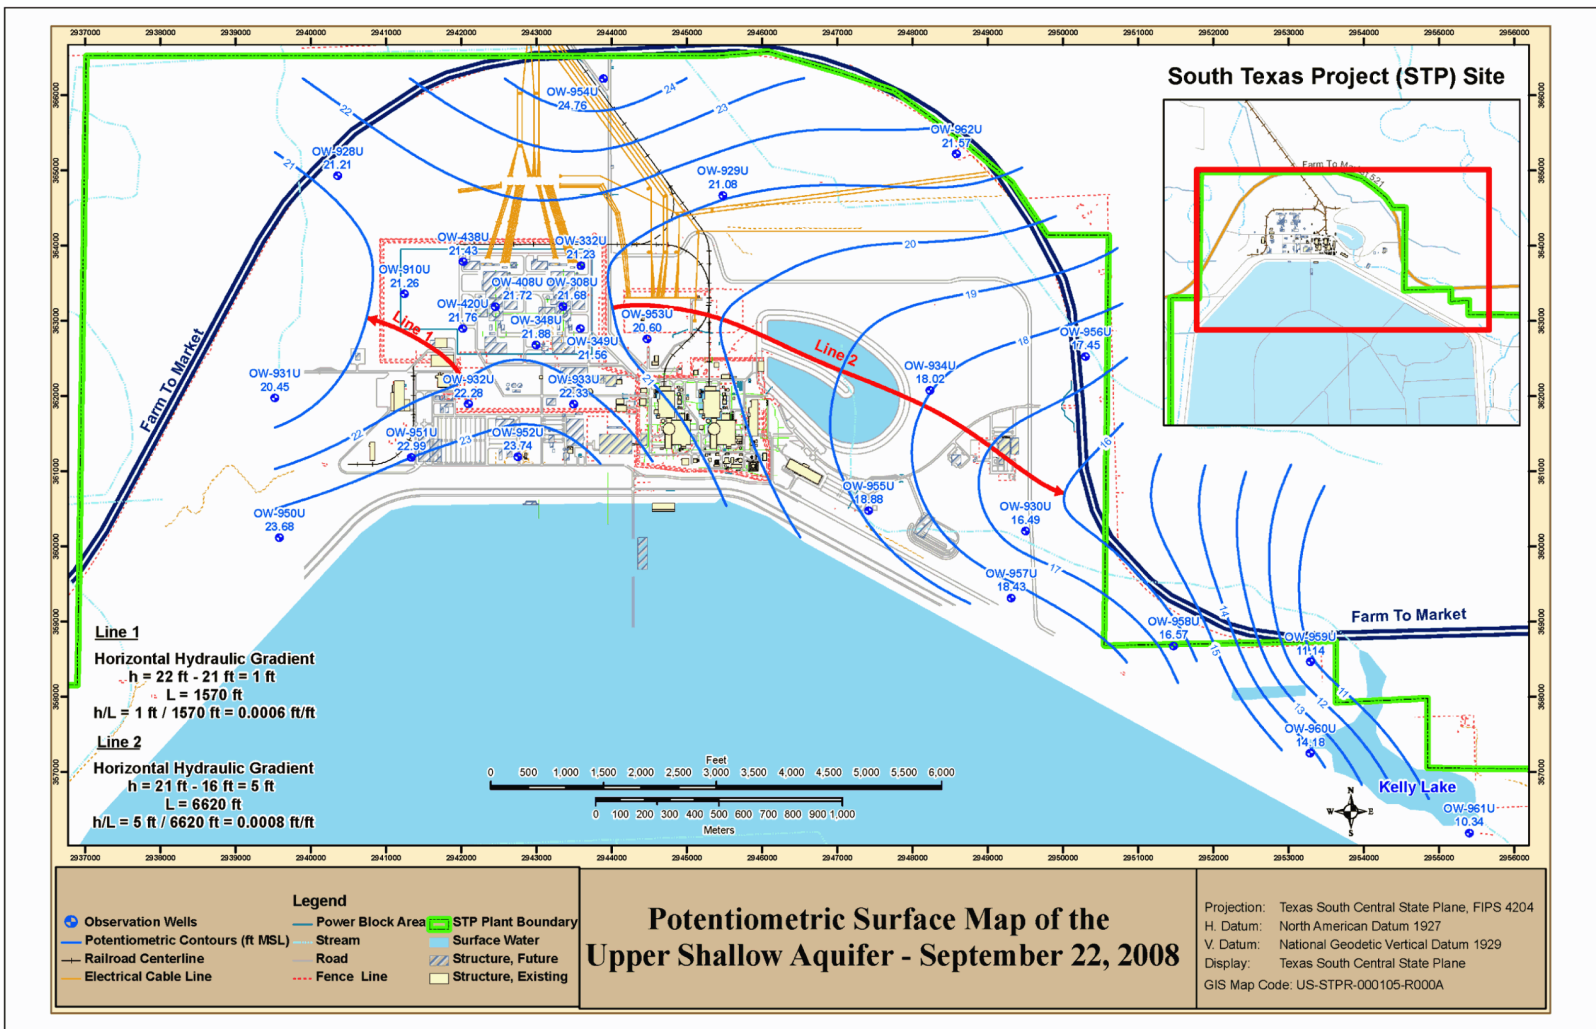


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 7 of 11)





**Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 8 of 11)**

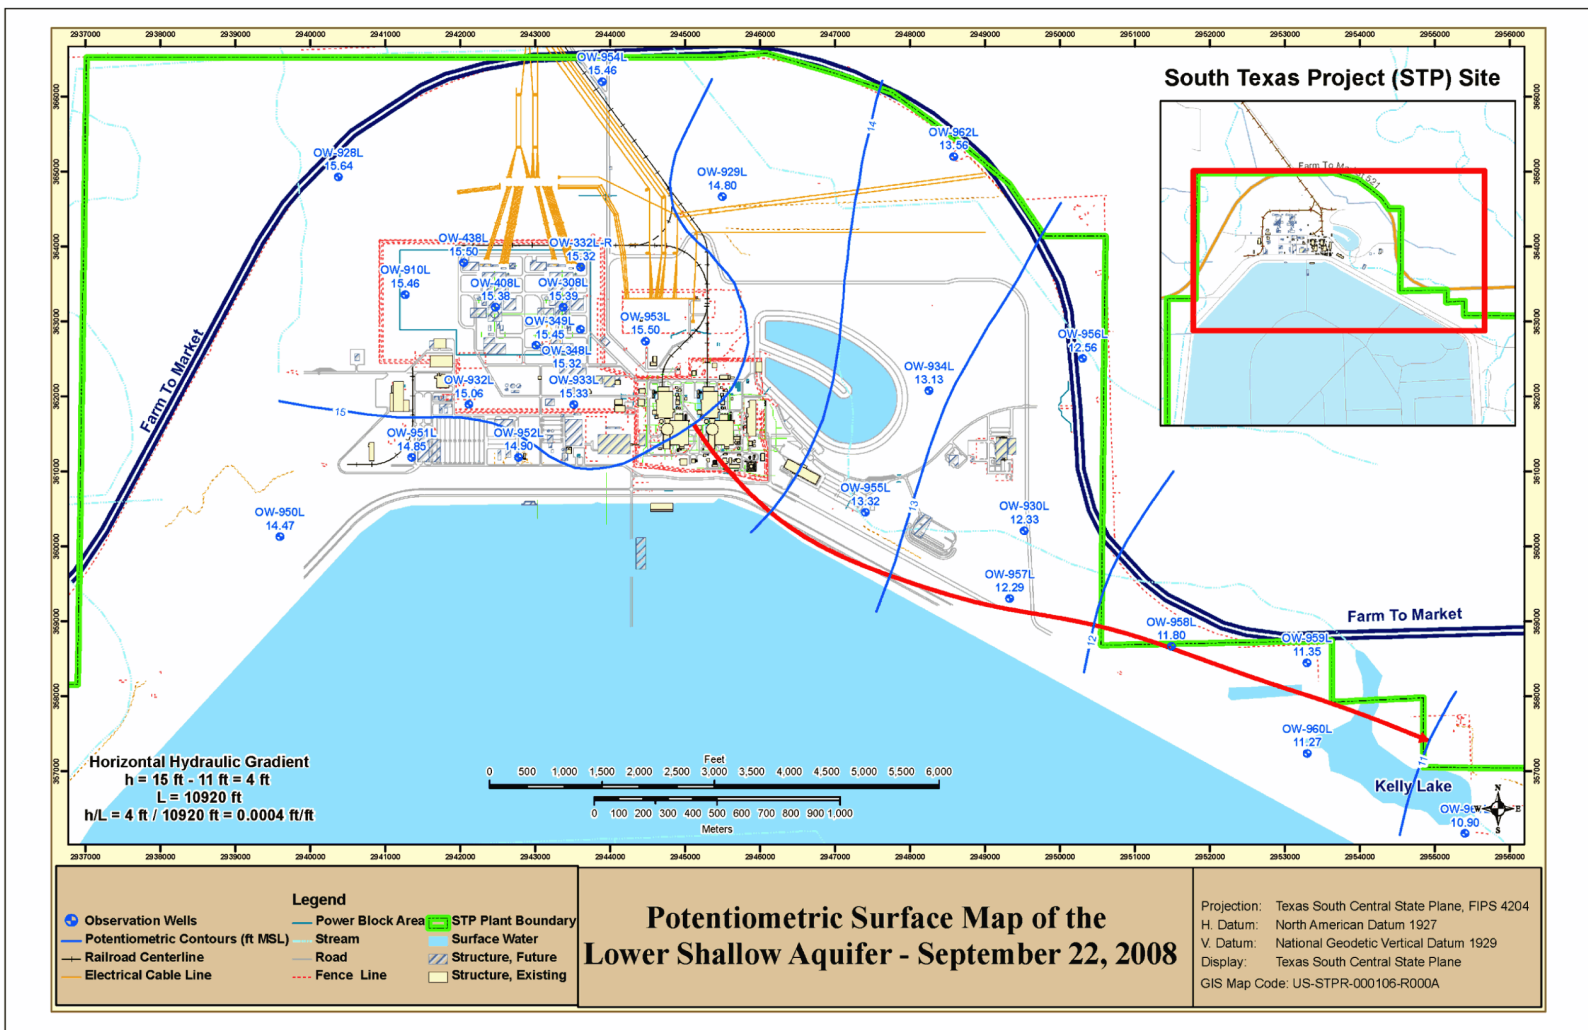


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 9 of 11)

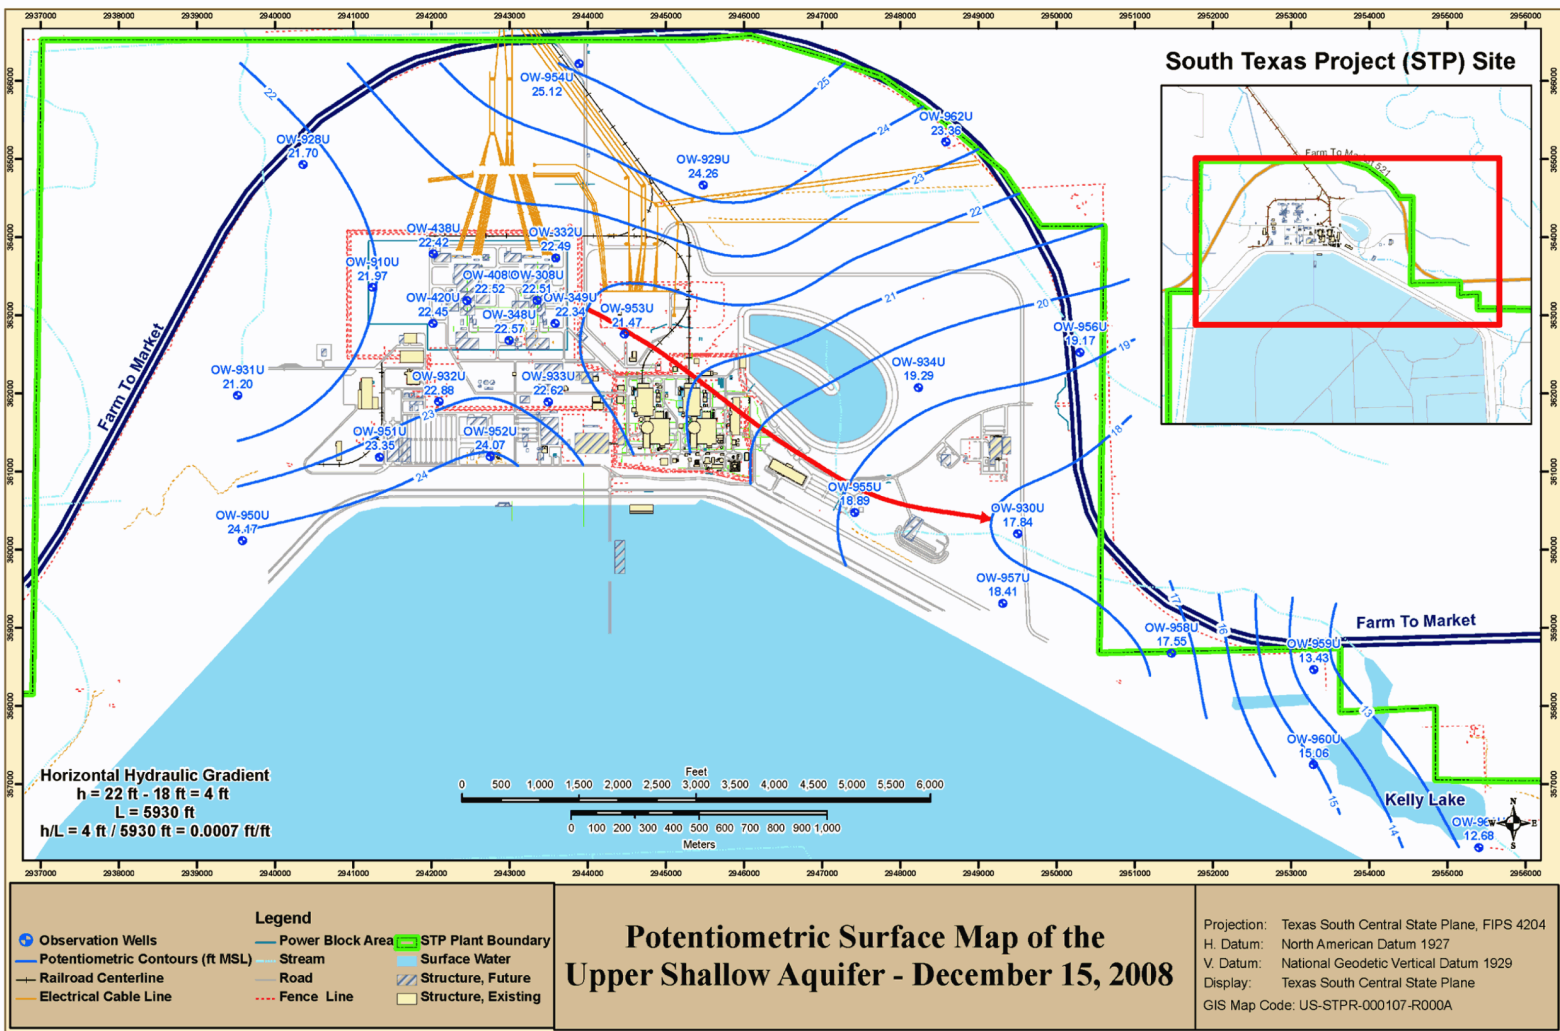


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 10 of 11)

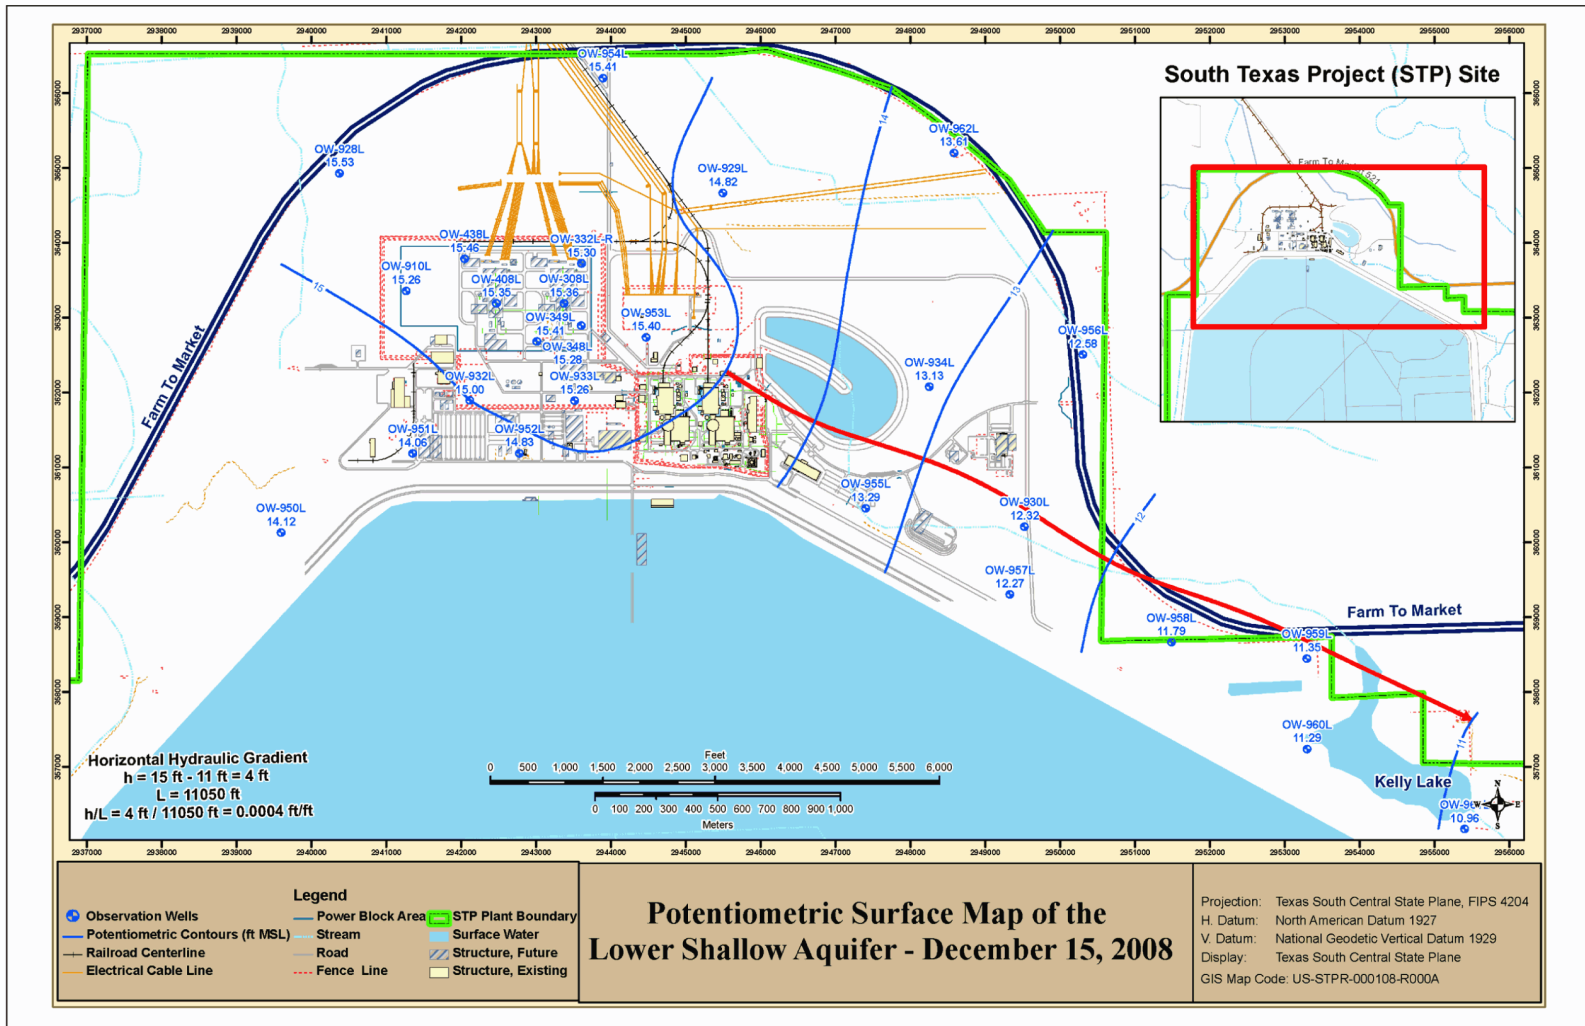


Figure 2.4S.12-19 Quarterly Potentiometric Surface Maps in the STP 3 & 4 Areas (Sheet 11 of 11)

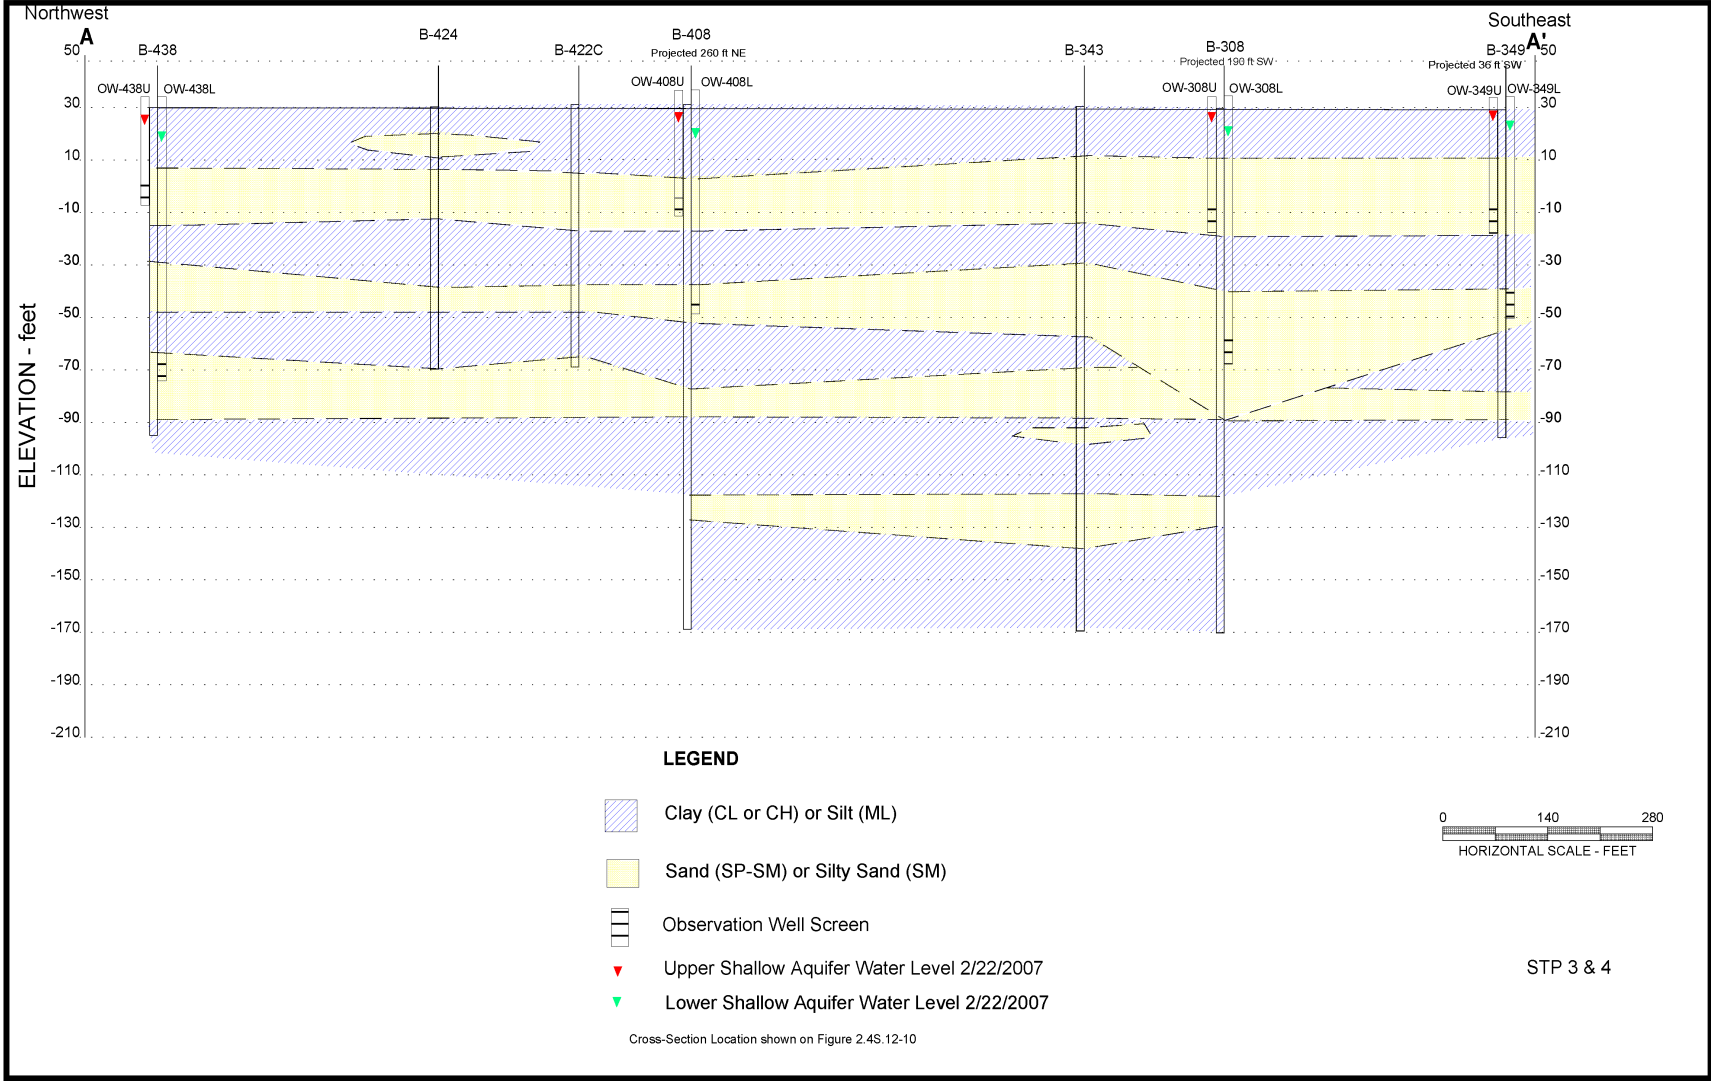


Figure 2.4S.12-20 Hydrogeologic Cross-Section A-A'



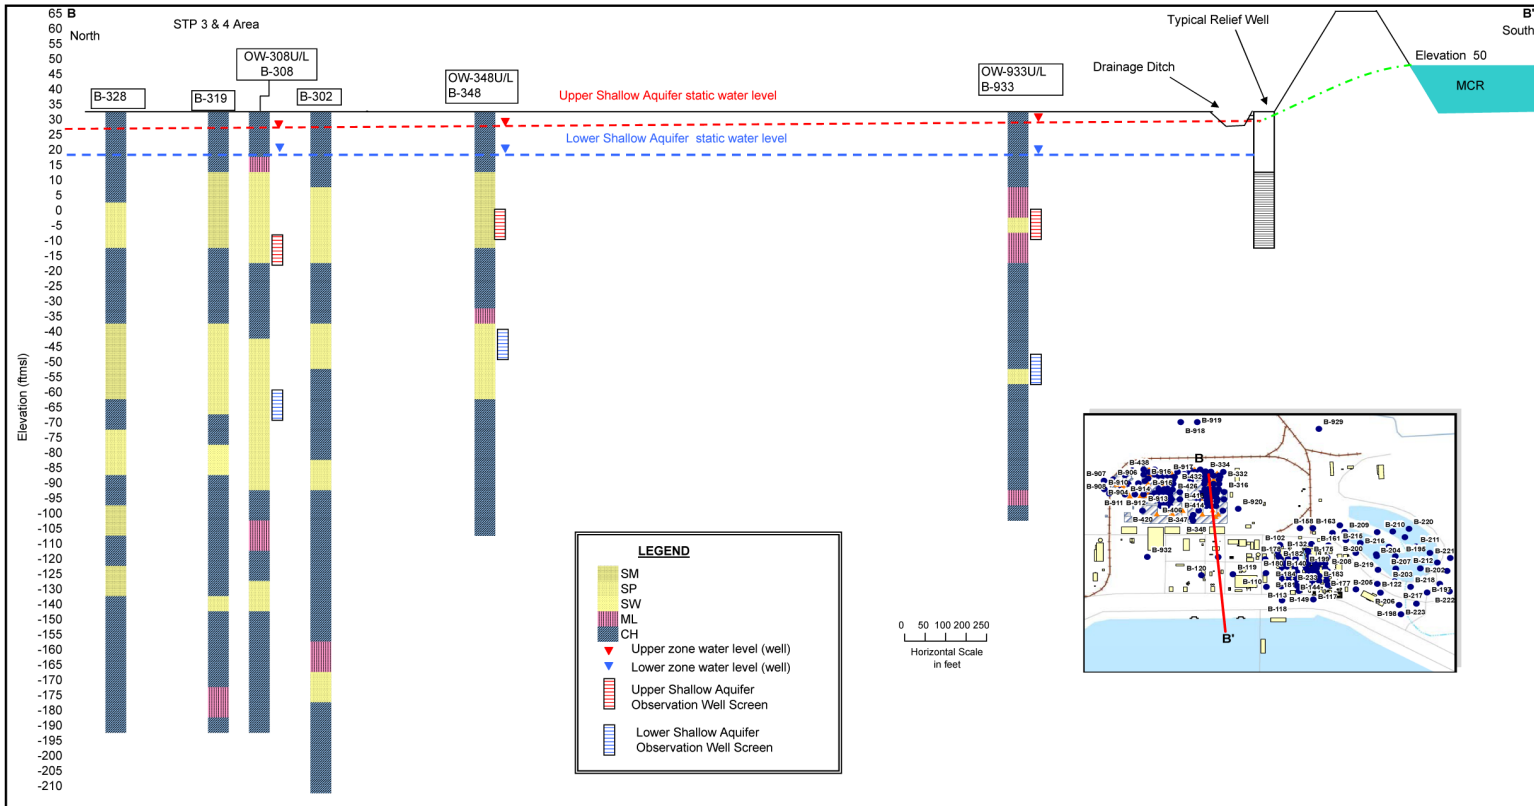
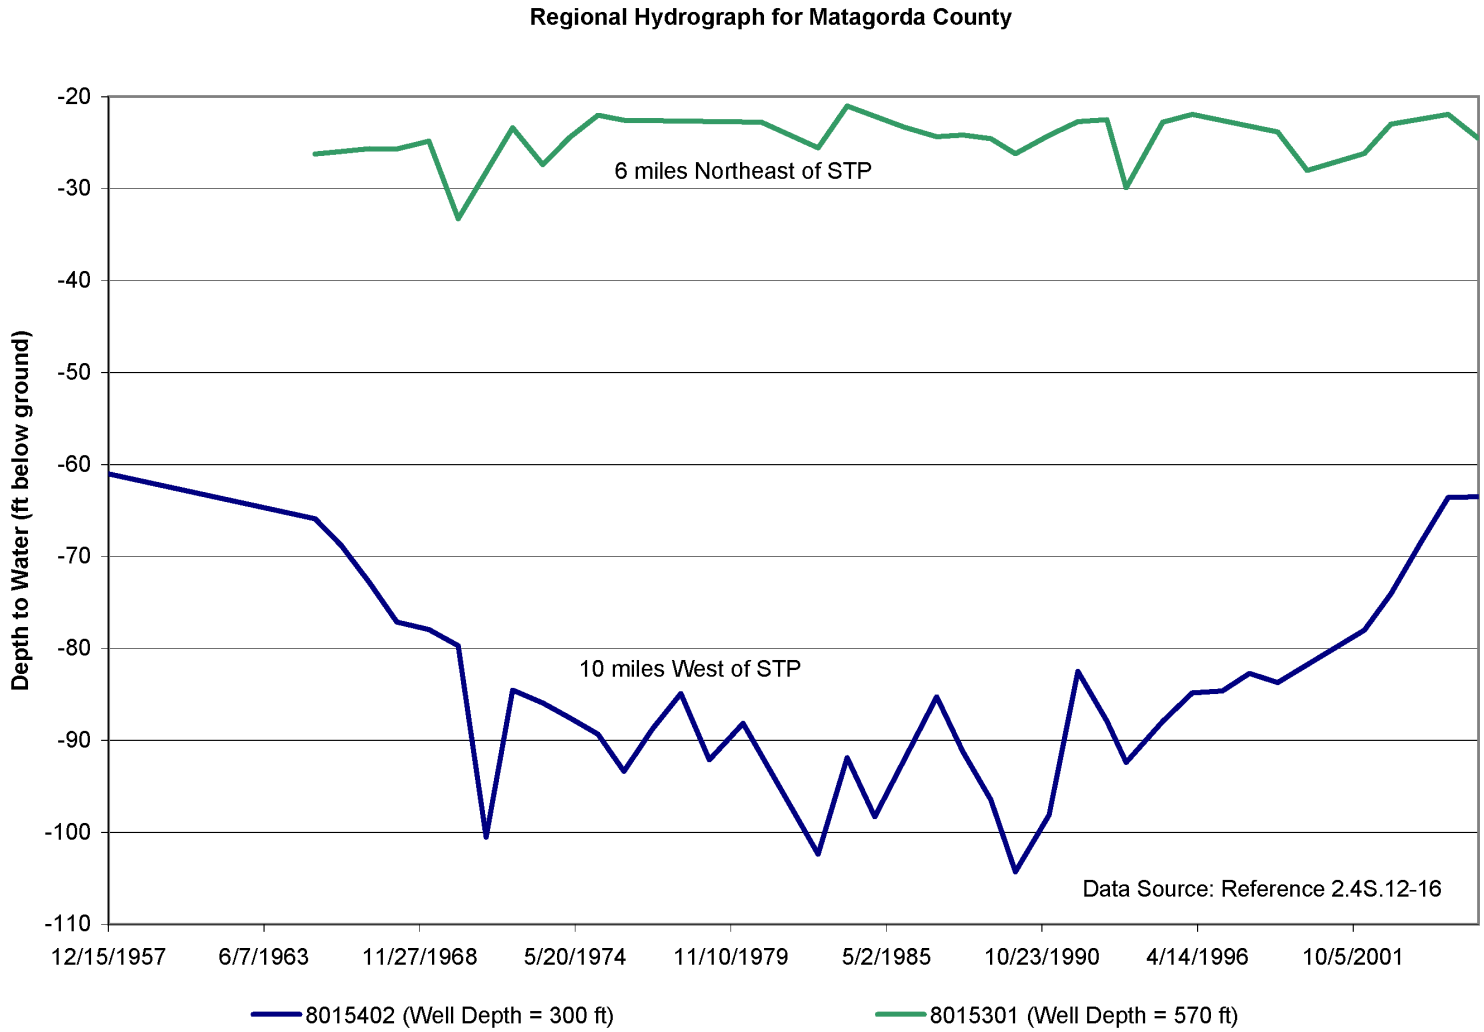


Figure 2.4S.12-21 Conceptual Hydrogeologic Cross-Section B-B'



**Figure 2.4S.12-22 Regional Hydrographs for Deep Aquifer**

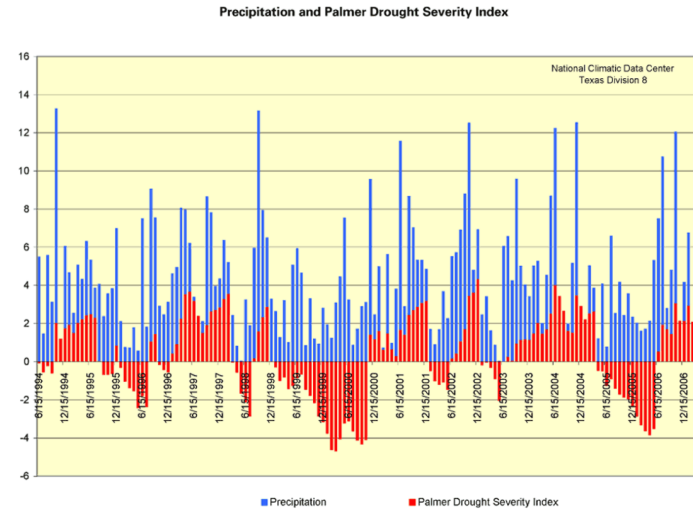
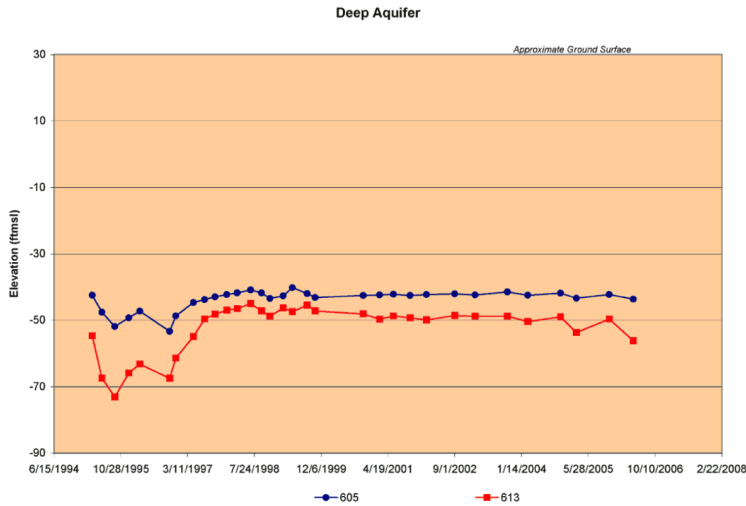
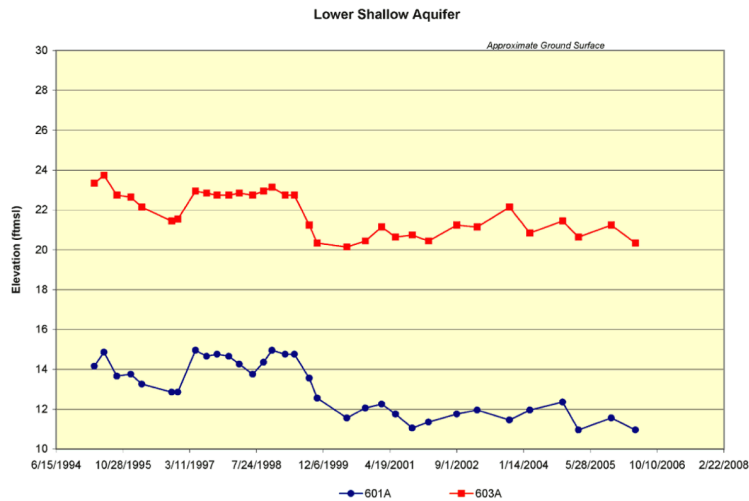
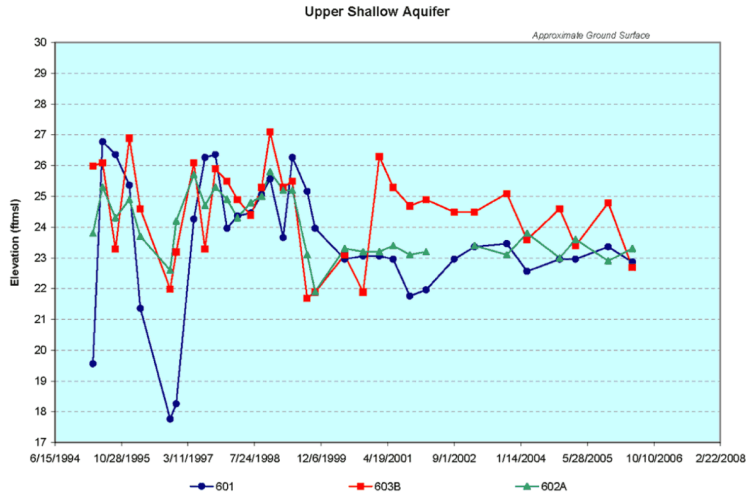


Figure 2.4S.12-23 Hydrographs of Selected Wells at the STP Site



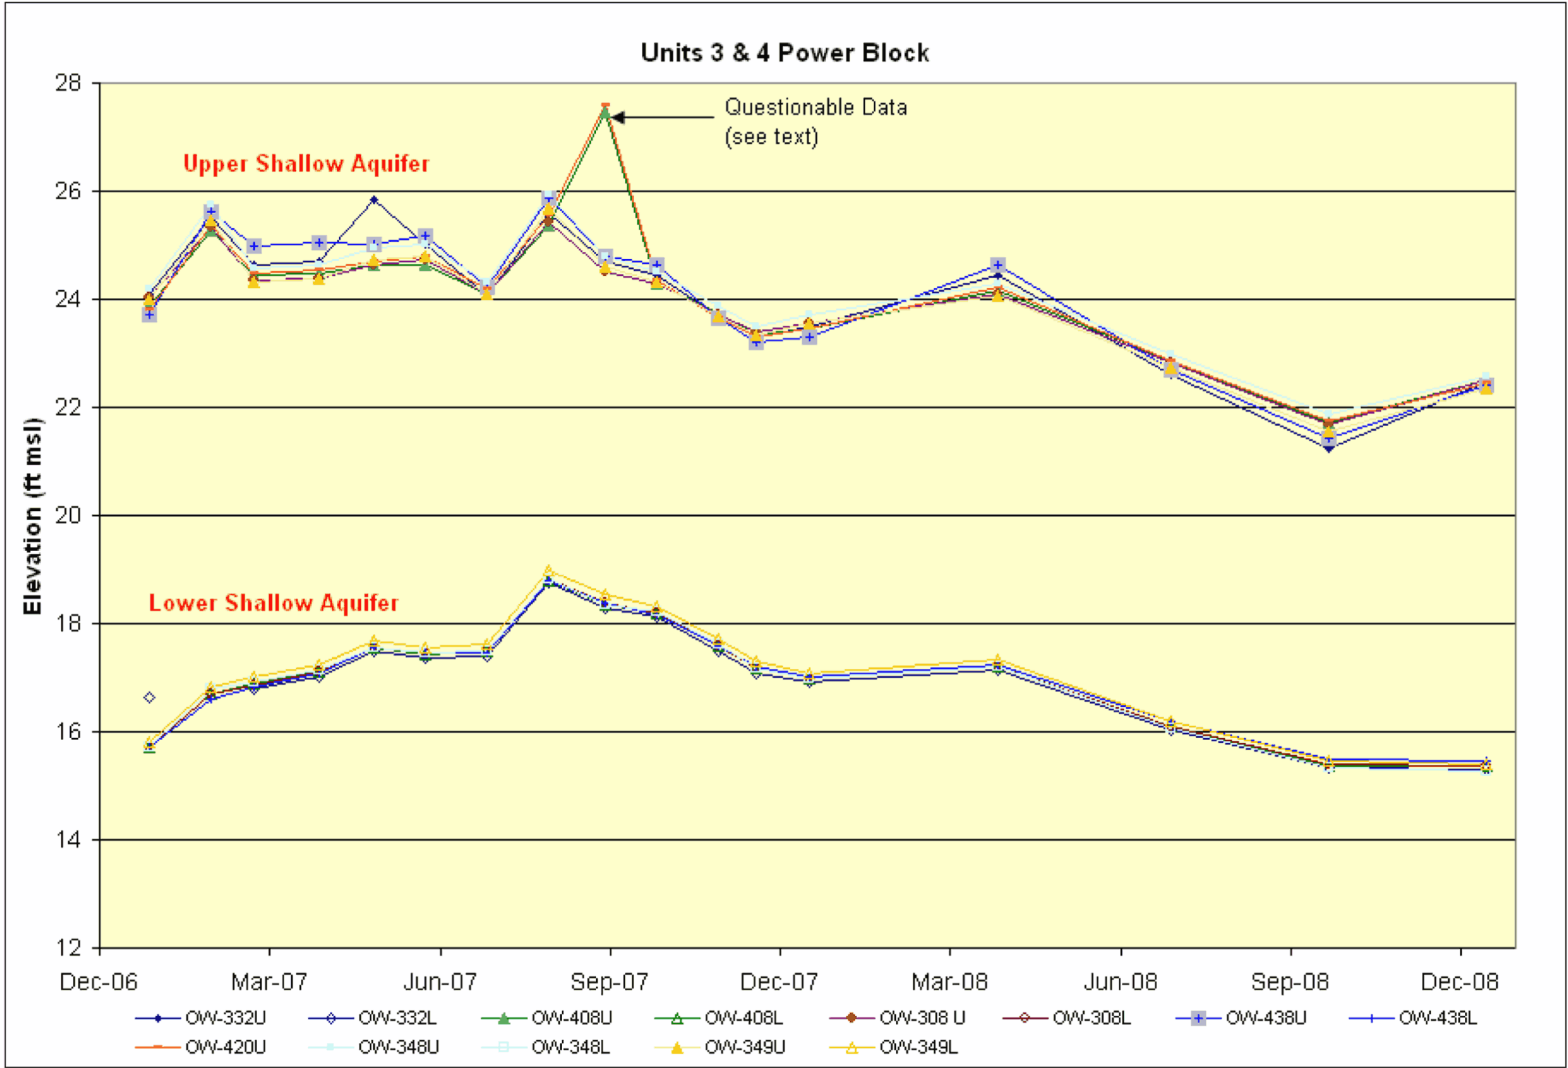
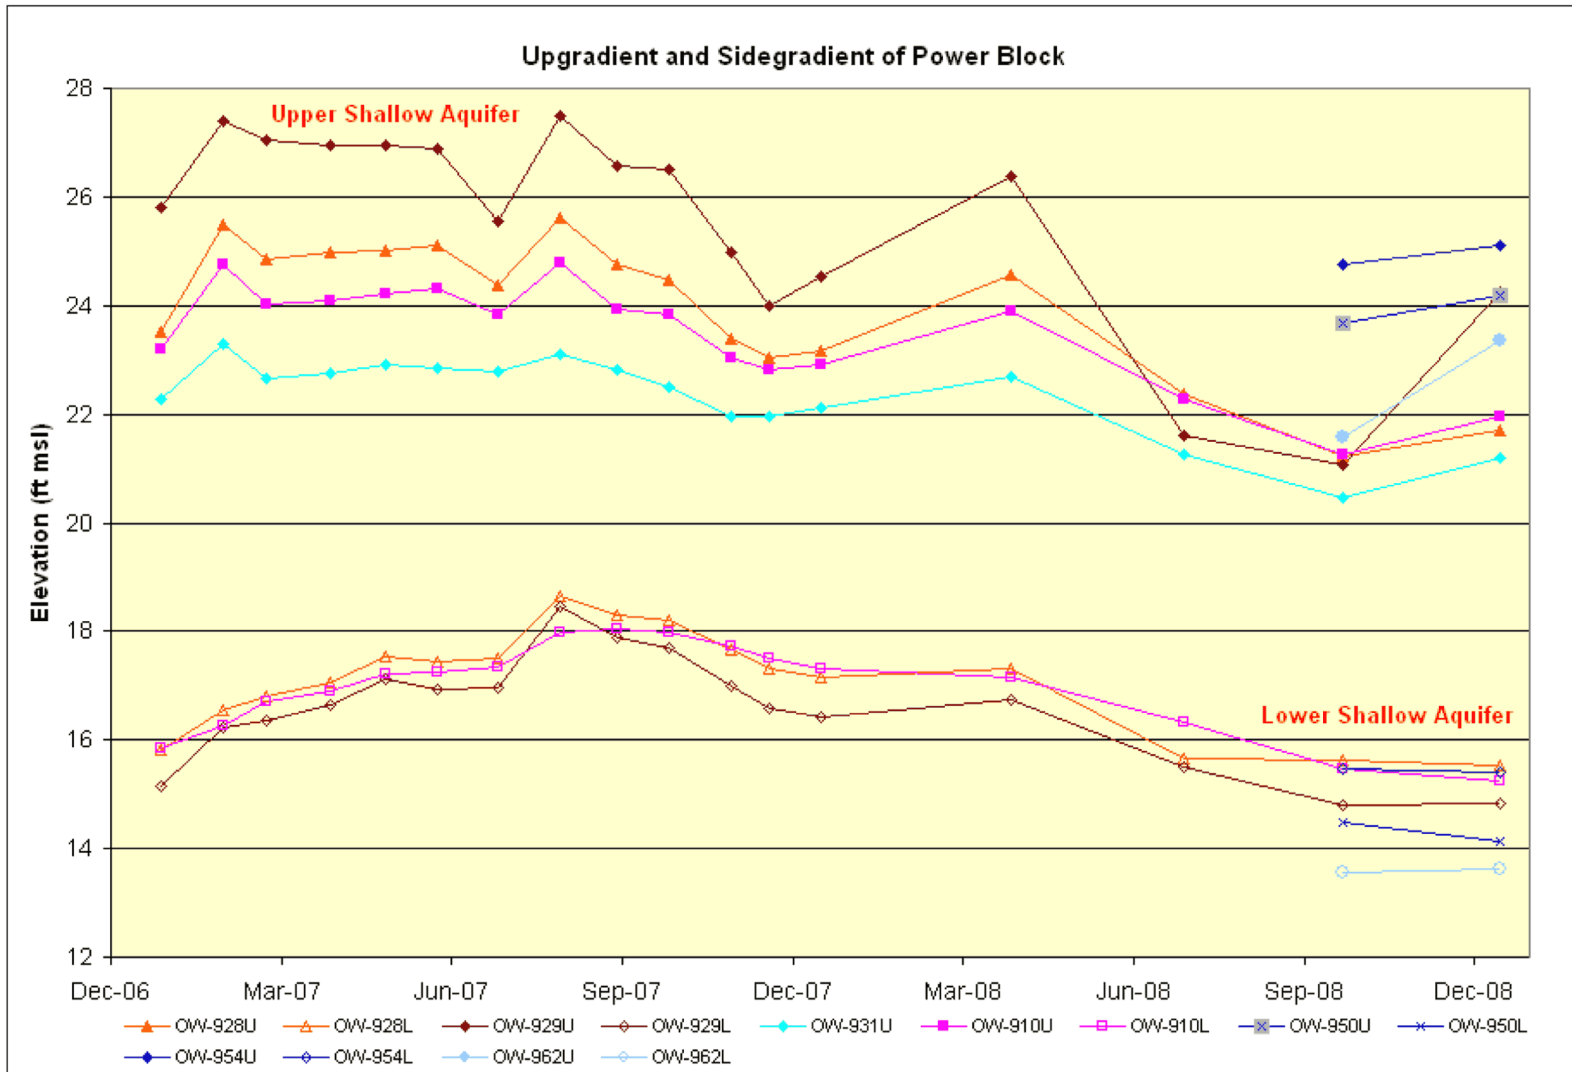
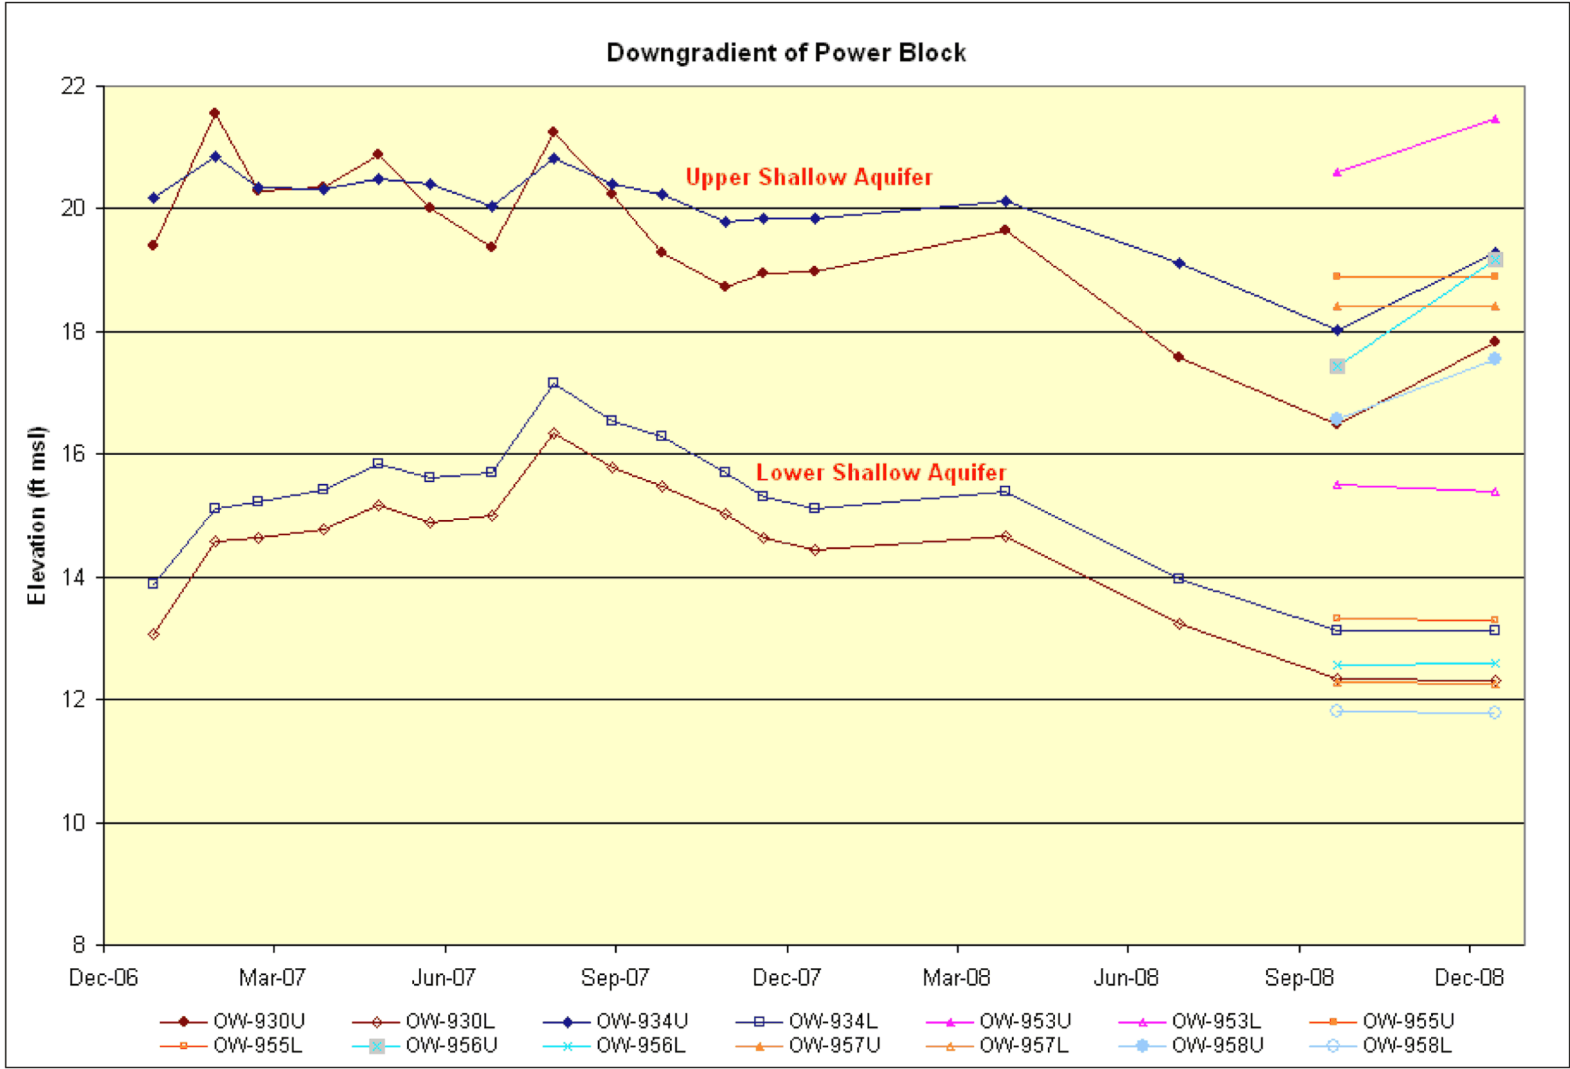


Figure 2.4S.12-24 Hydrographs of Wells in the STP 3 & 4 Area (Sheet 1 of 4)



**Figure 2.4S.12-24 Hydrographs of Wells in the STP 3 & 4 Area (Sheet 2 of 4)**



**Figure 2.4S.12-24 Hydrographs of Wells in the STP 3 & 4 Area (Sheet 3 of 4)**

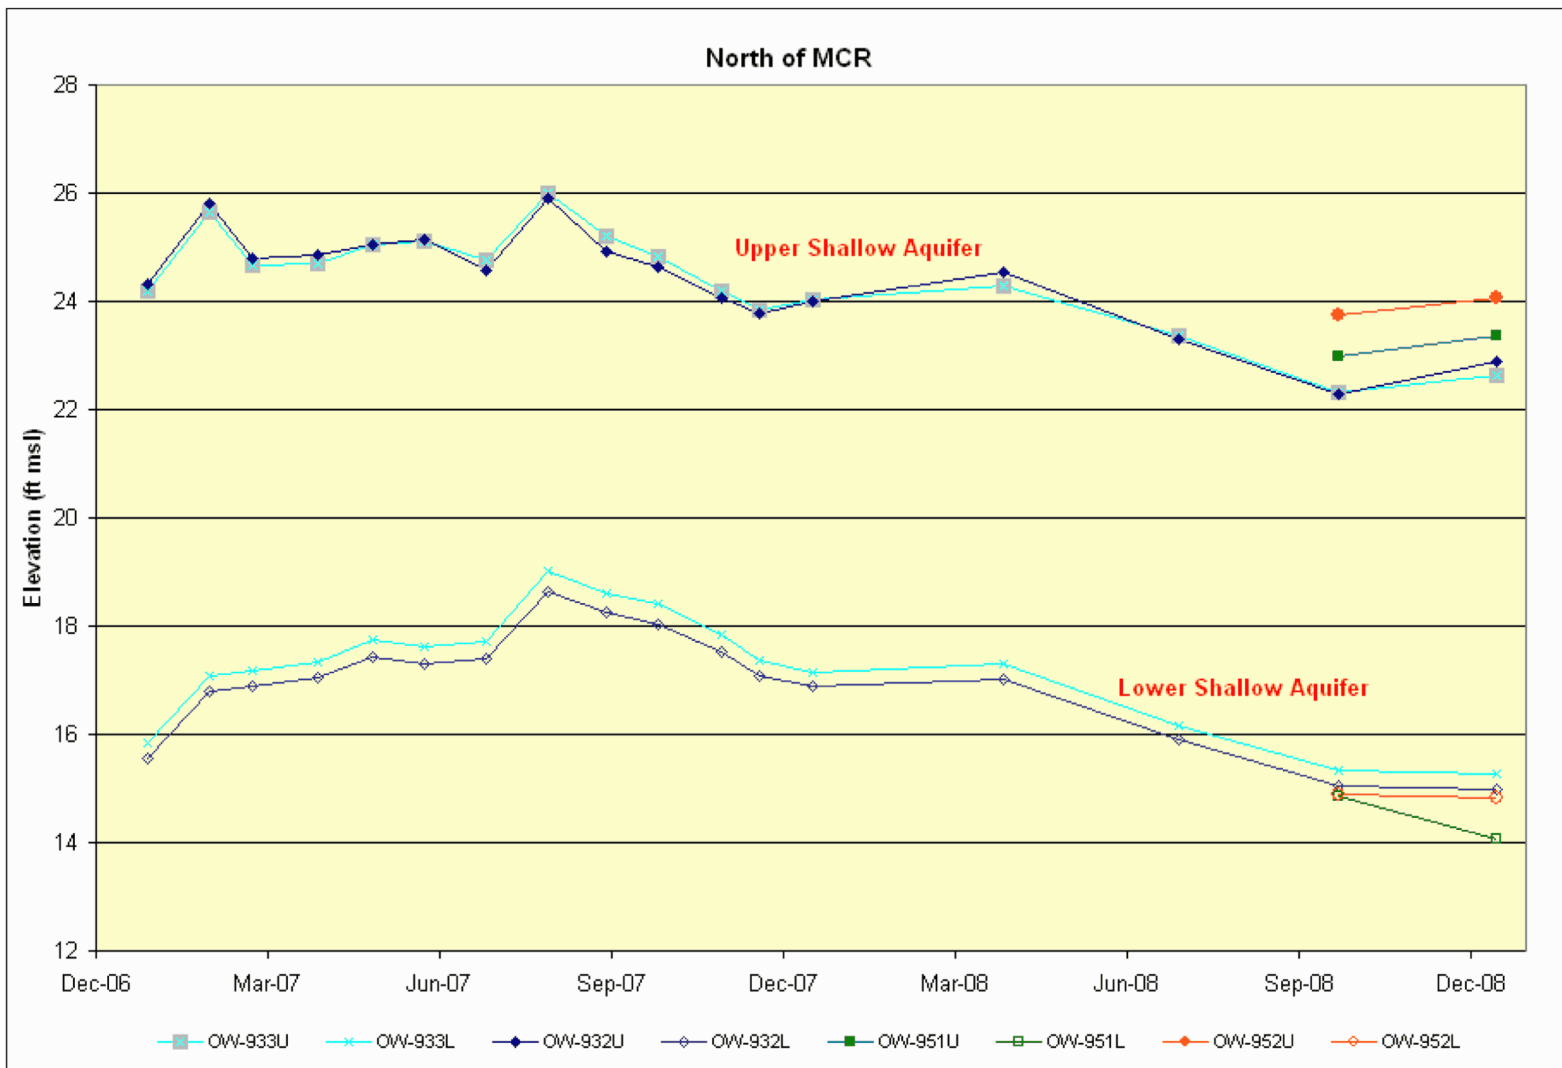


Figure 2.4S.12-24 Hydrographs of Wells in the STP 3 & 4 Area (Sheet 4 of 4)

Parameter	Regional Transmissivity (gpd/ft)	STP Deep Aquifer Transmissivity (gpd/ft)	STP Shallow Aquifer Transmissivity (gpd/ft)	Regional Storage Coefficient (unitless)	STP Deep Aquifer Storage Coefficient (unitless)	STP Shallow Aquifer Storage Coefficient (unitless)
Sample Size (N)	40	3	5	6	2	4
Standard Deviation	71,936	14,526	11,620	0.0006	0.0004	0.0006
Mean	84,500	33,245	14,320	0.0008	0.0005	0.0009
Geometric Mean	63,725	31,379	9,295	0.0005	0.0004	0.0008
Median	63,800	25,533	13,000	0.0010	0.0005	0.0007

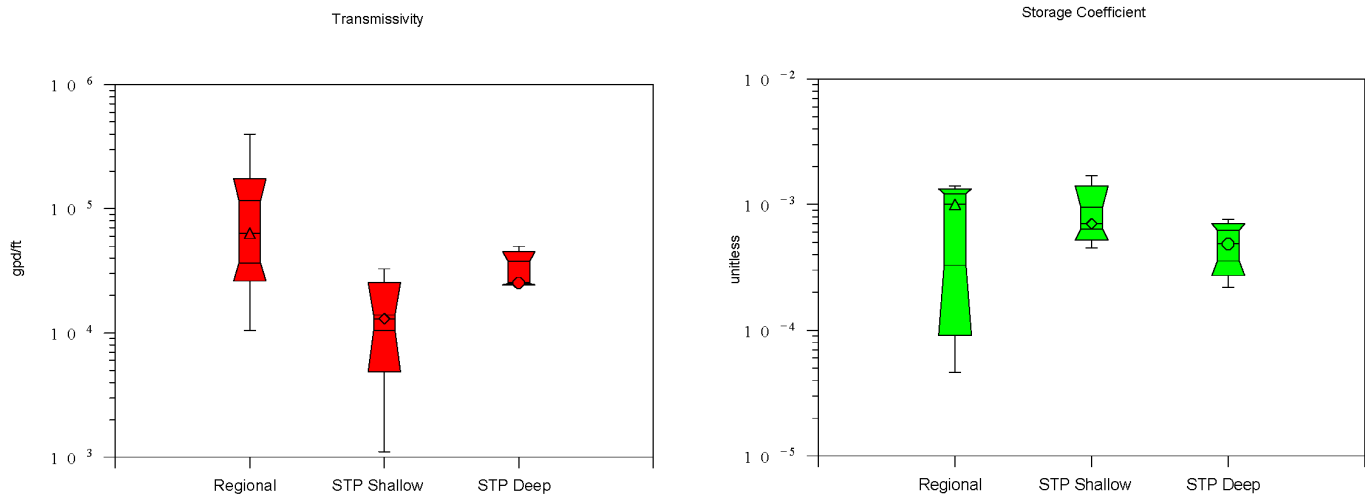


Figure 2.4S.12-25 Summary of Aquifer Transmissivity and Storage Coefficient Data from Aquifer Pumping Tests

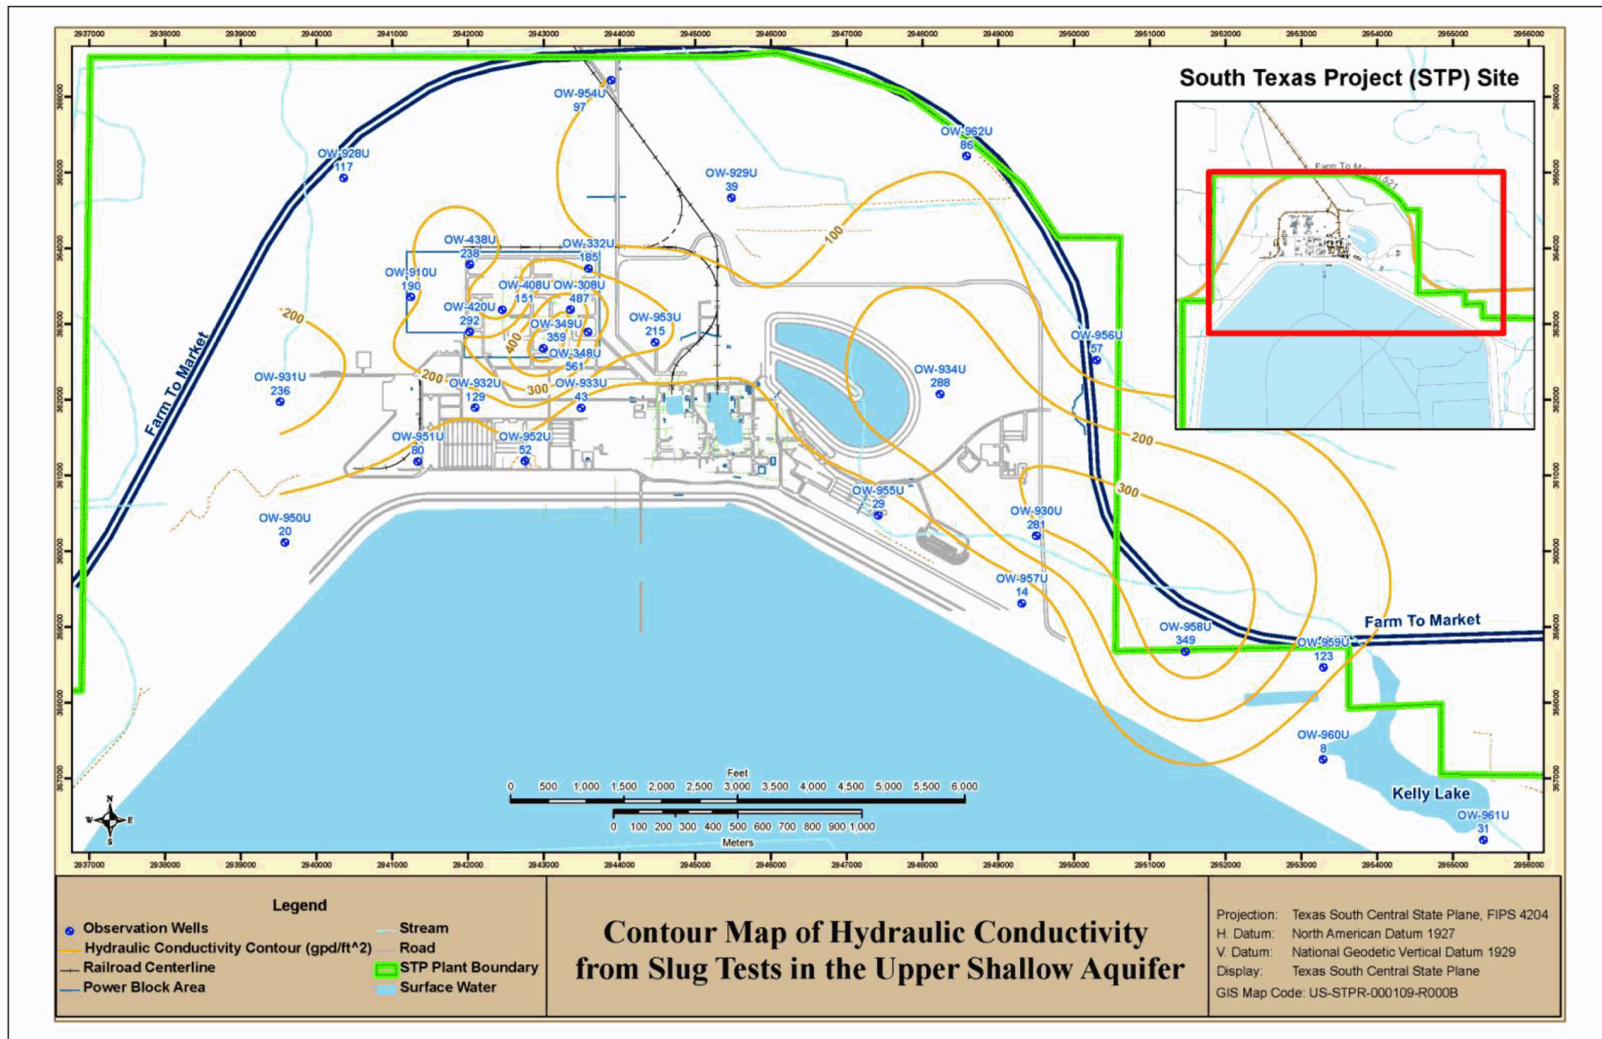


Figure 2.4S.12-26 Contour Maps of Hydraulic Conductivity from Slug Tests in the Shallow Aquifer (Sheet 1 of 2)

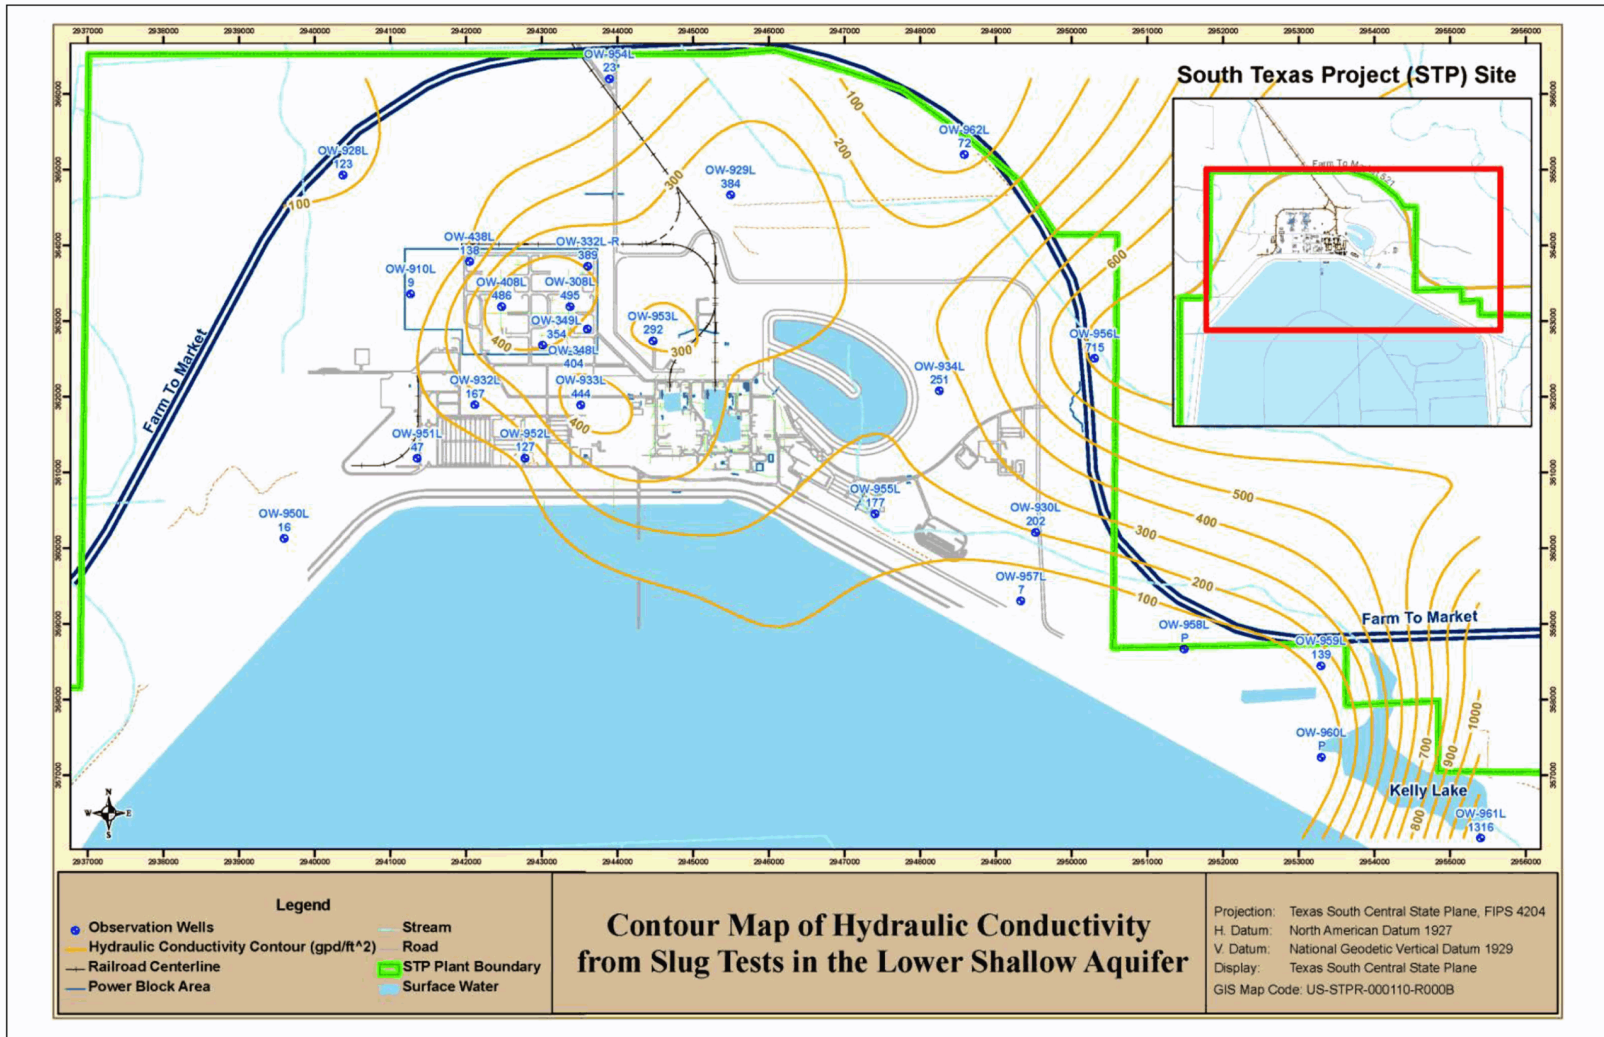


Figure 2.4S.12-26 Contour Maps of Hydraulic Conductivity from Slug Tests in the Shallow Aquifer (Sheet 2 of 2)

Statistic	Regional Hydraulic Conductivity (gpd/ft <sup>2</sup> )	STP Aquifer Pumping Test Hydraulic Conductivity (gpd/ft <sup>2</sup> )	STP Slug Test Hydraulic Conductivity (gpd/ft <sup>2</sup> )	STP Grain Size Hydraulic Conductivity (gpd/ft <sup>2</sup> )
Sample Size (N)	35	5	52	12
Standard Deviation	623	230	227	403
Mean	539	429	222	1,249
Geometric Mean	420	337	126	1,278
Median	413	420	159	1,086

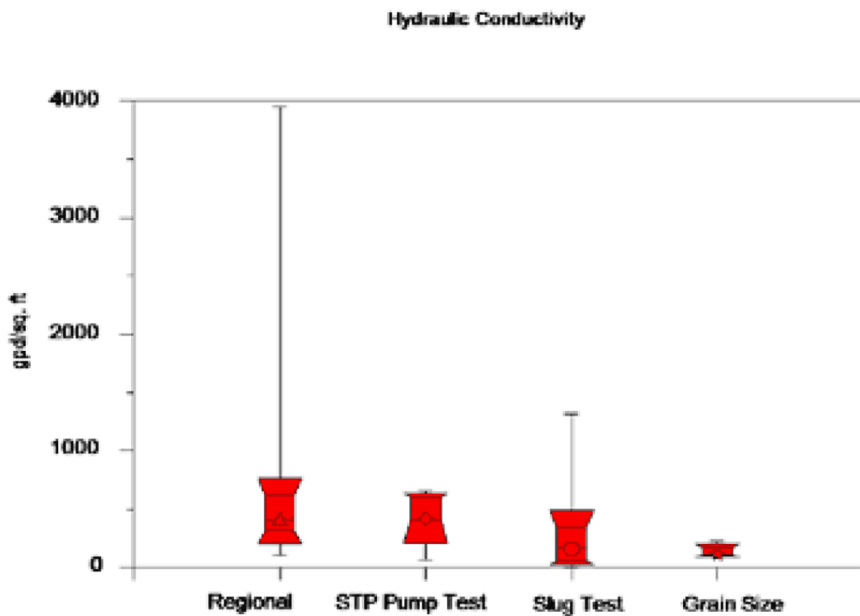


Figure 2.4S.12-27 Summary of Hydraulic Conductivity from Aquifer Pumping Tests, Slug Tests, and Grain Size



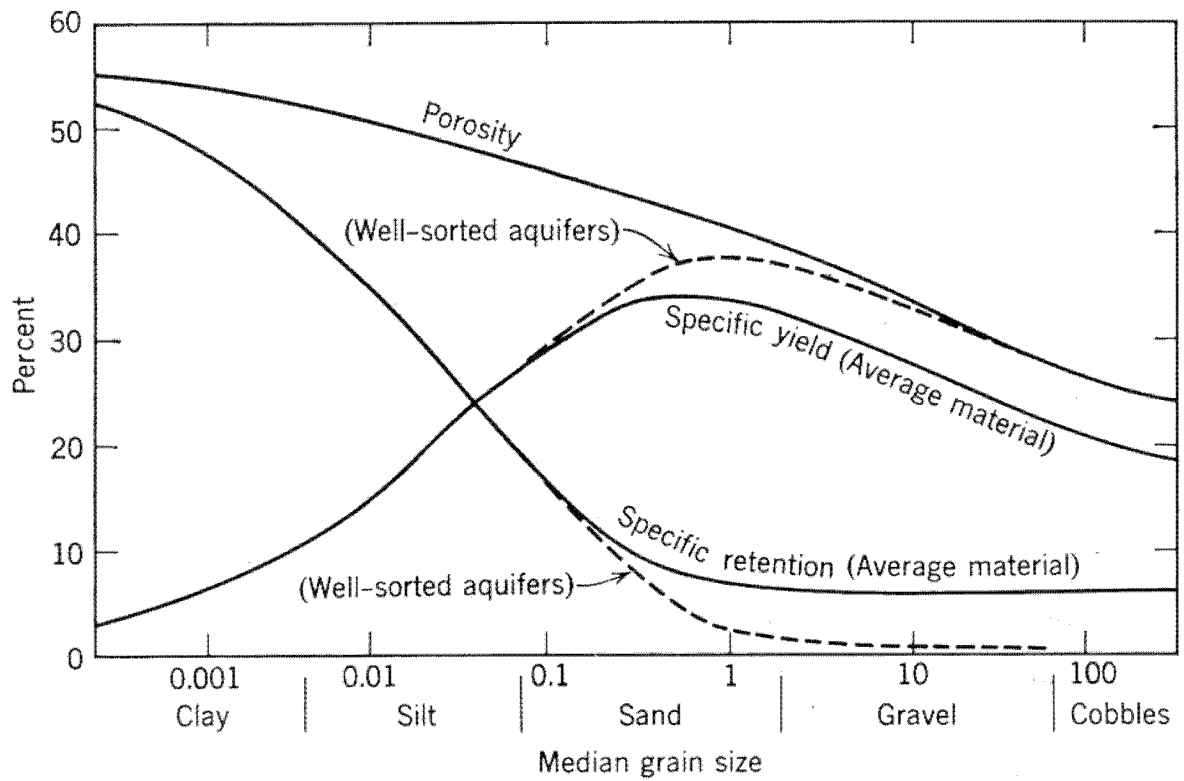


Figure 2.4S.12-28 Relationship of Porosity, Specific Yield, and Specific Retention (Reference 2.4S.12-18)






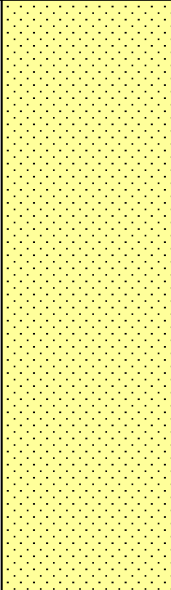
Unit	Hydrogeologic Zone	Ground Surface	Thickness	Geologic Materials
Shallow Aquifer	Upper Shallow Aquifer Confining Layer		10 - 30 ft	Clay and Silt
	Upper Shallow Aquifer		20 - 30 ft	Silty Sand and Poorly Graded Sand
	Lower Shallow Aquifer Confining Layer		15 - 25 ft	Clay and Silt
	Lower Shallow Aquifer		25 - 50 ft	Silty Sand and Poorly Graded Sand with thin Clay and Silt Layers
Deep Aquifer Confining Layer			100 - 150 ft	Silty Clay and Silt with thin Sand Layers
Deep Aquifer			>500 ft	Sand with thin Clay and Silt Layers

Figure 2.4S.12-29 Simplified Hydrostratigraphic Section

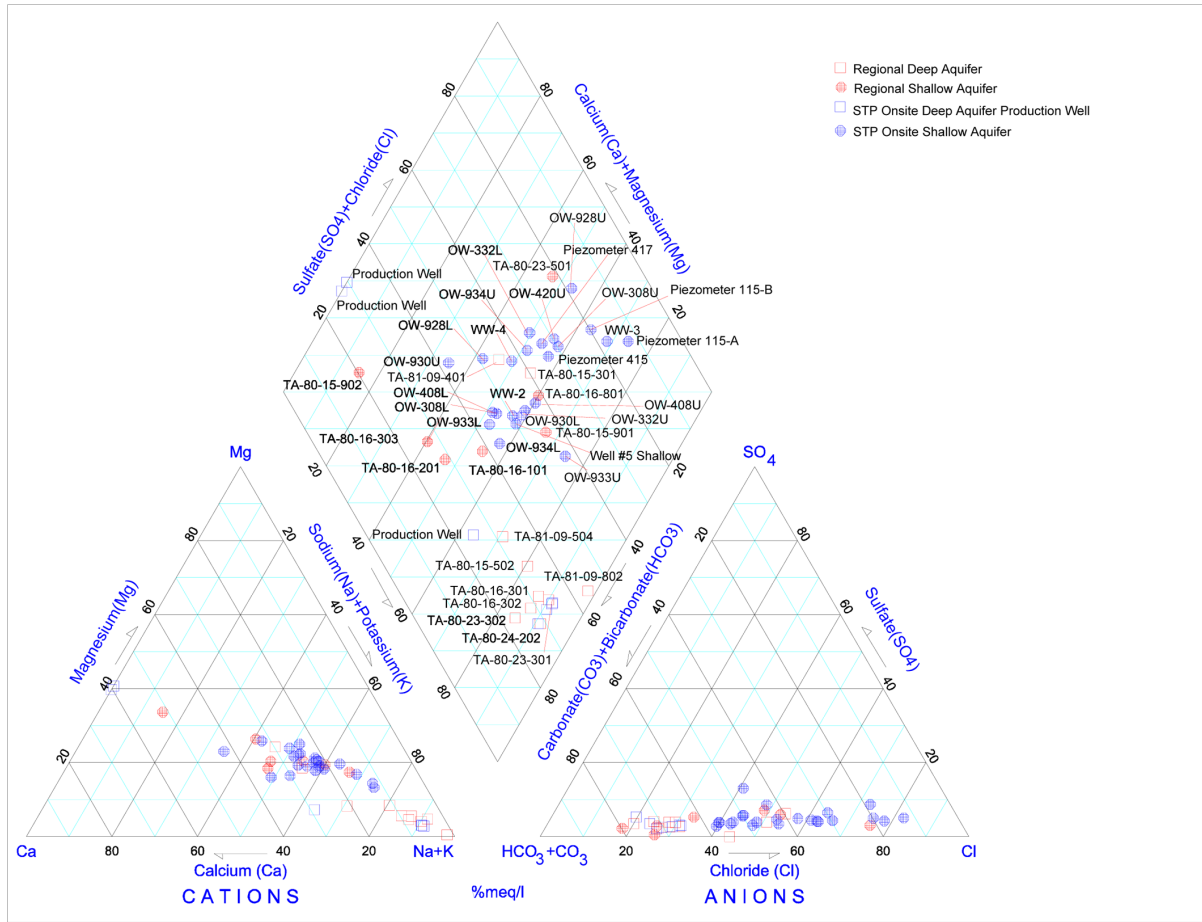


Figure 2.4S.12-30 Trilinear Diagram of Hydrogeochemical Data



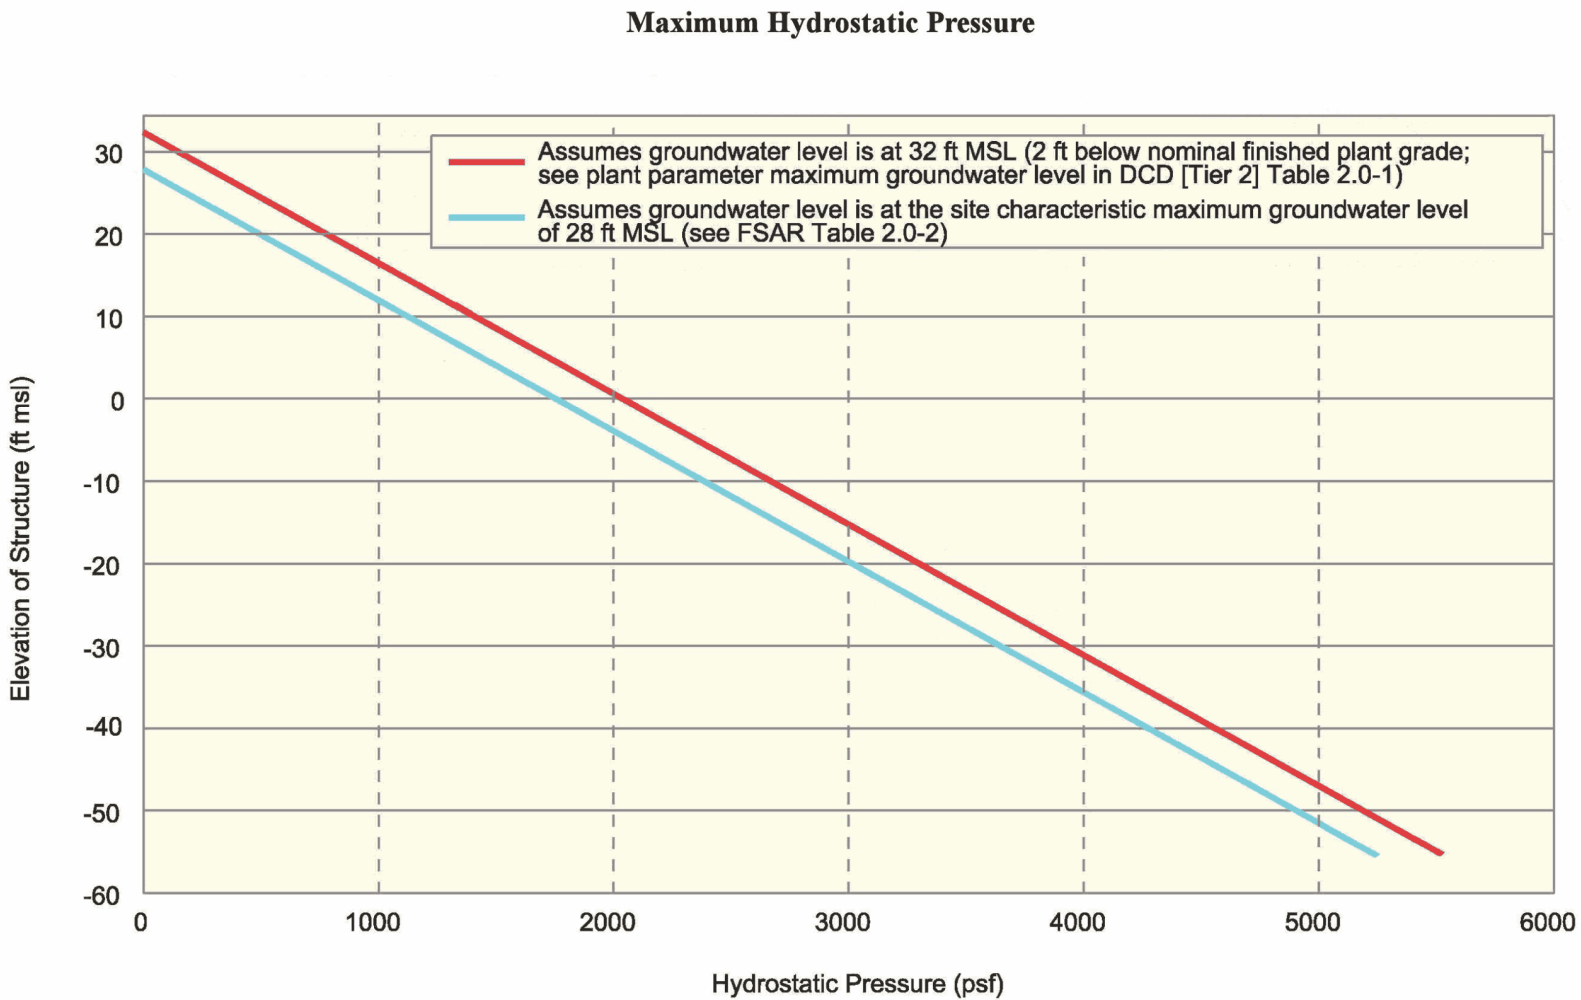


Figure 2.4S.12-32 Subsurface Hydrostatic Loading

**Figure 2.4S.12-33 Potentiometric Surface in the Upper Shallow Aquifer**