

Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire (RACHELLE-FIRE)

Volume 1:

Peak Heat Release Rates and
Effect of Obstructed Plume

Final Report

U.S. Nuclear Regulatory Commission
Office of Nuclear Regulatory Research
Washington, D.C. 20555-0001

Electric Power Research Institute
3420 Hillview Avenue
Palo Alto, CA 94304-1338



AVAILABILITY OF REFERENCE MATERIALS IN NRC PUBLICATIONS

NRC Reference Material

As of November 1999, you may electronically access NUREG-series publications and other NRC records at NRC's Library at www.nrc.gov/reading-rm.html. Publicly released records include, to name a few, NUREG-series publications; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulletins and information notices; inspection and investigative reports; licensee event reports; and Commission papers and their attachments.

NRC publications in the NUREG series, NRC regulations, and Title 10, "Energy," in the *Code of Federal Regulations* may also be purchased from one of these two sources.

1. The Superintendent of Documents

U.S. Government Publishing Office
Mail Stop IDCC
Washington, DC 20402-0001
Internet: bookstore.gpo.gov
Telephone: (202) 512-1800
Fax: (202) 512-2104

2. The National Technical Information Service

5301 Shawnee Rd., Alexandria, VA 22312-0002
www.ntis.gov
1-800-553-6847 or, locally, (703) 605-6000

A single copy of each NRC draft report for comment is available free, to the extent of supply, upon written request as follows:

Address: **U.S. Nuclear Regulatory Commission**
Office of Administration
Publications Branch
Washington, DC 20555-0001
E-mail: distribution.resource@nrc.gov
Facsimile: (301) 415-2289

Some publications in the NUREG series that are posted at NRC's Web site address www.nrc.gov/reading-rm/doc-collections/nuregs are updated periodically and may differ from the last printed version. Although references to material found on a Web site bear the date the material was accessed, the material available on the date cited may subsequently be removed from the site.

Non-NRC Reference Material

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at—

The NRC Technical Library

Two White Flint North
11545 Rockville Pike
Rockville, MD 20852-2738

These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute

11 West 42nd Street
New York, NY 10036-8002
www.ansi.org
(212) 642-4900

Legally binding regulatory requirements are stated only in laws; NRC regulations; licenses, including technical specifications; or orders, not in NUREG-series publications. The views expressed in contractor-prepared publications in this series are not necessarily those of the NRC.

The NUREG series comprises (1) technical and administrative reports and books prepared by the staff (NUREG-XXXX) or agency contractors (NUREG/CR-XXXX), (2) proceedings of conferences (NUREG/CP-XXXX), (3) reports resulting from international agreements (NUREG/IA-XXXX), (4) brochures (NUREG/BR-XXXX), and (5) compilations of legal decisions and orders of the Commission and Atomic and Safety Licensing Boards and of Directors' decisions under Section 2.206 of NRC's regulations (NUREG-0750).

DISCLAIMER: This report was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any employee, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product, or process disclosed in this publication, or represents that its use by such third party would not infringe privately owned rights.

Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire (RACHELLE-FIRE)

Volume 1:
Peak Heat Release Rates and
Effect of Obstructed Plume

Final Report

April 2016

U.S. Nuclear Regulatory Commission
Office of Nuclear Regulatory Research (RES)
Washington, D.C. 20555-0001

U.S. NRC-RES Project Manager
M. H. Salley

Electric Power Research Institute (EPRI)
3420 Hillview Avenue
Palo Alto, CA 94304-1338

EPRI Project Manager
A. Lindeman

DISCLAIMER OF WARRANTIES AND LIMITATION OF LIABILITIES

THIS DOCUMENT WAS PREPARED BY THE ORGANIZATION(S) NAMED BELOW AS AN ACCOUNT OF WORK SPONSORED OR COSPONSORED BY THE ELECTRIC POWER RESEARCH INSTITUTE, INC. (EPRI). NEITHER EPRI, ANY MEMBER OF EPRI, ANY COSPONSOR, THE ORGANIZATION(S) BELOW, ANY PERSON ACTING ON BEHALF OF ANY OF THEM:

(A) MAKES ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, (I) WITH RESPECT TO THE USE OF ANY INFORMATION, APPARATUS, METHOD, PROCESS, OR SIMILAR ITEM DISCLOSED IN THIS DOCUMENT, INCLUDING MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, OR (II) THAT SUCH USE DOES NOT INFRINGE ON OR INTERFERE WITH PRIVATELY OWNED RIGHTS, INCLUDING ANY PARTY'S INTELLECTUAL PROPERTY, OR (III) THAT THIS DOCUMENT IS SUITABLE TO ANY PARTICULAR USER'S CIRCUMSTANCE; OR

(B) ASSUMES RESPONSIBILITY FOR ANY DAMAGES OR OTHER LIABILITY WHATSOEVER (INCLUDING ANY CONSEQUENTIAL DAMAGES, EVEN IF EPRI OR ANY EPRI REPRESENTATIVE HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES) RESULTING FROM YOUR SELECTION OR USE OF THIS DOCUMENT OR ANY INFORMATION, APPARATUS, METHOD, PROCESS, OR SIMILAR ITEM DISCLOSED IN THIS DOCUMENT.

REFERENCE HEREIN TO ANY SPECIFIC COMMERCIAL PRODUCT, PROCESS, OR SERVICE BY ITS TRADE NAME, TRADEMARK, MANUFACTURER, OR OTHERWISE, DOES NOT NECESSARILY CONSTITUTE OR IMPLY ITS ENDORSEMENT, RECOMMENDATION, OR FAVORING BY EPRI.

THE FOLLOWING ORGANIZATIONS PREPARED THIS REPORT:

U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research

Electric Power Research Institute

Brookhaven National Laboratory

S. Nowlen (Consultant)

Jensen Hughes, Inc.

Engineering Planning and Management

Duke Energy

THE TECHNICAL CONTENTS OF THIS DOCUMENT WERE **NOT** PREPARED IN ACCORDANCE WITH THE EPRI NUCLEAR QUALITY ASSURANCE PROGRAM MANUAL THAT FULFILLS THE REQUIREMENTS OF 10 CFR 50, APPENDIX B AND 10 CFR PART 21, ANSI N45.2-1977 AND/OR THE INTENT OF ISO-9001 (1994). USE OF THE CONTENTS OF THIS DOCUMENT IN NUCLEAR SAFETY OR NUCLEAR QUALITY APPLICATIONS REQUIRES ADDITIONAL ACTIONS BY USER PURSUANT TO THEIR INTERNAL PROCEDURES.

NOTE

For further information about EPRI, call the EPRI Customer Assistance Center at 800.313.3774 or e-mail askepri@epri.com.

Electric Power Research Institute, EPRI, and TOGETHER...SHAPING THE FUTURE OF ELECTRICITY are registered service marks of the Electric Power Research Institute, Inc.

Copyright © 2016 Electric Power Research Institute, Inc. All rights reserved.

ABSTRACT

The Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire (RACHELLE-FIRE) program involves a working group of experienced fire protection and fire probabilistic risk assessment researchers and practitioners focused on enhancing the methodology used to model electrical enclosure fires in nuclear power plants (NPPs). This report documents the results from the working group's efforts to develop technical information in three areas: (1) classification of electrical enclosures in terms of function, size, contents, and ventilation, (2) determination of peak heat release rate (HRR) probability distributions considering specific electrical enclosure characteristics, and (3) development of a method to account for the impact of the enclosure on the vertical thermal zone of influence (ZOI) above the enclosure during fire.

Electrical enclosures have been classified in classification groups based on their electrical function, contents, and size. Power enclosures, such as switchgear, load centers, motor control centers, battery chargers, and power inverters, are grouped based on their function. Remaining electrical enclosures are classified as small, medium, and large based on their volumetric size. This classification is primarily based on the size because it can be easily assessed by visual inspection during walkdowns without opening the electrical enclosure. Distinctions based on insulation type (unqualified thermoplastic versus lower flammability cable types which include thermoset, qualified thermoplastic and SIS wire) and open versus closed door configurations have been retained for certain enclosure groupings. Peak HRR values may be refined based on visual inspection of the interior of the enclosures if fuel type, fuel quantity, and cable bundling arrangement can be expected to limit fire growth.

Peak HRR distributions for the different classification groups have been developed. These distributions are based on the results of different experimental programs intended to measure the HRR associated with fires in electrical enclosures. The working group evaluated the configuration factors in these fire tests and compared them with the actual configuration of electrical enclosures used in commercial NPPs and the available plant fire event experience. The resulting probability distributions are intended to map the configurations of the electrical enclosures in operation at the plant with the experimental factors evaluated during the test programs. As a result, HRR probability distributions are available for a wide range of electrical enclosure types and configurations.

In order to provide a comprehensive characterization of electrical enclosure fires, the working group evaluated the temperature characteristics of fire plumes associated with these events using the Fire Dynamics Simulator (FDS) program. Computer simulations of various enclosure configurations were developed for evaluating the fire burning inside electrical enclosures and the fire plume temperature characteristics that would be generated. Based on this research, new fire plume temperature profiles reflecting the obstructed nature of fire plumes generated from fires inside electrical enclosures are provided.

Finally, examples, consolidating the information described in this report, are provided. The examples have been selected and designed to illustrate how to incorporate the information documented in this report into existing approaches for modeling fires in electrical enclosures.

PREFACE

This report supplements previous work on heat release rates (HRRs) and fire modeling related to the fire probabilistic risk assessment (PRA) methodology and data published in NUREG/CR-6850 (EPRI 1011989), *EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities*, Volumes 1 and 2, September 2005; and its Supplement 1 (EPRI 1019259), *Fire Probabilistic Risk Assessment Methods Enhancements*, September 2010.

In 2002, EPRI published *Fire Modeling Guide for Nuclear Power Plant Applications* (EPRI 1002981). In June 2014, EPRI published 3002000830, *Fire-Induced Vulnerability Evaluation (FIVE) Revision 2*, providing an updated library of fire modeling tools to predict consequences for typical hazards found in nuclear power plants. In December 2004, NRC published NUREG-1805, *Fire Dynamics Tools (FDT^s) – Quantitative Fire Hazard Analysis Methods for the U.S. Nuclear Regulatory Commission Fire Protection Inspection Program*. In July 2013, NRC published a supplement to NUREG-1805 that expanded and updated the calculation methods included in the original NUREG.

In May 2007, NRC and EPRI published NUREG-1824 (EPRI 1011999), *Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications*, consisting of seven volumes on five different fire modeling tools. These reports performed a verification and validation exercise on fire modeling analysis tools for use in fire PRAs. Subsequently, NRC and EPRI published draft Supplement 1 (EPRI 3002002182) to NUREG-1824 in November 2014 for public comment. This supplement evaluates the latest versions of the models and expanded the range of validation for the models.

In November 2008, NRC published NUREG/CR-6978, *A Phenomena Identification and Ranking Table (PIRT) Exercise for Nuclear Power Plant Fire Modeling Applications*. Through the use of nuclear power plant (NPP) specific examples, the PIRT panel identified the state of knowledge and importance of key fire phenomena necessary for successful application of fire modeling to NPP scenarios.

In November 2012, NRC and EPRI published NUREG-1934 (EPRI 1023259), *Nuclear Power Plant Fire Modeling Analysis Guidelines (NPP FIRE MAG)*. This report provides fire modeling analysis guidelines for use in fire PRAs.

In an effort to facilitate use of fire modeling for NPP applications and improve understanding of the fire hazards associated with electrical cables, NRC has sponsored two major research programs. The first program examined the impact of fire on cable functionality. The results of this research were documented in the three volumes of NUREG/CR-6931, *Cable Response to Live Fire (CAROLFIRE)*, published in 2007. The second test program examined the flammability properties of cables and is documented in the NUREG/CR-7010 reports. Volume 1 of the NUREG/CR-7010 series, *Cable Heat Release, Ignition, and Spreading Tray Installations during Fire (CHRISTIFIRE)* was published in 2012 and examined cables in horizontal trays. Volume 2 was published in 2013 and provided results for cables in vertical trays and corridors. Experiments are currently underway and a third volume will explore the conditions necessary to achieve ignition of cables and effectiveness of protective measures (i.e., coatings) for cables.

In December 2014, NRC and EPRI published NUREG-2169 (EPRI 3002002936), *Nuclear Power Plant Fire Ignition Frequencies and Non-Suppression Probability Estimation Using the Updated Fire Events Database*. This report provides fire ignition frequencies and non-suppression probability estimates through the year 2009 using EPRI's updated fire events database (EPRI 1025284).

This document does not constitute regulatory requirements. NRC-RES participation in this study does not constitute or imply regulatory approval of its applications based upon this methodology.

CONTENTS

ABSTRACT	iii
PREFACE	v
CONTENTS	vii
FIGURES	xi
TABLES	xv
EXECUTIVE SUMMARY	xvii
EPRI PERSPECTIVE	xxi
CITATIONS	xxiii
ACKNOWLEDGMENTS	xxv
ACRONYMS	xxvii
1 INTRODUCTION	1-1
1.1 Background	1-1
1.2 Approach	1-2
1.3 Scope and Terminology	1-4
1.4 Objectives	1-5
1.5 Report Organization	1-6
2 OVERVIEW OF THE PROCESS	2-1
2.1 Classification of Electrical Enclosures	2-1
2.1.1 Review of Existing Guidance	2-1
2.1.2 Understanding the Fire Hazards Associated with Different Electrical Enclosures	2-2
2.2 Process Used in Developing the HRR Distributions	2-4
2.2.1 Literature Review	2-5
2.2.2 Informing the Distributions	2-5
2.2.3 TS/QTP/SIS versus TP Distributions	2-6
2.2.4 Identification of Influencing Factors	2-8
2.2.5 Calibration Exercise	2-10
2.2.6 Assessment of Electrical Enclosure Heat Release Rates	2-11
2.2.7 Building Consensus	2-11
2.2.8 Ensuring Consistency and Applicability	2-12
2.2.9 Finalizing the Consensus	2-15
2.3 Method for Characterizing Electrical Enclosure Fire Plumes	2-15
3 CLASSIFICATION OF ELECTRICAL ENCLOSURES	3-1
3.1 Functionally Based Enclosure Groups	3-3
3.1.1 Group 1: Switchgear and Load Centers	3-3
3.1.2 Group 2: Motor Control Centers (MCCs) and Battery Chargers	3-4
3.1.3 Group 3: Power Inverters	3-7
3.2 Group 4: All Other Electrical Enclosures	3-8
3.2.1 Open versus Closed Configurations	3-9
3.2.2 Assignment Based on Physical Size	3-13
3.2.2.1 Group 4a: Large Enclosures	3-14
3.2.2.2 Group 4b: Medium Enclosures	3-15
3.2.2.3 Group 4c: Small Enclosures	3-16
3.2.3 Assignment Based on Fuel Loading Characteristics	3-18

4	APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES	4-1
4.1	Recommended Peak Heat Release Rate Distributions	4-1
4.2	Practice for Establishing Fire Diameter.....	4-4
4.3	Special Fuel Loading Configurations	4-8
4.3.1	Special Case 1: No Ignition Sources Present.....	4-8
4.3.2	Special Case 2: Cables Enclosed in Conduits.....	4-9
4.3.3	Special Case 3: Metal Enclosed Wire-Ways and Switch/Device Covers	4-11
5	CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS	5-1
5.1	Assumptions and Limitations	5-1
5.1.1	Fire Dynamics Simulator.....	5-1
5.1.2	Zone of Influence Applicability	5-2
5.1.3	Flame Height	5-3
5.1.4	Types of Obstructions.....	5-3
5.1.5	Other Applicability Limitations.....	5-3
5.2	Technical Approach	5-5
5.2.1	Review of Past Studies.....	5-5
5.2.2	Plume Theory	5-5
5.2.2.1	Plume Scaling.....	5-6
5.2.2.2	Heskestad Plume Temperature	5-6
5.2.3	The FDS Simulation Parameters	5-7
5.2.3.1	Heat Release Rate (HRR)	5-7
5.2.3.2	Fire Source Diameter	5-7
5.2.3.3	Obstruction Configuration	5-7
5.2.3.4	Enclosure Configurations	5-9
5.2.3.5	FDS Simulation Matrix.....	5-9
5.2.3.6	Simulation Compartment	5-10
5.2.3.7	Temperature Measurement Plane.....	5-11
5.2.4	Preliminary FDS Simulations	5-11
5.2.4.1	No Obstruction – Baseline	5-12
5.2.4.2	Flat Plate Obstruction	5-15
5.2.4.3	Arch Obstruction	5-17
5.2.4.4	Three-Wall Obstruction.....	5-18
5.2.4.5	Statistical Analysis	5-20
5.3	FDS Simulation Results	5-20
5.3.1	Analysis of Non-Conservative Results.....	5-21
5.3.2	Obstruction Configuration	5-23
5.3.3	Fire Source Diameter.....	5-25
5.3.4	Heat Release Rate	5-25
5.3.5	Fire Source Elevation	5-26
5.3.6	Statistical Analysis	5-27
5.3.7	Summary of Results	5-28
5.3.7.1	Bias and Uncertainty	5-30
5.3.7.2	Sensitivity to Center Openings on the Obstruction.....	5-33
5.3.7.3	Sensitivity to Fire Orientation.....	5-34
5.3.7.4	Sensitivity to Obstructions with a Soffit.....	5-35
5.3.7.5	Sensitivity to Thickness of Steel Enclosure	5-36

5.3.8	Horizontal Zone of Influence.....	5-37
5.3.8.1	Existing Definition of Horizontal ZOI.....	5-37
5.3.8.2	Horizontal Plume Shift ZOI.....	5-39
5.3.8.3	Recommendations.....	5-42
6	CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS.....	6-1
6.1	Assessment of FDS Simulation Results.....	6-1
6.2	Prediction of ZOI Correction.....	6-1
6.2.1	Temperature Rise (Example 1).....	6-1
6.2.2	Zone of Influence (Example 2).....	6-2
6.2.3	Zone of Influence Sensitivity (Example 3).....	6-4
6.2.4	Fire Protection SDP Application (Example 4).....	6-5
6.2.5	Fire PRA Application (Example 5).....	6-6
6.3	Plume Temperature and ZOI Corrections.....	6-8
6.4	Application of the Correction.....	6-8
7	SUMMARY, CONCLUSIONS, AND FUTURE RESEARCH.....	7-1
7.1	Classification of Electrical Enclosures.....	7-2
7.2	Peak Heat Release Rate Probability Distributions.....	7-2
7.3	Obstructed Plume Analysis.....	7-5
7.4	Example Applications.....	7-5
7.5	Future Research.....	7-6
8	REFERENCES.....	8-1
APPENDIX A	WG MEMBERS, NON-WG CONTRIBUTORS, AND FACILITATOR RESUMES.....	A-1
APPENDIX B	OVERVIEW OF WORKING GROUP ACTIVITIES.....	B-1
APPENDIX C	PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES.....	C-1
APPENDIX D	ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS.....	D-1
APPENDIX E	OBSTRUCTED PLUME FIRE MODELING RESULTS.....	E-1
APPENDIX F	EXAMPLES OF ENCLOSURE FIRE ANALYSIS.....	F-1
SUPPLEMENT	FIRE MODELS, INPUT DATA FILES, AND OTHER SUPPORTING INFORMATION.....	CD

FIGURES

Figure 2-1	Fire Size/Intensity Calibration (0 to 40 kW)	2-10
Figure 2-2	Fire Size/Intensity Calibration (50 to 1000 kW)	2-11
Figure 2-3	HELEN-FIRE Test No. 68	2-15
Figure 3-1	Switchgear and Load Center	3-4
Figure 3-2	A Typical Vertical MCC Channel	3-5
Figure 3-3	A Typical Bank of MCC Cabinets	3-6
Figure 3-4	A Typical Battery Charger	3-7
Figure 3-5	A Typical Inverter Cabinet (Exterior – Left, Interior – Right)	3-8
Figure 3-6	Examples of closed cabinets (a) fully closed cabinet and (b) closed with openings at the bottom	3-10
Figure 3-7	Two examples of closed cabinets with louvered front panels	3-11
Figure 3-8	Example of closed cabinet with openings on the side panels at the top and bottom	3-12
Figure 3-9	Example of an open cabinet with a combustible panel at top and louvers at the bottom of the front	3-13
Figure 3-10	Large Enclosures (Open)	3-14
Figure 3-11	Large Enclosures (Closed)	3-15
Figure 3-12	Medium Enclosures	3-16
Figure 3-13	Small Enclosures (Note: top left enclosure may be well-sealed)	3-17
Figure 3-14	Two “Very Low Fuel Loading” Enclosures	3-19
Figure 3-15	Large Enclosure (Closed and Open Configurations): Example of a “Low Fuel Loading” Subgroup	3-20
Figure 4-1	A Graphical Representation of the Data in Table 4-3	4-7
Figure 4-2	Cropped Photo of Electrical Enclosure with Bundled Panel Wiring and Cable, Limited Combustible Loading, and No Ignition Sources	4-9
Figure 4-3	Photograph of LPMC (left) and FMC (right) Within Electrical Enclosure	4-11
Figure 4-4	Photograph of Metal Enclosed Wire-Ways Within Electrical Enclosure (MCB)	4-12
Figure 4-5	Photograph of Switch/Devices Cover (Labeled B) Within an Electrical Enclosure	4-12
Figure 4-6	An Example of Non-Enclosed Wire-Ways That Would Not Qualify as Metal Enclosed Wire-Ways	4-13
Figure 4-7	An Example of Substantially Ventilated Switch and/or Device Covers That Would Not Qualify for Reduction	4-14
Figure 5-1	Obstruction Geometries: Flat Plate, Arch, Three Walls	5-8
Figure 5-2	Simulation Fire Source Elevations: 0.3 m, 1.1 m, 2.0 m	5-8
Figure 5-3	Obstruction Configurations: Flat Plate, Arch, and Three Walls	5-9
Figure 5-4	Simulation Compartment	5-10
Figure 5-5	Slice File FDS Simulation Temperature Measurements	5-11
Figure 5-6	a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 0.9 m (diameter), 2 m (elevation) – Non-Obstructed Geometry	5-12
Figure 5-7	HRR vs. Time, Unobstructed Simulation – 200 kW, 0.6 m (diameter), 1.1 m (elevation)	5-13
Figure 5-8	HRR vs. Time, Unobstructed Simulation – 1000 kW, 0.9 m (diameter), 2 m (elevation)	5-14

Figure 5-9	Temperature vs. Elevation Above Floor, Unobstructed Simulation – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 0.9 m (diameter), 2 m (elevation)	5-14
Figure 5-10	a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 1.2 m (diameter), 2 m (elevation) – Plate Obstruction	5-15
Figure 5-11	Temperature vs. Time, Flat Plate – 200 kW, 0.6 m (diameter), 2 m (elevation) – Elevations Above the Obstruction.....	5-16
Figure 5-12	Temperature vs. Elevation Above Floor, Flat Plate Obstruction – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 1.2 m (diameter), 2 m (elevation)	5-17
Figure 5-13	a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 1.2 m (diameter), 2 m (elevation) – Arch Obstruction.....	5-17
Figure 5-14	Temperature vs. Height Above Floor – Arch Obstruction – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 1.2 m (diameter), 2 m (elevation)	5-18
Figure 5-15	a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 1.2 m (diameter), 2 m (elevation) – Three-Wall Obstruction.....	5-19
Figure 5-16	Temperature vs. Height Above Floor – Three-Wall Obstruction – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 1.2 m (diameter), 2 m (elevation)	5-19
Figure 5-17	Unobstructed versus Obstructed Plume Temperatures.....	5-21
Figure 5-18	a) Three-Wall Obstruction, 500 kW, 0.3 m b) No Obstruction, 500 kW, 0.3 m.....	5-22
Figure 5-19	a) Three-Wall Obstruction, 1000 kW, 1.2 m b) No Obstruction, 1000 kW, 1.2 m.....	5-23
Figure 5-20	Unobstructed versus Obstructed Plume Temperatures – Different Geometries	5-24
Figure 5-21	Plume Flows Subject to Different Obstruction Geometries: a) Flat Plate, b) Arch, c) Three-Wall, d) Unobstructed	5-24
Figure 5-22	Unobstructed versus Obstructed Plume Temperatures – Different Fire Source Diameters.....	5-25
Figure 5-23	Unobstructed versus Obstructed Plume Temperatures – Different HRRs.....	5-26
Figure 5-24	Unobstructed versus Obstructed Plume Temperatures – Different Fire Source Elevations.....	5-27
Figure 5-25	Obstruction Effect on Plume Proportionality Constant, Different Geometries	5-29
Figure 5-26	Obstruction Effect on Plume Proportionality Constant.....	5-30
Figure 5-27	Unobstructed versus Obstructed Plume Temperatures – Bias and Uncertainty.....	5-32
Figure 5-28	Heskestad versus Unobstructed Plume Temperatures – Bias and Uncertainty.....	5-32
Figure 5-29	Heskestad versus Obstructed Plume Temperatures – Bias and Uncertainty.....	5-33
Figure 5-30	a) Vertically Oriented Fire Source, b) Fire Source Located Along the Cabinet Wall Surfaces	5-35
Figure 5-31	Top Obstruction with a Soffit.....	5-36
Figure 5-32	Unobstructed vs. Obstructed Plume Temperatures – Soffit Sensitivity	5-36
Figure 5-33	Unobstructed vs. Obstructed Plume Temperatures – Enclosure Thickness Sensitivity	5-37
Figure 5-34	SDP Ball and Column	5-38
Figure 5-35	Obstruction Plume Shift	5-39

Figure 5-36	Determination of Horizontal Plume Shift.....	5-40
Figure 5-37	Comparison of Horizontal ZOI Resulting from Plume Shift to Thermal Radiation Exposure	5-41
Figure 5-38	Maximum Angle from Horizontal Plume Shift	5-42
Figure 5-39	Recommended ZOI for an Electrical Enclosure Fire a) Without Top Obstruction Credit, and b) with Top Obstruction Credit	5-43
Figure 6-1	Unobstructed and Obstructed Temperature Predictions	6-2
Figure 6-2	Vertical Plume ZOI.....	6-3
Figure 6-3	ZOI Difference for Obstructed and Unobstructed Plume Flows Using Heskestad Fire Plume Correlation.....	6-4
Figure 6-4	Example 4, Reduction in Vertical ZOI Due to Obstructed Plume Credit	6-6
Figure 6-5	Fire PRA Example Reduction of Vertical ZOI	6-7

TABLES

Table 3-1	Distinguishing Characteristics for Default versus Low Fuel Loading Conditions.....	3-22
Table 4-1	Peak HRR Distributions for Functionally Based Classification Groups 1, 2, and 3 Enclosures	4-2
Table 4-2	Peak Heat Release Rate Distributions for Classification Group 4 (All Other) Electrical Enclosures	4-3
Table 4-3	Range of Fire Diameters as a Function of Fire Intensity (HRR) That Remain Within the Validation Range for the Plume Correlations	4-6
Table 4-4	Minimum and Maximum Fire Diameter Values for the 98 th Percentile HRR Values Cited in Tables 4-1 and 4-2	4-7
Table 5-1	FDS Obstructed Plume Simulation Test Matrix	5-9
Table 5-2	Bias and Uncertainty of Obstructed and Unobstructed Plume Temperature Rise.....	5-31
Table 5-3	Bias and Uncertainty of Obstructed (with Center Opening) and Unobstructed Plume Temperature Rise	5-34
Table 6-1	Example 2 ZOI Calculations	6-3
Table 7-1	Peak Heat Release Rate Distributions for Electrical Enclosures.....	7-4

EXECUTIVE SUMMARY

During the last decade, a number of commercial nuclear power plants (NPPs) have been developing fire probabilistic risk assessments (fire PRAs) to support risk-informed applications, including a voluntary transition from a deterministic fire protection program to a risk-informed/performance-based (RI/PB) program in accordance with National Fire Protection Association (NFPA) Standard 805, 2001 Edition. Most fire PRAs are based on methods and data described in NUREG/CR-6850 (EPRI 1011989), which was developed by a joint effort of both the Nuclear Regulatory Commission's Office of Nuclear Regulatory Research (NRC-RES) and the Electric Power Research Institute (EPRI). The wide application of this methodology has identified technical areas where additional research and data could better characterize the fire risks representing as-built plant conditions.

One important element supporting fire PRAs and other performance-based approaches is the estimation of the fire hazard using mathematical fire models (i.e., "fire modeling"). Fire modeling is used to support fire PRA developments to determine the effects of fire hazards on plant risk. For most fire modeling applications, the fire's heat release rate (HRR) is the most critical and difficult-to-predict parameter in characterizing the fire hazard. Specific to commercial NPP applications, the characterization of HRRs in electrical enclosures has been identified as a key technical area requiring additional research. In order to address this need, the NRC-RES and EPRI initiated the Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire (RACHELLE-FIRE) program.

The RACHELLE-FIRE program involves a working group of experienced fire protection and fire probabilistic risk assessment researchers and practitioners focused on reaching a consensus in estimating the peak HRR distributions for electrical enclosures used in NPPs. Based on the efforts of the working group, new methods and data have been developed in three specific areas:

- Classification of electrical enclosures in terms of function, size, contents, and ventilation conditions,
- Determination of peak HRR probability distributions considering specific electrical enclosure characteristics, and
- Characterization of fire plumes associated with fires in electrical enclosures.

Examples of fire modeling applications are included to show the differences between the current approach and the new HRR values including the effect of obstructed plume considerations. Appendix E of this report and the fire modeling software, input files, and other supporting information used to develop the results are provided on an accompanying compact disk (CD).

The classification of electrical enclosures and the determination of their corresponding HRR probability distributions were published in Appendix G of NUREG/CR-6850 (EPRI 1011989). These distributions are applied to a given electrical enclosure based on three factors: qualified versus unqualified cable, open versus closed doors, and single versus multiple cable bundles. As suggested earlier, the methods and data documented in this report provide more refined electrical enclosure classifications and corresponding peak HRR distributions.

The new electrical enclosure classifications are based on their electrical function, size, and content. Power enclosures such as switchgear, load centers, motor control centers, battery chargers and power inverters are grouped based on function. Other electrical enclosures are classified as small, medium, or large based on their volumetric size. The classification is primarily based on the size because it can easily be assessed by visual inspection during walkdowns without the need for opening the electrical enclosure. “Large” and “medium” volumetric classifications can be refined to account for the amount and configuration of combustible fuel load, type of cable insulation material, and ventilation configuration. These refinements can result in lower HRR values based on visual inspection of the enclosure internals.

In practice, the classification described above is intended to work as follows. Electrical enclosures are first classified based on function and size. This classification should be a quick determination since it only requires external visual inspection and knowledge of the enclosure function. A “default” peak HRR distribution is assigned to this initial classification. This default distribution is intended to be conservative as no visual inspection of the enclosure internals is necessary. Based on visual inspection of the enclosure internals, the initial classification can be refined with one of two sub-groups: “low” and “very low” loading. These low and very low categories would allow analysts additional flexibility to reflect actual plant conditions identified through plant walkdowns and the examination of enclosure internals.

The revised peak HRR probability distributions (i.e., gamma distributions) for each of the new enclosure classification groups were developed based on the following factors:

- Review of experimental factors and configurations in testing programs intended to assess the HRR generated by electrical enclosure fires. Both domestic and international test programs were included within the scope of this research.
- Statistical analysis of the applicable experimental results.
- Extensive review and comparison of existing electrical enclosure configurations and operating experience in commercial NPPs and the influencing experimental factors.

Consistent with Appendices E and G of NUREG/CR-6850 (EPRI 1011989), the probability distributions are defined based on the 75th and 98th percentile values, with the 98th percentile value intended for use as the maximum (or peak) HRR to be assumed for any enclosure in a given type/function classification group. The 98th percentile value is also the value used during initial ignition source screening.

In order to provide a comprehensive characterization of electrical enclosure fires, the working group evaluated the temperature characteristics of fire plumes associated with these events using the National Institute of Standards and Technology’s (NIST) Fire Dynamics Simulator (FDS), version 6.0.1. In practice, fire plume temperatures are used to define the vertical component of a zone of influence (ZOI). The vertical component of the ZOI is the region above the fire where the fire plume temperatures could damage electrical cables and/or cause damage to nearby secondary combustibles.

Current practice for determining the vertical component of the ZOI includes a relatively simple process for establishing the elevation and diameter of the fire source. Typical fire modeling also uses the closed-form correlations to predict plume temperatures given a fire located within the enclosure. This practice is conservative because the fire source is positioned assuming that the

enclosure does not exist. That is, the fire plume is modeled as if the fire were out in an open location, not inside an enclosure. In reality, the enclosure itself, and especially the enclosure's top cover, disrupts the plume development as compared to open unobstructed plumes. A more realistic treatment of the fire plume calculation is provided to account for the dispersion of the plume as it interacts with the top plate of a steel enclosure. The resulting approach is intended to be used in plume temperature calculations supporting the characterization of the ZOI in the early stages of the fire (i.e., before significant room temperature increases). Finally, a method to account for obstructions when estimating fire plume temperatures and the vertical component of the ZOI is provided.

In summary, this report provides a refined approach for the characterization and modeling of fires in electrical enclosures. The report is based on recent research on electrical enclosure fires, lessons learned over the last ten years developing fire PRAs and the understanding of the corresponding risk insights, as well as new research associated with obstructed fire plumes. Examples, consolidating the information in this report, are also provided. The examples have been selected and designed to illustrate how to incorporate the research documented in this report into the existing approaches for modeling fires in electrical enclosures.

EPRI PERSPECTIVE

Since its publication in 2005, NUREG/CR-6850 (EPRI 1011989) has been extensively used as the methodology for developing fire probabilistic risk assessments (fire PRA) in support of NFPA 805 and other risk-informed applications. Initial applications of the methodology resulted in conservative estimates of risk, which generated the need for methodology revisions and refinements over the past decade. Although a number of these revisions and refinements have been finalized and implemented, several technical areas have been identified where supplementary research could better characterize the fire risks at nuclear power plants (NPPs). One of the most important technical areas is the characterization of the fire hazard associated with electrical cabinets. In practice, this hazard is characterized in the form of heat release rates and the corresponding temperature profile surrounding the cabinet. In order to address this need, a working group between EPRI and NRC-RES was assembled to develop new heat release rates with consideration of new test data, operating experience, and general usage of the methodology. This report documents the results of the research conducted by the working group in the form of a practical methodology. Specifically, the report provides updated technical methods and data in three areas:

- The classification of electrical cabinets in terms of function (e.g., power and control cabinets), size, combustible contents, and ventilation conditions,
- The determination of peak heat release rate probability distributions considering specific electrical cabinet characteristics, and
- The characterization of fire plumes associated with fires in electrical enclosures.

The original peak heat release rate values provided for use in fire PRAs are documented in NUREG/CR-6850 (EPRI 1011989) Table G-1. The five distributions are distinguished by cable qualification type, such that two or three distributions are expected to represent the peak fire intensity for all electrical cabinet fires at NPPs. With the understanding that electrical cabinets at NPPs are of many different sizes, shapes, functions, and configurations, the working group re-classified the electrical cabinets to more accurately represent the population in commercial NPPs. These new classifications serve as the foundation to re-evaluate the peak heat release rate probability distributions.

The peak heat release rate probability distributions provided in this report have been developed through a consensus process, based on the results of several experimental test programs and a review of fire event experience. These peak heat release rate probability distributions can be assigned considering the cabinet function, size, and combustible content.

Existing practice models electrical cabinet fires assuming the fire is burning outside of the enclosure. In reality, the cabinet top cover disrupts the plume development as compared to fires occurring in the open. In order to understand the effects of obstructions on the temperature profile of fire plumes, Fire Dynamics Simulator was used to model fires inside electrical cabinets. Simulations were performed in which flames and fire plume flows were subjected to obstructions. The studies of the obstructed plume simulations demonstrate lower temperatures above the fire location compared to the unobstructed cases due primarily to the

entrainment of fresh air above the obstructions. Based on this research, a new method is available for estimating temperatures associated with obstructed fire plumes.

With the combination of the new heat release rates and obstructed plume methodology, a more realistic representation of the fire hazard associated with electrical cabinets can be achieved.

CITATIONS

This report was prepared by the following:

U.S. Nuclear Regulatory Commission
Washington, D.C. 20555-0001
Principal Investigators:
N. Melly
D. Stroup
G. Taylor

Electric Power Research Institute
3420 Hillview Avenue
Palo Alto, CA 94304
Principal Investigator:
A. Lindeman

Under contract to NRC:

Brookhaven National Laboratory
P.O. Box 5000
Upton, NY 11973
Principal Investigator:
M. Subudhi

Consultant
42 Sacred Way
Glorieta, NM 87535
Principal Investigator:
S. Nowlen

Under contract to EPRI:

Jensen Hughes, Inc.
3610 Commerce Dr. Suite 817
Baltimore, MD 21227
Principal Investigators:
F. Joglar
J. DeJoseph
V. Ontiveros
J. Williamson

Engineering Planning and Management
5520 Dillard Drive, Suite 250
Cary, NC 27518
Principal Investigator:
D. Miskiewicz

This report describes research sponsored jointly by the U.S. Nuclear Regulatory Commission's (NRC) Office of Nuclear Regulatory Research (RES) and the Electric Power Research Institute (EPRI).

The report is a corporate document that should be cited in the literature in the following manner:

Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire (RACHELLE-FIRE), Volume 1: Peak Heat Release Rates and Effect of Obstructed Plume, U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES), Rockville, MD, and Electric Power Research Institute (EPRI), Palo Alto, CA: 2015. NUREG-2178, V1, and EPRI 3002005578.

ACKNOWLEDGMENTS

This report was completed using a working group, which included stakeholders from the U.S. Nuclear Regulatory Commission (NRC) and the Electric Power Research Institute (EPRI). The authors appreciate the support of their respective organizations that cooperatively shared some or all of the cost and time for participation in this study.

The working group members would like to thank Dr. Manomohan Subudhi, Brookhaven National Laboratory (BNL), for facilitating the working group discussions and developing the early drafts of this report.

Special thanks go to Dr. Justin Williamson and Dr. Victor Ontiveros of Jensen Hughes, under the guidance of Dr. Francisco Joglar, for running the National Institute of Standards and Technology (NIST) Fire Dynamics Simulator models for the obstructed plume characterization. The authors thank Dr. Kevin McGrattan of NIST for his presentation and discussions of the results from the NRC-sponsored electrical enclosure tests conducted by NIST at the Naval Research Laboratory's Chesapeake Bay Fire Test Detachment facility. The authors are grateful to Mr. Mark Schairer of EPM for his peer review of the obstructed plume study. Special thanks go to working group member Ms. Joelle DeJoseph and Duke Energy for providing a large library of electrical enclosure pictures as well as piloting the new heat release rates and obstructed plume methodology.

The technical support of Mr. Kenneth Hamburger and Mr. Philip Smith of NRC, who participated in working group meetings, provided analysis of fire test data, and supplied input to the fire size calibration exercises, is acknowledged and greatly appreciated. In addition, the working group members would like to thank Dr. Susan LeStrange of Jensen Hughes and Ms. Shivani Mehta of NRC for their support of the heat release results spreadsheet development and analysis.

Finally, a draft of this report was Noticed in the Federal Register for public comment on April 30, 2015 (80 FR 24290). The authors thank the Office of Nuclear Reactor Regulation and those members of the public, specifically Victoria K. Anderson, Nuclear Energy Institute; Krystyna Gavin, Appendix R Solutions; James Barstow and Richard Gropp, Exelon Generation; and Laurence Rigollet, IRSN; who provided comments during the public comment period.

ACRONYMS

AC	Alternating Current
ACRS	Advisory Committee on Reactor Safeguards
ADAMS	Agencywide Documents Access and Management System
ARCH_xxx	Obstruction Case with Flat Plate and Two Side Walls
BASE_xxx	Base Case with No Obstruction
BNL	Brookhaven National Laboratory
Btu	British thermal unit
CBD	Chesapeake Bay Fire Test Detachment
CCDP	Conditional Core Damage Probability
CD	Compact Disc
CDF	Core Damage Frequency
CFD	Computational Fluid Dynamics
CFR	Code of Federal Regulations
COR	Code of Record
DC	Direct Current
DUKE	Duke Energy
EMT	Electrical Metallic Conduit
EPM	Engineering Planning and Management
EPRI	Electric Power Research Institute
ERFBS	Electrical Raceway Fire Barrier System
FAQ	Frequently Asked Questions
FDS	Fire Dynamics Simulator
FEDB	Fire Events Data Base
FMC	Flexible Metal Conduit
FR	Federal Register
GRC	Galvanized Rigid Conduit
HEAF	High Energy Arc Fault
HELEN-FIRE	Heat Release Rates of Electrical Enclosure Fires
HGL	Hot Gas Layer
HRR	Heat Release Rate
IEEE	Institute of Electrical and Electronics Engineers
IMT	Intermediate Metallic Conduit
IRSN	Institute de Radioprotection et de Surete Nucleaire (France)
kW	kilowatt
LFMC	Liquid-Tight Flexible Metal Conduit
MCB	Main Control Board
MCC	Motor Control Center
MW	Megawatt
NEI	Nuclear Energy Institute
NFPA	National Fire Protection Association
NIST	National Institute of Standards and Technology
NPP	Nuclear Power Plant
NRC	Nuclear Regulatory Commission
NSP	Non-Suppression Probability
OBST_xxx	Obstruction Case with Flat Plate

PAU	Plant Analysis Unit
PMMA	Poly(methyl methacrylate)
PRA	Probabilistic Risk Assessment
QTP	Qualified Thermoplastic (i.e., IEEE-383 flame spread test)
RACHELLE-FIRE	Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire
RES	NRC's Office of Nuclear Regulatory Research
RI/PB	Risk-Informed/Performance-Based
RMC	Rigid Metal Conduit
SDP	Significance Determination Process
SF	Severity Factor
SIS	Synthetic Insulated Switchboard Wire or XLPE-Insulated Conductor (see UL 44, TS-Insulated Wires and Cables)
SNL	Sandia National Laboratories
SR	Silicon Rubber
STD	Standard
TP	Thermoplastic
THREEWALL_xxx	Obstruction Case with Flat Plate and Three Side Walls
TS	Thermoset
UL	Underwriter Laboratory
US	United States
VAC	Voltage in AC
V&V	Verification and Validation
VTT	Valtion teknillinen tutkimuskeskus (Finland)
WG	Working Group
XLPE	Cross-Linked Polyethylene
ZOI	Zone of Influence

1 INTRODUCTION

1.1 Background

In 2001, the National Fire Protection Association (NFPA) issued the first edition of NFPA 805, *Performance-Based Standard for Fire Protection for Light-Water Reactor Electrical Generating Plants, 2001 Edition* [1]¹. On July 16, 2004, the U.S. Nuclear Regulatory Commission (NRC) amended its regulations in *Title 10, Section 50.48, of the Code of Federal Regulations (10 CFR 50.48), Fire Protection* [2], to allow U.S. utilities to adopt and maintain risk-informed, performance-based fire protection programs. Paragraph (c) of 10 CFR 50.48 endorses, with exceptions, the NFPA 805 Standard – 2001 Edition, as a voluntary alternative for demonstrating compliance with the deterministic programs given in Appendix R to 10 CFR 50 [3] in accordance with Paragraph (b) of 10 CFR 50.48 or the plant-specific fire protection license conditions.

In 2005, the Electric Power Research Institute (EPRI) and the NRC's Office of Nuclear Regulatory Research (RES) issued a joint technical report titled *EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities*, EPRI 1011989, NUREG/CR-6850 [4]², presenting methods and data for conducting a fire probabilistic risk assessment (fire PRA). As utilities develop fire PRAs to support a transition to NFPA 805 or in pursuit of other risk-informed applications, the methods in NUREG/CR-6850 have been used extensively. The methodology described in NUREG/CR-6850 for modeling fires in electrical enclosures generally consisted of:

1. Identifying the electrical enclosures that should be considered ignition sources in a fire PRA (see Chapter 6 of NUREG/CR-6850 and associated fire PRA frequently asked questions (FAQs)),
2. Assigning a heat release rate (HRR) probability distribution to the peak heat release rate (see Appendices E and G of NUREG/CR-6850), and
3. Determining the region nearby the electrical enclosure where the fire could generate damage to nearby equipment and cables. This region is usually referred to as the zone of influence (ZOI) (see Chapter 8 and Appendix F of NUREG/CR-6850).

Although the first and third items were not new concepts introduced by NUREG/CR-6850 (i.e., previous fire PRA methodologies provided similar or identical information), the second item was new. Earlier fire PRA methods provided the characterization of electrical enclosures using point values for the heat release rate instead of probability distributions. The reason why NUREG/CR-6850 provided the use of probability distributions was twofold. First, this approach allows for the uncertainty associated with the HRRs to be considered in the risk quantification process. Second, it allows for an independent assessment of the severity factor term in the risk equation based on the characteristics of the electrical enclosure (i.e., the ignition source) and the geometry/configuration of the fire scenario that could be generated by the postulated fire.

¹ Ref. 1, NFPA 805, 2001 Edition is hereafter referred to as "NFPA 805", and all references to this standard refer to the 2001 edition of this standard, which is the code of record (COR) as required by NRC regulations.

² Ref. 4, NUREG/CR-6850 (EPRI 1011989) is hereafter referred to as "NUREG/CR-6850".

INTRODUCTION

Fire modeling is used to support fire PRAs to determine the effects of fire hazards on plant cables and equipment. For most fire model applications, the HRR of the fire is the most important parameter to specify. The HRR, measured in kilowatts (kW)³, is the rate at which the combustion reaction produces heat. Appendix G of NUREG/CR-6850 provides peak HRR distributions for fixed ignition sources, such as electrical enclosures. For electrical enclosures, five heat release distributions are specified, which are dependent on 1) the number of cable bundles, 2) the type of internal combustibles (e.g., qualified or unqualified cables), and 3) the ventilation conditions (open/closed doors).

The wide application of the methods and data summarized above over the last ten years, together with fire research conducted after NUREG/CR-6850 was published, has led to the identification of key areas in the fire modeling of electrical enclosures where refinements can be developed. Specifically:

- A number of testing programs for evaluating HRRs in electrical enclosures have recently been completed. For example, in 2013 a series of experiments were sponsored by the Nuclear Regulatory Commission's Office of Nuclear Regulatory Research (NRC-RES) and conducted by the National Institute of Standards and Technology (NIST) at the Chesapeake Bay Fire Test Detachment (CBD) of the Naval Research Laboratory to obtain additional data to support re-quantification of HRR estimates for electrical enclosures. This testing effort used electrical enclosures removed from a nuclear facility, and electrical cables and panel wiring representative of those commonly found in U.S. nuclear power plants (NPPs). In total, 112 individual fire tests were conducted, and the result of this effort is documented in NUREG/CR-7197, "Heat Release Rates of Electrical Enclosure Fires (HELEN-FIRE)" [5].
- An extensive collection and review of recent fire events records throughout the entire U.S. nuclear industry was conducted.
- Numerous fire PRAs have been developed providing specific information (e.g., numerous pictures of cabinet internals, detailed enclosure construction specifications, etc.) associated with potential influencing factors in electrical enclosure fires.

Refinements are necessary because a comparison of the fire modeling results and resulting risk contribution of electrical enclosure fires compared with the fire experience in the U.S. commercial nuclear industry suggests that current information may be conservative for fire scenarios presenting specific characteristics.

1.2 Approach

The characterization of fires inside electrical enclosures has been identified as a technical area where existing methods and data could be refined. In an effort to obtain more realistic data for analysis of electrical enclosure fires and associated peak heat release rates, the NRC-RES sponsored a program with NIST. Subsequent to the completion of that test program, RES together with the EPRI established a working group composed of technical experts in experimental test programs, fire PRA, operating experience, fire modeling, and circuit analysis to review the new data, other available test data, and industry experience in an effort to develop refinements.

³ 1 Btu/s is equal to 1.055 kW.

During the project planning phase, the project sponsors evaluated the potential approaches to achieve the specific objectives of this report. Options included the use of formal expert elicitation panels, methods development panels, and facilitated working groups. It was decided not to pursue a formal expert elicitation type process due to the availability of test data, operating experience, an established and acceptable methodology for implementation, and the understanding of influencing factors affecting the diffusion flame combustion process. Instead, the use of a facilitated working group (WG) represented by members with the collective professional experience to reach a consensus in estimating the peak HRR distributions for electrical enclosures in typical NPP configurations and to address some of the challenging fire modeling issues was chosen. The decision to use the facilitated WG approach was based on the nature of the planned work, the urgency of the needed information to support fire PRA application reviews, increased efficiency (provided a consensus opinion could be reached quickly), and the availability of test data to support the planned efforts. Where expertise beyond the collective knowledge of the WG was needed, individual experts were consulted. At this time, consultation with non-WG experts was primarily in the fire modeling area although experts were also asked to comment on the proposed enclosure classification groups.

The WG representation was balanced between the regulator (i.e., four members from the NRC/National Laboratories) and the nuclear power industry (i.e., four members from EPRI/nuclear power industry). The WG members are listed below, along with their affiliations. Brief resumes are included in Appendix A.

Joelle DeJoseph, Jensen Hughes, formerly with Duke Energy (DUKE)
Francisco Joglar, Jensen Hughes
Ashley Lindeman, EPRI
Nicholas Melly, NRC-RES
David Miskiewicz, Engineering Planning and Management (EPM)
Steven Nowlen, Consultant⁴
David Stroup, NRC-RES
Gabriel Taylor, NRC-RES

A number of additional subject matter experts also participated in WG meetings. Mr. Mark Henry Salley of NRC-RES provided general assistance and oversight. Dr. Kevin McGrattan of NIST provided technical assistance associated with the Fire Dynamics Simulator (FDS) software and fire test results conducted at the CBD facility. Dr. Justin Williamson and Dr. Victor Ontiveros of Jensen Hughes performed the computer simulations of obstructed plumes. Finally, Dr. Manomohan Subudhi of Brookhaven National Laboratories (BNL) served as the moderator/facilitator of the meetings and discussions.

In developing the information documented in this report, the facilitated WG held four multi-day meetings between April and September 2014. A summary of the working group's interactions is included in Appendix B. These meetings allowed the WG to effectively communicate opinions and receive constructive feedback on possible approaches for addressing the project objectives. The early meetings allowed the WG to formulate a project outline and actions to be completed, while the later meetings allowed the WG's progress to be reviewed and formalized. In the latter half of this process, weekly conference calls were also held to update WG members on the status of current and planned activities. Ultimately, the results and approaches presented in this report represent the WG's consensus opinion.

⁴ Steven Nowlen (retired) was a Distinguished Member of the Technical Staff at Sandia National Laboratories.

1.3 Scope and Terminology

The fundamental scope of this report is the characterization and analysis of those plant fire ignition sources that, under NUREG/CR-6850 - Task 6, have been counted as members of fire ignition source: Bin 4 - main control board, Bin 10 - battery chargers, and Bin 15 - electrical cabinets. The methods of this report are not applicable to any other fire ignition source and, in particular, are not applicable to electrical enclosures that are either not counted as fire ignition sources (per the counting information) or that are counted as junction boxes (fire ignition source Bin 18). This report also does not deal with high energy arc fault initiated fires in any electrical enclosure (fire ignition source Bin 16).

The Refining and Characterizing Heat Release Rates from Electrical Enclosures During Fire (RACHELLE-FIRE) program deals with the analysis of fires that originate in electrical or electronic equipment housed within a support structure, generally metal, that is either enclosed or made up of open rack-type panels or supports. In this report, these housings are referred to as “electrical enclosures.” The term “electrical enclosure” is meant to be broadly inclusive of essentially any box or structure, with the exception of cable trays and conduits, whose primary purpose is to house electrical and/or electronic components. “Electrical enclosure” as used in this report does encompass the open rack panels used in some NPP applications even though, strictly speaking, these are not enclosures (e.g., a relay rack or an open support structure used to house instrument and/or control components).

In past practice, a variety of terms have been used to identify these same items. For example, NUREG/CR-6850 used the terms “panel” and “cabinet” extensively. The terms “relay rack,” “control or circuit boards,” and “junction box” are also used. In general, “electrical enclosure” is a more widely recognized and generic term used among electrical equipment manufacturers and electrical engineers (e.g., see the various standards published by the National Electrical Manufacturers Association). The term “electrical enclosure” as used in this report is inclusive of cabinets, panels, and relay racks as those terms are used in NUREG/CR-6850 and other related fire PRA documents and standards.

In NUREG/CR-6850 the term “enclosure” is used in two other contexts—namely, the regulatory issue of cables and components that share a “common enclosure” (e.g., cables routed in the same cable tray), and the modeling of “enclosure fires” (i.e., fires that occur within a room as opposed to fires that occur in an open unconfined space). The reader is cautioned not to confuse these unrelated uses of the word “enclosure.”

The facilitated WG developed fire source burning behaviors characterized by a distribution on peak HRR reflecting the aleatory uncertainty associated with fire development. The WG used the same approach that was used when developing the distributions found in Appendix G of NUREG/CR-6850 and did not attempt to explicitly characterize the uncertainty of these peak HRR distributions or the appropriateness of using a two-parameter distribution profile whose parameters were derived from the 75th and 98th percentile WG consensus estimates.

NUREG/CR-6850 also refers to “qualified thermoplastic cables” when setting the fire characteristics of electrical enclosure fires. In this context, the designation “qualified” is a reference to the IEEE-383 cable qualification standard which originally included a vertical flame

spread test⁵. The IEEE-383 flame spread test [6] has been a common historical flammability benchmark used in the U.S. nuclear power industry, and cables that pass that test are considered “qualified” as low flame spread cables. Since publication of the IEEE-383 standard in 1974, it has been common practice for plants to specify low flame spread cables per that test in procurement actions. In some cases cables have also been “back-qualified” through testing done some time after procurement and/or installation. The flame spread test is only a minor aspect of the overall IEEE-383 standard which focuses mainly on severe accident equipment qualification testing. Cables that pass the flame spread test may not comply with other portions of the standard but would still be considered low flame spread.

The intended practice under the methods presented here is to treat qualified TP (QTP) cables (i.e., cables shown to pass the IEEE-383 flame spread test) consistently with the treatment outlined in NUREG/CR-6850; namely, QTP cables are given equivalent status relative to fire characterization as are TS cables. That is, if the application involves TP cables but those cables were tested and passed the IEEE-383 flame spread test, then the analyst may treat those QTP cables as equivalent to TS cables when selecting the appropriate peak HRR distribution (e.g., when applying Tables 4-1 and 4-2 from this report). A similar treatment is afforded to SIS wires which are also required to pass flammability tests. Hence, the lower flammability cable types are grouped together under the classification TS/QTP/SIS. Finally, the discussion of QTP cables in the context of flammability (ignition and flame spread) is entirely separate from the assessment of cable damage thresholds. QTP cables should be assumed to have damage thresholds similar to unqualified TP cables when assessing cable functionality.

1.4 Objectives

This report documents the working group’s efforts and consensus in three technical areas:

1. The classification of electrical enclosures typically selected as ignition sources in probabilistic studies (i.e., fire modeling or fire PRAs) in the commercial nuclear power industry,
2. The characterization of peak HRRs associated with the different electrical enclosures, and
3. The characterization of fire plume temperatures generated by fires inside electrical enclosures.

The research results in these three areas were consolidated in the form of technical information that can be applied in fire modeling studies supporting fire PRAs. This technical information includes:

1. The classification of electrical enclosures in terms of function, size, combustible contents, and ventilation conditions,
2. The determination of peak HRR probability distributions considering specific electrical enclosure characteristics such as function, size, combustible contents, ignition potential, and ventilation conditions, and
3. The characterization of fire plumes associated with fires in electrical enclosures.

⁵ Note that since its original publication under IEEE-383, the flame spread test portion of the standard has been removed from IEEE-383 and published instead under IEEE-1202. The two tests are essentially the same.

INTRODUCTION

It should be noted that the methods and data described in this report are a supplement to existing methods and data, primarily documented in NUREG/CR-6850, its corresponding supplement, and fire PRA FAQs. Analyses already completed with the existing methods and data can be considered bounding and may not need to be supplemented with the information provided in this document. Specifically:

- The classification of electrical enclosures is consistent and does not affect the existing ignition source counting information available in Chapter 6 of NUREG/CR-6850 and applicable fire PRA FAQs.
- The probability distributions for peak HRRs can replace the ones currently available in Appendix E and G of NUREG/CR-6850. However, the existing distributions in NUREG/CR-6850 are considered bounding when compared with their corresponding counterparts described in this document.

The characterization of fire plumes generated by fires in electrical enclosures, when applicable to a given scenario, is expected to produce lower plume temperatures than the ones obtained using existing information (unobstructed plume). Consequently, the existing information is bounding, as the use of “unobstructed” fire plume temperature models produces higher gas temperatures.

The combination of the revised peak HRR rate distributions and the obstructed plume study may affect the size of the fire zone of influence (ZOI). The ZOI is a crucial element of the fire PRA development as it has a direct impact on damaged equipment postulated in the fire PRA response model. Two cases are most likely:

- For cases that have followed the NUREG/CR-6850 guidance directly, the new guidance will either not impact the ZOI or will result in a reduction in the size of the ZOI in all cases.
- If the analyst has deviated from the NUREG/CR-6850 guidance, then cases may be encountered where the new guidance could increase the size of the ZOI depending mainly on the peak HRR profile assigned to the electrical enclosure.

As a general rule, if the new peak HRR distributions applicable to a specific case cite a 98th percentile value that is greater than the 98th percentile value assumed in the original fire PRA, then a review of those cases against the new guidance would be recommended as a part of PRA maintenance efforts. For all other cases, the original analysis would remain conservative compared to the new guidance.

1.5 Report Organization

This report is organized as follows:

- Section 2 describes the activities and process used by the working group to develop the new HRR distributions and the obstructed plume methodology.
- Sections 3 and 4 discuss the classification of electrical enclosures. Section 3 describes the new electrical enclosure classification groups. This section also describes the effect of the enclosure internal fuel load configuration on the peak HRR. Section 4 documents the consensus peak HRR probability distributions for the different electrical enclosure classification groups.

- Sections 5 and 6 describe the research associated with obstructed fire plume temperatures. Specifically, Section 5 describes the technical basis for the methodology provided in this report. The methodology and example applications are provided in Section 6.
- Section 7 provides the summary of results and conclusions of this study. In addition, areas for future research as discussed during the working group meetings are identified in this section.
- Appendix A includes the resumes of WG members, technical contributors, and working group moderator.
- Appendix B provides an overview of the deliberation activities of the WG members on estimating the HRR distributions for various enclosure types. This includes the process used by the WG, and defined issues that were considered by the WG in this project.
- Appendix C presents a library of pictures and descriptions for the electrical enclosure types described in Section 3. These pictures serve as information for the classification of electrical enclosures in specific applications.
- Appendix D summarizes the statistical analysis in support of the peak HRR probability distributions described in Section 4. The statistical analysis is based on available fire test results for the different enclosure classifications.
- Appendix E (included on the compact disk (CD)) lists the obstructed plume temperature numerical results obtained using FDS.
- Appendix F describes several examples illustrating the application of the revised peak HRR probability distributions and the implementation of the information associated with obstructed fire plume temperatures for determining the vertical component of the ZOI.
- A CD accompanying this report contains Appendix E, the fire modeling software, input files, and other information used to develop the results in this report.

2

OVERVIEW OF THE PROCESS

This section describes activities by the working group (WG) members and the process followed to: (1) classify electrical enclosures, (2) develop revised heat release rate (HRR) distributions for each classification, and (3) investigate the fire plume characterization generated by electrical enclosure fires. The following sections describe each of these topics in detail. Although the process for each of these three activities is described separately, there was overlap, especially between the electrical enclosure classification and the development of the updated peak HRR values.

2.1 Classification of Electrical Enclosures

The classification of electrical enclosures is based on the following process:

- Review existing enclosure classification guidance documented in Appendix G of NUREG/CR-6850 [4]. The review supported an understanding of:
 - Existing guidance for classifying electrical enclosures
 - Application/experience using the existing approach
 - Limitations and areas for enhancement/improved realism
- Review the fire hazards associated with electrical enclosures, including:
 - Extensive review of photographs depicting electrical enclosure internals to assess variability in fuel load and configuration
 - Equipment functional differences
 - Discussion of ignition source strength/types among the different electrical enclosures
 - Collection and review of available experimental test series
 - Review of U.S. operating experience using the Updated Fire Events Database (EPRI 1025284) [7]
 - Focus on implementation and practical application

2.1.1 Review of Existing Guidance

The WG reviewed Appendix G of NUREG/CR-6850, specifically Table G-1, which lists the recommended HRR probability distributions for five different types of enclosures. The classification of all electrical enclosures into five ignition source groups is based primarily on:

- Number of cable bundles, i.e., one cable bundle or more than one bundle
- Qualified or unqualified cables
- Open or closed electrical enclosure (for more than one bundle and unqualified cable)

The existing guidance uses cable bundle parameter characterization to correlate the recommended HRR values to fire test data configurations from the NRC/Sandia National Laboratories (SNL) [8] and Valtion teknillinen tutkimuskeskus (VTT) [9, 10, 11] control electrical enclosure test programs. Similarly, the ventilation configuration of the enclosure (i.e., open or closed electrical enclosure) and the qualification of the cables involved in the tests also correlated to the experimental programs.

A key limitation of the original Appendix G electrical enclosure classification approach is in its practical application. For example, the original authors have stated that their intent was that the single bundle cases would cover most of the higher voltage power switching equipment (e.g., switchgear and load centers) and most other enclosures would likely fall into the “more than one bundle” cases including those with significant fuel loads other than cables (e.g., control components). It was also intended that the “single bundle” cases would include cases where an enclosure contained more than one bundle but due to the internal configuration, fire was likely to impact only a single bundle at a time (e.g., internal separation of the bundles with no significant inter-bundle fuel available). However, unless internal inspection was possible, analysts appear to default to the higher “more than one bundle” cases and, in practice, the latter argument, fire will remain confined to one bundle, has been difficult to justify.

The WG also noted that based on Table G-1 of NUREG/CR-6850, probabilistic risk assessment (PRA) analysts had, in some cases, assigned unreasonably high peak HRR values to certain small and medium size enclosures. This is a result of the relatively low number of electrical enclosure peak HRR estimates available for selection.

The WG agreed that a classification based on size and functionality of the electrical enclosure would provide a more practical implementation of the methodology. The WG determined that these are factors that can be easily determined by visual inspection during a walkdown without the need to open the electrical enclosure. At the same time, a classification based on enclosure size and functionality generated the need for understanding the fire hazards associated with the different functions and sizes.

2.1.2 Understanding the Fire Hazards Associated with Different Electrical Enclosures

In order to understand the effects enclosure function, size, and combustible loading characteristics have on peak fire vulnerability, the WG reviewed hundreds of electrical enclosure photographs of closed and open door configurations currently installed in commercial nuclear power plants (NPPs). During the review process, the WG discussed in detail the typical configurations for specific types of electrical enclosures to support a common understanding among the WG members of the similarities and differences among the types of electrical enclosures found in commercial NPPs. Additionally, the WG collected and studied experimental data and operating experience associated with electrical enclosure fires. Based on these activities, the WG considered the following attributes for electrical enclosure fires in classifying all relevant ignition sources:

- An enclosure’s internal volume and the amount of combustible materials (mostly cable insulations and electronic cards) have a significant effect on the maximum fire size if the ignition remains undetected and unsuppressed.
- Experience has shown that voltage and current ratings can have a significant effect on the ignition size and duration of the pre-growth phase of a fire. However, there is essentially no evidence to show how these factors would impact the peak HRR. The presumption of the WG is that once ignited, higher ignition energies available would tend to increase the likelihood of larger fires, but ignition energy has very limited effect on the worst-case peak HRR values.

- Switchgear, load centers, motor control centers (MCCs), power inverters, and battery chargers are normally housed in closed, vented enclosures and have very small amounts of cables, limiting the size of the expected fires. Variations among the equipment manufacturers and from plant to plant installations are not significant enough to affect the fire characteristics among enclosures within each of these functional types.
- Neatly organized internals (e.g., jacket-stripped cable with conductor bundles neatly zip-tied and run in an orderly fashion along the walls of the enclosure, wires leading to enclosure internals neatly arranged and run in tight bundles between the mounted electrical and electronic devices, high levels of internal partitioning with some components housed in internal metal enclosures within a larger enclosure) are more difficult to ignite and take a longer time for initial ignition and fire growth than disorderly contents (e.g., loose or no bundling of cables, large quantities or small conductor wires routed throughout, quantities of excess or spare cable often left inside an enclosure, wide dispersal of fuels over the enclosure interior). The most significant contributor to this observation is that loose bundling increases the exposed cable surface area allowing oxygen to reach cables within a bundle more readily than with a tight bundle. This effect is analogous to trying to ignite kindling versus a log. Even given well organized contents, once the conductor bundle ties melt, tests have shown that the fire size could grow rapidly, but in general, a larger initial fire is needed and a relatively lower peak HRR value will still be expected than that given an enclosure with disorderly internals.
- Enclosure venting conditions range from fully open equipment racks to fully enclosed and tightly sealed conditions. Larger enclosures usually have some degree of venting, typically top and bottom louvers on the horizontal face of the enclosure, that provide for adequate ventilation and cooling of devices when in operation. Fire tests have shown that ventilation characteristics can have a significant effect on the fire growth behavior inside an enclosure [8, 11]. A restricted ventilation condition (e.g., a closed and vented electrical enclosure) tends to have a “capping” effect on fire HRR. While attempts to develop direct correlations between ventilation opening size and peak HRR have not succeeded, the SNL and VTT tests, as well as testing performed in France [12], have all found that ventilation is an important parameter (see further discussion of the French tests in Section 2.2.8). Both open and closed electrical enclosures are expected to experience a preponderance of smaller fires with limited or no propagation, but under worst case conditions, a fire in an open configuration can grow to a larger size than one in a closed configuration, other factors being equivalent, due to the ventilation effect.
- Tests have shown that cables with thermoplastic (TP) conductor insulation ignite and spread fire far more easily than those with thermoset (TS) insulation. Tests have also shown that TP cables qualified (QTP) as low flame spread per the IEEE-383 standard vertical flame spread test will show substantially reduced flammability compared to an unqualified cable. Finally, switchboard (SIS) wire, which is widely used in manufacturer pre-wired installations, is also subject to flammability testing and exhibits low flame spread characteristics.
- Fires more readily spread vertically upward inside an enclosure than horizontally across the enclosure width. Given enough time, conditions conducive to flame spread may result in the involvement of all combustibles inside an enclosure.

OVERVIEW OF THE PROCESS

After deliberation, the WG proposed an initial set of enclosure classification groups based on enclosure type/function rather than number of cable bundles. The final classification groups evolved slightly through the rest of the process but remained largely as defined originally. Section 3, “Classification of Electrical Enclosures,” describes the four classification groups and associated sub-groupings in detail, along with the factors considered to support this classification. The first three groups are based on the equipment functional classification, while the last group is based on the size and is intended to represent “all other” electrical enclosures not covered by the first three classes. The classification of electrical enclosures as fire ignition sources (Bins 4, 10, and 15) in accordance with Task 6 of NUREG/CR-6850 is based on assignment of each enclosure to one of the following classification groups¹:

- Group 1: Switchgear and Load Centers
- Group 2: MCCs and Battery Chargers
- Group 3: Power Inverters
- Group 4: All Other Electrical Enclosures
 - Group 4a: Large Enclosures
 - Group 4b: Medium Enclosures
 - Group 4c: Small Enclosures

2.2 Process Used in Developing the HRR Distributions

The WG developed the HRR distributions, as presented in Section 4, for each classification group by conducting the following activities.

- A literature survey that consisted of reviewing:
 - Experimental test series conducted in the U.S. and internationally over the last three decades
 - U.S. NPP operating experience documented in EPRI’s Fire Events Database
- Identification of influencing factors. The WG identified the following influencing factors:
 - Electrical enclosure volume
 - Electrical enclosure function
 - Combustible type
 - Amount of combustible materials
 - Combustible material configuration
 - Electrical ignition size/potential
 - Ventilation conditions
- Calibration exercise
- Assessment of electrical enclosure heat release rates
- Building and achieving consensus
- Ensuring consistency and applicability
- Finalizing the consensus

¹ Each classification group is assigned a simple alpha-numeric identifier in order to simplify aspects of the discussions that follow and to promote a common PRA vocabulary. It is suggested that these designations be used as “shorthand” identifiers when citing classification results for in-plant enclosures (e.g., in fire PRA databases).

2.2.1 Literature Review

The WG began with a review of the available information relevant to electrical enclosure fire behavior, including both experimental data and actual plant fire experience. The available information included:

- NRC/SNL control electrical enclosure fire tests [8],
- VTT tests from Finland [9, 10, 11],
- IRSN tests from France [12],
- recently completed set of tests by NRC/NIST [5], and
- the EPRI updated fire events database [13].

Each test program was discussed in some detail including consideration of the test results as well as the test objectives and approach. Actual fire experience was reviewed based on the recently updated EPRI fire events database [13], which covers U.S. commercial NPP fire events. All of the fire events involving electrical enclosures were identified and reviewed, focusing especially on plant events occurring from 1990 through 2009. Insights from the event reports were discussed and factored into the consensus process as deemed appropriate by the WG members.

2.2.2 Informing the Distributions

As noted in Section 2.2.1, most of published studies associated with HRRs generated from electrical cabinet fires were considered by the WG to inform the development of HRR distributions. Each test program had different objectives and thus each test program influenced the HRR distributions in different and/or unique ways. The WG's treatment of specific tests from each test program is discussed in greater detail in Section 2.2.8. The three major test programs that had the most direct influence on the final distributions and the particular influences derived from each are outlined in a broader context as follows:

- The NRC-RES/SNL Cabinet Fire Tests (NUREG/CR-4527 V. 1 & 2): These tests, conducted in the late 1980's were the earliest of the test programs considered. As noted in Section 2.2.8, some of these tests were discounted based mainly on the unrealistic nature of the ignition sources used. In addition, this test series tended to be considered in the context of the worst-case conditions expected to be generated by an electrical cabinet fire. That is, the NRC-RES/SNL tests were considered as a significant factor in establishing the 98th percentile values for the Group 4a (other – large) enclosures especially in the context of the open configurations. The early “scoping” and “screening” tests from this program provided input into a number of the functional groups (especially functional Groups 1 and 2) in that many of those early tests involved more limited fuel loading conditions (e.g., one or two cable bundles in the enclosure corners) with larger ignition sources.
- The VTT Cabinet Fire Tests (VTT 186, VTT 269, VTT 521²): The VTT tests were performed not long after the RES/SNL tests were completed. These particular tests had

² Some of the experiments in the VTT 521 report are also documented in earlier VTT reports. Specifically, tests 1 through 6B were already included as part of the data within the scope of this project evaluated by the working group. The working group considered the new tests documented in VTT 521. These tests are experiments 7 through 10.

OVERVIEW OF THE PROCESS

a strong influence on the 98th percentile values established for the Group 4a and 4b enclosures (other – large and other – medium) and, in particular, for the closed configurations. The VTT tests differed from the NRC-RES/SNL tests in the fuel loading used in the tests. The NRC-RES/SNL tests used cable-only fuel loads, the VTT tests used fuel loads that included other combustibles (e.g., printed circuit cards). The VTT tests also explored exclusively closed cabinet configurations, as one major objective was to investigate ventilation effects on the heat release rate.

- The RES/NIST HELEN-FIRE tests (NUREG/CR-7197): The most recent investigation is the HELEN-FIRE test series which included over 100 experiments. The HELEN-FIRE tests were intended to explore the behavior of an enclosure fire given more realistic (i.e., smaller) ignition sources. In fact, some of the ignition sources used (e.g., the two smaller size cartridge heaters) were found to be too small to initiate a propagating fire. Consequently, many of the tests saw low HRRs (i.e., less than 5kW). However, even with the larger ignition sources, many tests saw very limited fire spread and relatively low heat release rates. At the same time, a number of tests had peak HRR values in excess of 50kW. One of the major insights taken from this test set is that, while the larger fires cannot be ruled out, under realistic ignition conditions (e.g., those that might arise due to electrical component failures), a preponderance of smaller fires with limited fire spread are to be expected. This information had a strong influence on the established 75th percentile values for all enclosure groups. In particular, the working group intentionally weighted the peak HRR distributions “to the left”; that is, to emphasize a stronger predominance of smaller fires. Note also that this observation is also consistent with the operating experience as used in the analysis of fire frequencies which shows a predominance of smaller fires and very few larger fires.

Given these considerations, some of the recommended peak HRR distributions have similar 98th percentile values as compared to the original distributions included in NUREG/CR-6850. This is not unexpected since the original distributions were derived based on the same NRC-RES/SNL and VTT test programs as considered here. However, the new HRR distributions have refined the enclosure binning process creating new bins specific to certain enclosure functional types, generally citing lower 98th percentile values. Also, for comparable enclosure type bins (e.g., large open enclosures), the new distributions have reduced the 75th percentile values significantly compared to the original NUREG/CR-6850 distributions. Again, all of the revised distributions have been weighed towards a higher likelihood of smaller fires and lowering the likelihood of larger fires.

2.2.3 TS/QTP/SIS versus TP Distributions

Most peak HRR distributions have two common attributes:

- Within a given enclosure group, the 75th percentile value for the TS/QTP/SIS type is generally one-half the value assigned for the 75th percentile in the corresponding unqualified TP type. This is intended to reflect that small fires initiated within the enclosure are much less likely to develop into a large fire given TS/QTP/SIS cables than given unqualified TP cables.
- Within a given enclosure group, the TS/QTP/SIS and unqualified TP peak HRR distributions generally have the same value for the 98th percentile (with the exception of 4a – large/open/default). This is intended to reflect that under worst-case fire conditions, the type of cable present will not significantly impact the fire peak intensity.

The following paragraphs describe the factors and test insights that led the working group to these decisions regarding the peak HRR distributions.

The first factor considered when establishing the 98th percentile values is the evidence from the two bench-board fire tests from the RES/SNL test set; namely, NUREG/CR-4527 Vol 2, tests 23 and 24. Those two tests were set up with fuel loads that were as close to identical in mass and arrangement as possible to each other, with the main difference being the ignition source and cable type. Both tests involved cable-only fuel loads and these two tests represent the most direct evidence for similar worst-case fire behavior available. Both of these tests resulted in full cabinet involvement and essentially full cabinet burnout. The measured peak HRR for the TS cable test (23) was 1,235kW compared to the TP test (24) at 1,300kW. These two results are, for all intents, equivalent and provide strong evidence that worst-case fire behavior is likely similar even given cable-only fuel loads.

The second factor that weighed into the WG's decisions is that while cabinets are grouped based on cable type, cables are not the only fuel present. There are very few cabinets (e.g., junction/termination cabinets) where the fuel load is essentially all cables. Cables do play an important role in the fire behavior and most importantly in early fire behavior. The expected source for most if not all electrical enclosure fires is an electrical component fault that causes ignition of the wires attached to the component. Given amenable circumstance, fire may then spread through the cables and ultimately into other non-cable fuels (i.e., if the fire is not suppressed). In most cabinets components also represent fuel (e.g., switches, circuit cards, relay housings, meter cases, plastic wire-ways, etc.). The distributions reflect the overall electrical enclosure fire behavior and must, therefore, cover the range of non-cable fuels that may be present. Most of the available tests have used cable-only fuel loads, the exceptions being the VTT tests and a small number of tests from HELEN-FIRE which included significant loads of printed circuit cards in particular. These few circuit card tests show that the other non-cable fuels can be quite important to fire behavior. The non-cable fuels do not generally come with low flame spread versus regular the way that cables do. While the nature of the non-cable fuels will vary greatly from cabinet to cabinet, there is no distinction for components that would be analogous to the TS/QTP/SIS versus TP distinctions made for cables. As a result, the WG concluded that a worst case fire (e.g., the 98th percentile fire) would certainly involve the non-cable fuels present leading to similar fire behavior regardless of the type of cables used.

One physical effect unique to the case of electrical enclosure fires (e.g., in comparison to an open cable tray fire) is the importance of radiative feedback to worst-case fire conditions. In a typical open cable tray fire (e.g., see CHRISTIFIRE NUREG/CR-7010 Vol 1 [14]) the worst-case fire behavior is driven mainly by whether or not horizontal fire spread beyond the exposure fire plume occurs. Horizontal fire spread is in part radiation driven but is also highly dependent on the ignition properties of the fuel. Prior testing programs have involved a range of cable types from and all of the types described here are included in the available literature. Testing has shown that TS, QTP and SIS cables typically have higher ignition thresholds (i.e., the materials ignite at higher temperatures, higher heat fluxes) versus unqualified TP cables. As a result, the TS, QTP and SIS cables are more likely to self-extinguish without propagation especially as the fire progresses beyond the plume/flame zone of the exposure fire. In contrast, unqualified TP cables spread more readily generally resulting in higher likelihood of larger, and longer duration, fires. CHRISTIFIRE [14], in particular, saw much smaller overall fire sizes and durations for TS and QTP cables than for unqualified TP.

OVERVIEW OF THE PROCESS

Another factor that the WG considered is that electrical enclosure fire tests have shown a different effect to be dominant to the worst-case fires than that observed for cable tray fires; namely, what amounts to the generation of flashover-level temperature conditions within the enclosure. During the early stages of an electrical enclosure fire, flame spread plays a similar role as for cable trays, in this case involving both vertical and horizontal flame spread. Here again, TS/QTP/SIS cables tend to spread less readily than unqualified TP cables. As a result, initial fire spread for the TS/QTP/SIS cables will generally require a more energetic ignition source and/or more conducive fire spread conditions (e.g., air gaps among wire bundles) making fire spread less likely. The key to the development of worst-case electrical enclosure fire conditions, however, is a transition to something similar to flashover conditions occurring within the electrical enclosure. In a room fire, flashover is a condition where radiant heating from the hot gas layer becomes intense enough that all exposed combustibles will spontaneously ignite resulting in a sudden surge in fire intensity. The case within an electrical enclosure, while not strictly considered flashover, can reach similar levels of radiant heating once the fire grows to a sufficient intensity. That is, if the early stage fire is sustained long enough and spreads far enough, temperatures within the enclosure rise to what is effectively flashover levels (e.g., 500-600 °C are considered typical flashover temperatures). At that point, full involvement of the fuels present within the electrical enclosure is likely and fire intensity is limited mainly by oxygen availability and total fuel load (e.g., burn out will occur once fuels are consumed). This is consistent with all of the electrical enclosure fire tests performed to date. Once conditions inside the cabinet reach flashover-like levels, the cable type will have little effect on fire intensity. Cable type does, however, impact the likelihood that fires will ever grow to this level and this is reflected via the 75th percentile values as discussed immediately below.

Also note that the early stage electrical enclosure fire behavior as described above (i.e., fire starting in a component and initially spreading to nearby wires), coupled with observed test results, provide the primary basis for the assumed 75th percentile values. That is, with the early stage fire development being driven by cable flame spread behaviors, the likelihood of a fire transitioning from ignition to sustained and growing fire conditions is lower given TS/QTP/SIS cables than given TP cables. This is reflected in the distributions where the 75th percentile values for TS/QTP/SIS cases are typically one-half the value assigned to TP cables. Again, this treatment is intended to reflect a lower likelihood that sustained and growing fire conditions will occur given typical real-life ignition sources and TS/QTP/SIS cables.

As a final point, from a practical standpoint, using the same 98th percentile for all cabinets within a given group has analytical advantages. The working group concluded that the recommended treatment would be representative for TP combustible loads and might be slightly conservative for TS/QTP/SIS combustible loads. However, given the evidence, it would be difficult to argue that TS/QTP/SIS cables should have substantially lower worst-case fire conditions (i.e., 98th percentile values). A moderate reduction for TS/QTP/SIS might be argued (e.g., a few percent), but moderate differences would make little difference to the final PRA result. With the default distributions, it is not necessary to verify cabinet contents in order to complete initial screening of all electrical enclosures (i.e., screening against the default 98th percentile values). The approach does allow for refinement beyond the initial screening steps.

2.2.4 Identification of Influencing Factors

The WG identified factors that can influence the HRR generated by an electrical enclosure fire. These influencing factors form the basis for determining the probability distributions for the different electrical enclosure classifications. Specifically:

- **Electrical enclosure volume:** The electrical enclosure volume is a factor explicitly represented in the electrical enclosure classification for Group 4. The WG agreed that the enclosure volume provides a practical approach for classification.
- **Combustible type:** The combustible type is classified as either unqualified TP or lower flammability cable types (TS/QTP/SIS) for the final HRR distribution categories. For HRR and flame spread, per the discussion in Section 1.3, TP cables that are qualified as low flame spread per IEEE-383 flame spread test (QTP cables) are treated as equivalent to TS cables in peak HRR tables; that is, QTP cables are mapped to the same combustible type groups as are TS cables. Similar treatment is also given to SIS wire; that is, SIS wire is also mapped to the same combustible type groups as are TS and QTP cables. Hence, the two combustible type groups are TP (meaning unqualified TP) versus TS/QTP/SIS cable. The treatment here is not related to damage thresholds for different cable types, only to flammability and its effects on the likelihood that small fires will grow to become larger fires.
- **Amount of combustible materials:** The WG agreed that the amount of combustible material is similar for the types of electrical enclosures classified by their function (Groups 1-3) and for small enclosures (Group 4c). However, for the “all other” – large and medium enclosure classification groups (Groups 4a and 4b), the amount of combustible material can vary widely. For that reason, the “all other” – large and medium enclosure classifications (Groups 4a and 4b) were further divided to allow for additional resolution in assigning peak HRR probability distributions. The WG agreed that pursuit of this further refinement (low or very low combustible loading) requires internal inspection of the electrical enclosure.
- **Combustible material configuration:** Similar to the factor associated with the amount of combustible material, the WG agreed that the combustible configuration is similar for the types of electrical enclosures classified by their function (Groups 1-3) and for the small “all other” enclosure classification (Group 4c). However, for large and medium “all other” enclosure classifications (Groups 4a and 4b), the configuration can vary widely. For that reason, these two classifications were further divided to allow for additional resolution in assigning peak HRR probability distributions. The WG agreed that assignment of peak HRR distributions based on combustible configuration requires internal inspection of the electrical enclosure.
- **Electrical ignition size/potential:** The WG agreed that the electrical ignition size and potential can be a factor in the resulting HRR, although no clear conclusions can be reached with existing experimental data. However, this factor is implicitly included in the classification process by separating the enclosures by function (Groups 1-3) from the “all other” enclosure classification (Group 4). The peak HRR probability recommended for the functional electrical enclosures (Groups 1-3) considered this in the determination of the 75th and 98th percentiles.
- **Ventilation conditions:** The WG agreed that the electrical enclosures classified by their function (Groups 1-3) are vented but closed (i.e., they have vents of some type but not open doors). Due to the inherent electrical hazards associated with these enclosures and the plant procedures governing their maintenance, the WG agreed that peak HRR probability distributions are only needed for closed electrical enclosure configurations. This is not the case for the “all other” enclosure classes, which have both open and closed configurations as evidenced by numerous enclosure pictures available to the group. Therefore, the WG developed probability distributions for both open and closed “all other” (Group 4) electrical enclosure configurations.

2.2.5 Calibration Exercise

A calibration exercise was conducted to ensure a common understanding of what a particular HRR value in kilowatts (kW) implies with respect to an electrical enclosure fire. This exercise involved the collection, by the NRC staff, of still photos and videos taken mainly from the most recent NRC/NIST test set [5]. The examples were chosen to illustrate a range of fire intensities and burning behaviors. During a webinar/conference call the NRC staff explained the attributes (i.e., amount of combustibles, ventilation condition, and cable insulation material type) of each example case and then showed the still photos and/or videos. Each WG member was then asked to predict the peak HRR value being illustrated. Time lapse videos were then shown of the tests, and the actual peak HRR measurement was provided to the WG. Initially, individual estimates showed wide variation, but by the end of the exercise, all members showed a good ability to estimate the peak HRR values for a particular fire size, specifically, accounting for the amount of combustibles.

Figure 2-1 and Figure 2-2 illustrate the fire sizes and the corresponding fire intensities in kilowatts for two examples used in the calibration exercise. Note that these are not cable insulation/enclosure fires. Nonetheless, they do visually illustrate relative fire intensities for common objects, a coffee maker and a Christmas tree, over the course of a fire test.



Figure 2-1
Fire Size/Intensity Calibration (0 to 40 kW)

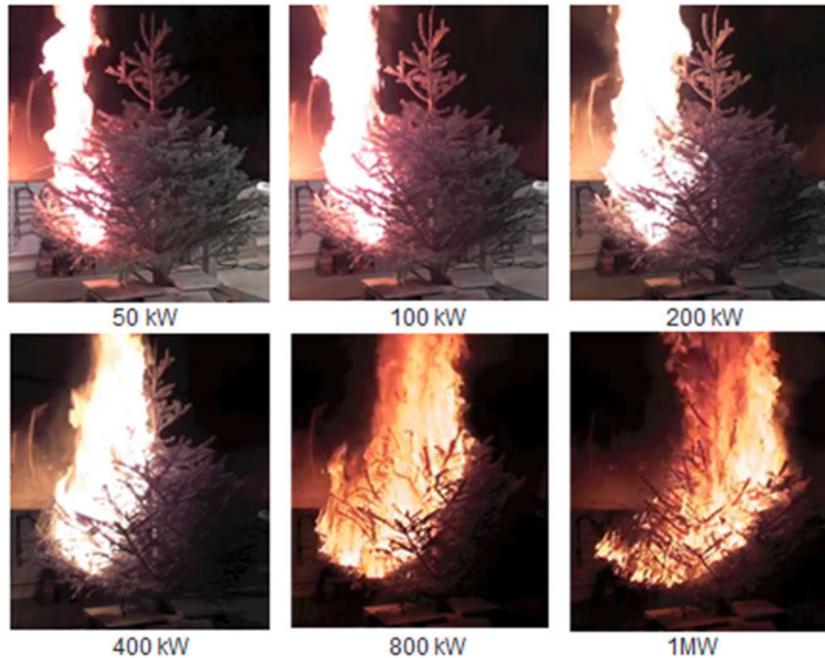


Figure 2-2
Fire Size/Intensity Calibration (50 to 1000 kW)

2.2.6 Assessment of Electrical Enclosure Heat Release Rates

Each member of the WG was tasked to independently assign 75th and 98th percentile HRR values for the newly developed enclosure classification groups defined in Section 3. Consideration of specific experiments, operational experience, influencing factors, and so on were incorporated into the specific distributions on an individual basis.

2.2.7 Building Consensus

Consensus is defined by Merriam-Webster as general agreement about something [15]. For the purposes of this report, consensus represents agreement from all members of the WG on the parameters and conclusions offered. WG members were first tasked with determination of HRR profiles on an independent basis. Consensus was ultimately obtained on a group level through a data-informed process supported by technical discussion of available testing and operational experience.

Using this consensus process the peak HRR distributions for each of the enclosure classification groups were defined. This activity took place during a WG meeting with all members present. Initially, for each enclosure type/function group, the members were polled regarding their individual estimates of the peak HRR distribution for that group (developed in the second step as noted above). A broad consensus was evident for most cases, with some outlier estimates on both the high and low sides. Each member was asked to describe their reasoning for each case and, as a more common understanding of the conditions being assumed and the applicable data set was developed, consensus values were proposed and agreement obtained. Through these discussions, preliminary consensus estimates were developed by the WG. Based on these preliminary consensus values, the WG fitted a gamma

distribution based on the two HRR values corresponding to 75th and 98th percentiles for each classification group (see Appendix D.3).

2.2.8 Ensuring Consistency and Applicability

To ensure consistency and applicability of the consensus estimates, each of the available tests was reviewed and assigned to one or more classification groups. Certain tests were discussed and, based on one or more test-specific factors, were judged to be of questionable applicability. In some cases, tests were partly *discounted*; that is, they were considered somewhat applicable but not directly characteristic of realistic fire conditions. No attempt was made to “weigh” the discounted tests against other tests, and the discounted tests are included in the experimental data distributions, but the final recommended peak HRR distributions typically will not bound these tests. Other tests were *dismissed* entirely; that is, they were not considered applicable to actual enclosures given the nature of the fuels burned and are excluded from the data sets entirely. Appendix D presents the mapping of test data to the HRR distributions chosen by the WG members based on a consensus basis. It is emphasized that the revised peak HRR distributions are not based directly on fitting any particular set of test data. However, the available test data were used by WG members to inform their selection of representative distributions. Ultimately, the consensus distributions were compared to test data considered applicable to each enclosure classification group to ensure that any inconsistencies could either be explained (e.g., based on a sparse or otherwise poor data set) or, where possible, eliminated (see Appendix D).

The cases where test data were discounted or dismissed are detailed as follows (also see Appendix D.1):

- The original NRC/SNL electrical enclosure fire test series [8] included a small number of tests involving either a heptane fuel pool (Tests PCT-4A and PCT-4C) or a gas burner placed inside an otherwise empty control enclosure (Tests 21 and 22). These tests were never intended to represent an actual fire in an electrical enclosure; rather, they were intended to provide for characterization of room effects given a large, well-characterized fire within an electrical enclosure shell. These tests were not considered relevant to characterization of actual electrical enclosure fires and were *dismissed* entirely.
- One test from the original NRC/SNL test series [8] was *dismissed* based on the non-representative nature of the ignition source; namely, Test 23, which involved qualified TS cables in a bench board electrical enclosure. For Test 23, the WG agreed that the extent of the fire growth seen in this test was likely driven largely by the intensity and duration of the ignition source, which burned at roughly 40 kW for over 30 minutes. Many test programs have shown that TS cables require a significant and sustained ignition source or they will likely self-extinguish. Hence, the peak heat release rate in this test, estimated at 1235 kW, would not be expected given a more realistic ignition source. In general, some form of an ignition source must be used to initiate a fire test, and the test programs considered by the WG represent a range of potential ignition sources. In the case of Test 23, the WG concluded that the ignition source used is much more intense than those to be expected for a control enclosure application and that the measured peak HRR would not have been reached had a less energetic and/or shorter duration ignition source been used. Nominally, Test 23 would be assigned to the open “all other” electrical enclosure, thermoset cable type classification group. However, the test was *dismissed* from the data set, and the corresponding peak HRR distribution was not formulated to bound this particular experiment.

- The NRC/SNL tests also included a test essentially identical to Test 23 except that unqualified TP cables were used; namely, Test 24 [8]. In this case, the test was included in the data set for open “all other” electrical enclosures with TP cables because TP cables do propagate fire more easily. However, this test was treated as an outlier case, again due to the nature of the ignition source. While this test was considered somewhat relevant, it was partially *discounted* and the corresponding peak HRR distribution does not bound this particular experiment³. The WG concluded that given a more realistic ignition source, full electrical enclosure involvement was still possible although the fire would have likely grown at a slower pace and reached a lower peak than that observed in the test. Test 24 is included in the test data set for the large “all other” (Group 4a), open, TP cable classification group, as shown in Appendix D.
- The “analytical tests” performed by IRSN [12] involved PMMA slabs burned within an electrical enclosure mock-up shell. The objective of these tests was to assess whether enclosure vent size correlated to the maximum HRR possible given a fire within an enclosure. The fuels in these tests are not representative of real electrical enclosures. However, the IRSN tests performed with closed-door conditions did highlight that the HRR is tightly linked to the natural ventilation of the cabinet. Following up on the efforts of Keski-Rahkonen related to the VTT tests [11], French efforts to develop direct correlations of the ventilation effect were not entirely successful. One significant complicating factor is that unburned pyrolosates generated within the electrical enclosure can burn after they exit the enclosure where virtually unlimited oxygen supplies are again available. As a result approaches based on the “chimney effect” tend to fall short as they do not account for the burning that may take place outside the cabinet. The French tests, in particular, demonstrate a significant effect where restricted ventilation did appear to cap the peak HRR possible from an enclosure fire (see related discussion in Section 2.1.2 above). The French tests qualitatively informed the distributions to the extent that the open and closed ventilation conditions are assigned different HRR distributions and that the open configuration distributions are the higher of the two. However, given the unrealistic nature of the fuels, the IRSN tests using PMMA slabs were otherwise *dismissed* from the peak HRR distribution development effort.
- The tests conducted by NIST at CBD [5] were based on a catalog of pictures obtained during walkdowns of various NPPs as well as the discretion of the test engineers. Two test scenarios in particular were chosen in order to evaluate the worst-case condition beyond that typically seen in NPPs. These tests are identified as test numbers 68, 71 (closed door), and 83 (open door, see Figure 2-3). The cabinets were filled with the maximum loading of jacket-stripped cables and distributed in a manner to facilitate flame spread. That is, the cables were separated to allow for the maximum burning area of the fuel and to facilitate full burnout. These cases were altered to evaluate the impact of various test conditions (e.g., ventilation, configuration, and ignition) on the fire growth within the electrical enclosures. The tests were not dismissed, but they were discounted because the combustible loading arrangement was not typical of any known NPP cabinet type. However, these tests provide some indication of the absolute upper bound fire conditions that might occur given the enclosure geometry. The data was used by the working group to inform the consensus distributions. These tests along with some large

³ Similarly, the NUREG/CR-6850 HRR distribution for thermoplastic, open enclosure, multiple bundles does not bound this experiment.

OVERVIEW OF THE PROCESS

fire test data from the NRC/SNL tests [8] were mapped to the large and medium size enclosure classification groups.

- The WG carefully considered the applicability of the most recent HELEN-FIRE [5] tests based on a combination of factors
 - *Combination of cold temperatures and small ignition sources:* Most of these tests were performed with the electrical enclosures and, more importantly, the cables, at initial temperatures of 0 °C (32 °F) or less. These initial conditions likely caused some delays in, and in some cases may have prevented, cable ignition, sustained burning, and/or fire spread. The frigid ambient conditions combined with the smaller (1 kW and 5 kW) ignition sources in many cases were unable to create a self-sustaining fire under the test conditions.
 - While all of the NIST tests are included in at least one of the classification group test data sets, the WG chose not to include some of these tests in the experimental distributions for the other classification groups. In particular, those tests using the two smaller ignition sources (i.e., the 1 kW and 5 kW electric cartridge heaters) where the cables never ignited and no flame spread was observed were included in the small “all other” electrical enclosure (Group 4c) data set, but were excluded from the other data sets.
 - *Change in test conditions:* The WG reviewed videos, journal notes, etc, to indicate instances where the test conditions appear to be disrupted or reset. Such conditions may include opening cabinet doors, increasing the intensity of the ignition source, jostling of the cables, or other effects. This was typically observed in cases where the fire was not developing beyond the ignition source or where the fire appeared to have “stalled” its growth.
 - The WG treated these cases as, effectively, a reset and re-start of a new experiment. The tests where conditions were changed during a single test are documented in HELEN-FIRE [5] using letter designators (A, B, etc.). On a limited basis, some of the split tests may have been dismissed as data points as the test may not have peaked, the HRR may be an artifact of HRR rampdown, etc.
 - *Non-representative of NPP equipment:* In a few instances, the test conditions were designed to generate a large fire. See for instance Figure 2-3, test 68.
 - In a limited number of cases, large deviations from typical NPP conditions were observed and as a result carefully considered in the development of the HRR distributions.



Figure 2-3
HELEN-FIRE Test No. 68

2.2.9 Finalizing the Consensus

As a final step, the WG had an additional opportunity to consider the consensus distributions, review again the test sets associated with each classification, and propose alternative treatment, if applicable. Based on this review, the WG found that some of the HRR profiles for the “all other” – large and medium enclosures (Groups 4a and 4b) did not address certain enclosures that have combustible loads (e.g., cables) less than what is assumed as the default condition; namely, a significant fuel load relative to enclosure volume that may be arranged in a manner conducive to fire spread. To address enclosures with limited and neatly configured combustibles, the WG added two separate sub-groups for these two enclosure classes. One sub-group (i.e., low fuel loading) represents enclosures with combustible loads relatively less than that of the default case. The second sub-group (i.e., very low fuel loading) represents enclosures with very sparse combustible loads relative to enclosure volume. In both sub-groups, it is assumed that all combustibles are neatly organized. Descriptions of these sub-groups are presented in Section 3.2.2. The WG repeated the steps discussed in Sections 2.2.2 through 2.2.8 to reach a consensus on these sub-group HRR estimates.

2.3 Method for Characterizing Electrical Enclosure Fire Plumes

The initial concept of the obstructed plume was discussed during the first meeting of the WG. The common treatment of fire plume effects for electrical enclosure fires completely ignores the effects of the enclosure surfaces, especially the top, on plume development and is therefore

OVERVIEW OF THE PROCESS

quite conservative. The “Obstructed Plume” concept involved using Fire Dynamics Simulator (FDS) as a surrogate for experimental data to support a more realistic representation of the early stage fire development and thermal insult to fire targets located within a plume. In simple terms, FDS is used as a tool to evaluate the effect an obstruction has on fire plume thermal characteristics and supports the development of an adjustment factor for the vertical zone of influence (ZOI) and plume temperature.

During the first meeting, the WG identified obstruction configurations, ventilation conditions, and fire size and location, along with measurements and locations to include in the FDS simulation. During the second meeting preliminary results of the FDS simulations were presented. At this meeting, the WG decided that the approach appeared to yield encouraging results to improve the realism in modeling electrical enclosure fires, compared to existing guidance in NUREG/CR-6850. The WG suggested modifications to the electrical enclosure modeling and fire size. At the third meeting the WG determined that the work and documentation was at a level of quality to facilitate a peer review. Between the third and fourth meeting the peer review comments were received, reviewed, and incorporated into the study as appropriate. The results of this work, including the assumptions, approach, results, and correlation, are presented in Sections 5 and 6 of this report.

3

CLASSIFICATION OF ELECTRICAL ENCLOSURES

This section describes the classification of electrical enclosures based on the enclosure's electrical function, physical size and location (e.g., free standing, wall mounted), amount and character of fuel loading, ventilation characteristics, and the cable insulation material type. Section 2.1 presents the process pursued by the working group (WG) to develop these classifications.

Appendix C provides photographs of a range of electrical enclosures and their installed configuration in NPPs. This appendix is provided as a more extended supplement to the discussion presented in this section. The appendix is based mainly on the presentation of many photographs of actual in-plant cabinets that illustrate various aspects of the electrical enclosure groups and fuel loading conditions. The reader is encouraged to use Appendix C liberally in pursuit of their own categorization efforts. This section includes a limited number of illustrative examples of those photographs as compared to Appendix C.

The classification of electrical enclosure heat release rates (HRRs) as fire ignition sources (Bins 4, 10, and 15) in accordance with Task 6 of NUREG/CR-6850 is based on assignment of each enclosure to one of the following type/function classification groups¹:

- Group 1: Switchgear and Load Centers
- Group 2: MCCs and Battery Chargers
- Group 3: Power Inverters
- Group 4: All Other Electrical Enclosures
 - Group 4a: Large Enclosures
 - Group 4b: Medium Enclosures
 - Group 4c: Small Enclosures

The fire characterizations of these enclosure classification groups are described below. Section 3.1 describes the functionally based Groups 1-3 enclosures and Section 3.2 describes the classification and sub-grouping of Group 4 enclosures.

The discussions here are intended to highlight both similarities and differences between the various enclosure types considered. The factors highlighted in each section are those that are expected to substantially impact both the worst-case fire behaviors that might be expected (e.g., the 98th percentile peak HRR values) and the relative likelihood that, given an ignition event and in the absence of fire suppression, a large fire is likely to develop (as characterized by the 75th

¹ Each classification group is assigned a simple alpha-numeric identifier in order to simplify aspects of the discussions that follow and to promote a common PRA vocabulary. It is suggested that these designations be used as "shorthand" identifiers when citing classification results for in-plant enclosures (e.g., in fire PRA databases).

CLASSIFICATION OF ELECTRICAL ENCLOSURES

percentile peak HRR values). The primary factors considered in the final group classification process are as follows:

- **Physical size:** For classification Group 4, physical size is used as a general, readily obtainable characteristic that would influence fire behavior. The presumption is that a large or a medium enclosure holds the potential for higher intensity fires than a comparable but much smaller enclosure simply because it has the capacity to hold more combustible fuels and more possible ignition sources. However, that for classification Group 4, if visual inspection of the enclosure internals is possible, additional consideration can be given to the actual fuel load present, which may act to reduce the fire potential of a large or a medium enclosure to, in effect, that of a smaller enclosure.
- **Cable insulation type:** The HRR distributions presented in Section 4 distinguish between enclosures with lower flammability cables (which includes thermoset (TS) qualified thermoplastic (QTP) and synthetic insulated switchboard (SIS) wire) versus unqualified TP cable insulation/jacket materials. Enclosures with a mix of lower flammability and unqualified TP cables are treated as part of the TP flammability groups. Testing has consistently shown that unqualified TP cables ignite more easily and spread fire more readily than TS cables. QTP and SIS wire have shown similar behavior to TS cables and are grouped accordingly. However, testing also shows that if a growing fire is established in an electrical enclosure such that full burn-out of the enclosure is possible (barring suppression), the peak HRRs for TS/QTP/SIS and TP cables are quite similar. In general, the working group established the same 98th percentile peak HRR value for both cable types (with the exception of large open enclosures²). However, the 75th percentile peak HRR value is lower for TS/QTP/SIS cables than for TP (typically half as large). This reflects the observation that given an equivalent ignition event fire spread is less likely with TS/QTP/SIS cables than with TP cables. In other words, a larger percentage of TS/QTP/SIS cable fires are expected to remain small, even in the absence of suppression, compared to TP but, if the fire does spread, the worst-case peak HRR values are likely similar.
- **The combustible fuel load and configuration:** The total fuel load in an enclosure will influence the fire behavior, especially in cases where the fuel load is especially sparse. Equally important is the configuration of the fuels present. For example, large power cables will burn far less readily than will small instrument and control wires (the “logs versus kindling” analogy). Similarly, testing³ has shown that cables that are tightly bound and routed in an orderly manner will burn less readily than would loosely bound cables routed in a disorderly fashion (see Section 2.1.2, bullet 4, for related discussions).
- **Enclosure ventilation condition:** All other factors being equal, an enclosure with very small ventilation openings will not burn as well as a very well ventilated enclosure. The approach presented does not explicitly address the ventilation conditions of a specific enclosure. However, the peak HRR distributions are expected to bound the typical ventilation conditions for the specific equipment classification group.

² Based on test results, the WG concluded that a 1000 kW fire in case of the large enclosure group with TP cable insulation and open door ventilation configuration would bound the worst possible enclosure classes that may be existing in NPPs.

³ This observation is consistent with both the original NRC’s cabinet fire testing in the 1980s [8] and with the more recent NIST tests [5].

- **The nature of the ignition sources present:** Given the presence of higher energy ignition sources (e.g., higher power components and arc-fault sources) a higher intensity fire is more likely to develop in comparison to a similar enclosure with only low energy ignition sources present (e.g., control and instrument components).

3.1 Functionally Based Enclosure Groups

Electrical enclosures in nuclear power plants (NPPs) are categorized based first on their electrical function and second on the cable insulation type (TP or TS/QTP/SIS). For some enclosures this is sufficient. In particular, switchgear, load centers, motor control centers (MCCs), battery chargers, and inverters are all characterized based on function and fuel type alone. The following three functional groups have been defined to characterize the anticipated fire hazards for these types of enclosures.

3.1.1 *Group 1: Switchgear and Load Centers*

This type/function group includes the enclosures housing higher power electrical switching and interrupting devices⁴. Switchgear and load centers are both common and readily identifiable in NPPs. The term “switchgear” generally refers to medium voltage (>1000 VAC) switching equipment. The term “load center” is commonly used to describe low voltage (≤ 1000 VAC) switchgear.

Generally, load centers are physically smaller than the medium voltage switchgear and as many as four individual switches (typical) may be found to share a single vertical segment or cabinet as these are counted⁵ under NUREG/CR-6850. For switchgear, the breaker cubical itself is generally housed in the lower section of the enclosure (due to its weight and physical size) and the associated control and monitoring equipment is housed in the upper section of the enclosure. For load centers, the breaker cubical and associated control and monitoring components share a common space. Switchgear and load centers have been combined into a single classification group for fire characterization purposes based on several factors.

First, these devices perform essentially the same function; namely, switching and overload protection for higher power loads associated with, most commonly, a subsidiary power distribution bus. The distinctions between switchgear and load centers are mainly associated with voltage and total power per switch.

Second, these devices have similar ignition sources and energies present; namely, those associated with failures in the primary switching unit including its input/output power leads, and those associated with the lower voltage control and monitoring components.

Third, switchgear and load center enclosures typically have limited fuel loads (i.e., in comparison to most other electrical enclosures), and the characteristics of the fuels present are

⁴ Note that switchgear and load centers are subject to high energy arcing fault (HEAF) events in addition to general thermal fires. The discussions here are limited to thermal fires only, but the working group did recognize that, consistent with the event data, some thermal fires are initiated by arc fault failures that do not reach the energy and impact levels associated with the HEAF events. The NRC-RES is currently leading an International Test Program, Joint Analysis of Arc Faults, to better understand the fire risk of these events.

⁵ In NUREG/CR-6850 Task 6, electrical cabinets are counted by vertical section. Hence, a single load center vertical section may house multiple switches. In contrast, medium voltage switchgears are typically housed individually; that is, there is typically only one switch per vertical section.

CLASSIFICATION OF ELECTRICAL ENCLOSURES

similar. In both cases, much of the fuel load is associated with the larger diameter input/output power cables which will not burn easily but will burn given a sufficient ignition event and/or sustained fire. The balance of fuel in both device types is associated with the control and monitoring components including smaller gauge instrument and control wiring, and this fuel will burn more easily. The presence of the control and monitoring components and wiring is one of the more significant factors considered to influence the overall fire growth potential.

Finally, both switchgear and load centers will almost certainly be found in a closed, vented enclosure configuration due to safety standards and the need to dissipate internally generated normal heat loads⁶. Given similar enclosure conditions, fire characteristics will also tend toward similar behaviors.

Given the similarities described above, both switchgear and load centers are treated in the same manner relative to general fire characterization (again, excluding high energy arc fault treatment). Figure 3-1 provides exterior photographs of a typical bank of switchgear and load centers.



Switchgear Bank



Load Centers

Figure 3-1
Switchgear and Load Center

3.1.2 Group 2: Motor Control Centers (MCCs) and Battery Chargers

MCCs and battery chargers are also common and readily identifiable in all plants. A typical plant will have many MCCs but typically only a handful of battery chargers. While these two device types perform markedly different functions, the two have been combined into one group for fire characterization based on similarities in size, fuel loading, and the energy available to potentially initiate a fire.

MCCs are commonly at the same voltage and powered from a load center. Typically, a single MCC cubical will service a single end device such as a pump or motor. MCCs may also be

⁶ The working group consulted a number of knowledgeable experts outside the working group regarding these enclosure configuration assumptions and none were able to cite an exception to the enclosure assumptions as cited here.

used to supply lower level distribution buses such as house lighting and power. As with load centers, MCCs are commonly housed in stacks so that a single vertical section of MCCs (i.e., one cabinet as counted in NUREG/CR-6850) will commonly house four to five individual breaker cubicles but could house as many as twelve individual breakers. The fuel load for a typical MCC includes both the input/output power cables and control monitoring devices and wiring. In comparison to switchgear and load centers, the power cables will be smaller. While these smaller cables will burn more easily, they also represent a lower fuel loading than the larger power cables associated with switchgear and load centers. The potential ignition sources also include both the power and control components.

One factor considered important by the WG is that an MCC is highly compartmented and this feature will limit the intensity of most MCC fires. Switchgear and load centers tend to be large enclosures with little internal partitioning. For MCCs, each individual breaker is typically housed within its own enclosure (often referred to as a compartment or cubicle) and a vertical section, or stack, is made up of several compartments. In addition, each stack is commonly associated with a narrow vertical channel used to route field cables into and out of the compartments (see Figure 3-2). This channel is a common/shared portion of the MCC, and the possibility that fire might spread from one compartment into this vertical channel was a significant factor in the working group's assessment of the worst-case fire potential.



Figure 3-2
A Typical Vertical MCC Channel

CLASSIFICATION OF ELECTRICAL ENCLOSURES

Another factor considered important by the WG is that MCC cabinets tend to have more restrictive ventilation openings. In comparison to switchgear, for example, the heat loads associated with MCCs are much lower so that less ventilation is necessary to maintain components within operable temperatures. The limited ventilation conditions will tend to limit fire potential. However, MCCs may not be fully sealed and are subject to arc faults, albeit not at the HEAF level. An arc-fault initiated fire holds the potential to breach the MCC cabinet and the assumed fire characteristics reflect this (i.e., the arc fault may open a section of the MCC).

Figure 3-3 shows a typical bank of MCC stacks. This bank contains eight stacks and would be counted as eight vertical sections per NUREG/CR-6850. The stack on the far left contains 10 individual switches, which are near the maximum possible for a typical MCC stack configuration. By contrast, the two center stacks appear to contain just two switches each.



Figure 3-3
A Typical Bank of MCC Cabinets

The second component of this functional group is battery chargers. While less common, all plants will have a limited number of battery chargers present. Note that only those battery chargers associated with banks of large, multi-cell, emergency station batteries are included in this functional group; that is, chargers tied to the battery banks counted as Bin 1 ignition sources consistent with Task 6 of NUREG/CR-6850. This group does *not* include small battery chargers that may be associated with individual battery-powered equipment items (e.g., emergency lighting, a skid-mounted pump or motor, diesel generator start-up batteries, or a piece of portable electrical equipment).

There are typically two or three battery chargers per battery bank. Battery chargers require considerable ventilation in order to dissipate internal heat loads and should not be treated as “well-sealed” electrical enclosures under typical conditions. This was considered an important factor influencing the worst-case fire potential by the working group. Battery chargers also contain significant ignition energy sources, including the potential for internal arc faults, given connections to both a significant AC input power source and the output connections to the

primary battery bank itself. On the other hand, the fuel load in a typical battery charger is limited, especially in comparison to the total volume of the enclosure. The relatively low fuel to volume ratio compared to other enclosures appears to be driven by the presence of a number of relatively large components with very little fuel contribution (e.g., transformers, rectifiers, and fuses). Like MCCs, the primary fuel loads are associated with both the input/output power cables and the control and monitoring components and wiring. Figure 3-4 shows an external view of a typical battery charger.



Figure 3-4
A Typical Battery Charger

The WG concluded that the fire characteristics for MCC and battery charger enclosures would be effectively the same despite functional differences. Both types have similar physical sizes (e.g., volume) and contain similar ignition source energy potentials. MCCs tend to have higher fuel loads but limited ventilation, whereas battery chargers tend toward lower fuel loads but more open ventilation conditions. These two off-setting factors in particular led the WG to conclude that the likely fire characteristics were similar enough that, for convenience, these two functional device types can be combined into one type/function group for fire characterization purposes.

3.1.3 Group 3: Power Inverters

This type/function group includes those enclosures whose primary purpose is to house a DC-to-AC power inverter. This functional group is *not* intended to include other electrical enclosures that happen to house one or more small power inverters such as those that might service individual circuits or devices. Given these constraints, inverters will be present in limited numbers at all plants.

Nominally one might anticipate that inverters and battery chargers would be quite similar given that the two devices perform complementary functions; that is, battery chargers convert AC power to DC power while inverters convert DC power to AC power. The WG found that while

CLASSIFICATION OF ELECTRICAL ENCLOSURES

there are similarities, there are also important differences that are judged to significantly impact worst-case fire intensities. Like battery chargers, inverter enclosures are typically well ventilated in order to dissipate normal heat loads and should not be treated as “well-sealed” electrical enclosures under typical conditions. Further, significant electrical energy is present to act as ignition sources including both the input connections to the associated battery banks and the output connections to serviced AC distribution buses. However, the fuel loads for inverters are typically higher than those observed for battery chargers. The higher fuel load appears to be associated with the additional control and monitoring components and wiring associated with conditioning of the AC output power given that modern AC devices require reasonably “clean” input power to run reliably. In contrast, battery banks are more tolerant and require less rigorous signal conditioning of charger output. Based mainly on the higher quantity and general nature of the fuel loading, inverters are assigned to higher peak HRR levels than are battery chargers. Figure 3-5 shows a typical inverter including both an external and internal view.

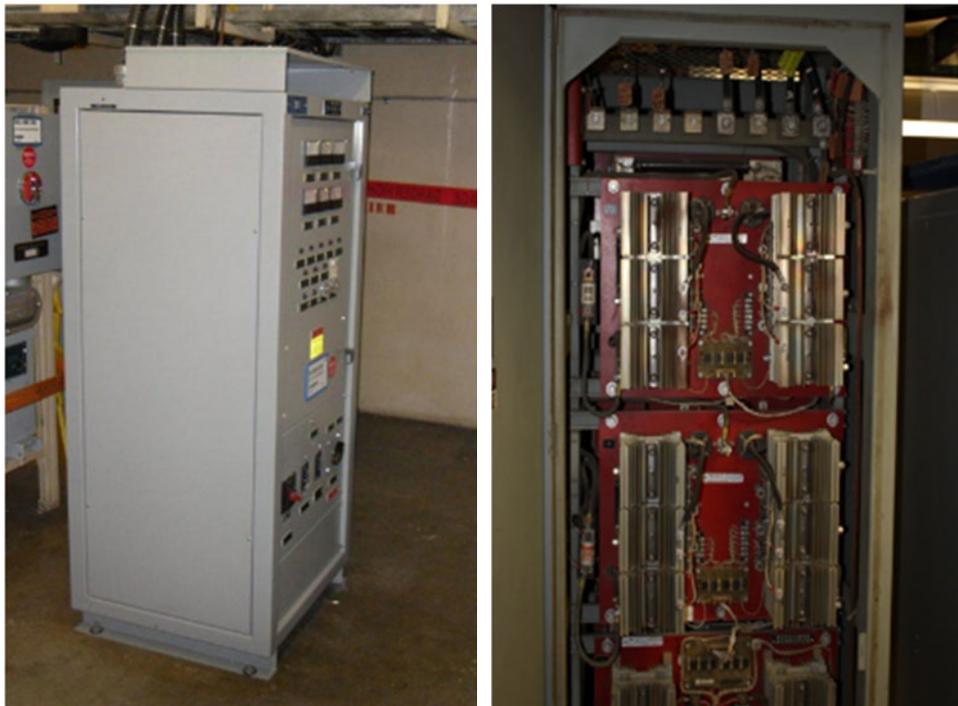


Figure 3-5
A Typical Inverter Cabinet (Exterior – Left, Interior – Right)

3.2 Group 4: All Other Electrical Enclosures

If an electrical enclosure counted in fire frequency does not fit into one of the three functional groups defined in Section 3.1 above, it is treated using classification Group 4; namely, All Other Electrical Enclosures. This group may encompass a wide range of enclosures including those associated with, for example, control components, instrumentation, low voltage breaker panels, lighting panels, communications equipment, individual or grouped switch/disconnect boxes, open rack panels, and alarm panels, among others. Group 4 is intended as a “catch-all” for the remaining electrical enclosure fire ignition sources.

Group 4 will also include the main control board (MCB). That is, each vertical section of the unit's MCB would be treated as a Group 4 electrical enclosure. The MCB sections would be classified like any other Group 4 enclosure; that is, a vertical section may be large or medium (though likely not small), open or closed, and the considerations for default/low/very low fuel loading and the associated special cases (described below) would also apply depending on the MCB configuration. Note also that the assigned peak HRR distributions would apply to the burning of a single vertical section. This report has not altered any of the other elements of the MCB analysis (e.g., NUREG/CR-6850 Appendix L and other guidance related to fire spread between vertical sections).

For classification Group 4, a more complex classification basis has been defined in order to reflect differences in the fire potential for this broadly defined enclosure group. Distinctions within this group ultimately lead to seven possible classification outcomes for a given enclosure that are based on (1) the physical size and (2) the fuel loading characteristics.

3.2.1 Open versus Closed Configurations

The peak HRR distributions are provided for two generalized ventilation configurations; namely, "open" and "closed" enclosure configurations. These configurations are defined as follows:

- A "closed" configuration means that metal panels enclose all four sides and the top of the electrical enclosure. Enclosures that are not floor-based (e.g., wall mounted panels) must also have a metal cover on the bottom. A closed electrical enclosure may have ventilation openings (e.g., vents, grilles, gaps between the top and side walls, ventilation channels, ventilation fans, wire mesh covered slots, etc.). For example, an enclosure would be considered closed even given an access door with ventilation louvers present over essentially the full surface of the door as long as the door is normally closed. Also note that there is no intent that analysts consider a normally closed cabinet to be open simply because periodic or occasional maintenance or surveillance requires service access to enclosure internals. As long as the enclosure doors are normally closed when unattended, the enclosure is considered a closed configuration. A closed electrical enclosure may also have surface mounted components on one or more of the side panels (e.g., switches, meters, indicating lights).

Examples of closed cabinets are shown in Figure 3-6, Figure 3-7, and Figure 3-8.



Figure 3-6
Examples of closed cabinets (a) fully closed cabinet and (b) closed with openings at the bottom



Figure 3-7
Two examples of closed cabinets with louvered front panels



Figure 3-8
Example of closed cabinet with openings on the side panels at the top and bottom.

- An “open” configuration means that one or more sides of the enclosure, including top and/or bottom are substantially open; that is, they are effectively missing. A common example is a main control board where the backs of the individual sections are open. This is often seen in conjunction with controlled access space such as a service walkway behind the main control board. Given such a configuration the main control board sections would be treated as open enclosures. Another common example would be open relay racks or open instrument racks that are, in effect, enclosures without sides or a top. For enclosures with a wire mesh, if half or more of a side is mesh the cabinet should be considered open for classification of HRR.
 - Some judgement may be needed in cases where a substantive portion of one side panel is comprised of a plastic cover such as PMMA⁷ that would be expected to melt in the early stages of a fire rendering a nominally closed enclosure open. As a general rule, if the PMMA section represents one-half or more of the side panel or door surface, the enclosure should be treated as open for the purposes of HRR determination.

⁷ PMMA is Polymethyl methacrylate – a transparent thermoplastic material often used as an alternative to regular glass and sometimes referred to by the tradename Plexiglas®.

- An exception to the PMMA case is allowed given an electrical enclosure that includes a secondary protective cover door that protects face-mounted components from dust and/or casual contact. That is, if the outer protective cover can be opened but immediately inside that cover is a primary enclosure metal side panel with surface mounted components, then the electrical enclosure may be treated as closed given the other criteria for a closed configuration are met.

Examples of open cabinets are shown in Figure 3-9 and Figure 3-10.



Figure 3-9
Example of an open cabinet with a combustible panel at top and louvers at the bottom of the front.

3.2.2 Assignment Based on Physical Size

The first aspect of the characterization process is to define the enclosure as Large (4a), Medium (4b), or Small (4c). This is a simple volume-based decision using the following criteria:

- Group 4a – Large Enclosures: an enclosure with a volume greater than 1.4 m³ (50 ft³).
- Group 4b – Medium Enclosures: an enclosure with a volume greater than 0.34 m³ (12 ft³) but no more than 1.4 m³ (50 ft³).
- Group 4c – Small Enclosures: an enclosure with a volume of no more than 0.34 m³ (12 ft³).

CLASSIFICATION OF ELECTRICAL ENCLOSURES

The following paragraphs provide additional discussion regarding each of these classification group categories:

3.2.2.1 Group 4a: Large Enclosures

This type/function group is intended to cover mainly the larger control and instrumentation cabinets that are common in many areas of the plant. This group also includes low voltage power and lighting (typically 110 or 220 VAC house power) distribution panels (i.e., breaker panels) if such enclosures meeting the size criteria exist in the plant⁸. The electrical enclosures included as large enclosures may cover a wide range in terms of both physical size and function. Large enclosures would include most of the cabinets in the main control room including the main control board (MCB), but with the possible exception of some smaller computer or instrument racks if present. This group would include the typical open racks of the relay room. This group can also include a range of general electrical enclosures that may be found throughout the plant. Additional examples may include alternate shutdown panels, diesel generator control cabinets, and signal conditioning cabinets, among others. Again, the determining factor for classification as a large enclosure is the total enclosure volume, not the specific enclosure function.

Figure 3-10 and Figure 3-11 illustrate open and closed configurations of typical large enclosures.



Figure 3-10
Large Enclosures (Open)

⁸ Note that the presence of a lighting or breaker panel meeting the large size criteria is considered unlikely and most such panels will likely fall into groups 4b and 4c.



Figure 3-11
Large Enclosures (Closed)

3.2.2.2 Group 4b: Medium Enclosures

This type/function group is intended to cover enclosures that are comparatively smaller than the large enclosure group but that may still contain a substantial fuel load and significant ignition sources (see Figure 3-12). This group includes a wide range of instrument and control cabinets as well as many typical low voltage (<1000V) enclosures housing power and lighting circuit breaker panels, local control panels that may service several devices, and larger alarm panels such as a large, centralized fire protection alarm/control panel that services multiple fire protection (detection and/or suppression) systems. The group might include smaller signal conditioning cabinets. This group would also include most portable rack-mount computer and instrumentation cabinets that might, again, be found in use throughout the plant. Again, for any enclosure not meeting the functional group definitions from Section 3.1, the determining factor for categorization as a medium enclosure is the enclosure volume, not the enclosure function.



Figure 3-12
Medium Enclosures

3.2.2.3 Group 4c: Small Enclosures

This type/function group is intended to cover the range of small, often wall-mounted or pedestal-mounted, local control, alarm and switching boxes that did not meet the criteria for exclusion from the electrical enclosure ignition source counting information but that, due to their size and content, would represent minimal fire threats. This group (see Figure 3-13) would include localized motor or pump control cabinets, small house power and lighting breaker panels, terminal block cabinets that did not meet the criteria for treatment as junction boxes, and individual switch/disconnect boxes. This group would also include localized alarm, communication, or indication panels that did not meet the fire ignition source exclusion criteria.



Figure 3-13
Small Enclosures (Note: top left enclosure may be well-sealed)

There is no explicit voltage cutoff associated with this group and the group may include items such as 480 VAC disconnect switch boxes, fuse cabinets, and power disconnect switches that are commonly housed in individual switch cabinets. For small enclosures, the WG agreed to limit the volume to no more than 0.34 m³ (12 ft³). For an enclosure of this size, the amount of combustibile materials present would be sharply limited, and such enclosures are normally found in a *closed* configuration. While some of these enclosures would contain significant potential ignition sources (e.g., a 480 V disconnect switch) the peak fire size would be limited by the fuel content and, for most such enclosures, the fire would be expected to remain contained inside. Even given an arc fault in a disconnect switch, which might breach the enclosure, the lack of fuel would mean that any flashover or fire would likely self-extinguish very quickly, a view supported by the event data. As a result, small enclosures are expected to present minimal threats to targets outside the box, and the provided fire characteristics reflect this assessment.

3.2.3 Assignment Based on Fuel Loading Characteristics

The second set of categorization criteria is limited to “Large Enclosure” and “Medium Enclosure” groups and is based on the fuel loading configuration. This second set of criteria may result in assignment of these two groups (Groups 4a and 4b) to one of three sub-groups as follows:

- Sub-Group 4a(a) or 4b(a) – Default Fuel Loading
- Sub-Group 4a(b) or 4b(b) – Low Fuel Loading
- Sub-Group 4a(c) or 4b(c) – Very Low Fuel Loading

This second categorization step is not applied to “(4c) Small Enclosures” given that the small enclosures are inherently fuel limited (as discussed above). Even for (4a) Large Enclosures and (4b) Medium Enclosures, this second categorization step is *optional*; that is, assignment of an enclosure to the Default Fuel Loading sub-group [4a(a) or 4b(a)] is acceptable without further examination of the enclosure. The assignment of an enclosure to either the Low Fuel Loading [4a(b) or 4b(b)] or Very Low Fuel Loading [4a(c) or 4b(c)] sub-group does require visual examination of the enclosure’s internal content. Hence, if visual observation is not possible (e.g., the analyst is not allowed to open the enclosure) then the Default Fuel Loading is assumed.

As the names imply, the Low Fuel Loading and Very Low Fuel Loading sub-categories reflect a decreasing amount of combustibles and/or a fuel configuration less conducive to fire spread when compared with their default cases. The criteria applied here are *not* based on a specific threshold fuel loading (e.g., total combustible mass). This is because it will be virtually impossible to determine the total fuel mass with any degree of confidence. Rather, the criteria are based on visual examination, analyst judgment, and comparison to sample photographs provided in this section and in Appendix C. The physical examination process will look for certain basic characteristics to determine the appropriate category for a given enclosure.

The analyst is cautioned that these considerations must include all of the fuels present within the enclosure. In particular, simply opening the access door to an enclosure does not always reveal all of the combustibles present. It is not expected that the analyst would open and examine the interior of small electrical enclosures housed within a larger enclosure (e.g., a vendor-provided electrical housing or smaller purpose-built enclosures housing a small fraction of the enclosure contents). However, in many enclosures quantities of fuels may be hidden behind intermediate partitions or component mounting panels. That is, components may be mounted onto internal partitioning panels so that they are readily accessible for service. This may be accompanied by through-wiring such that the lead cables are hidden behind the mounting panels. In some cases, opening both sides of the panel may still leave a central wire-routing space hidden. The analysis is expected to identify such spaces, if they exist, and to include any hidden fuels in the assessment.

Very Low Fuel Loading

The easiest of the three categories to identify should be the Very Low Fuel Loading configuration; hence, this sub-group is covered first. Figure 3-14 illustrates two enclosures each with a very low fuel load. The enclosure on the left would be a Large Enclosure Group [4a(c)], and the enclosure on the right would be a Medium Enclosure Group [4b(c)].



Figure 3-14
Two “Very Low Fuel Loading” Enclosures

In this sub-group, the electrical enclosure should show a very sparse fuel load including consideration of all combustibles present. There should be only a small number of cables and components present in comparison to the total enclosure volume. The combustible contents should be both limited in quantity and widely dispersed within the enclosure. The cables that are present should be neatly arranged and restrained; for example, those cables present should be routed in an orderly fashion and tied to internal restraints. The intent here is that the combustibles present should be arranged such that if a fire were to ignite somewhere in the enclosure, it would be very unlikely to spread to nearby combustibles.

Characteristics that would *preclude* this categorization would include a significant loading of printed circuit cards, or the presence of components with a significant potential for energetic faults (i.e., arc-flash type failures with significant energy⁹).

This category would commonly apply to a range of instrument and control cabinets (or open racks) where there are relatively few components present and each instrument, indicator, or switch is serviced by only one or two small cables. The fuels should be dispersed widely over the enclosure volume such that fire spread would be difficult to achieve. Typically, the fuel load would be limited to only face-mounted components and the wires servicing those components.

⁹ This criterion is intended to cover items with voltages in excess of 125 VDC or 220 VAC. All devices have some potential for arcing, including a light switch. The intent here is to cover only those devices with a significant arc flash potential, e.g., ones that would require personal protective equipment per appropriate IEEE standards.

CLASSIFICATION OF ELECTRICAL ENCLOSURES

Distinguishing between the Default [Sub-Groups 4a(a) or 4b(a)] and Low Fuel Loading [Subgroups 4a(b) or 4b(b)] configurations will require more judgment in application. The distinctions are based on not only the raw fuel load (e.g., total combustible mass) but also the configuration of that fuel load. That is, if the internal cable conductors are tightly bundled (no air gaps visible), and wires leading to the electrical or electronic devices are neatly organized, fire is less likely to spread. In contrast, cables in loose bundles (air gaps visible between adjacent cables) or run in Panduit (e.g., routed without ties in a vertical cable routing channel) will burn more readily and would be indicative of a default fuel load. The presence or absence of other combustible materials is also important to this assessment. In order to assess these conditions, the enclosure must be opened and an assessment must be performed. Descriptions of these two rating levels are provided below.

Low Fuel Loading

This loading implies a fuel configuration that is light and/or moderate but not conducive to fire spread. Assignment of this rating level to an enclosure implies that if a fire were to ignite, the fuel loading is such that fire development will be both slow and difficult. For example, cables in tight bundles (no air gaps visible between cables in the bundle) are more difficult to burn and are considered as one indicator of a fuel load that is not conducive to fire spread (see Figure 3-15).

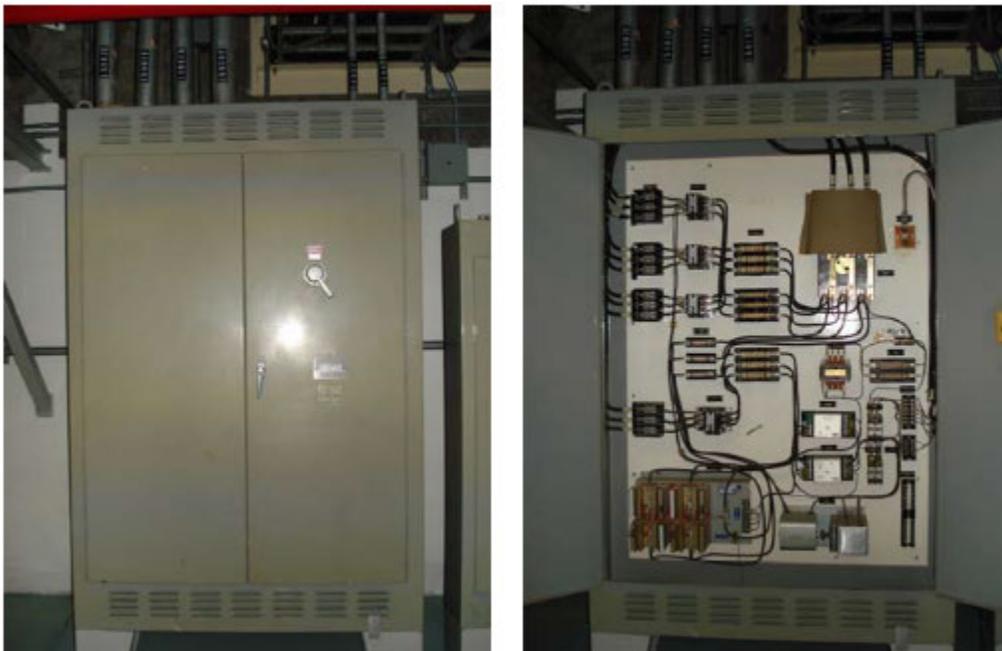


Figure 3-15
Large Enclosure (Closed and Open Configurations): Example of a “Low Fuel Loading” Subgroup

To assist in the decision making process, Table 3-1 provides information that may be used to assign the Default Fuel Loading versus Low Fuel Loading ranking to a given enclosure. Note that both sets of criteria must be met for assignment to a lower fuel loading condition. If one set of criteria is met and the other is not, the Default Fuel Load ranking would apply.

Default Fuel Loading

This would be the default assignment made to an enclosure unless the enclosure contents can be visually examined and dispositioned. A Default Fuel Loading would represent a relatively high density of fuels (i.e., in comparison to enclosure volume) which includes both cables and all other flammable materials present (e.g., circuit cards, switches, relays, etc.). The fuel may be distributed throughout the enclosure and may be arranged in a somewhat disorderly fashion. Some abandoned in place legacy cables may also be present. An enclosure with a high load of control components and/or circuit cards would typically imply a default fuel loading.

It is understood by the WG that fire PRA analysts will likely not have the opportunity to routinely open and inspect electrical enclosures during plant walkdowns. The HRR classification process is intended to accommodate this reality. That is, the working group anticipates that an analyst would typically begin by assigning the default fuel loading condition to most, if not all, enclosures, ranking enclosures based on function and size only. This approach would allow for an initial screening to be performed in order to identify risk-significant enclosures. If an enclosure is shown not to be a significant fire risk contributor using the default fuel loading assumptions, then further analysis of that enclosure might not be warranted. However, for significant enclosures, the analyst has the option of inspecting enclosure internals (given plant permission of course) and refining the HRR characterization if appropriate.

CLASSIFICATION OF ELECTRICAL ENCLOSURES

**Table 3-1
Distinguishing Characteristics for Default versus Low Fuel Loading Conditions**

Characteristic	Conditions Indicative of Default Fuel Loading	Conditions Indicative of Low Fuel Loading
Fuel Loading Level and Fuel Types	<p>There is a relatively high content of fuels including both cables and other combustible materials, or there is a significant load of printed circuit cards present.</p> <p>Bundles of excess or spare cable may be present (e.g., loops of excess or spare cable often found in the bottom of the enclosure).</p> <p>There is a relatively heavy load of smaller diameter (e.g., light power, control, or instrument) cables present where the cable jackets have been stripped and individual conductors routed to terminations within the enclosure. This would include higher load termination or terminal block cabinets, breaker cabinets, fuse cabinets, switching transfer cabinets, etc.</p>	<p>The fuel load is at most moderate and is comprised mainly of cables. There are no, or at most a handful of, open or exposed printed circuit cards present.</p> <p>Or,</p> <p>If combustibles other than cables are present in moderate quantities (e.g., circuit cards or other components) they are housed in closed metal boxes within the larger enclosure. These internal boxes may be vented, but should not have any fully open sides (e.g., an open-back rack mount circuit card cabinet would not meet this criterion).</p>
Cable Bundling Arrangement	<p>Cables may or may not be bundled. If cables are bound or bundled, air gaps between cables are evident (i.e., the bundles are not tight).</p> <p>Cables may be routed in cable wire-ways (e.g., Panduit) but are not tightly bound within the wire-way.</p> <p>Cables may also hang loosely in the enclosure with little or no restraint.</p> <p>Cables leading into the enclosure may be tightly bundled, but the wires leading to individual components are not. For example, when the cables are stripped of their jackets, the individual conductors are routed to their terminations in a somewhat disorderly fashion (e.g., without restraint or in loose bundles).</p>	<p>Cables will be routed in tight bundles (no air gaps evident between cables) and in an orderly manner. Bundles will be separated from each other and will be secured to internal panel elements (e.g., structural supports or other internals).</p> <p>If cable wire-ways (e.g., Panduit) are used, the cables in the wire way are tightly bound within the wire-way.</p> <p>Wires or individual conductors leading to internal components are also tightly bundled, are arranged in an orderly manner, and are secured to supporting elements (e.g., panels or support structures).</p>

4

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

This section provides specific application guidance for the heat release rate (HRR) characterization of electrical enclosures for three specific aspects of the analysis as follows:

- Section 4.1 describes the peak HRR probability distributions provided by the working group (WG). The process used to develop these probability distributions is discussed in Section 2. Guidance for the assignment of a given electrical enclosure to a specific classification group is discussed in Section 3.
- Section 4.2 describes a recommended practice for establishing the fire diameter to be used in the plume temperature analysis. Fire diameter is a key parameter when the fire plume temperature correlations are applied, and there has been little guidance regarding selection of an appropriate value in prior documents.
- Section 4.3 describes three special fuel loading configuration cases where a unique treatment of combustibles within an electrical enclosure beyond the process described in Section 3 is warranted.

4.1 Recommended Peak Heat Release Rate Distributions

For each enclosure type as defined in Section 3, a gamma distribution was fitted to the 75th and 98th fire intensity values which were defined based on the consensus process described in Section 2.2. The consensus peak HRR distributions are all defined as gamma distributions, largely as a matter of convenience but also because the characteristics of the gamma distribution match desired characteristics of the peak HRR distribution. In particular, the distribution is strictly positive, and second, the likelihood of large fires becomes very small. The distributions for the three functional classification groups (Groups 1, 2, and 3) are defined in Table 4-1.

Included in the table are the shape parameter, alpha (α), and rate parameter, beta (β), characterizing each gamma distribution. Also given are the corresponding 75th and 98th percentile HRR values. The 98th percentile value is the peak HRR value provided for use in the fire ignition source screening Task 7 from NUREG/CR-6850. That is, as with the original NUREG/CR-6850 values, the 98th percentile represents the worst-case peak fire intensity for each classification group. The analyst is not expected to postulate fire intensities in excess of the 98th percentile value.

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

Table 4-1 Peak HRR Distributions for Functionally Based Classification Groups 1, 2, and 3 Enclosures					
Classification Group	Fuel Type* (TS/QTP/SIS or TP)	Alpha	Beta	75th Percentile (kW)	98th Percentile (kW)
1 – Switchgear and Load Centers	TS/QTP/SIS	0.32	79	30	170
	TP	0.99	44	60	170
2 – MCCs and Battery Chargers	TS/QTP/SIS	0.36	57	25	130
	TP	1.21	30	50	130
3 – Power Inverters	TS/QTP/SIS	0.23	111	25	200
	TP	0.52	73	50	200

Notes:
It is assumed that, based on electrical code and personnel safety compliance requirements, all switchgear, load centers, MCCs, battery chargers, and power inverters would be normally closed enclosures that are opened only when under service. For these electrical enclosures no open enclosure fire condition has been provided for and should not be assumed given a normally closed condition. If a normally open enclosure of these types is encountered, the closed enclosure distributions presented here would not apply.

Per Sections 1.3 and 2.2.2, qualified TP cables (QTP - cables that have been tested and passed the IEEE-383 vertical flame spread test) and SIS wire are included in the same group as are the TS fuel type groups.

Also note that these revised distributions only characterize the peak HRR values. It is presumed that the analysis will include, as necessary to the analysis goals, consideration of the transient nature of the fire development process (i.e., growth to the peak HRR over time, steady burning, and fuel burnout). The new peak HRR distributions presented here are, by intent, compatible with the commonly applied methods of fire analysis in this regard.

In practice, for any given electrical enclosure, the enclosure is first categorized in accordance with Section 3 and placed into one of the available type/function classification Groups 1 through 4. The cable type present in the enclosure is classified in one of two groups. The first group is cable that is thermoset (TS), qualified thermoplastic (QTP) or SIS wire. The second group is unqualified thermoplastic (TP) cable. For classification Group 4 enclosures, the sub-categorization process based on fuel loading and configuration may also be applied (i.e., defining as Default Fuel Loading, Low Fuel Loading, or Very Low Fuel Loading). If this process is not applied (e.g., internal inspection is not possible or otherwise not performed), then the default fuel loading categorization will apply. The distributions for classification Group 4 are defined in Table 4-2, including both the size and fuel characterization aspects of Group 4.

**Table 4-2
Peak Heat Release Rate Distributions for Classification Group 4 (All Other) Electrical Enclosures**

Enclosure Class/Function Group	Enclosure Ventilation (Open or Closed Doors)	Fuel Type* (TS/QTP/SIS or TP Cables)	Gamma Distribution Characteristics											
			(a) Default			(b) Low Fuel Loading			(c) Very Low Fuel Loading					
			Alpha	Beta	75 th Percentile (kW)	98 th Percentile (kW)	Alpha	Beta	75 th Percentile (kW)	98 th Percentile (kW)	Alpha	Beta	75 th Percentile (kW)	98 th Percentile (kW)
4a – Large Enclosures >1.42 m ³ (>50 ft ³)	Closed	TS/QTP/SIS	0.23	223	50	400	0.23	111	25	200	0.38	32	15	75
	Closed	TP	0.52	145	100	400	0.52	73	50	200	0.88	21	25	75
	Open	TS/QTP/SIS	0.26	365	100	700	0.26	182	50	350	0.38	32	15	75
	Open	TP	0.38	428	200	1000	0.38	214	100	500	0.88	21	25	75
4b – Medium Enclosures ≤1.42 m ³ (50 ft ³) and >0.34 m ³ (12 ft ³)	Closed	TS/QTP/SIS	0.23	111	25	200	0.27	51	15	100	0.88	12	15	45
	Closed	TP	0.52	73	50	200	0.52	36	25	100	0.88	12	15	45
	Open	TS/QTP/SIS	0.23	182	40	325	0.19	92	15	150	0.88	12	15	45
	Open	TP	0.51	119	80	325	0.30	72	25	150	0.88	12	15	45
4c – Small Enclosures ≤0.34 m ³ (12 ft ³)	Not Applicable	All	0.88	12	15	45	The fuel load characterization approach is not applicable to small enclosures.							

Notes:

1. Sub-categories **Column (b)**: Low Fuel Loading and **Column (c)**: Very Low Fuel Loading require opening enclosure doors to assess the internal configuration consistent with the discussions in Section 3 of this report.
2. See Section 3.2.1 for a discussion of the open versus closed electrical enclosure configurations.
- * Per Sections 1.3 and 2.2.2, qualified TP cables (QTP - cables that have been tested and passed the IEEE-383 vertical flame spread test) and SIS wire are included in the same groups as are the TS fuel type groups.

4.2 Practice for Establishing Fire Diameter

Fire plume correlations, including the Heskestad plume temperature correlation, require that the user specify a fire diameter (or area) in a fire model. The selected fire diameter can significantly impact the resulting calculations. In general, the combination of a HRR and a fire diameter will determine the nature of the fire being simulated. In the extremes, a very small fire diameter relative to fire HRR implies a jet fire while a very large fire diameter relative to fire HRR implies a widely diffuse flame with very low flame height (e.g., like a bed of charcoal). Electrical enclosure fires fall between these two extremes; that is, they represent neither jet fires nor stove-top burner type fires, but, rather, are best represented as diffusion flames of limited height and relatively broad base.

NUREG/CR-6850 does not provide any information on fire diameter, leaving the choice to analyst judgment. FAQ 08-0043, *Location of Fires within Electrical Cabinets* [16], provides some related guidance by recommending assumed locations for modeling electrical enclosure fires. Fire locations are specified based on the presence and configurations of the vents and potential for failure of the enclosure doors. While in some instances the area of the base of the fire might be assumed equal to the vent area, the FAQ does not directly address this issue.

Since publication of NUREG/CR-6850, a verification and validation (V&V) of fire models for use in probabilistic risk assessment (PRA) applications has also been completed and reported in NUREG-1824 (EPRI 1011999) [17]. Supplement 1 to NUREG-1824 (EPRI 3002002182) [18] was issued in 2015 which expands the range of validation for the fire models. As a part of the effort, a specific group of experimental data sets was used as the basis for model validation; hence, the parameter range represented by the applied experimental data sets defines the range over which the validation results are applicable. That information provides an opportunity to characterize a range of appropriate fire diameter values that would fall within the validation range of the V&V report.

One common practice has been to assume a fire diameter that yields a total fire area equal to the horizontal footprint of the electrical enclosure's top. This is considered acceptable practice for higher fire intensities (HRR values), but could violate the correlation's validation range at lower HRR values (i.e., it would yield the "bed of charcoal" type fire which is not realistic for an electrical enclosure fire). The practice recommended here is as follows:

- Use a fire diameter that yields an area equal to the enclosure's footprint **unless** the result falls outside the validation range for the plume fire correlation being used.
- If the fire diameter lies outside the range of the plume correlation for the fire HRR being postulated (i.e., the diameter is too large) then **reduce** the fire diameter to the maximum allowed based on the validation range of the plume correlation being applied.

The discussions that follow describe the validation range for the most common plume correlation which leads to specific guidance regarding maximum fire diameter as a function of fire HRR. A table of the results is also provided.

Specific to the case of fire plume calculations, a non-dimensional group called ‘ Q_d^* ’ is defined¹ as follows:

$$Q_d^* = Q / [\rho_\infty \cdot c_{p\infty} \cdot T_\infty \cdot g^{1/2} \cdot D^{5/2}] \quad (4-1)$$

Where:

- Q = fire heat release rate (kW)
- ρ_∞ = ambient air density (~1.2 kg/m³)
- $c_{p\infty}$ = specific heat ambient air (1.0 kJ/kg·°K)
- T_∞ = ambient temperature (~293 °K)
- g = gravitational acceleration (9.8 m/s²)
- D = fire diameter (m)

This group is related to the “Froude Number” which characterizes the ratio of momentum driven flows to buoyancy driven flows and is especially relevant to plume fire behavior. A high value of this dimensionless group implies a fire with a relatively small diameter compared to the fire intensity; that is, a largely momentum driven fire plume. In the extreme, a high value would imply a jet fire as noted above. Conversely, a low number implies a fire that is dispersed over a wide surface in comparison to fire intensity; that is, a largely buoyancy driven fire plume which is the case of primary interest here. As stated in the V&V report, a typical value of Q_d^* is on the order of 1.0. The validated range is 0.2-9.1 (see the second row of Table 2-5 in Supplement 1 of NUREG-1824 (EPRI 3002002182) [18]).

Using this information, it is possible to characterize the relationship between fire intensities (i.e., HRRs) and the range of fire diameters that fall within the validation basis provided by NUREG-1824 Supplement 1 (EPRI 3002002182) [18]. In practice, when given a particular fire intensity value the implied range of fire diameter values that would fall within the bounds of the NUREG-1824 Supplement 1 (EPRI 3002002182) validation basis can be calculated.

To do this, it is easiest to re-order Equation 4-1 to solve for D as a function of Q and Q_d^* as follows:

$$D = [Q / (C_1 \cdot Q_d^*)]^{2/5} \quad (4-2)$$

Where:

$$C_1 = \rho_\infty \cdot c_{p\infty} \cdot T_\infty \cdot g^{1/2} \quad (4-3)$$

Using this modified relationship and the maximum and minimum values of Q_d^* represented in the V&V experimental data sets (i.e., 9.1 and 0.2), the range of diameter values is easily calculated. Note again that the minimum diameter is associated with the maximum value of Q_d^* and vice-versa. The results for a range of fire intensities are shown in Table 4-3 and the same results are plotted in Figure 4-1. Also, Table 4-4 provides minimum and maximum fire diameter values specific to each of the unique 98th percentile HRR values provided by the WG in Table 4-1 and Table 4-2 for electrical enclosures.

¹ See the second row in Table 2-5 of Supplement 1 of NUREG-1824 (EPRI 3002002182) [18].

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

Note again that the primary point that will typically be encountered is that the analyst should not exceed the maximum fire diameters listed in Tables 4-3 (for general fire sizes) and Table 4-4 (for the 98th percentile distribution values). The minimum fire diameters are provided mainly for general reference. However, in the unlikely event that an analyst encounters a case where the horizontal footprint of an electrical enclosure is smaller than the area implied by the minimum fire diameter in Tables 4-3 and 4-4, then it is recommended that the analyst increase the fire diameter assumed when using the correlation to the minimum value presented in these tables. The result will remain realistic even if that value implies an area greater than the enclosure footprint.

Table 4-3
Range of Fire Diameters as a Function of Fire Intensity (HRR) That Remain Within the Validation Range for the Plume Correlations

Fire Intensity HRR Values (kW)	Minimum Fire Diameter $Q_d^* = 9.1$ (m)	Maximum Fire Diameter $Q_d^* = 0.2$ (m)
5	0.0478	0.2200
10	0.0631	0.2904
25	0.0910	0.4189
50	0.1200	0.5527
100	0.1584	0.7293
250	0.2285	1.0522
350	0.2614	1.2038
500	0.3015	1.3884
700	0.3450	1.5884
850	0.3728	1.7167
1000	0.3978	1.8320

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

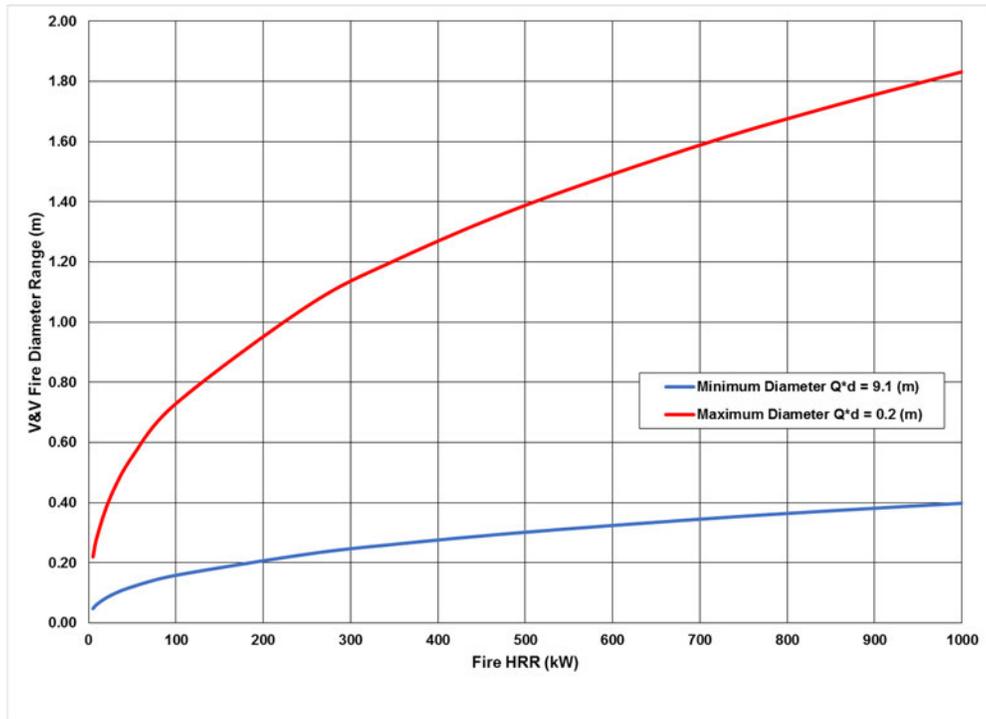


Figure 4-1
A Graphical Representation of the Data in Table 4-3

Table 4-4
Minimum and Maximum Fire Diameter Values for the 98th Percentile HRR Values Cited in Tables 4-1 and 4-2

98 th Percentile HRR Values (kW)	Minimum Fire Diameter $Q^*_d = 9.1$ (m)	Maximum Fire Diameter $Q^*_d = 0.2$ (m)
45	0.1151	0.5299
75	0.1412	0.6501
100	0.1584	0.7293
130	0.1759	0.8100
150	0.1863	0.8577
170	0.1958	0.9018
200	0.2090	0.9624
325	0.2538	1.1686
350	0.2614	1.2038
400	0.2758	1.2698
500	0.3015	1.3884
700	0.3450	1.5884

4.3 Special Fuel Loading Configurations

There are three special fuel loading configuration cases that could impact the assignment of a Group 4 electrical enclosure to the Default Fuel Loading, Low Fuel Loading, or Very Low Fuel Loading sub-group. In particular, there are certain cable routing configurations that would limit the exposure of fuels that may be present or that would eliminate potential ignition sources. These special configurations may be taken into consideration during the assignment process, as described in the following paragraphs.

4.3.1 *Special Case 1: No Ignition Sources Present*

The first special case is an electrical enclosure that has no ignition sources present. This condition will likely not be obvious based on external examination. Hence, an enclosure counted during the initial ignition source counting process may need to be reconsidered if this special case does apply.

A limited number of electrical enclosures found in nuclear power facilities may be effectively empty on internal inspection. These may be enclosures that once housed plant equipment but at some point were emptied and abandoned, enclosures installed as spare compartments against future need, or enclosures that only contain cables routed to other electrical enclosures or floor elevations (i.e., a cable pass-through with no terminations or end devices present).

In addition, enclosures containing some level of cables and components may be found that have been fully and permanently de-energized and are no longer in use. In the case of electrical enclosures, the fire ignition source is universally electrical in nature. Hence, without electrical energy present, there is no fire potential. Note that this particular case would not be applicable to an enclosure that is de-energized during some modes of plant operation but energized during others. Current methods do not extend to special treatment for such enclosures and it is not the intent of this method to address such cases. However, an enclosure that has been fully and permanently de-energized can be considered to have no ignition sources present.

Figure 4-2 provides an example of an enclosure that only contains pass-through electrical cables and some abandoned panel wiring (no terminations, no end devices). Since no ignition sources are present in the enclosure, it should not be counted as an ignition source and hence, no heat release rate would be assigned to it. It is provided that if such an enclosure is encountered, it should be removed from the list of ignition sources (i.e., it would no longer be considered as a potential source of a fire scenario). It is also provided that removal from the analysis be documented carefully including the basis for the decisions taken.



Figure 4-2
Cropped Photo of Electrical Enclosure with Bundled Panel Wiring and Cable, Limited Combustible Loading, and No Ignition Sources

4.3.2 Special Case 2: Cables Enclosed in Conduits

Rigid metal conduit², flexible metal conduit (FMC), and liquid-tight flexible metal conduit (LFMC) are raceways of circular cross-section made from either metal tube or, in the case of flexible conduits, helically wound, formed, and interlocked metal strips. Analysts may find that on internal inspection, the cables within an electrical enclosure are contained in such conduits. The use of flexible conduit within an enclosure is more likely than rigid conduit, but the use of rigid conduit cannot be precluded.

In general fire PRA practice, cables that are enclosed in metal conduit (rigid or flexible) are considered potential damage targets but are not considered to contribute to fuel loading or fire spread. Extending this concept to electrical enclosures, it is provided that in assessing the fuel load, do not include cables that are routed in rigid or flexible metal conduit. That is, such cables do not need to be considered as adding to the cabinet fuel load. The other criteria for

² Rigid metal conduit, as that term is used here, is intended to include a range of products including actual rigid metal conduit (RMC) which is thick-walled threaded tubing, galvanized rigid conduit (GRC), intermediate metal conduit (IMC), electrical metallic tubing (EMT), and aluminum conduit.

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

assignment to a particular fuel configuration (default, low, or very low) would apply based on any other combustibles present (e.g., cable not in conduit or other components).

LFMC differs from FMC in that the former has an outer liquid-tight, non-metallic, sunlight-resistant jacket over an inner flexible metal core. This outer jacket is typically a fire retardant polyvinyl chloride (PVC) TP that is of very low flammability. The flexible conduit provides a barrier between the energized insulated electrical conductors internal to the flexible conduit and external combustible materials within the electrical enclosure. Cables routed in LFMC will burn less intensely than would cables routed randomly within an enclosure. Hence, the LFMC is also considered a routing configuration that is less conducive to fire development (e.g., similar to tight versus loose bundles).

It is provided that while cables routed in LFMC cannot be dismissed as a contributor to fuel load entirely (because of the outer jacket), if most of the cables present are routed in LFMC this would generally allow for one step down in the fuel loading configuration assignment provided other assignment criteria are met. The presence of a small percentage of exposed cables would be permissible, but regardless, the criteria associated with the lower fuel configuration assignment must be met. That is:

- An enclosure that might otherwise be classified as a Default Fuel Loading might be reduced to a Low Fuel Loading provided the other criteria for Low Fuel Loading are also met (Table 3-1).
- An enclosure that could be assigned to the Low Fuel Loading group might be reduced to a Very Low Fuel Loading, again, provided the other criteria for Very Low Fuel Loading are also met (Table 3-1).
- An enclosure already assigned a Very Low Fuel Loading would remain a Very Low Fuel Loading enclosure.

Figure 4-3 illustrates two enclosure sections where flexible conduit is used exclusively to route panel wiring and electrical cables. The picture on the left in Figure 4-3 would likely fall into a Default Fuel Loading configuration if all the cables were exposed. Given the use of LMFC, the fuel loading assignment would be reduced to Low. The picture on the right in Figure 4-3 shows an enclosure where the cables are routed in FMC (in this case not LMFC). In this case, the consideration of the other fuels present would be necessary before an assignment can be made, but the cables in the FMC would not be included in the fuel load. Based on what is visible in the picture, the fuel loading assignment would likely be Low initially if all of the cables present were exposed. Excluding the cables in FMC from the fuel load may allow for a reduction to Very Low Fuel Loading depending on the nature of the fuels present in the metal enclosed wire-ways (see discussion of wire-ways below).

As always, it is provided that proper documentation be included and maintained with the fire PRA records.



Figure 4-3
Photograph of LPMC (left) and FMC (right) Within Electrical Enclosure

4.3.3 Special Case 3: Metal Enclosed Wire-Ways and Switch/Device Covers

Especially in later vintage plants, the inclusion of a design philosophy of train separation within an electrical enclosure included the use of metal enclosed wire-ways, switch covers, or device covers to separate redundant trains of insulated electrical conductors and cable. Examples of metal enclosed wire-ways and switch/device covers are shown in Figure 4-4 and Figure 4-5. This configuration is similar in some ways to the use of metal conduit, although the wire-ways typically have a larger cross-section than the conduits likely to be found inside an enclosure. The wire-ways and switch/device covers are also designed with removable covers that allow for access to the enclosed wiring. Finally, the wire-ways may include a limited degree of ventilation but are enclosed such that air flow into and out of the wire-way is sharply restricted. Despite these differences, the use of enclosed metal wire-ways or switch/device covers is considered to reduce the fire potential for an electrical enclosure in much the same way as conduits.

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

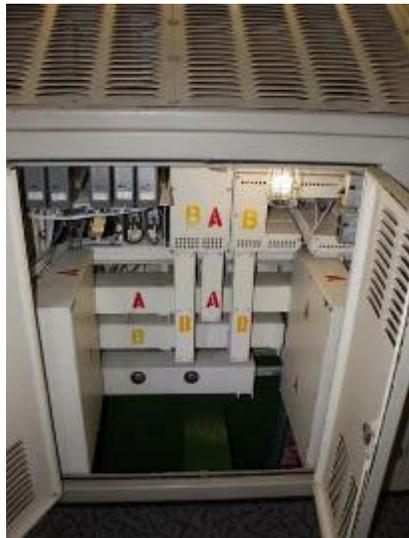


Figure 4-4
Photograph of Metal Enclosed Wire-Ways Within Electrical Enclosure (MCB)



Figure 4-5
Photograph of Switch/Devices Cover (Labeled B) Within an Electrical Enclosure

In those enclosures where metal enclosed wire-ways are used to route cables, the same approach as that described above for LFMC is provided (see the three examples for LFMC cited immediately above). That is, given that most of the cables present are routed in metal enclosed wire-ways or secured in switch and/or device covers, the fuel loading configuration assignment may be reduced by one step. The presence of a small percentage of exposed cables would be

APPLICATION GUIDANCE FOR HEAT RELEASE RATE CHARACTERIZATION OF ELECTRICAL ENCLOSURES

permissible, but regardless, all of the other criteria for the lower fuel configuration assignment must be met. For the cases shown in Figure 4-4 and Figure 4-5, the final fuel loading assignment would likely be either Low Fuel Loading or Very Low Fuel Loading depending on the details of the other fuels present (which cannot be easily discerned from the picture).

Note that this special case does not extend to non-metallic (e.g., plastic or fiberglass) wire-ways or to metallic wire-ways that are substantially ventilated. That is, these are installed wire-ways that are not enclosed, but rather, have large and regular openings (essentially alternating between solid “fingers” and open gaps) that allow for wire/cable entry and exit. Based on both photographs and the experience of the working group members, wires are often routed within such wire-ways in a loose arrangement of individual insulated conductors rather than in tightly bound bundles. A fire within such a wire-way might spread as easily as a fire in a loose cable bundle given ready access to oxygen and a high degree of exposed fuel surface area. Further, a non-metallic wire-way itself represents combustible fuel, albeit likely of a low flammability. While the use of non-metallic and/or highly ventilated wire-ways may impact fire behavior, there is currently no experimental basis for assessing the effects, and the effects may not be positive (i.e., they may not reduce fire potential, depending on details of the Installation). Hence, the working group decided that non-metallic and/or substantially ventilated wire-way systems would not qualify for this special case. An example of a ventilated wire-way that would be excluded from this special case (i.e., the wires in the wire-ways would be counted as exposed fuel) is shown in Figure 4-6. Likewise, substantially ventilated switch and/or device covers would be excluded from this special case for the same reasons. An example of a ventilated switch and/or device covers is shown in Figure 4-7.



Figure 4-6
An Example of Non-Enclosed Wire-Ways That Would Not Qualify as Metal Enclosed Wire-Ways

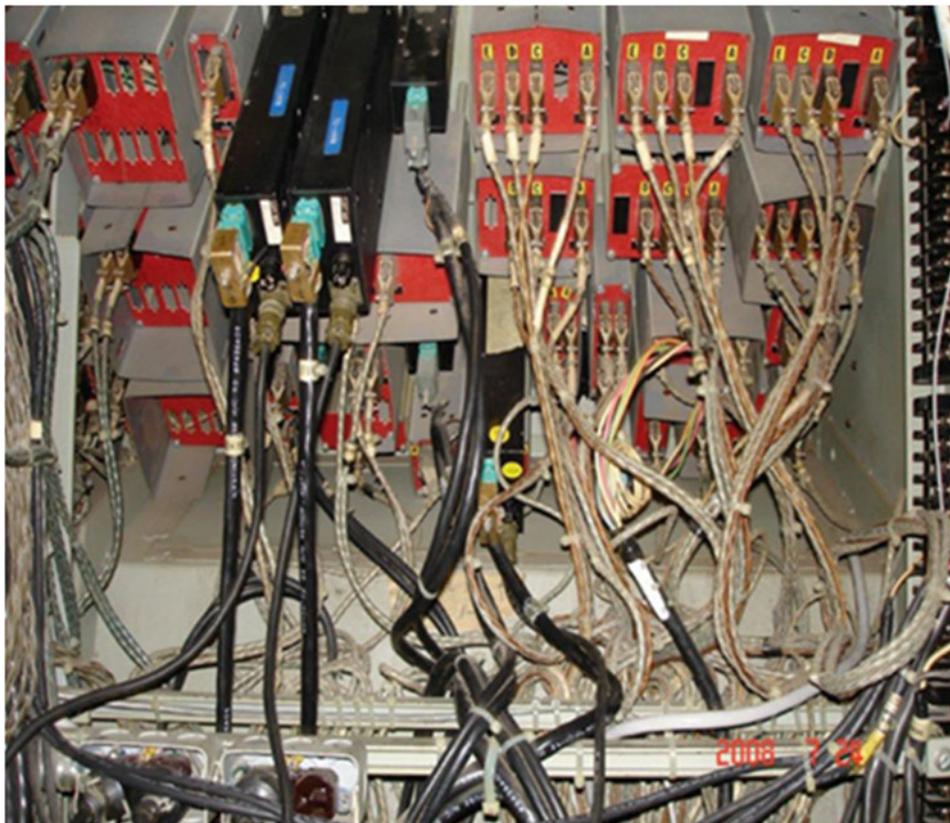


Figure 4-7
An Example of Substantially Ventilated Switch and/or Device Covers That Would Not Qualify for Reduction

As a final note, these three special configurations are not mutually exclusive. For example, the picture on the right in Figure 4-3 shows an enclosure section that actually includes both FMC and metal enclosed wire-ways. This is not unexpected, and the conditions should be evaluated consistently with the aggregate conditions as they exist.

5

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

This section describes the methodology used in characterizing axisymmetric fire plume models for enclosure fires. The Heskestad correlation is used as a basis for comparison of the obstructed plume predictions using the Fire Dynamics Simulator (FDS) computer software. Appendix E presents all results of the computer simulation studies representing obstructed and unobstructed plume effects, bias and uncertainty evaluation, sensitivity analysis of an opening on the top obstruction plate, and the sensitivity study of vertical source configuration.

5.1 Assumptions and Limitations

The Heskestad fire plume correlation is used for characterizing axisymmetric fire plumes [19, 20] as a basis for comparison of the obstructed plume model predictions from the FDS computer simulations. The following reasons are taken into consideration:

- The Heskestad correlation is a widely used model for calculating fire plume temperatures [4, 21, 22];
- The Heskestad correlation has been verified and validated for commercial nuclear power plant applications [17, 18, 23];
- As an algebraic mathematical model, the Heskestad correlation can be easily evaluated and applied for the purposes of this research and for fire probabilistic risk assessment (PRA) applications; and
- A review of a multitude of thermal plume correlations by Beyler [24] concluded that several reported correlations utilize a nearly identical approach to that utilized by Heskestad.

Note that the Heskestad correlation assumes axisymmetric plumes with the source of energy concentrated at a point in space near the base of the fire (i.e., the virtual origin). Consequently, this study includes fires modeled as axisymmetric plumes compared with FDS simulations with similar fire sources impacted by obstructions.

5.1.1 Fire Dynamics Simulator

Although the Fire Dynamics Simulator (FDS) is routinely used for solving practical fire problems in fire protection engineering, including fire reconstruction investigations, sprinkler design, and smoke management, it is also useful as a tool to study fundamental fire dynamics and combustion [25], including low speed transport of heat and combustion products from fire. This latter purpose serves as motivation for using FDS Version 6.0.1 as the source of the fire plume simulations developed in this study.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

The following reasons justify the use of FDS Version 6.0.1:

- FDS provides the flexibility to model the scenarios with the selected influencing factors required for supporting the study of obstructed plume flows.
- FDS has been verified and validated for commercial nuclear power plant applications [18, 26]. NIST updates the FDS verification and validation (V&V) study with each new version release [27].
- There is precedent in the commercial nuclear industry in using FDS for NFPA 805 applications. For example:
 - An FDS simulation provides the technical basis in the approach described in fire PRA FAQ 13-0004 [28] dealing with “sensitive electronics” inside electrical cabinets.
 - A number of fire PRAs have used FDS in support of the fire modeling calculations for estimating time to control room abandonment due to fire generated conditions.
- In comparison to an experimental program, FDS models can be revised and reproduced at very little cost or time delay.
- FDS base case simulations for fire plumes (i.e., unobstructed plumes in the application described here) have been compared with fire plume temperature correlations as a benchmark.
 - In Section 5.2, FDS results of baseline unobstructed configurations are compared to the Heskestad correlation to demonstrate consistent predictions between the two models.
 - Also in Section 5.2, FDS results of obstructed configurations are compared to the Heskestad correlation to demonstrate that the obstruction may reduce the plume temperature significantly.
 - In Section 5.3, FDS results of obstructed configurations are compared to FDS results of the unobstructed configurations to identify systematic functional trends in the data (e.g., construction type, fire base height, fire diameter, etc.).
 - In Section 5.3.7.1, all of the results are compared using statistical analysis in order to develop appropriate guidance for the treatment of obstructed plumes using a modified Heskestad correlation.

5.1.2 Zone of Influence Applicability

The information developed here applies to determining the fire plume component (i.e., vertical zone of influence (ZOI) distance and potential horizontal shift of the plume) generated in the initial stages of the fire.

The analysis does not include room heat up effects (i.e., development of a room hot gas layer). The scope of this analysis is limited to the evaluation of a fire plume that is not influenced by the presence of walls or ceiling of the surrounding compartment. This limitation prevents any direct evaluation of the potential effects of an obstructed plume on the development of a room hot gas layer. The practical implication of this is that the information is focused on the “early stages” of a fire where substantial smoke accumulation and room heat up has not yet occurred. This limitation also prevents any direct evaluation of the potential effects of an obstructed plume on

the smoke visibility reduction in a compartment. Existing guidance for the evaluation of smoke visibility reduction is still applicable and should be used without modification.

This analysis also does not provide any justification to alter the treatment of the thermal radiation horizontal ZOI. The existing guidance provided in NUREG/CR-6850 [4], and NUREG/CR-6850 Supplement 1 [21], should be used to determine the thermal radiation horizontal ZOI. While the obstructed plume may shift the plume horizontally, the horizontal ZOI remains bounded by the radiation ZOI. Implications on the maximum extent of the vertical and horizontal ZOI due to an obstructed plume will be discussed in Section 6.

5.1.3 Flame Height

The effect that an obstruction may have on flame height has not been previously investigated. In many cases the flames impinge upon or encompass the obstructions. The maximum extent of the vertical ZOI includes contribution from both the flame impingement region and the plume. The outcome of this study will have no impact on damage predictions for targets exposed to direct flame impingement or within the cabinet. More advanced techniques that utilize event tree analysis to credit the delay in damage states have to carefully consider the treatment of the flame impingement zone using the existing information in NUREG/CR-6850 [4].

5.1.4 Types of Obstructions

The obstructions modeled in this investigation represent electrical enclosure surfaces, including the enclosure top and, in some cases, the side walls of the enclosures. The top obstructions are located within the flame, intermittent, and plume regions of the fire source. Ratios of mean flame height, L , to the elevation of the top obstruction, H range from $L/H = 0.22$ to 2.06 . The flame height, L , varies based on the selected HRR of the fire as described in Section 5.2.3.1. The elevation of the top obstruction, H , is a fixed value of 2.3 m (7.5 ft). These obstructions are considered to be in the near-flame region most appropriate for NPP applications, and are representative of a typical enclosure height evaluated in fire PRAs. Side obstructions have been implemented in a way that would demonstrate their effect on the thermal plume without appreciably limiting the supply of oxygen to the fire source. The configurations explored here emphasize the effect of the top surface, while also considering the possibility that side surfaces may produce increased thermal exposures.

The obstructions modeled in this investigation include top obstructions without any openings. A number of sensitivity simulations are performed using openings of various percentages of the obstruction top surface area. These additional simulations are used to determine applicability of information when applied to enclosures with openings at the top.

5.1.5 Other Applicability Limitations

- The methodology described in Sections 5 and 6 of this report (i.e., the evaluation temperatures associated with obstructed fire plume flows) is provided for scenarios involving fires in open or closed electrical enclosures as described in Section 3.2.1.
 - The enclosure walls may be solid or have ventilation openings as described in Section 3.2.1. Since the FDS simulations were conducted with enclosures with “no walls” (i.e., only a cabinet top), with two side walls, and with three walls to ensure the fire is not oxygen limited, this recommendation ensures a

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

conservative application of the approach even if the enclosure walls have openings or vents.

- Since FDS has the inherent capability to predict plume temperatures under the influence of an obstruction [27], FDS results should never be adjusted in post-processing calculations to account for the obstructed plume credit. The bias correction developed in this report does not apply to results obtained directly from FDS and is only intended for use with the Heskestad fire plume temperature correlation. A qualified user of FDS should develop an appropriate set of inputs to address the effects of cabinet obstructions directly, and not by adjusting the output data with a bias correction.
- The simulations developed in FDS consist of enclosure obstructions with steel thermo-physical properties consistent with electrical enclosure tops found in NPP applications. Application is limited to metal or other similarly robust obstructions that could not fail (melt or burn away) at elevated temperatures and allow unobstructed plume flows. Note that the results show that the effect of the obstruction is not strongly sensitive to small openings in the top surface, up to 5% of the top surface area as indicated in Section 5.3.7.2. Therefore, small openings ($\leq 5\%$ of top plate) that may be generated by the heat from the fire due to warping or tearing of weld joints, etc. can be ignored provided the material is sufficient to withstand melting or burn away when directly exposed to flames. The analysis also shows that the result is not strongly sensitive to varying the thickness of the enclosure surface material in Section 5.3.7.5. Therefore, the recommendations can be applied to any electrical enclosure provided the above limitations are also met.
- Temperature predictions at specified intervals are made up to 6 m (20 ft.) above the fire source, which is the typical elevation of room heights in NPPs. The analysis is based on the highest temperature predicted in the particular plane elevation.
- Heat release rates (HRR) up to a limit of 1000 kW, which is roughly equal to the highest 98th percentile HRR value provided for ignition sources in Tables 4.1 and 4.2 of this report. This limit also corresponds to the maximum HRR specified for a 98th percentile electrical enclosure fire in NUREG/CR-6850 [4].
- The current investigation does not consider the effects on the plume temperature after fire spread to secondary combustibles, such as cable trays or exposed cables ignited above the initiating fire source.
- The current investigation does not consider the potential effects of a fire located adjacent to a wall or corner; however, there is no evidence to suggest that this analysis will invalidate the current treatment of these configurations. Existing information on the treatment of wall and corner effects on the plume ZOI may be applied.
- The current investigation applies to defining the thermal plume exposure and extent of the ZOI, assuming relevant temperature exposures for thermoplastic (TP) and thermoset (TS) cable targets. The range of relevant temperatures includes 130 °C (266 °F) to 800 °C (1470 °F) as defined in Section 5.3.6.

5.2 Technical Approach

The Heskestad plume correlation is typically used for unobstructed plume simulations and modified to account for changes in plume temperature due to an obstruction. This modification is estimated through a comparison of the results of fire model simulations against the existing Heskestad plume correlation. The software used to simulate and estimate fire plume temperatures subject to obstructions in this study is FDS Version 6.0.1.

FDS is a computational fluid dynamics (CFD) tool, developed and maintained by the National Institute of Standards and Technology, capable of studying fundamental fire dynamics and combustion [29], including low speed transport of heat and combustion products from a fire. FDS solves numerically a form of the Navier-Stokes equations (i.e., conservation of momentum in fluid flow) appropriate for low speed, thermally driven flow with an emphasis on smoke and heat transport from fires. The formulation of the equations and the numerical algorithm are contained in the FDS Technical Reference Guide [30]. Verification and validation of the model are discussed in the FDS Verification and Validation Guides [27, 31]. FDS has also been verified and validated for commercial nuclear applications [18, 26].

5.2.1 Review of Past Studies

A review of the literature was conducted to identify existing studies related to obstructed plumes. Most studies including fire plume flows subject to an obstruction focus on one of two areas: (1) exposure to objects of varying sizes and geometries in a fire plume, and (2) delayed actuation and impeding discharge patterns of sprinklers caused by obstructions. However, no specific study associated with fire plume temperatures above obstructions was noted. Information on the impact of obstructions on plume temperatures is needed in the nuclear power industry as more realism is factored into the modeling of electrical enclosure fires. Fires ignite inside electrical enclosures, and it may be overly conservative to model the plume without any consideration of the effects that the top of the enclosure may have on the plume temperature and hence, on the vertical ZOI.

No experimental or modeling studies exist that report the plume temperature above an obstruction. However, FDS is designed with all the appropriate physical sub-models to evaluate this configuration. FDS is considered an appropriate tool for evaluating much more complex configurations than what is explored in this investigation. All model configurations evaluated in this report conform within the model V&V limits specified in NUREG-1824 [17] and Supplement 1 [18].

5.2.2 Plume Theory

The point source solution of turbulent plume flow has shown a remarkable ability to correlate velocities, temperatures, and mass flow rates above the flame tip [20, 24, 32]. This solution assumes the fire to be a single point source of heat located near the base of the fire. The details of the point source become less observable as the distance from the point increase until only the total heat output of the fire becomes relevant. This investigation focuses on the near field plume behavior, where the temperatures of interest are comparable to the damage thresholds of electrical cables used in NPPs.

5.2.2.1 Plume Scaling

Significant efforts have been undertaken in the study of plume theory. Relations developed by Zukoski [33] are capable of estimating plume temperatures and velocities for fires uninfluenced by obstructions. Using these relationships, the following simplified proportionality allows for an estimation of the plume centerline temperatures at different elevations above a fire source by Beyler [24]

$$\Delta T_m \sim \dot{Q}^{2/3} z^{-5/3} \quad (5-1)$$

Where, ΔT_m is the rise in plume temperature above ambient in Kelvin, \dot{Q} is the heat release rate in kW, and z is the height above the fire source in meters. Constants of proportionality have been determined by a number of investigators. The constant of proportionality, A , modified to include the virtual origin, z_0 , can be estimated as:

$$A \approx \frac{\Delta T_m}{\dot{Q}^{2/3} (z - z_0)^{-5/3}} \quad (5-2)$$

When comparing these constants of proportionality determined by various investigators, values range from 21.6 to 29.7. A value of 26 is suggested for use when the convective heat release rate is known and 22 when flame radiation is significant. One of the relations that follow the above proportionality is the Heskestad fire plume correlation.

5.2.2.2 Heskestad Plume Temperature

In this investigation the correlation used to predict the changing fire plume temperature was developed by Heskestad:

$$\Delta T = 9.1 \left[\frac{T_0}{(g c_p^2 \rho_0^2)} \right]^{1/3} \dot{Q}_c^{2/3} (z - z_0)^{-5/3} \quad (5-3)$$

Where, ΔT is the change in temperature above ambient, g is the acceleration due to gravity, c_p is the specific heat of air, ρ is the density of air, \dot{Q}_c is the convective heat release rate, z is the height above the top of the combustible, and z_0 is the height of the virtual origin calculated as:

$$z_0 = -1.02D + 0.083\dot{Q}^{2/5} \quad (5-4)$$

Where, D is the diameter of the fire source (m) and \dot{Q} is the heat release rate (kW).

This correlation is only valid above the mean flame height, L . The mean flame height can be calculated as:

$$L = -1.02D + 0.230\dot{Q}^{2/5} \quad (5-5)$$

The Heskestad fire plume correlation is chosen for this study because it is identified as the preferred correlation for use in calculating the damage temperature in ZOI applications by NUREG/CR-6850 (Appendix F). In addition, the correlation is currently verified and validated for use in fire PRA [26].

To determine the effects on plume temperature rise caused by an obstruction on targets above the obstruction, a modification of the Heskestad fire plume correlation is made to account for changes in the fire plume temperature rise as given below:

$$\Delta T = B \left(9.1 \left[\frac{T_0}{(g c_p^2 \rho_0^2)} \right]^{1/3} \right) \dot{Q}_c^{2/3} (z - z_0)^{-5/3} \quad (5-6)$$

Where, B is a bias determined from differences between the plume temperature rise above a fire subject to an obstruction and those of the unmodified Heskestad fire plume correlation.

5.2.3 The FDS Simulation Parameters

Using FDS, one hundred fifty six (156) simulations, thirty nine (39) unobstructed and one hundred seventeen (117) with obstructions, were performed to develop the simulated plume temperature data for this study. Four influencing factors have been chosen to define a “test matrix,” namely, heat release rate, fire diameter, elevation of the fire source, and number of enclosure walls included with the obstruction. These factors are based on the study of fire plume flows currently available in the fire protection engineering literature and the specific needs for this study.

5.2.3.1 Heat Release Rate (HRR)

The HRR is perhaps the most important influencing factor in all fire modeling applications. In the specific case of axisymmetric fire plumes, it represents the energy released at a point in space near the base of fire generating the upward movement of flows. Heat release rate values selected for this study range from approximately 50 to 1000 kW (which is approximately the highest fire intensity) applied for electrical enclosure heat release rate scenarios.

5.2.3.2 Fire Source Diameter

The fire source diameter characterizes the size of the fire base. It has been identified as an important parameter governing fire plume temperatures, because it has a strong influence on plume velocities, entrainment, and flame heights. Consequently, it is included as an influencing factor to evaluate its impact on fire plume temperatures subject to obstructions. The range of effective fire diameters selected for this study are 0.3 m (1 ft.), 0.6 m (2 ft.), 0.9 m (3 ft.), and 1.2 (4 ft.) where $D_{eff} = \sqrt{4A/\pi}$. The Fire Froude Number (Q^*) is used to select pairings of fire diameters and HRRs appropriate for this investigation. Q^* values ranging between 0.34 and 1.87 were calculated for the parameters used in this study. These values fall mostly within the validated range, 0.2 to 9.1, of the Q^* as reported in Table 3-3 in Supplement 1 of NUREG-1824 [18], with a small set of configurations less than the minimum valid Fire Froude Number of 0.4. These configurations are not anticipated to invalidate the conclusions generated in this study because the substantial validation performed for FDS [27] expands the limits reported in NUREG-1824 [18], and the model inputs are prescribed within the existing validation range for the use of FDS.

5.2.3.3 Obstruction Configuration

Electrical enclosures represent a common ignition source in nuclear power plant fire scenarios. When developing a zone of influence, the fire within an enclosure may be subject to the enclosure top and sides as an obstruction within the plume region. The obstructions used in this investigation consist of a flat plate obstruction with a thickness of 0.0015 m (0.06 in) centered over the fire source at an elevation of 2.3 m (7.5 ft) with a varying number of walls. The dimensions of the obstructions are 8 cm (3 in) larger than the fire base on a side, and

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

change in size with the fire source used in each simulation. Obstructions representing electrical enclosures with no walls and a top cover, two walls with a top cover, and three walls with a top cover are used in this investigation.

Three different obstructions used in the investigation are shown in Figure 5-1. The first type of obstruction is a single flat plate obstruction (circled in red). The second obstruction includes the flat plate and two walls (identified by red arrows) running from the floor surface to the flat plate obstruction, resembling an arch. The other two surfaces are open to the environment (signified by the blue line). The third obstruction is similar to the arch obstruction with an additional, third wall that allows smoke and heat to exit only on the side indicated by the blue arrow.

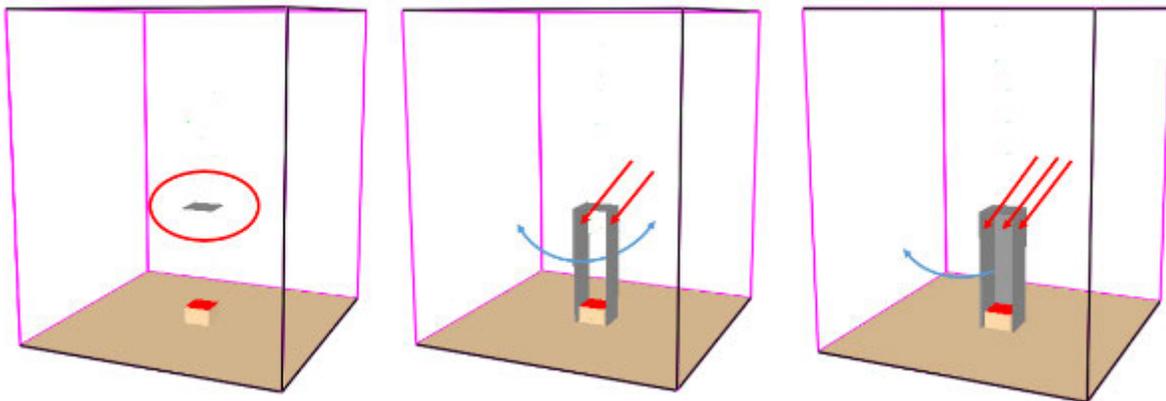


Figure 5-1
Obstruction Geometries: Flat Plate, Arch, Three Walls

In Figure 5-2, the change in elevation of the fuel source is presented. The three elevations used in this investigation are 0.3 m (1 ft) – one foot above the floor surface, 1.1 m (3.6 ft) – half the distance between the floor surface and the top of the obstruction, and 2.0 m (6.6 ft) – one foot below the top of the obstruction.

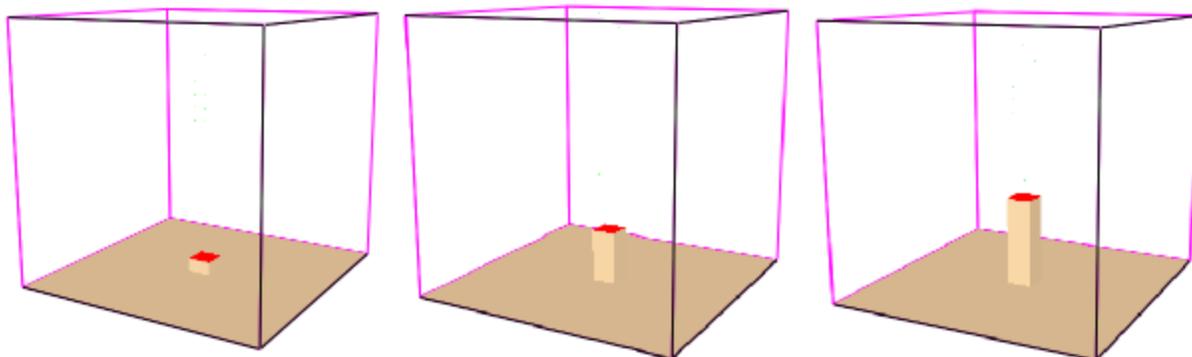


Figure 5-2
Simulation Fire Source Elevations: 0.3 m, 1.1 m, 2.0 m

Evidence gathered from these simulations is used to determine the effect of an obstruction on plume temperatures and subsequently determine any resulting change in the ZOI.

5.2.3.4 Enclosure Configurations

Figure 5-3 illustrates three enclosure configurations seen in NPPs where the obstructed plume effects are realized. Without considering the wall effect, the enclosure presented in Figure 5-3a is an example of the single flat plate obstruction geometry. The enclosure is vented on all four sides with a solid top (circled in red). The enclosure presented in Figure 5-3b has a solid top and two side walls, resembling arch obstruction geometry (circled in red). The remaining two top sides are vented to the environment. The enclosure presented in Figure 5-3c is an example of the three-wall obstruction geometry. The enclosure has three solid walls, a solid top, and a single door with slotted vents (circled in red).

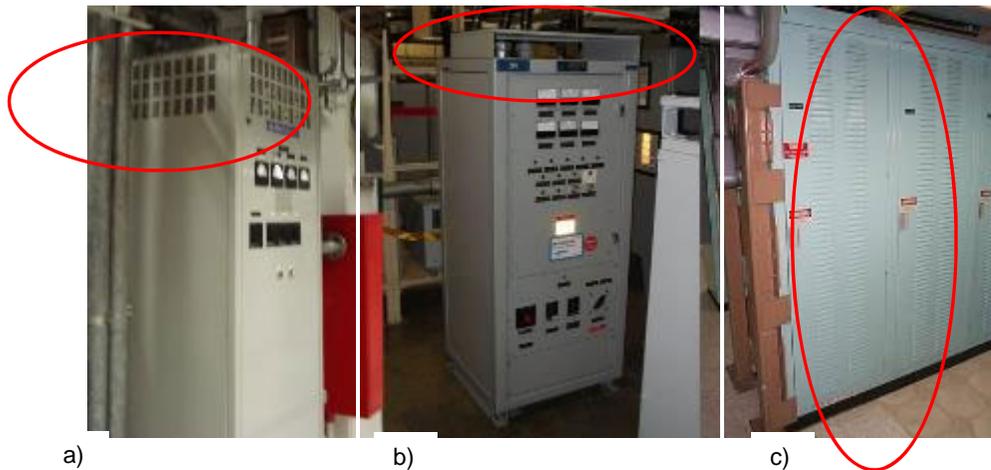


Figure 5-3
Obstruction Configurations: Flat Plate, Arch, and Three Walls

5.2.3.5 FDS Simulation Matrix

A matrix of simulations performed in this investigation is presented in Table 5-1. This investigation includes eight HRRs, three obstructed cases, one unobstructed case, up to four fire diameters and three fire source elevations. Applicable pairings of HRR and source diameter are selected using Q^* as identified in Section 5.2.3.2. Entries that are listed as “N/A” are not applicable because the Q^* for the configuration is outside the validation range [18]. This results in a total of 108 unique simulations.

Table 5-1
FDS Obstructed Plume Simulation Test Matrix

HRR (kW)	Fire Source Diameter (m)				Fire Source Elevation (m)		
	0.3	0.6	0.9	1.2	0.3	1.1	2
50	X	N/A	N/A	N/A	X	X	X
100	X	N/A	N/A	N/A	X	X	X
200	N/A	X	N/A	N/A	X	X	X
300	N/A	X	X	N/A	X	X	X

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

HRR (kW)	Fire Source Diameter (m)				Fire Source Elevation (m)		
	0.3	0.6	0.9	1.2	0.3	1.1	2
400	N/A	X	X	N/A	X	X	X
500	N/A	X	X	N/A	X	X	X
600	N/A	X	X	N/A	X	X	X
1,000	N/A	N/A	X	X	X	X	X

N/A signifies no FDS simulation was performed.

Note that most of the obstructions modeled in this investigation include top obstructions without any openings or penetrations. In addition, a number of sensitivity simulations were completed using openings of various percentages of the obstruction top surface area. These additional simulations are used to determine the applicability of information presented in this study when applied to enclosures with openings or penetrations on the enclosure's top.

5.2.3.6 Simulation Compartment

The compartment (i.e., the computational space) for the simulations used in this investigation measures 5 m (16 ft) x 5 m (16 ft) x 6 m (19.7 ft) (see Figure 5-4). The compartment is open on all sides and the top and includes a concrete floor. In this investigation room heat up effects are not included. A mesh of 125 x 125 x 150 was used for each simulation, resulting in a grid resolution of 4 cm [δx (m)].

For simulations involving buoyant plumes, a measure of how well the flow field is resolved is given by the non-dimensional expression $D^*/\delta x$, where D^* (m) is a characteristic fire diameter:

$$D^* = \left(\frac{\dot{Q}}{\rho_0 c_p T_0 \sqrt{g}} \right)^{\frac{2}{5}} \quad (5-7)$$

All other terms have been defined for Equation 5-7. The values of $D^*/\delta x$ defined in this investigation range from 7.3 to 19.6, which falls within or exceeds the values of $D^*/\delta x$ used in the validation study of FDS [26]. A larger ratio means more fire dynamics are resolved directly by FDS and the results are considered more accurate.

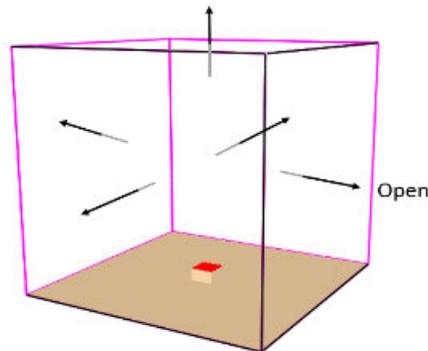


Figure 5-4
Simulation Compartment

5.2.3.7 Temperature Measurement Plane

All reported temperature predictions are obtained from slice files in FDS every 0.03 seconds using the quantitative tool provided with FDS, `fds2ascii.exe`. This tool allows for extracting the precise data provided in the slice file. Slice files save horizontal planar slices of data at user specified locations (see Figure 5-5). This is the equivalent of experimentally placing gas temperature measurement devices at 4 cm (1.6 in) spacing in the horizontal plane at each elevation. Temperatures used in this investigation are averaged over a period of 10 seconds using `fds2ascii.exe` in order to determine averaged plume centerline data in a manner similar to that used to develop the plume correlations by Heskestad. Each simulation predicts a total time of 30 seconds which, as discussed in Section 5.2.4.1, is longer than necessary to achieve steady state plume conditions. The slice files are included at elevations spaced every 0.3 m (1 ft) from the floor to the top of the 6 m (19.7 ft) tall compartment. Note, locations below the top of the obstruction are not included in the analysis per the limitation listed in Section 5.1.3. Using the slice file to record temperature measurements ensures that the maximum plume temperature can be recorded for analysis, regardless of its location in the plane. This is especially important as different obstruction geometries shift the plumes location away from the center of the fire source (see Figure 5-5). The maximum plume temperature at each elevation above the obstruction is used to determine the effect of an obstruction on plume temperatures and develop information for any resulting change in the ZOI. In some configurations, such as depicted in Figure 5-5, the plume was observed to shift horizontally due to the obstruction. This effect is discussed in further detail in Section 5.3.8.

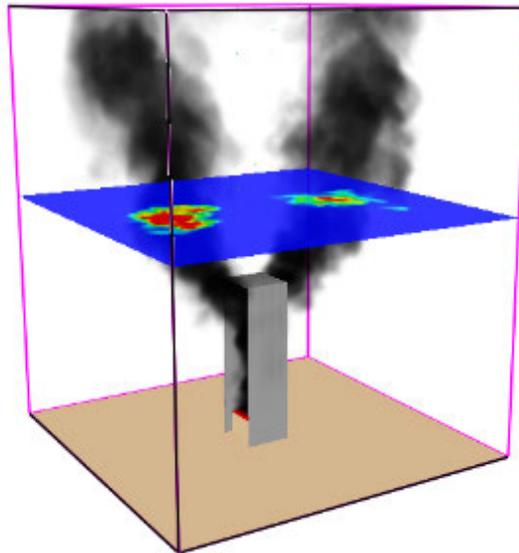


Figure 5-5
Slice File FDS Simulation Temperature Measurements

5.2.4 Preliminary FDS Simulations

In this section, the results for simulations with fuel sources under different obstruction configurations are reviewed and analyzed to ensure proper implementation of the analysis and to confirm that the results provide the correct data. First, the results for unobstructed fires are discussed for 200 kW and 1000 kW fires. This is then followed by six simulations consisting of 200 kW and 1000 kW fires subject to the three different obstruction configurations.

5.2.4.1 No Obstruction – Baseline

Simulations with the fire source subject to no obstructions for each of eight HRRs, three diameters, and three fire source elevations used in this investigation were performed for comparison against the obstructed cases. In Figure 5-6, unobstructed fires with HRRs of 200 kW and 1000 kW are presented. Also shown in Figure 5-6 are two of the fire source diameters and elevations used in the investigation. The 200 kW fire has an effective fire source diameter of 0.6 m (1 ft) and a source elevation of 1.1 m (3.6 ft). The 1000 kW fire has an effective fire source diameter of 0.9 m (3 ft) and a fire source elevation of 2 m (6.6 ft).

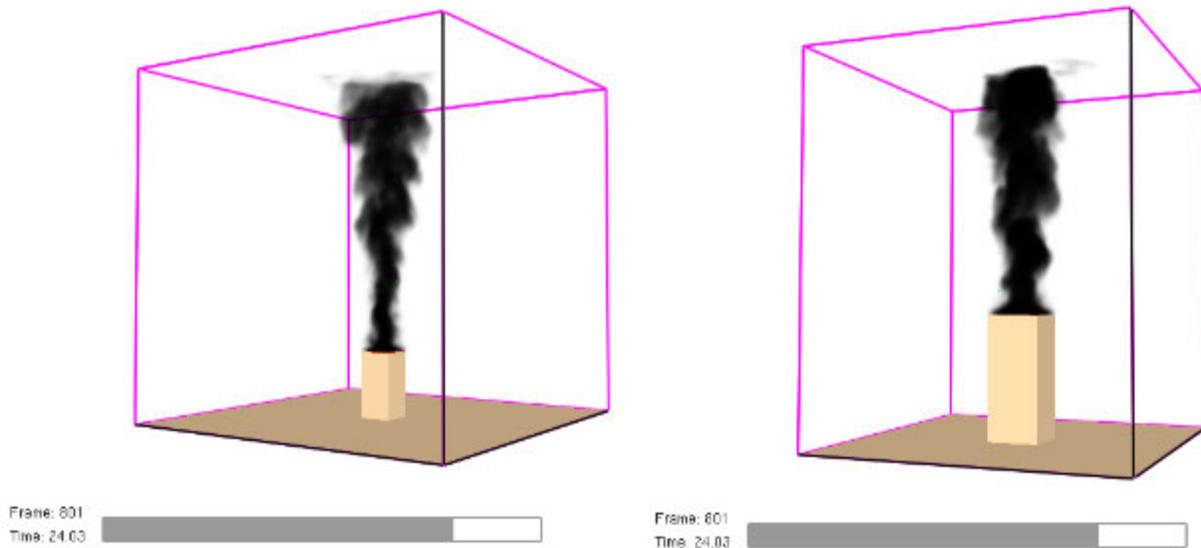


Figure 5-6
a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 0.9 m (diameter), 2 m (elevation) – Non-Obstructed Geometry

Figure 5-7 and Figure 5-8 show the HRR versus time for the two unobstructed simulations presented in Figure 5-6. The HRRs shown are the FDS default described by:

$$\dot{Q}(t) = \dot{Q}_0 \cdot \tanh\left(\frac{t}{\tau}\right) \quad (5-8)$$

Where, \dot{Q}_0 is the user-specified HRR in kW, t is elapsed time in seconds, and τ is the time for the HRR to ramp up to its prescribed value in seconds. The default value for τ in FDS, one second, was specified in this investigation. This fire growth rate is considerably faster than that provided by NUREG/CR-6850 [4], and is applied here to achieve a fast steady state performance and limit simulation time. For this study, only the steady state behavior of the plume is of interest. The HRR for the two simulations quickly reaches the user-specified values of 200 kW and 1000 kW and varies throughout the remainder of the simulation due to turbulent fluctuations simulated by FDS. In Figure 5-7 and Figure 5-8, the one-second time-averaged HRR is presented along with the resulting HRR described by Equation 5-8 directly to verify that the HRR has been implemented correctly.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

In Figure 5-9, the fire plume temperatures predicted by FDS and the Heskestad fire plume correlation (Equation 5-3) are presented. For the 200 kW and 1000 kW fires, the Heskestad fire plume correlation agrees with the FDS simulated plume temperatures. Note that the FDS and Heskestad predictions are essentially the same with only minor variations. The most significant variation is that for the larger fire, FDS predicts somewhat lower temperatures in the flame zone region very close to the fire source. This is of no major significance to this study because the predicted temperatures for both models are in the 700-900 °C range, which is well in excess of values of interest to fire PRA (e.g., typical cable or component failure temperatures).

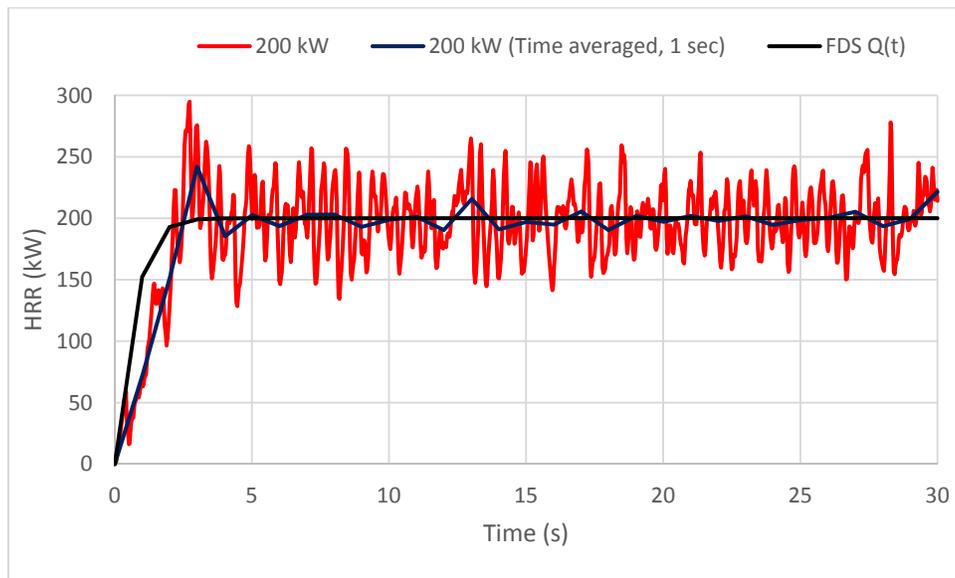


Figure 5-7
HRR vs. Time, Unobstructed Simulation – 200 kW, 0.6 m (diameter), 1.1 m (elevation)

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

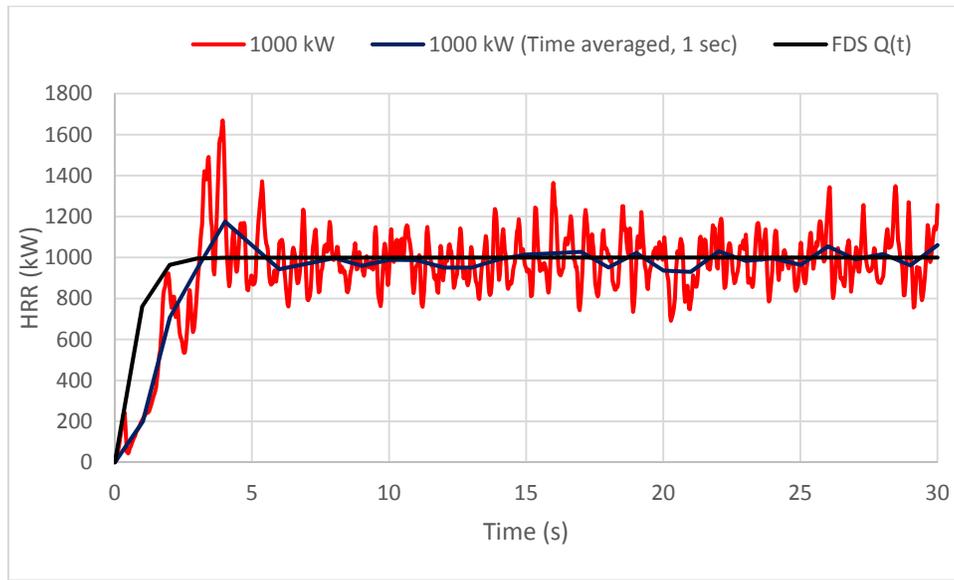


Figure 5-8
HRR vs. Time, Unobstructed Simulation – 1000 kW, 0.9 m (diameter), 2 m (elevation)

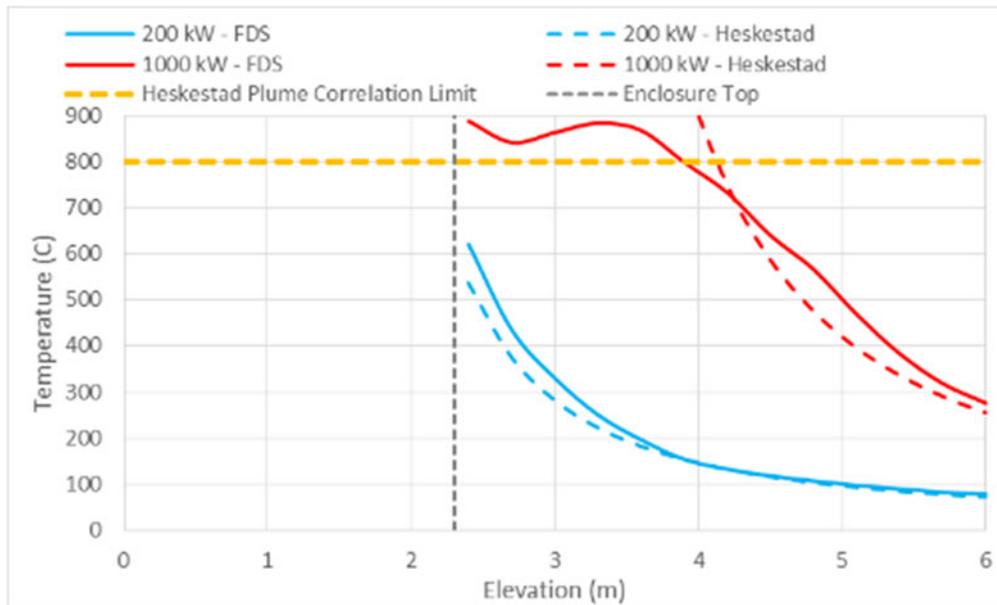


Figure 5-9
Temperature vs. Elevation Above Floor, Unobstructed Simulation – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 0.9 m (diameter), 2 m (elevation)

5.2.4.2 Flat Plate Obstruction

Figure 5-10 shows fires with HRRs of 200 kW and 1000 kW subject to a flat plate obstruction. The HRRs for the simulations presented in Figure 5-10 are similar to those presented in Figure 5-7 and Figure 5-8.

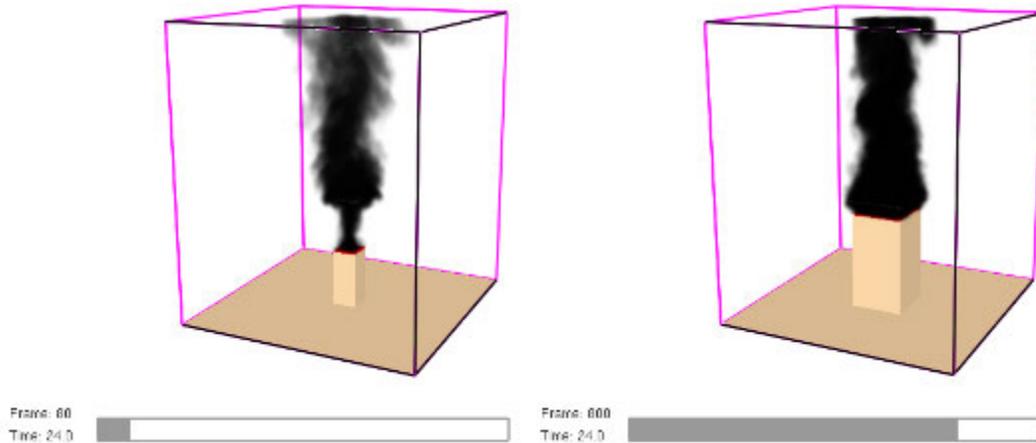


Figure 5-10

a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 1.2 m (diameter), 2 m (elevation) – Plate Obstruction

Figure 5-11 presents the temperature at different elevations versus time for the flat plate obstruction simulation with a 200 kW fire. These results show that the temperature becomes sufficiently steady after 15 seconds, and remains steady for 300 seconds. In this investigation the temperature measurements are averaged over a period of 10 seconds, as described in Section 5.2.3.7. The measurements are averaged between the period of 20 and 30 seconds at which time the results have become steady. Several sensitivity cases were completed using both extended simulation times and the FDS input parameter 'TIME_SHRINK_FACTOR,' which reduces the specific heats of various materials by a user specified factor. These results, supported by the global energy balance provided with each simulation, show that the transient heating of the top surface of the enclosure plays no role in the long term trend of the simulated plume temperatures.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

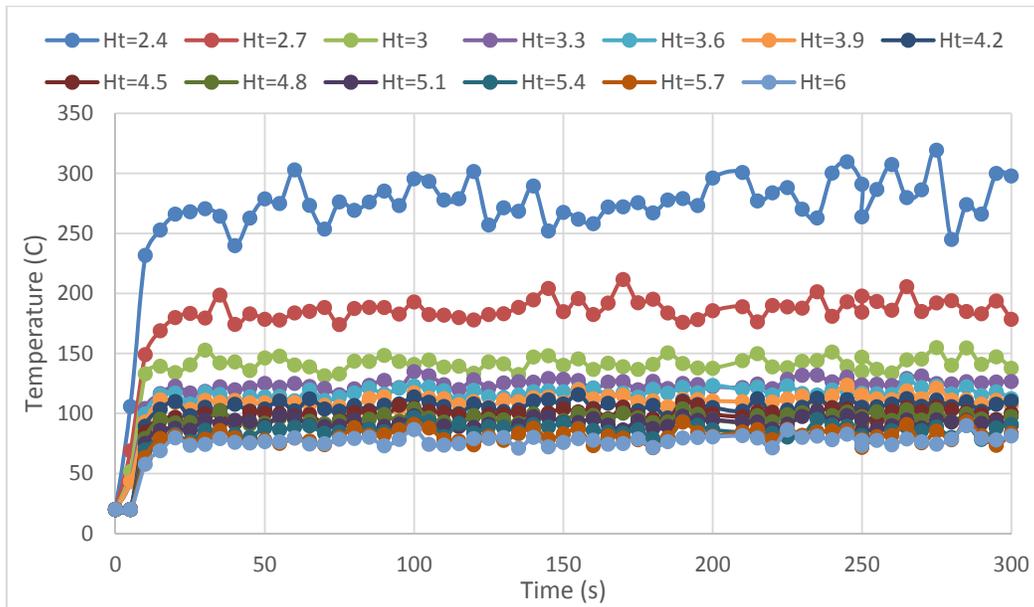


Figure 5-11
Temperature vs. Time, Flat Plate – 200 kW, 0.6 m (diameter), 2 m (elevation) – Elevations Above the Obstruction

Figure 5-12 presents the temperature profiles for the 200 kW and 1000 kW HRRs subject to a flat plate obstruction. Also included is the Heskestad (Equation 5-3) fire plume correlation temperature with identical model inputs. A comparison between the results suggests that the Heskestad plume temperature equation is over-predicting the plume temperature fires obstructed by a flat plate. This over-prediction suggests that the flat plate obstruction has reduced the plume temperature rise at elevations above the obstruction. It is likely that as the plume flows around the obstruction it is slightly broken up and results in an increased entrainment of fresh cool air. This entrainment reduces the plume temperature when compared to an unobstructed case predicted by the Heskestad fire plume correlation.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

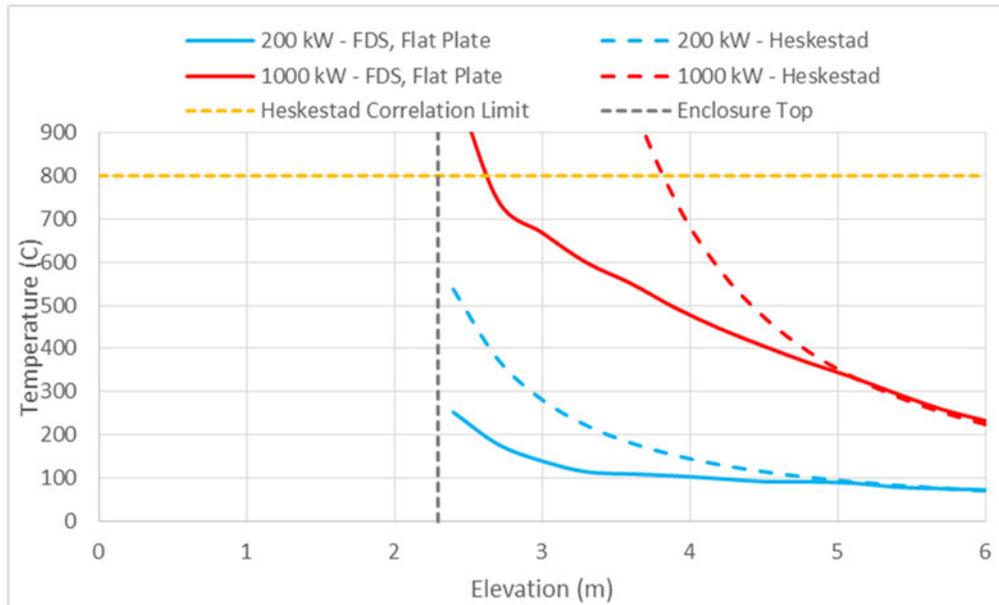


Figure 5-12
Temperature vs. Elevation Above Floor, Flat Plate Obstruction – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 1.2 m (diameter), 2 m (elevation)

5.2.4.3 Arch Obstruction

Figure 5-13 shows simulations of a 200 kW fire and a 1000 kW fire subject to an arch obstruction, a flat plate ceiling located at an elevation of 2.3 m, and two walls. Plots of the HRR vs. Time for the 200 kW and 1000 kW fires are similar to those seen in Figure 5-7 and Figure 5-8.

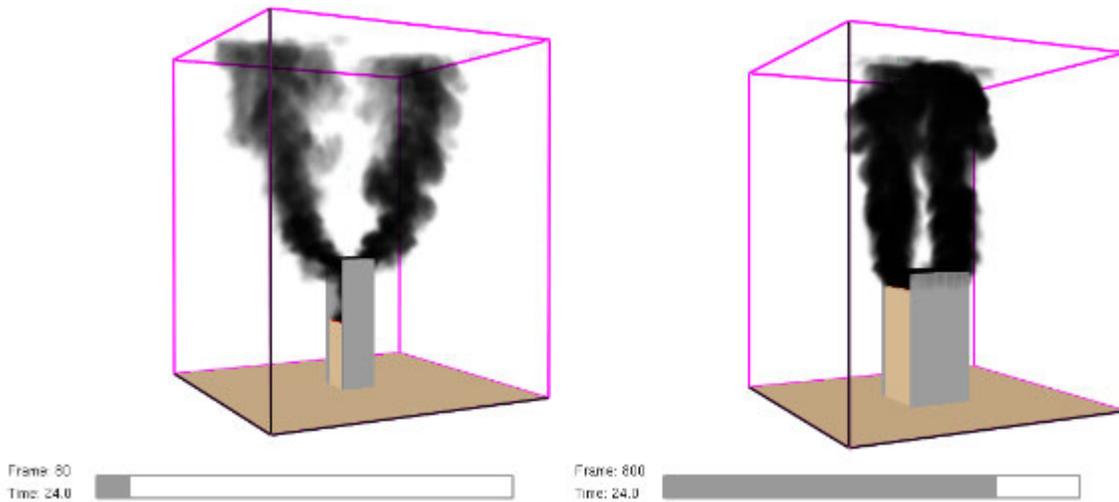


Figure 5-13
a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 1.2 m (diameter), 2 m (elevation) – Arch Obstruction

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

The temperature profiles for the 200 kW and 1000 kW simulation are presented in Figure 5-14.

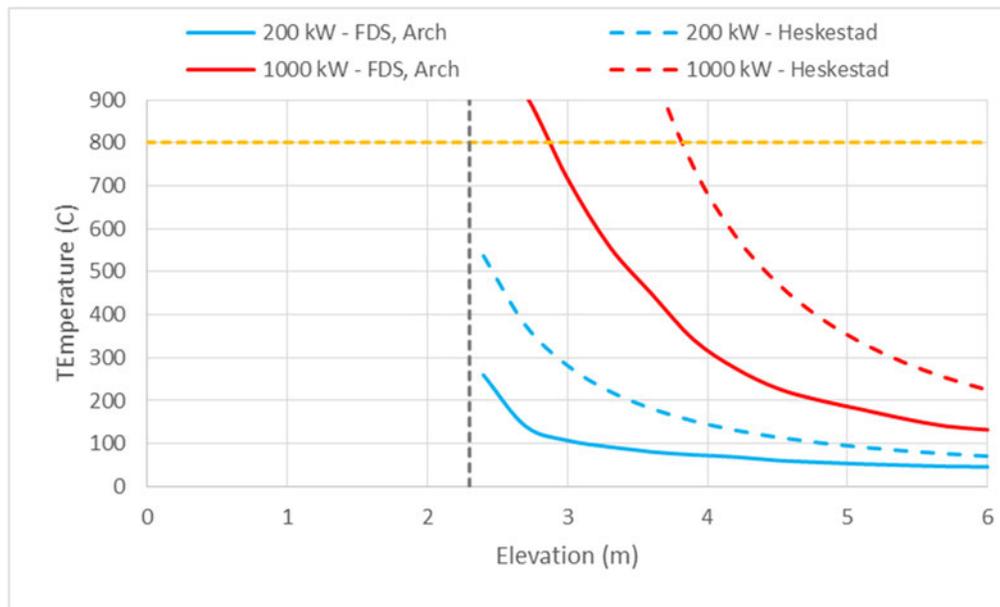


Figure 5-14

Temperature vs. Height Above Floor – Arch Obstruction – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 1.2 m (diameter), 2 m (elevation)

Figure 5-14 includes the Heskestad correlation plume temperatures using identical inputs. It appears that the arch obstruction is also influential on the plume temperatures, as the simulated temperatures are lower than those predicted by the Heskestad fire plume correlation. This is likely a result of the increased entrainment resulting from the two plumes created by the arch obstruction geometry (see Figure 5-13). Being split into two separate plumes increases the surface area available for the plumes to entrain cooler fresh air which results in lower plume temperatures above the obstruction.

5.2.4.4 Three-Wall Obstruction

Figure 5-15 shows simulations of a 200 kW fire and a 1000 kW fire subject to a three-wall obstruction, a flat plate ceiling located at an elevation of 2.3 m (7.5 ft) and three walls. Plots of the HRR vs. Time for the 200 kW and 1000 kW fires are similar to those seen in Figure 5-7 and Figure 5-8.

The temperature profiles for the 200 kW and 1000 kW fires are presented in Figure 5-16.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

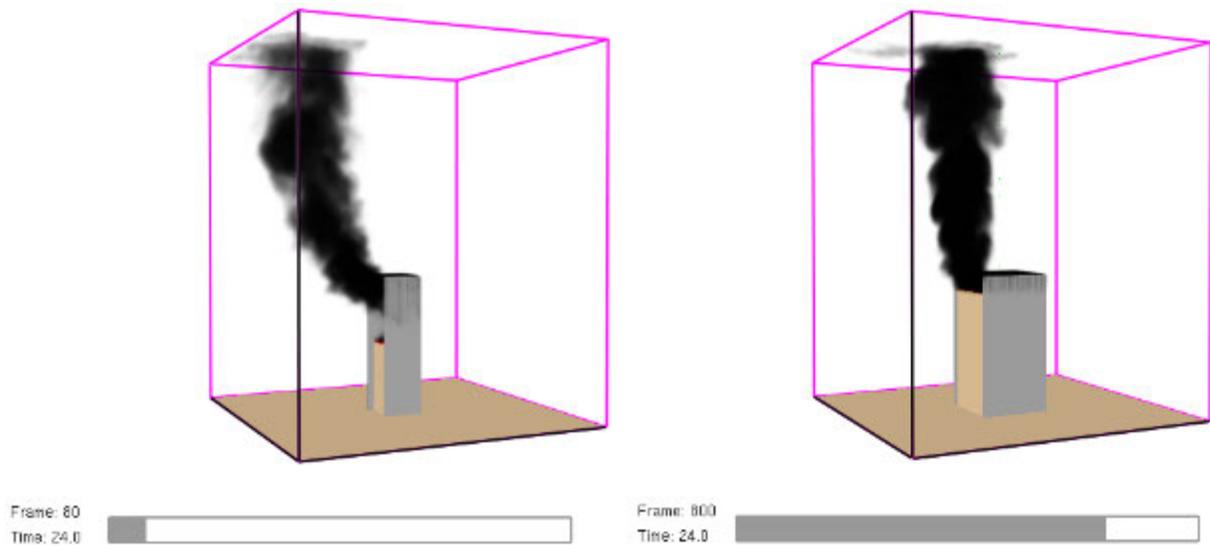


Figure 5-15
a) 200 kW, 0.6 m (diameter), 1.1 m (elevation) and b) 1000 kW, 1.2 m (diameter), 2 m (elevation) – Three-Wall Obstruction

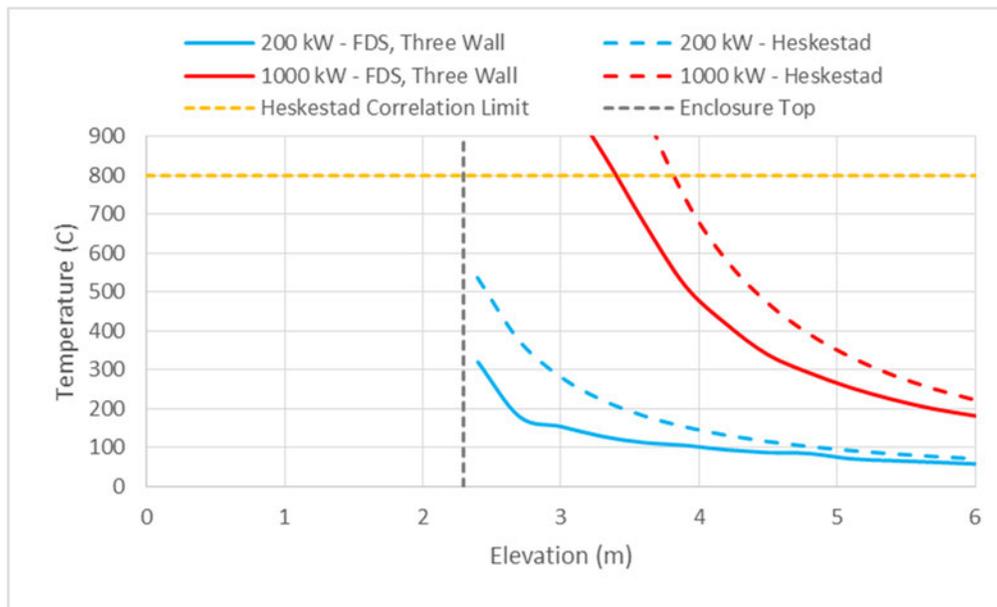


Figure 5-16
Temperature vs. Height Above Floor – Three-Wall Obstruction – 200 kW, 0.6 m (diameter), 1.1 m (elevation) and 1000 kW, 1.2 m (diameter), 2 m (elevation)

Figure 5-16 includes the Heskestad correlation plume temperatures using identical inputs. It appears that the three-wall obstruction, similar to the flat plate and arch obstruction, influences plume temperatures, as the simulated temperatures are lower than those predicted by the

Heskestad fire plume correlation. Once again, this is likely a result of an increased entrainment of fresh, cool, air in the plume caused by the obstruction.

5.2.4.5 Statistical Analysis

The bias introduced by the plume obstructions is evaluated using the statistical model provided in NUREG-1934 [22]. In this study, the 'Experimental' value (E) may be either the unobstructed FDS prediction, or the unbiased Heskestad plume from Equation 5-3 [20]. The 'Modeled' value (M) will be the obstructed FDS prediction from the planar slice data processing. This way, the experiment value is based on an established method to predict plume temperatures that is accepted when used within valid limits established by NUREG-1824 Supplement 1 [18]. The model value is then the new information developed in this study that is biased by the presence of the obstruction. The following expressions are used to define the statistical analysis:

$$E|\theta \sim N(\theta, \sigma_E^2); \quad \tilde{\sigma}_E = \sigma_E/\theta \quad (5-9)$$

$$M|\theta \sim N(\delta\theta, \sigma_M^2); \quad \tilde{\sigma}_M = \sigma_M/\delta\theta \quad (5-10)$$

$$\overline{\ln\left(\frac{M}{E}\right)} = \frac{1}{n} \sum_{i=1}^n \ln\left(\frac{M_i}{E_i}\right) \quad (5-11)$$

$$\tilde{\sigma}_M^2 + \tilde{\sigma}_E^2 = \frac{1}{1-n} \sum_{i=1}^n \left[\ln\left(\frac{M_i}{E_i}\right) - \overline{\ln\left(\frac{M}{E}\right)} \right]^2 \quad (5-12)$$

$$\delta = \exp\left(\overline{\ln\left(\frac{M}{E}\right)} + \frac{\tilde{\sigma}_M^2}{2} - \frac{\tilde{\sigma}_E^2}{2}\right) \quad (5-13)$$

Where, $N(\mu, \sigma^2)$ indicates a normal distribution with mean, μ , and standard deviation, σ , and the quantities θ , E , and M are the True, Experimental, and Modeled quantities of interest. In this case, E and M are defined as the plume temperature rise above ambient. The relative standard deviations, $\tilde{\sigma}_E$ and $\tilde{\sigma}_M$, are necessary in this framework and represent the fraction of the measured quantity that can be attributed to uncertainty. The quantity $\tilde{\sigma}_E$ is considered an input to the statistical model and can be estimated from prior analysis. The model bias, δ , is the primary quantity of interest for this study since it is equivalent to the term B proposed in Equation 5-6.

5.3 FDS Simulation Results

The FDS simulation results for all these cases are reported in Appendix E (Table E-1 for obstructed plume cases and Table E-2 for the unobstructed plume base case).

In Figure 5-17, the temperature increase results from all FDS simulations with obstructions are compared to unobstructed simulations with the same fire characteristics. Included in Figure 5-17 are temperature measurements made from directly above the obstructions, up to an elevation of 6 m (19.7 ft) at 0.3 m (1 ft) intervals. The x-axis is the unobstructed plume

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

temperature rise. The y-axis is the equivalent obstructed plume temperature rise. Consequently, if the obstructed and unobstructed measurements are close to each other, all the points would fit along the diagonal (bold black line). Data points below the diagonal suggest lower obstructed plume values when compared with the corresponding unobstructed predictions.

The results in Figure 5-17 show that obstructions do indeed influence plume temperatures. Two observations can be made. In most cases, it appears the obstruction reduces the plume temperatures above the obstructions. However, in a few cases the obstructed temperatures are greater than those of the unobstructed fire. These cases can be identified by relation to the 'perfect match line,' an indication of when the obstructed and unobstructed temperatures are equal. It is likely that these instances in which the obstructed temperatures are greater than the unobstructed temperatures are a result of different entrainment behavior caused by the obstructions. Of the results where the obstructed temperatures are greater than the unobstructed case, all measurements were taken at an elevation of 3 m (9.8 ft) or lower, within 0.7 m (2.3 ft) of the top obstruction, with flames reaching consistently or intermittently above the top obstruction. Furthermore, each of the configurations that exceed the match line corresponds to a fire located 0.3 m (1 ft) above the floor. This result suggests a limit of applicability for fires that are located near the base of the enclosure, and this configuration is explored in greater detail below.

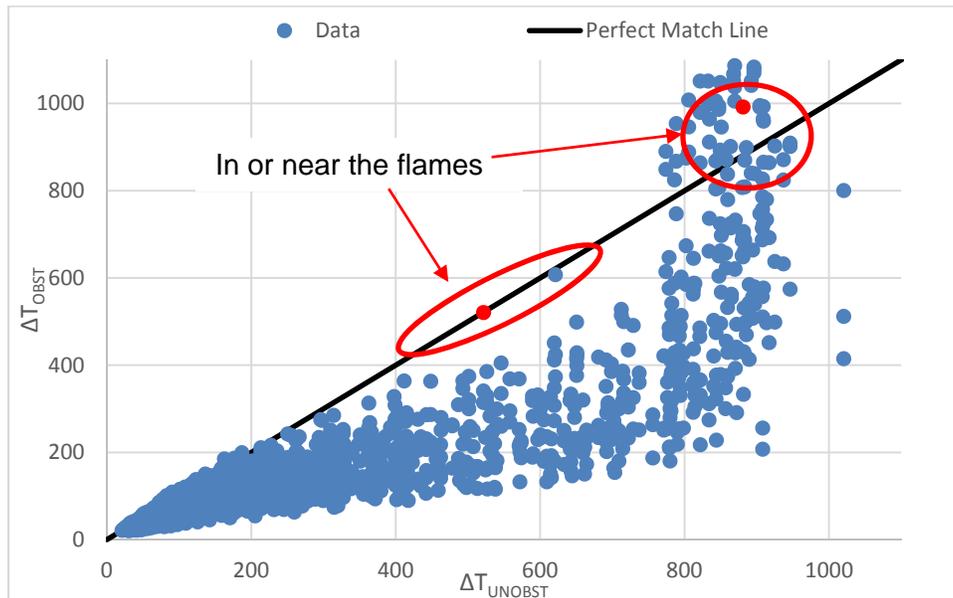


Figure 5-17
Unobstructed versus Obstructed Plume Temperatures

5.3.1 Analysis of Non-Conservative Results

In Figure 5-18 screen captures from one the simulations for the red dots near 500 °C (932 °F) highlighted in Figure 5-17 is shown. The data is from measurements made at an elevation of 2.4 m (7.9 ft), approximately 0.1 m (0.3 ft) above the top obstruction. In both incidents, the flames can be seen intermittently expanding above the top obstruction.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

Results from the simulations presented in Figure 5-18 show the flames intermittently reaching out and above the ceiling of a three-wall obstruction. The spillover of the flames has an effect of increasing the 10 second time averaged temperature used in this analysis. The increased flame heights and resulting increased temperatures are likely a result of reduced entrainment within the obstruction. However, the remainder of the plume temperatures above the obstruction are lower than those for an unobstructed case.

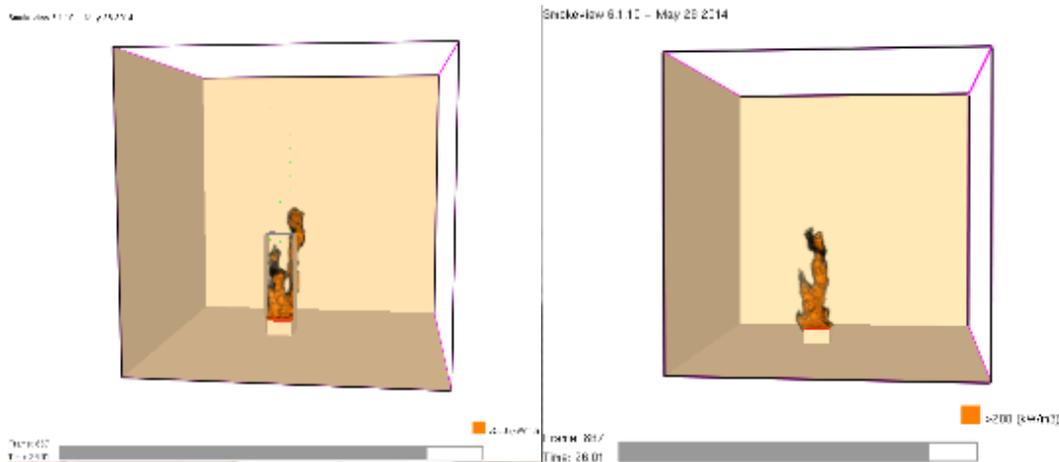


Figure 5-18

a) Three-Wall Obstruction, 500 kW, 0.3 m b) No Obstruction, 500 kW, 0.3 m

Another case where two simulations produce data above the perfect match line is examined for the red region near 900 °C (1652 °F) circled in Figure 5-17. In Figure 5-19, the comparison between a three-wall obstruction around a fire source at an elevation of 2 m (6.6 ft) and that of an unobstructed case is presented. Comparing these simulations, the flame length in the unobstructed simulation is greater than that observed in the obstructed simulation. Since both cases are within the flame region of the fire source, it is normal that they both produce temperatures near 900 °C (1652 °F), which is widely reported as the temperature within the flame by Heskestad. Since temperatures very near and inside the flame do not correlate with height as indicated in Equation 5-3, temperatures near the flame temperature should be filtered from the final analysis to determine the bias induced by the obstructions.

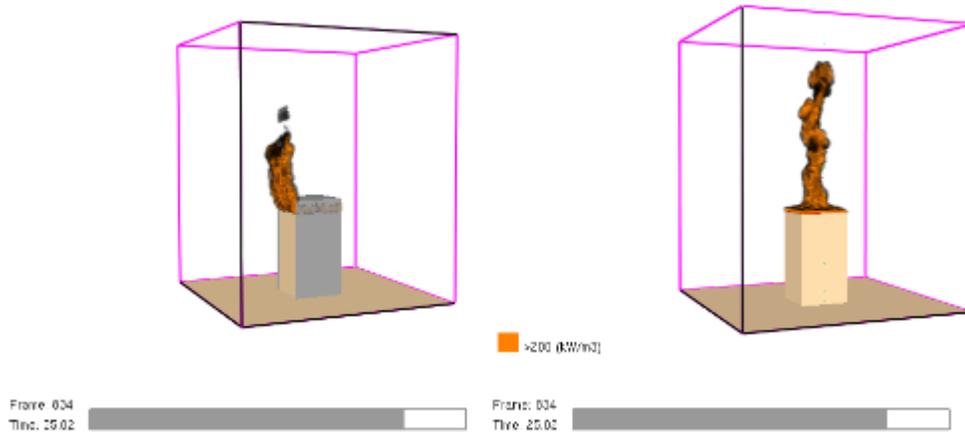


Figure 5-19
a) Three-Wall Obstruction, 1000 kW, 1.2 m b) No Obstruction, 1000 kW, 1.2 m

5.3.2 Obstruction Configuration

The same results presented in Figure 5-17 are presented once again in Figure 5-20; however, they are now grouped by the configuration of the obstruction used in the simulations.

Grouping the data by obstruction geometry does not point out any significant trends. This suggests that the geometry of an obstruction is not significant in terms of how the temperature rise is affected, but that simply the presence of an obstruction is influential.

However, some observations can be made from the results presented in Figure 5-20. It appears that the plume temperatures from the fires subjected to the three-wall obstruction are slightly closer to those of the unobstructed case when compared to the arch and flat plate geometries, which appear to have larger differences on average. The different performances are not considered to be statistically significant, and the ultimate information does not distinguish between the three configurations of the obstruction.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

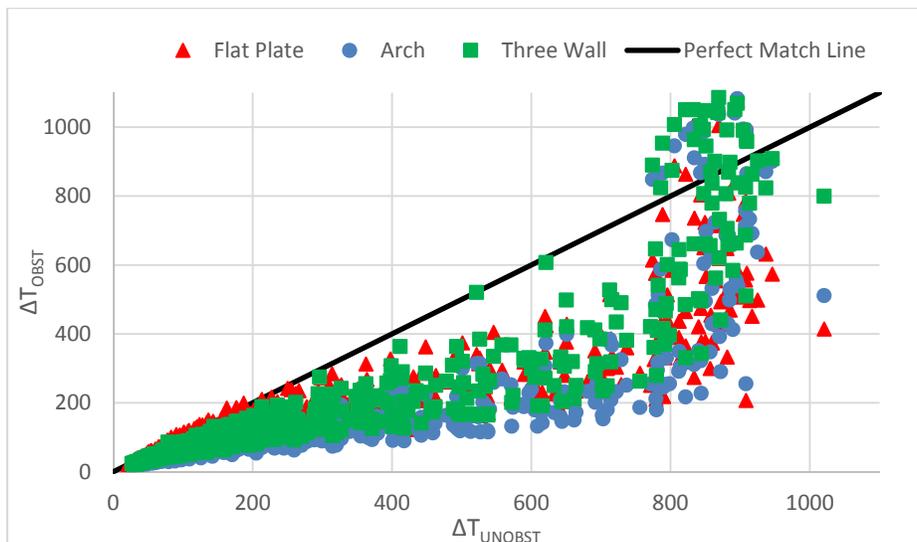


Figure 5-20
Unobstructed versus Obstructed Plume Temperatures – Different Geometries

In Figure 5-21, plume flows for the three different obstructions are presented for comparison with an unobstructed case. A comparison between Figure 5-21a and Figure 5-21d indicates that the flat plate obstruction has a tendency to increase the plume width at elevations around and above the obstruction. This causes an increased entrainment of fresh air into the plume and the observed reduced plume temperatures.

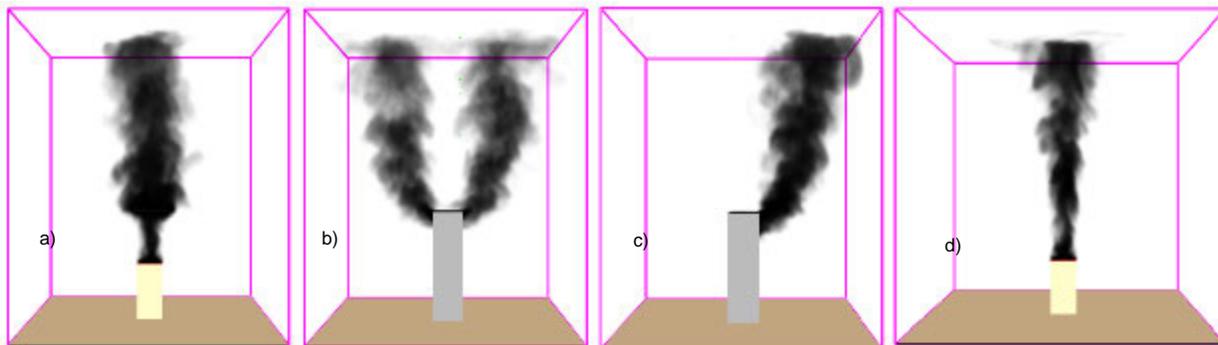


Figure 5-21
Plume Flows Subject to Different Obstruction Geometries: a) Flat Plate, b) Arch, c) Three-Wall, d) Unobstructed

As discussed in the previous section, the arch obstruction, Figure 5-21b, causes the plume to be split into two separate plumes directly above the obstruction. (It is possible for the two separate plumes to reconcile at higher elevations as shown in Figure 5-13. This split allows for an increased surface area with which fresh air can be entrained and the plume temperatures can be reduced.)

Plumes subject to the three-wall obstruction geometry (Figure 5-21c) are shifted off center when compared to the unobstructed geometry. Similar to the flows subject to the flat plate

obstruction, the three-wall obstruction appears to increase the plume width around and above the obstruction. This is likely the cause of the lower plume temperatures above the three-wall obstruction. In the previous section it was suggested that the three-wall obstruction geometry limits entrainment of fresh air at elevations below the top of the obstruction and that this entrainment likely increases the temperatures around and directly above the top. The competing effects of an increased entrainment from a larger plume area above the obstruction and the reduced entrainment within the obstruction are likely a reason temperatures above this obstruction are slightly higher than those of the other obstructions observed.

5.3.3 Fire Source Diameter

In Figure 5-22, the unobstructed and obstructed temperature comparisons are split into groups based on the different fire source diameters.

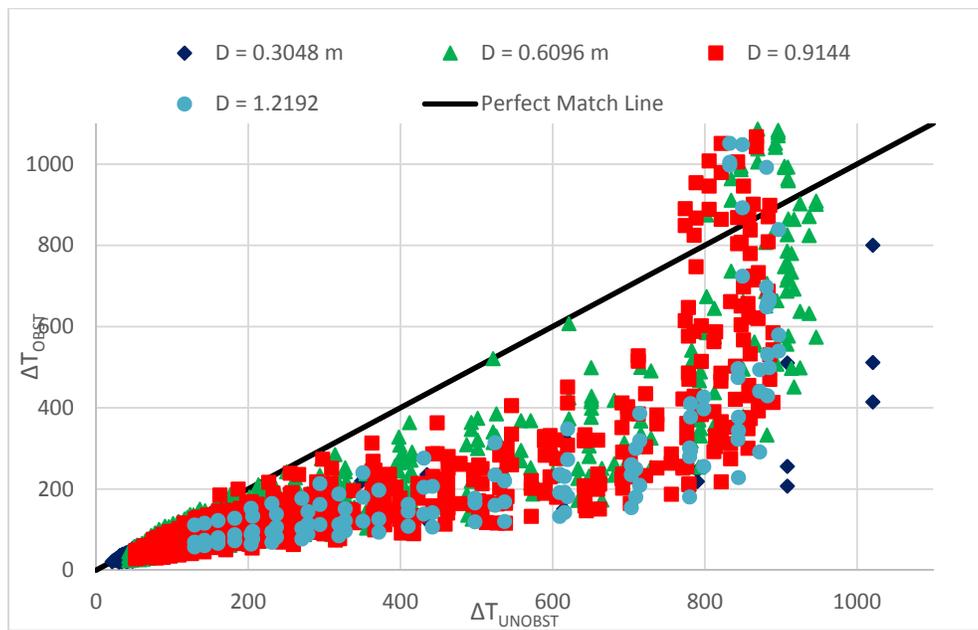


Figure 5-22
Unobstructed versus Obstructed Plume Temperatures – Different Fire Source Diameters

This grouping shows that, except at the lower ranges of plume temperature rises, only the larger diameter fires show instances of obstructed temperature rises greater than the unobstructed cases. Recalling the test matrix, the larger diameters allow for fires with larger HRRs, given the ranges on Q^* for NPP scenarios [18]. This likely contributes to the limited amount of fires with diameters of 0.3 m (1 ft) that produce temperatures near the flame temperature.

5.3.4 Heat Release Rate

In Figure 5-23 the unobstructed and obstructed temperature comparisons are split into groups based on the different heat release rates.

Grouping the comparisons by HRR, similar to the comparison of different obstruction geometries, no clear trend is seen. There is evidence of lower obstructed plume temperatures

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

from fires ranging from the lowest HRR used in this investigation of 50 kW to those of the largest with a HRR of 1000 kW. This shows that the presence of an obstruction and its effect on the plume temperatures is observable over a range of different HRRs. If any trend can be gleaned from the results grouped by HRR, it is that the results appear similar to those of the fire source diameter groupings presented in Figure 5-22 in which smaller fires are grouped at lower temperature and larger fires are capable of exceeding the unobstructed case in some configurations.

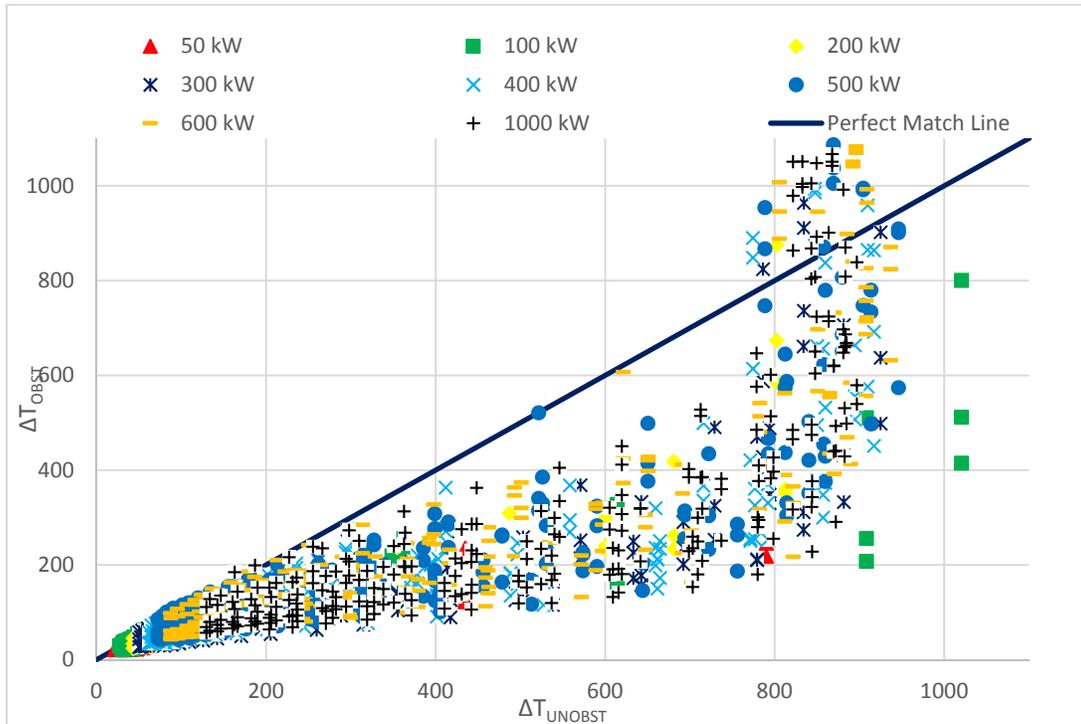


Figure 5-23
Unobstructed versus Obstructed Plume Temperatures – Different HRRs

5.3.5 Fire Source Elevation

In Figure 5-24 the simulations used in this investigation are grouped by the elevation of the fire source.

Grouping the data by fire source elevation brings insights as to the effect of an obstruction on plumes modeled in electrical enclosures. Following the 'one-foot rule,' current practice [16] recommends that if an enclosure is unvented, a fire should be assumed to be located at an elevation of one foot below the top of the enclosure. In Figure 5-24, it is clear that the fires located 0.3 m (1 ft.) above the ground demonstrate different behavior than either of the elevated fuel sources. The average behavior of these cases demonstrates lower temperatures, but the variability of the case suggests that it is possible that the fire performs similarly to an unobstructed case. A number of possibilities are considered to account for these observations. As already discussed, in some cases it is likely the obstruction causes a focusing of the plume

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

flow when compared to an unobstructed case. It is also possible that in some cases the walls at the edge of the simulation compartment cause a tilting of the plume flow such that the flow is not significantly affected by the presence of the obstruction and the natural variation in turbulent plume flow results in higher temperatures. This suggests that the information proposed in this investigation should not include fires at elevations less than half the height of the enclosure, as they behave similarly to fires in unobstructed configurations.

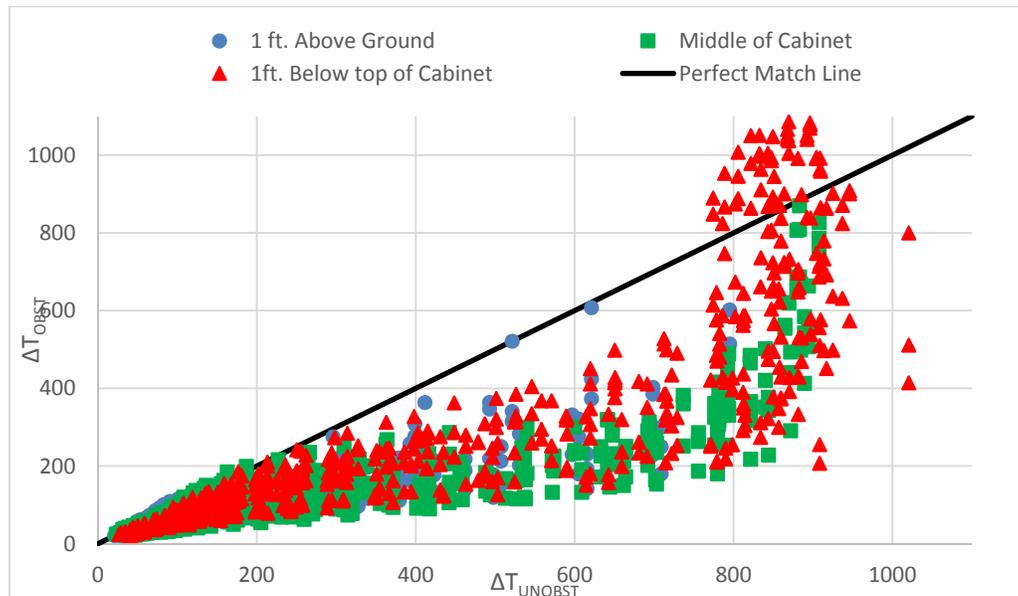


Figure 5-24
Unobstructed versus Obstructed Plume Temperatures – Different Fire Source Elevations

Additionally, current practice in NUREG/CR-6850, Supplement 1 [21] states that the location of the fire should be based on visual observation of the enclosure internals. However, this can be challenging if there are numerous cable bundles in different orientations or for cases in which a visual inspection of the enclosure internals is unavailable. In such cases, current information stipulates that fires are to be located 0.3 m (1 ft.) below the top of the enclosure, at the uppermost vent if the enclosure is vented, or at the highest location of any door or opening that may be expected to fail [21]. Therefore, given the observations that the fires located 0.3 m (1 ft.) above the ground are less likely to exhibit obstructed plume behavior and in keeping with current information, the results from simulations for fires located 0.3 m (1 ft.) above the ground are not included in the further analysis and information provided in this investigation.

5.3.6 Statistical Analysis

The results presented above indicate the necessity to define valid limits on the selection of temperature data for this analysis for determination of plume ZOI. As discussed above, temperatures within the flame region have been filtered out of the analysis. Temperatures within the flame height are typically not necessary in fire PRAs, in favor of more conservative treatments of damage (i.e., targets within the flame are damaged instantly). Since the maximum extent of the plume vertical ZOI always contains the flame height region, knowledge of the flame height is not necessary to develop a conservative treatment in the fire PRA.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

Furthermore, correlations such as that developed by Heskestad do not apply for temperatures very near the flames where near constant temperature rise is observed. This behavior effectively limits the data used in this analysis to temperatures less than approximately 800 °C (1472 °F).

Additionally, temperatures below 130 °C (266 °F) are below temperatures that are used for target damage in NPP applications (i.e., 205 °C (400 °F) and 330 °C (626 °F) for thermoplastic and thermoset cables, respectively, per NUREG/CR-6850 [4], Table 8-2). This temperature was chosen because it results in a negligible probability of causing damage for the 205°C (400 °F) limit using the bias (1.18) and normalized standard deviation (0.20) calculated for FDS [27]. A simple means of assessing the probability that a given prediction exceeds a threshold value due to model uncertainty is provided in NUREG-1934 [22]. This probability may be determined from the following equation:

$$P(x > x_c) = \frac{1}{2} \operatorname{erfc} \left(\frac{x_c - \mu}{\sigma \sqrt{2}} \right) \quad (5-14)$$

Where, P is the probability, x is a parameter value, x_c is a threshold parameter value, μ is the mean 'true' predicted value of the parameter, σ is the standard deviation of the model prediction for the parameter of interest, and the complementary error function is denoted by 'erfc'. The mean value is determined from the model bias as follows:

$$\mu = M/\delta \quad (5-15)$$

Where, M is the model prediction and δ is the model bias. The standard deviation is computed from the normalized standard deviation as follows [22]:

$$\sigma = \tilde{\sigma}_M(M/\delta) \quad (5-16)$$

Where, $\tilde{\sigma}_M$ is the normalized standard deviation.

The model bias and normalized standard deviation for FDS, Version 6 are as follows [27]:

- Plume Temperature (model bias): 1.18
- Plume Temperature (normalized standard deviation): 0.20

Following the procedures above, a model temperature prediction of 130 °C (266 °F) would result in a 0.00006% chance of causing damage to a target with a 205 °C (400 °F) critical temperature, due to model uncertainty.

5.3.7 Summary of Results

Recall that in the discussion of plume scaling theory in Section 5.2.2.1, a proportionality constant (A) was defined in Equation 5-2 (shown below again) as characterizing the ratio of plume temperature rise to a functional group made up of the fire HRR, and the distance from the fire's virtual origin:

$$A \approx \frac{\Delta T_m}{\dot{Q}^{2/3}(z-z_0)^{-5/3}} \quad (5-17)$$

Further, Beyler [24] noted that the values reported by various investigators ranged from 21.6 to 29.7. The average proportionality constant recommended by Beyler [24] is 26.0, and the corresponding value determined for the flat plate, arch, and three-wall obstructions are 16.6, 10.9, and 16.2, respectively. The fact that the values for obstructed plumes are lower than those reported for unobstructed plumes reflects the observation that the obstructions cause lower fire plume temperatures than would be observed for an unobstructed plume given the same fire HRR and elevation above the fire source.

The relative magnitude of these three values is also interesting. The lowest value, indicating the most significant effect relative to reducing plume temperatures, is associated with the arch configuration. This likely reflects the fact that the arch splits the plume into two parts that may not re-form over the obstruction, leading to enhanced entrainment as noted earlier. The highest value, indicating the least significant temperature reducing effect, is associated with the flat plate. In this case, the plume is disrupted, but re-forms into a single plume directly above the obstruction. As a result, the impact on temperature is reduced somewhat compared to the other cases. The three-wall configuration falls between the other two cases. With the three-wall obstruction a single plume is maintained, but that plume is diverted sharply sideways before regaining upward momentum. Some minor differences have been observed between the three different obstruction geometries. However, based on subsequent detailed statistical analysis in Section 5.3.7.1, the three configurations are recommended to be treated equivalently.

In Figure 5-25 the temperature rise above an obstruction predicted using the average proportionality constant for all three cases is plotted against elevation “z” (see Section 5.2.2.1 above the source normalized by the characteristic fire diameter, D^* , is presented. For comparison, the temperature rise predicted using the suggested proportionality constant of 26 by Beyler is included in Figure 5-25. These predictions are made using a representative case evaluated in this investigation: a HRR of 600 kW, a fire source diameter of 0.6 m, an ambient temperature of 20 °C (68 °F), and a radiative fraction of 0.3.

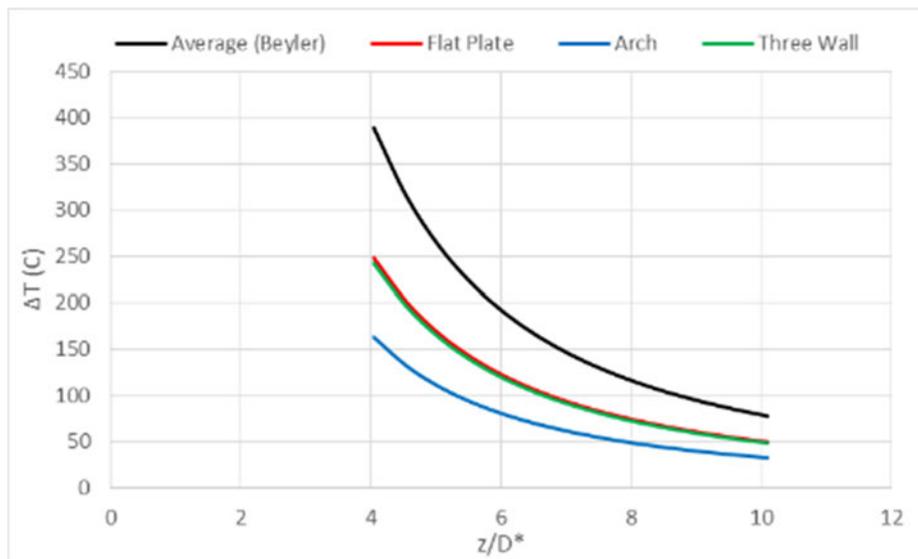


Figure 5-25
Obstruction Effect on Plume Proportionality Constant, Different Geometries

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

The same exercise is performed using the estimated modified average proportionality constants for fires subject to an obstruction. The results from the unobstructed FDS temperature data produce a proportionality constant of 29.8, which is similar to the maximum range reported by Beyler [24]. Again, the average proportionality constant recommended by Beyler [24] of 26.0 is included in Figure 5-26. The results from the obstructed FDS temperature data produce a proportionality constant of 15.8, which is notably smaller than the range reported by Beyler [24].

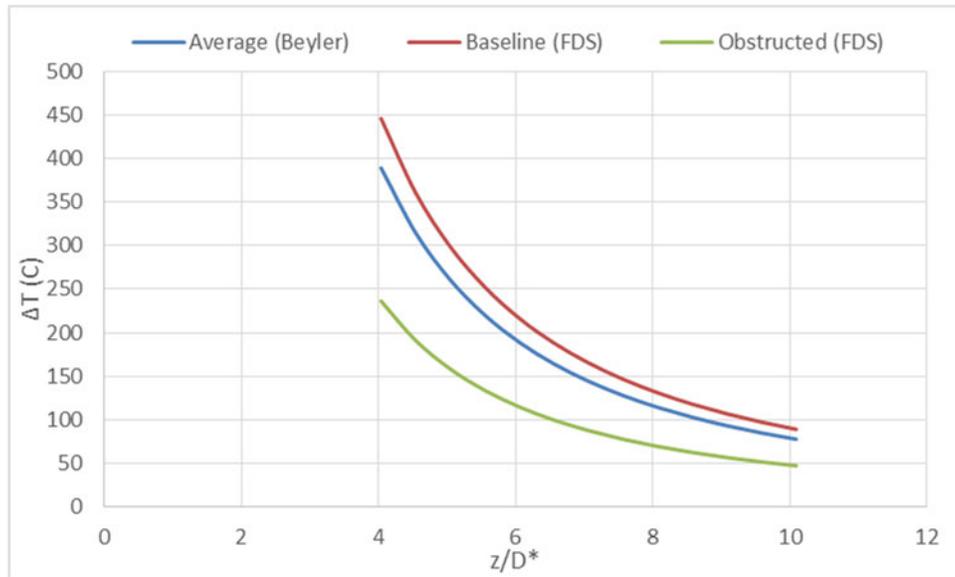


Figure 5-26
Obstruction Effect on Plume Proportionality Constant

The lower temperature rise predictions for the obstructed case is evidence that the obstructions are reducing the plume temperatures above an obstruction.

Figure 5-25 and Figure 5-26 demonstrate that the observed results for obstructed plumes can dramatically decrease plume temperatures and reduce the corresponding vertical ZOI for these fires using this approach.

5.3.7.1 Bias and Uncertainty

For the use of the results presented in this investigation with the Heskestad fire plume correlation in probabilistic analyses, model bias and uncertainty statistics for the plume temperature rise are provided in Table 5-2. The statistics provided were determined following the methods outlined in the FDS user's guide [29] and described in Section 5.2.4.5. Table E-3 in Appendix E presents the FDS results for this evaluation.

Results from FDS simulations indicate slightly different performance between the geometric configurations. However, there is insufficient evidence to support splitting the bias correction into three categories. Each of the three configurations have statically overlapping confidence intervals; therefore, a single value is appropriate.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

The bias of 0.62 estimated by a comparison of the temperature rise measured above an obstruction in the simulations to those estimated by the Heskestad fire plume correlation is the bias to be used when estimating obstructed plume temperatures using Equation 5-6 and the vertical plume ZOI. Examples of how to apply this bias and determine the change in the plume temperature rise and the vertical ZOI for a fire subject to an obstruction are presented in following section.

Table 5-2
Bias and Uncertainty of Obstructed and Unobstructed Plume Temperature Rise

Comparison	Bias	Model Uncertainty	Experimental Uncertainty [33]
Obstructed versus Unobstructed	0.54	0.32*	0.20
Unobstructed versus Heskestad	1.17	0.14	0.20
Obstructed versus Heskestad	0.62	0.28*	0.20

*Note: Observing the results presented in Figure 5-26 and Figure 5-28, the actual scatter in the data supports an estimated model uncertainty closer to 20%.

In Figure 5-27, a comparison of the bias and uncertainty results is presented with the obstructed and unobstructed plume temperature comparison results. This comparison is used to demonstrate that the two configurations demonstrate different performance and that this difference is sufficient to warrant enhanced treatment. The bias shows a clear tendency of the plume temperature rise from a fire subject to an obstruction to be lower than the unobstructed case by around 46%, which is considered significant.

In Figure 5-28, results from simulations without obstructions are compared with the plume temperature rise predicted when using the Heskestad fire plume correlation. This comparison is used to demonstrate that both FDS and the Heskestad fire plume correlation produce similar results when used to predict identical configurations. The figure shows similarity between the FDS simulations and the Heskestad fire plume correlation. There is a slight tendency for the FDS simulated results to be higher than those predicted by the Heskestad fire plume correlation with a bias of 1.17; however, the difference between the two models is considered to be acceptable and is similar to reported values for the performance of FDS [27].

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

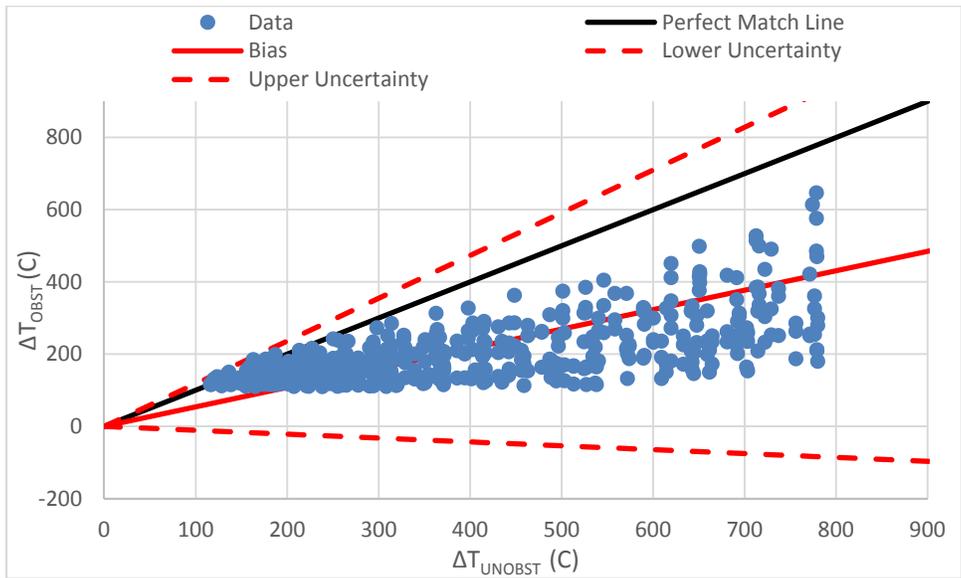


Figure 5-27
Unobstructed versus Obstructed Plume Temperatures – Bias and Uncertainty

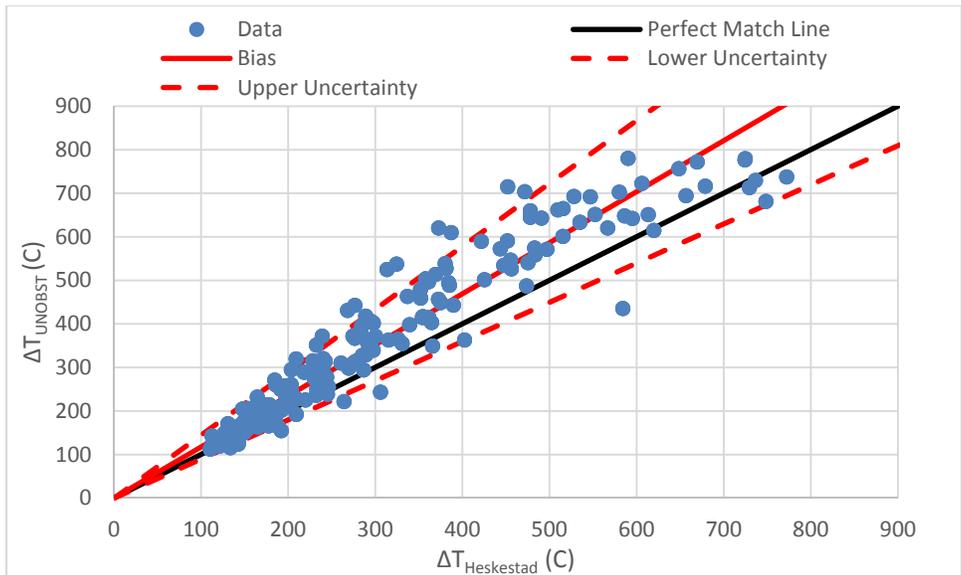


Figure 5-28
Heskestad versus Unobstructed Plume Temperatures – Bias and Uncertainty

When the plume temperature rise results for the simulations with obstructions are compared with the Heskestad fire plume correlation a difference is clear. In Figure 5-29, the obstructed fire plume temperature rise results are compared with the Heskestad fire plume correlation. The results show a clear estimation of lower temperatures for fires subject to obstructions. This suggests that in using the Heskestad fire plume correlation without accounting for obstruction cooling, fire plume temperatures are being over-estimated. The bias estimated when comparing

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

the obstructed plume temperature rise to those estimated by the Heskestad fire plume correlation is 0.62.

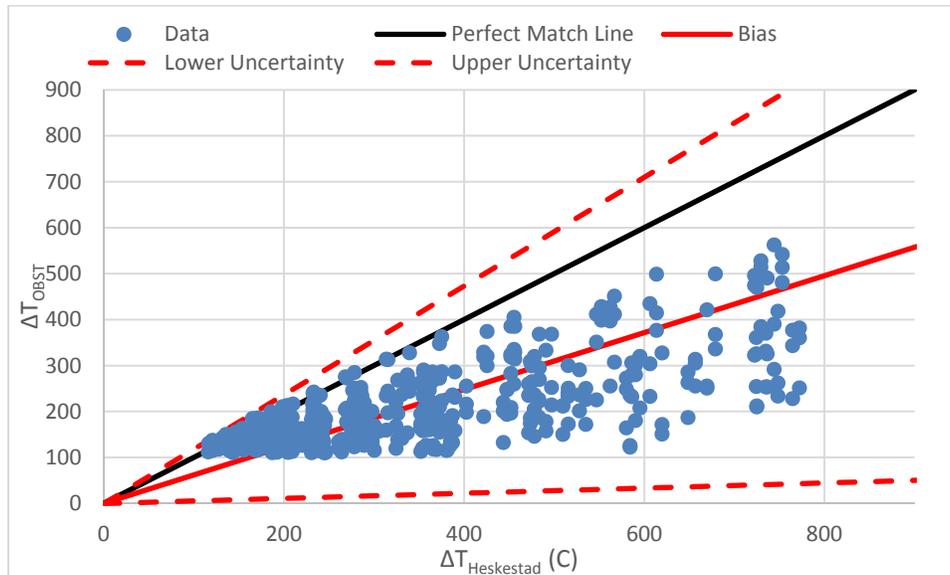


Figure 5-29
Heskestad versus Obstructed Plume Temperatures – Bias and Uncertainty

Results and evidence gathered from this investigation have potential to influence ZOI damage applications for NPP scenarios.

5.3.7.2 Sensitivity to Center Openings on the Obstruction

A number of simulations are performed with openings of varying sizes in the top of the obstruction. The opening is described as single opening in the center of the obstruction, as this is considered to be a conservative representation of distributed openings or penetrations that would be characteristic in NPPs. Due to the selected FDS grid resolution, the opening sizes used in this analysis ranged from 6.5% to 14% of the total top surface area, in order to align with the grid. The temperature rise above the obstruction using the different openings was compared to the temperature rise above unobstructed fires. The FDS results for this evaluation are presented in Table E-4 of Appendix E.

Opening percentages are dependent on the grid size and the source diameter of the simulations. Openings of sizes around 10% were selected to determine the effect of an opening on the plume temperatures above an obstruction. Two HRRs, 200 kW and 600 kW, were also used in these simulations to determine if changes caused by an opening were sensitive to changes in the HRR. The effect of an opening on the plume temperature above an obstruction does not appear to be sensitive to changes in the HRR.

The resulting biases presented in Table 5-3 show that openings of around 6.5% result in a fire plume temperature rise bias of 0.68, which differs from the obstructed bias of 0.54. As the cabinet open percentage increases to 12-14% of the total cabinet top area, the bias increases to 0.77, which is a noticeable departure from 0.54. These differences are considered sufficient to

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

warrant an additional limit of applicability. Based on an interpolation of the evidence, a 5% opening would result in an approximate bias difference of less than 15% when compared to the obstructed cases with no openings. In practice, a change in the exposure of less than 15% is considered insensitive to the parameter variation relative to the uncertainty of the overall fire PRA. A 15% percent threshold is selected based on the uncertainty in the measurement of the HRR parameter [34], which reportedly ranges from 17% to 23%. Because the HRR is a primary input and the value is set based on information provided in Section 4 of this report, the output resolution is selected to be consistent with the uncertainty in the input. Therefore, the information provided in this investigation is applicable for enclosures with openings up to 5% of the total top surface area. Any enclosure with cumulative openings in the top greater than 5% should be treated as an unobstructed geometry. An enclosure top may have penetrations, but as long as those penetrations are properly sealed those penetrations do not contribute to the cumulative opening area. Properly sealed openings include cable inside steel conduit, cable trays with solid steel top and bottom covers, electrical raceway fire barrier systems (ERFBSs) and penetrations sealed with approved non-combustible materials. Any opening that may allow airflow through the top of the enclosure should be considered in the 5% cumulative opening fraction, including all penetrations which cannot be clearly observed as well sealed.

Table 5-3
Bias and Uncertainty of Obstructed (with Center Opening) and Unobstructed Plume Temperature Rise

Comparison	Bias	Model Uncertainty	Experimental Uncertainty [33]
Obstructed versus Unobstructed	0.54	0.32	0.20
Opening (6.5%) versus Unobstructed	0.68	0.14	0.20
Opening (12-14%) versus Unobstructed	0.77	0.17	0.20

5.3.7.3 Sensitivity to Fire Orientation

A number of simulations were performed with fires oriented vertically (See Figure 5-30). In these simulations the fire source originates at the floor of the simulation compartment and reaches to an elevation of 1.96 m (6.4 ft.), approximately 0.3 m (1 ft.) below the top of the obstruction. In configuration a), fuel is released on all sides and across the full height of the column shaped fire source to simulate the effect of distributed combustible materials in the center of the enclosure. In configuration b), fuel is released on all interior surfaces of the electrical enclosure to simulate the effect of combustible materials mounted solely to the walls of the enclosure. The simulations using the vertical fire source are compared to the simulations with horizontal fire sources at different elevations used to develop the information presented in this report. Table E-5 of Appendix E presents the FDS results for this sensitivity evaluation.

Comparing the different simulations, the vertical fire source plume temperatures are very similar to those of a horizontal fire source with an elevation located in the center of the enclosure. Plume temperatures from simulations using horizontal fire sources located 0.3 m (1 ft.) below the top of the obstruction are found to be more conservative than those observed in the vertical fire source simulations. This suggests that assuming a horizontal fire source located 0.3 m (1 ft.) below the top of the obstruction results in a conservative analysis when compared to simulating a vertical fire source.

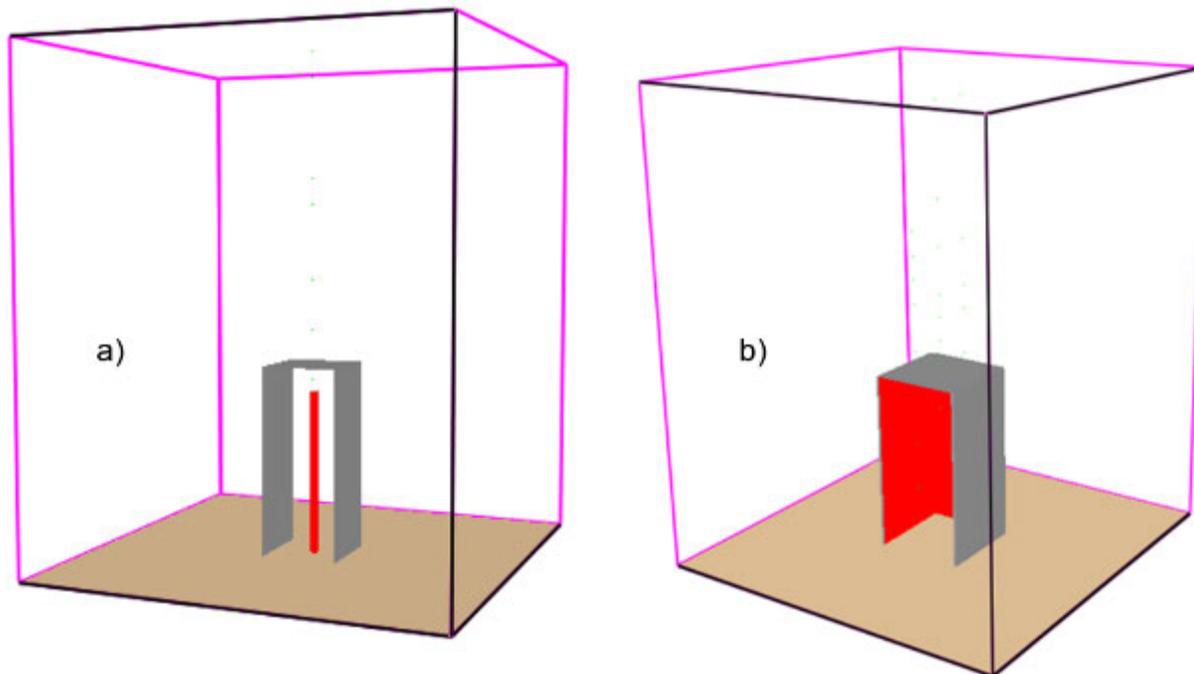


Figure 5-30
a) Vertically Oriented Fire Source, b) Fire Source Located Along the Cabinet Wall Surfaces

The opposite is found when comparing the vertical fire source plume temperatures with a horizontal fire source located 0.3 m (1 ft.) from the ground. In this comparison, the plume temperatures from the vertical fire source often exceed those of the horizontal source, resulting in a non-conservative comparison. As discussed in Section 6.4, the information following this investigation does not apply to fires located at elevations lower than the mid height of the enclosure. Therefore, a vertically oriented fire source can be conservatively represented by a horizontal fire source applied within the limits of implementation, and no additional restrictions are required.

5.3.7.4 Sensitivity to Obstructions with a Soffit

A number of simulations were performed using top obstructions equipped with a vertical soffit (see Figure 5-31). In these simulations the soffit is specified to extend 12 cm (6 in) below the top obstruction. This configuration is intended to simulate the possible effect of the soffit to change the thermal plume dynamics. Primarily, the soffit has the effect of reducing the horizontal extent of the plume observed in Figure 5-21 for some configurations.

Comparing the different simulations, the results of the top surface with a soffit are very similar to those of the flat top surface considered as the basis of this report. Plume temperature predictions of the soffit sensitivity cases are plotted with the original results in Figure 5-32. The results of the soffit obstructions fall within the existing scatter of data, or may fall below the existing data. This indicates that the existing approach for defining the bias and uncertainty will conservatively bound the effects of the soffit.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

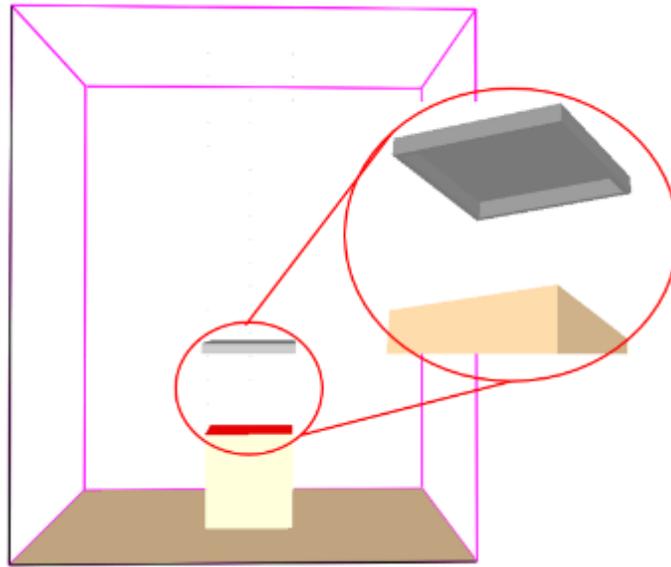


Figure 5-31
Top Obstruction with a Soffit

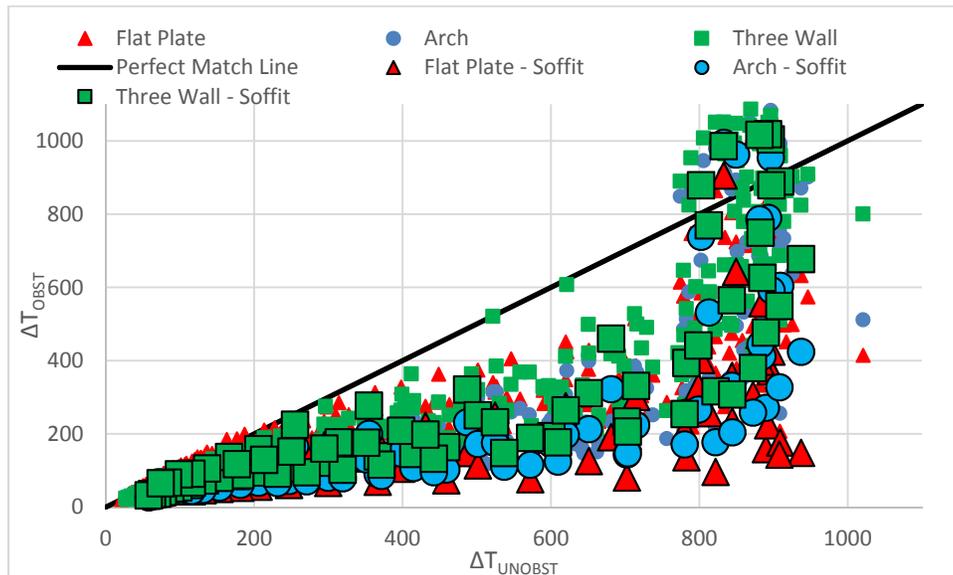


Figure 5-32
Unobstructed vs. Obstructed Plume Temperatures – Soffit Sensitivity

5.3.7.5 Sensitivity to Thickness of Steel Enclosure

A number of simulations were performed using top obstructions with various specified material thicknesses. The default material thickness used in this study is 0.0015 m, and the sensitivity cases consider effects of thicknesses of 0.001 m and 0.01 m. These configurations are

intended to simulate the possible effect of the material thickness to alter the plume temperatures through surface heat transfer effects.

Comparing the different simulations, the results of varying the thickness of the top surface are very similar to those of the default thickness considered as the basis of this report. Plume temperature predictions of the sensitivity cases are plotted with the original results in Figure 5-33. The results of the sensitivity cases fall within the existing scatter of data. This indicates that the existing approach for defining the bias and uncertainty can accurately predict the effects of various top obstruction thicknesses between 0.001 m and 0.01 m.

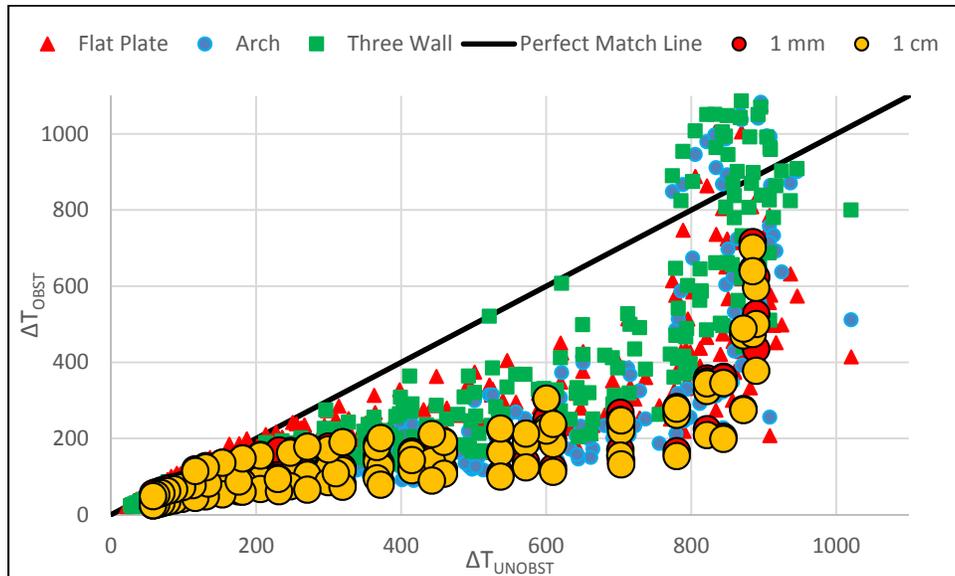


Figure 5-33
Unobstructed vs. Obstructed Plume Temperatures – Enclosure Thickness Sensitivity

5.3.8 Horizontal Zone of Influence

A horizontal ZOI may be defined for any ignition source defined in the fire PRA. This zone of influence is designed to determine the targets that may be damaged by thermal radiation exposure from the ignition source. While evaluating the obstructed plume temperatures, it was observed that a substantial horizontal component of the plume shift may occur. This section will quantify the observed horizontal shift of the obstructed plume, and compare the observed shift to existing methods of quantifying the extent of the horizontal ZOI.

5.3.8.1 Existing Definition of Horizontal ZOI

There are a number of existing methods to determine the horizontal zone of influence associated with an electrical enclosure fire. This section will not attempt to define all potential approaches that are validated for defining the horizontal ZOI, but will focus on the simplest and most common method in application. The Fire Protection Significance Determination Process (SDP) [23] defines the ZOI as the “ball and column” approach illustrated in Figure 5-34. Here, the radius, R , of the ball portion is defined as the critical radial distance that the ignition source may produce thermal radiation damage to an electrical target (e.g., cables). The height, H , of the column portion is defined as the critical vertical distance that the ignition source may

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

produce thermal plume damage to an electrical target. The union of these two damage zones is typically evaluated as a cylindrical volume with a radius, R , and a height, H , inside which all electrical targets will be damaged given the occurrence of a 98th percentile fire size in the ignition source.

The height of the cylinder can be defined exactly using Equation 5-3 for the unobstructed plume or Equation 5-6 for the obstructed plume with the appropriate selection of the model bias. The radius of the cylinder can be defined in a number of ways, but the simplest is the Point Source Model (PSM, Equation 5-18) defined in NUREG-1805, Supplement 1.

$$r = \sqrt{\frac{X_r \dot{Q}}{4\pi \dot{q}''}} \quad (5-18)$$

Where r (m) is the radial distance from the source location, X_r (-) is the radiative fraction, \dot{Q} (kW) is the HRR, and \dot{q}'' (kW/m²) is the radiative damage heat flux. Note that the guidance in NUREG/CR-6850 Supplement 1 suggests that the source location of the fire for an electrical enclosure should be treated as the edge of the enclosure to account for burning at the vent. Tables of the dimensions of the ZOI can be calculated for many different heat release rate and target thermal property combinations, examples of which are provided in NUREG/CR-6850, Table F-2 and the Fire Protection SDP, Table 2.3.2. The distance from the center of the electrical enclosure to the edge of the ZOI is then defined as:

$$R_{Rad} = r + \frac{W}{2} = \sqrt{\frac{X_r \dot{Q}}{4\pi \dot{q}''}} + \frac{W}{2} \quad (5-19)$$

Where R_{Rad} is an appropriate metric to compare the horizontal extent of the ZOI produced by the shifted plume associated with the obstructed plume simulations.

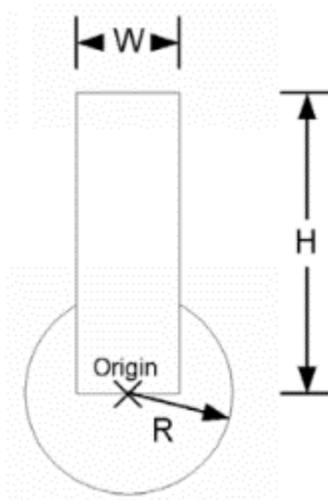


Figure 5-34
SDP Ball and Column

W: The diameter of the ignition source (m)
R: Critical the radial distance (heat flux) (m)
H: Critical distance for plume heights (m)

5.3.8.2 Horizontal Plume Shift ZOI

The obstructed plume simulation results demonstrated horizontal shifts of the plume centerline. This shift has the potential to expand the horizontal zone of influence associated with the ignition source. This effect is visualized in Figure 5-35, where the arch and three-wall obstructions produce clear horizontal shifts of the plume. The location of the plume centerline can be evaluated directly from the FDS slice file results in parallel with the determination of the peak centerline plume temperature as described in Section 5.2.3.7. This approach is visualized in Figure 5-36, and the location of the peak plume temperature relative to the center of the electrical enclosure is defined as R_{PO} (m). This metric allows for an immediate comparison of the plume shift to the thermal radiation ZOI.

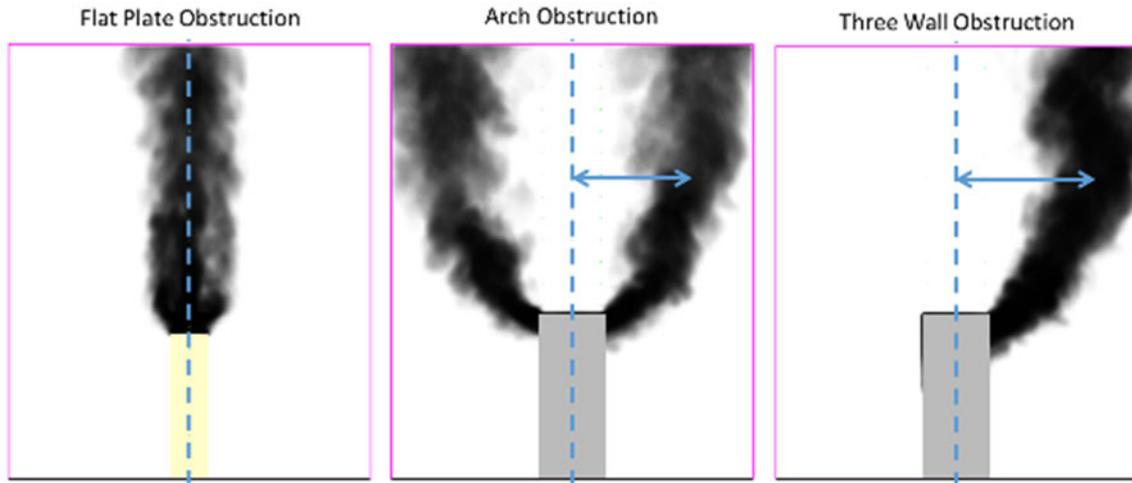


Figure 5-35
Obstruction Plume Shift

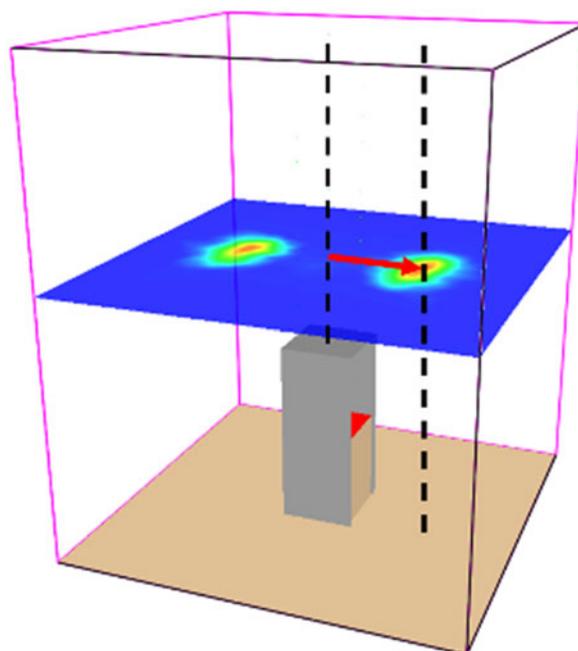


Figure 5-36
Determination of Horizontal Plume Shift

Comparison of the FDS simulation predictions of horizontal plume shift to the results determined for the PSM using Equation 5-19 are provided in Figure 5-37. The values for the distance that the plume has shifted from the centerline of the electrical enclosure are provided on the y-axis, and the values for the distance from the centerline of the horizontal thermal radiation ZOI are provided on the x-axis. The results show that for all cases, the thermal radiation ZOI extends farther than the plume will be shifted by the top obstruction. The data circled above the perfect match line in Figure 5-37 are all less than 200 °C (392 °C). These data correspond to locations that are above the plume ZOI for thermoset targets.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

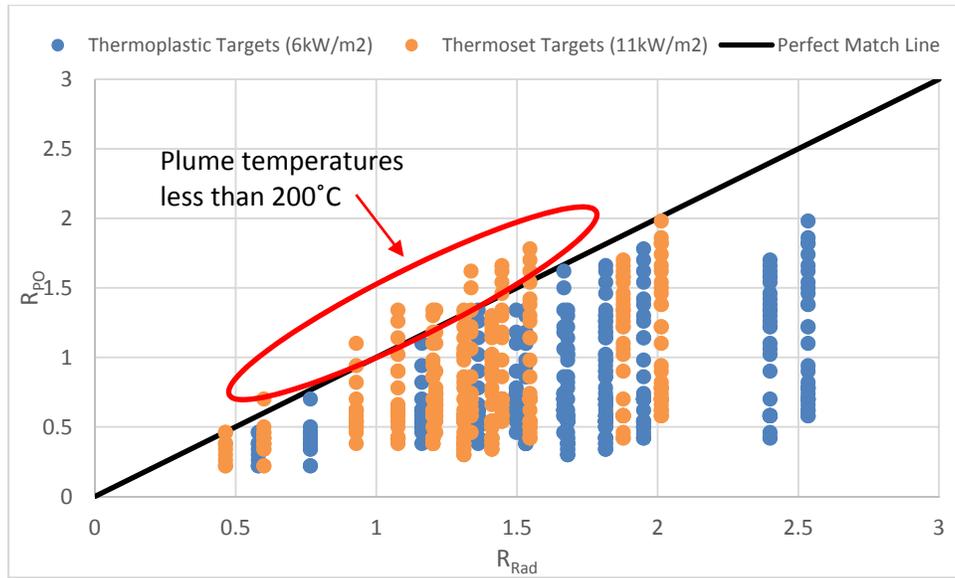


Figure 5-37
Comparison of Horizontal ZOI Resulting from Plume Shift to Thermal Radiation Exposure

A different way to quantify the plume shift is a similar approach to that taken in Volume 1 of NUREG/CR-7010 [14], in which the ignition of cable trays within a stack can be defined as an inverted frustum (trapezoid) with an angle of expansion of 35° with height. Here, the rate of expansion of the plume is defined in a similar way, where the base of the frustum is defined as the fire base height with dimensions equivalent to the plan dimensions of the electrical enclosure. Analyzing the data in Figure 5-37 using this approach, it can be found that the maximum angle observed from any FDS simulation of an obstructed plume is 28° from the vertical. In application, this angle can be treated as 30° for simplicity and conservatism. The illustration of the maximum extent of a thermal plume ZOI using this approach is provided in Figure 5-38.

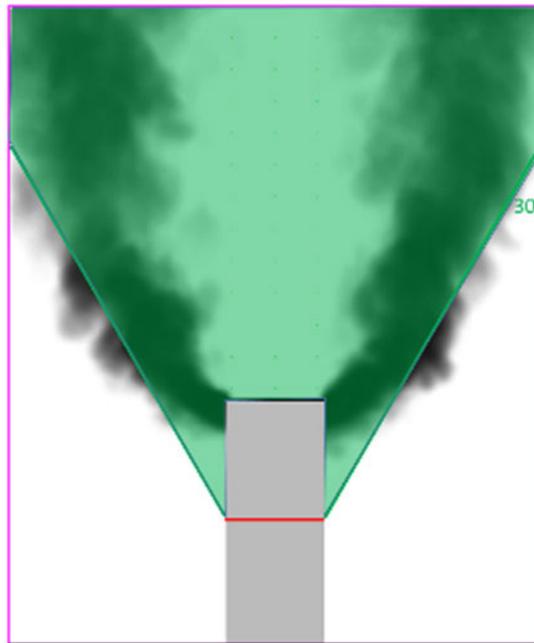


Figure 5-38
Maximum Angle from Horizontal Plume Shift

5.3.8.3 Recommendations

The findings from the FDS simulations demonstrate the following guidance can be applied to electrical enclosure fires that can be credited as having a solid top obstruction.

- The overall zone of influence should be defined using the ball and column concept introduced in the SDP [23] and described in NUREG/CR-6850 [4], resulting in a cylindrical shape that incorporates the vertical extent of the plume and the horizontal extent of the thermal radiation from the fire source.
- The height of the column should be defined by Equation 5-6 for configurations in which the obstructed plume credit is applicable. In all other cases where the obstructed plume cannot be justified, existing methods should be used corresponding to unobstructed plume temperature correlations.
- The width of the column should be defined using approved techniques for defining the horizontal extent of the thermal radiation from the source and the damage threshold of the most susceptible targets. The obstructed plume should not be credited for reducing the extent of the horizontal ZOI at this time. The width defined in this manner (i.e., using flame radiation models) will always bound the expected horizontal shift of the thermal plume due to the electrical enclosure top obstruction.
- In specific applications where the location of the fire plume is of direct interest to the analysis, the plume location can be defined to fall within an inverted frustum (trapezoid). The base should be defined at the fire base height with plan dimensions equivalent to the electrical enclosure. At elevations higher than the fire base height, the volume should expand with an angle of 30° relative to the vertical. The plume has been observed to always be located within this volume, regardless of the nature of the fuel source or electrical enclosure geometry.

CORRELATION OF OBSTRUCTED PLUME MODELS WITH HESKESTAD PLUME PREDICTIONS

The maximum extent of the ZOI is summarized in Figure 5-39 for both the unobstructed and obstructed plume cases.

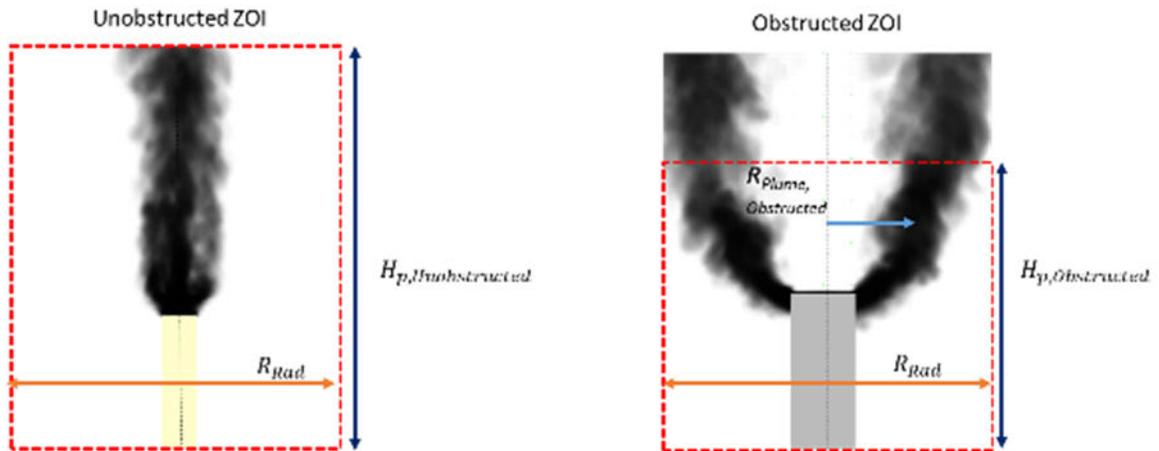


Figure 5-39
Recommended ZOI for an Electrical Enclosure Fire a) Without Top Obstruction Credit,
and b) with Top Obstruction Credit

6

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

This section presents the methodology and the development of an adjustment for the vertical thermal zone of influence (ZOI) for enclosure fires based on the Fire Dynamics Simulator (FDS) results presented in Section 5.

6.1 Assessment of FDS Simulation Results

The results presented in Section 5 have shown that for cases in which the fire plume flow is obstructed by different geometries, plume temperatures are often reduced above the obstruction. These reduced temperatures do not appear to be limited to a specific obstruction geometry, heat release rate (HRR), or fire source diameter. The results have been shown to be sensitive to some input parameters, and limits of implementation have been provided in Section 6.4, as appropriate. As a result, the vertical ZOI may be modified using the same approach independent of specific obstruction geometry, HRR, or fire source diameter provided the analyst applies the methodology with consideration for all of the assumptions and limitations provided in Section 5.1.

The height above the fire base, Z_B , with an obstruction present for which temperatures are high enough to cause damage can be determined through an algebraic modification of the Heskestad fire plume correlation shown below as:

$$Z_B = \left(\frac{B \cdot 9.1 \left[\frac{T_0}{(g c_p^2 \rho_0^2)} \right]^{1/3} \dot{Q}_c^{2/3}}{\Delta T} \right)^{3/5} + Z_0 \quad (6-1)$$

Where, B is the bias observed in the comparison between the plume temperature rise of flows subject to an obstruction and those predicted by the Heskestad fire plume correlation. Equation 6-1 can be used directly to determine the maximum extent of the thermal plume ZOI for fire probabilistic risk assessment (PRA) applications. The bias indicates the extent to which a model, on average, under- or over-predicts the measurements of a given quantity [22].

6.2 Prediction of ZOI Correction

6.2.1 Temperature Rise (Example 1)

Using the values presented in Figure F-3 of NUREG/CR-6850 [4] (Appendix F, page F-6), predict the exposure temperature for a fire using the existing information for unobstructed plumes, and the updated information for obstructed plumes.

The required inputs from Figure F-3 of NUREG 6850/CR-6850 [4] (Appendix F, page F-6) are HRR of 211 kW, fire diameter of 0.6 m (2 ft), radiative fraction of 0.4, and an assumed ambient

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

temperature of 20 °C (68 °F). Equation 5-3 (shown again below) was used to predict the plume centerline temperature for the unobstructed plume.

$$\Delta T = 9.1 \left[\frac{T_0}{(g c_p^2 \rho_0^2)} \right]^{1/3} \dot{Q}_c^{2/3} (z - z_0)^{-5/3} \quad (6-2)$$

Equation 5-6 (shown again below), with a bias, $B = 0.62$, was used to predict the plume centerline temperature for a plume obstructed by the enclosure top.

$$\Delta T = B \left(9.1 \left[\frac{T_0}{(g c_p^2 \rho_0^2)} \right]^{1/3} \right) \dot{Q}_c^{2/3} (z - z_0)^{-5/3} \quad (6-3)$$

The results were plotted with both temperature predictions versus the height above the fire base as illustrated in Figure 6-1, demonstrating a dramatic reduction in plume centerline temperature predictions for the obstructed plume relative to the unobstructed plume.

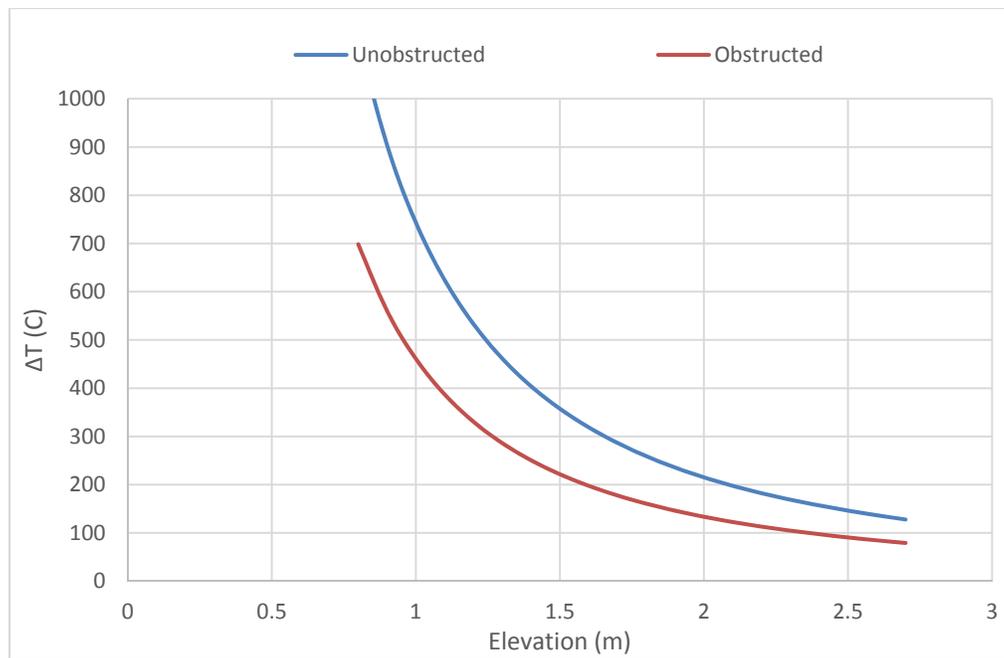


Figure 6-1
Unobstructed and Obstructed Temperature Predictions

6.2.2 Zone of Influence (Example 2)

Once again using the values presented in Figure F-3 of NUREG/CR-6850 [4] (Appendix F, page F-6), predict the maximum thermal plume ZOI height for a fire using the existing information for unobstructed plumes, and the updated information for obstructed plumes.

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

The required inputs from Figure F-3 of NUREG/CR-6850 [4] (Appendix F, page F-6) are HRR of 211 kW, fire diameter of 0.6 m (2 ft), radiative fraction of 0.4, and an assumed ambient temperature of 20 °C (68 °F). No information is provided for the target failure properties; therefore, both thermoset (330 °C (626 °F)) and thermoplastic (205 °C (400 °F)) cables are evaluated.

Use Equation 6-1 with a bias, $B = 1.0$, for the unobstructed plume case to evaluate the vertical plume ZOI elevation. Use the same HRR, fire diameter, assumed radiative fraction, and a bias of 0.62 to evaluate the vertical plume ZOI elevation for an obstructed plume. The results of this analysis are provided in Table 6-1, demonstrating a dramatic reduction in plume centerline temperature predictions. Visual representations of the changes in the vertical ZOI for obstructed plumes are presented in Figure 6-2.

Table 6-1
Example 2 ZOI Calculations

Target Type	Configuration	Bias	Heat Release Rate (kW)	Fire Diameter (m)	Radiative Fraction	Ambient Temperature (°C)	ZOI Height (m)
Thermoplastic (205°C)	Unobstructed	1.0	211	0.6	0.4	20	2.2
	Obstructed	0.62	211	0.6	0.4	20	1.7
Thermoset (330°C)	Unobstructed	1.0	211	0.6	0.4	20	1.6
	Obstructed	0.62	211	0.6	0.4	20	1.3

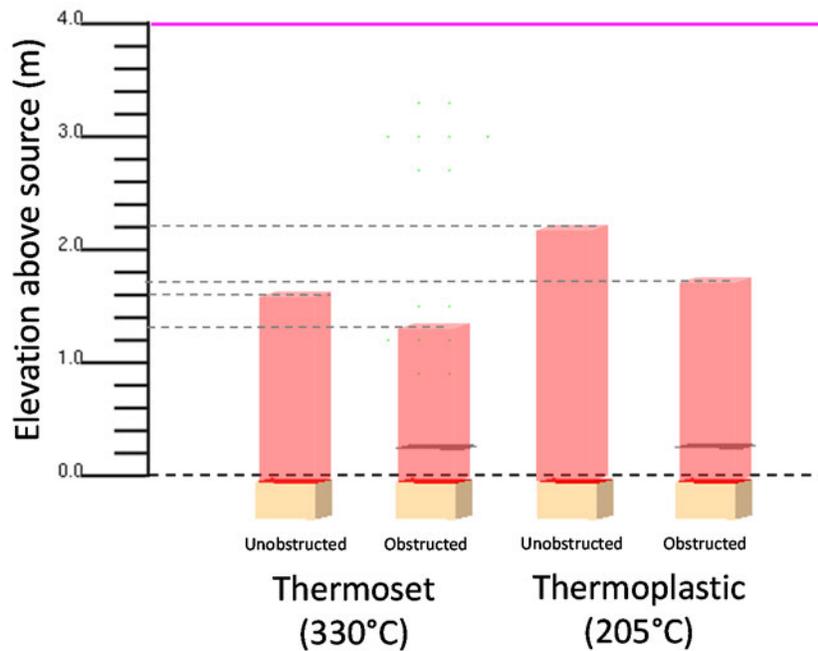


Figure 6-2
Vertical Plume ZOI

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

Comparing these results shows a reduction in the vertical plume ZOI elevation when crediting the obstruction for reducing the plume centerline temperature.

6.2.3 Zone of Influence Sensitivity (Example 3)

Evaluate the overall sensitivity of the ZOI for an obstructed plume relative to an unobstructed plume.

Evaluate the ratio of Equation 6-1 to the Heskestad fire correlation (Equation 6-3) solved for z , (i.e., Equation 6-1 with $B = 1.0$). This evaluation shows the change in the ZOI elevation when a plume flow is subject to an obstruction relative to an unobstructed plume as:

$$\frac{z_B}{z} \sim B^{\frac{3}{5}} = 0.62^{\frac{3}{5}} = 0.75 \quad (6-4)$$

The result in Equation 6-4 shows that the ZOI dimension of an obstructed plume is approximately 75% relative to the size of the initial ZOI evaluated using the Heskestad correlation.

Alternatively, it is appropriate to evaluate several specific configurations and show the difference between the two approaches graphically. The results of this analysis are obtained by solving Equation 6-1 for each of the fire configurations used in this analysis. The results of this analysis are provided in Figure 6-3, showing the difference in the vertical ZOI elevations at which fire plume temperatures are estimated to cause damage to

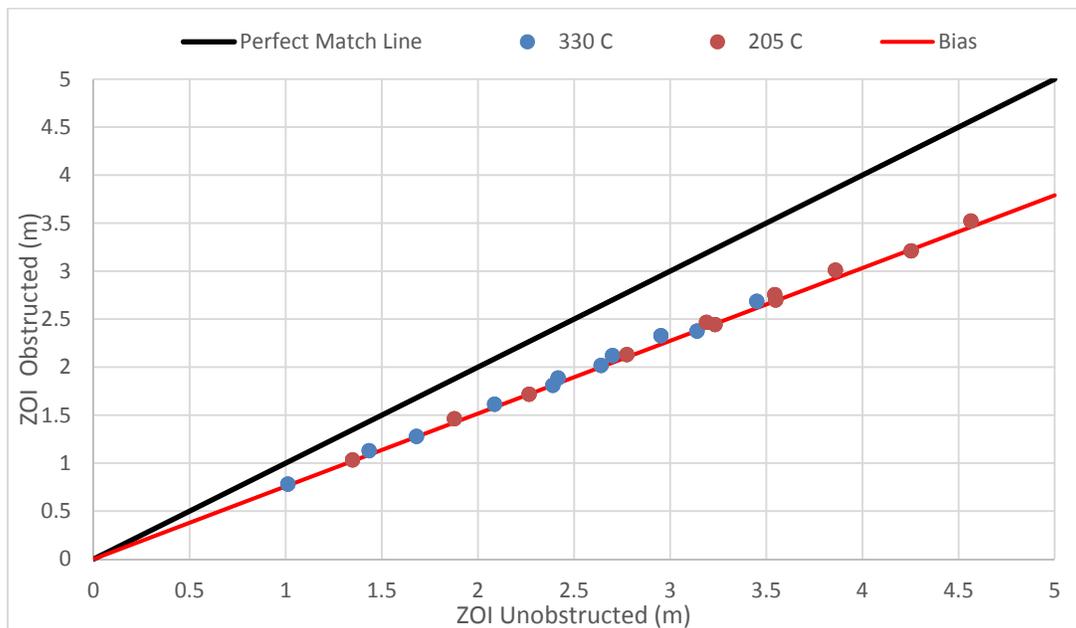


Figure 6-3
ZOI Difference for Obstructed and Unobstructed Plume Flows Using Heskestad Fire Plume Correlation

thermoset (330°C (626 °F)) and thermoplastic (205 °C (400 °F)) cables. The difference in the ZOI can be calculated as a bias following the technique outlines in the FDS manual, or in this case a linear correlation fit. The resulting bias is 0.76, showing a decrease in vertical ZOI of around 24% for fire plume flows subject to an obstruction. This closely matches the calculated change in elevation presented in Equation 6-4.

An analyst may use this information to estimate the reduction in overall risk that can be attributed to implementing the obstructed plume information provided in this report. The reduced ZOI may result in fewer risk important targets being exposed by the ignition source, and therefore reduced risk in the fire PRA.

6.2.4 Fire Protection SDP Application (Example 4)

During an inspection, it was noted that a section of a cable tray protected with an electrical raceway fire barrier system (ERFBS) was not properly maintained. This section of cable tray was noted to be within the plume ZOI of an electrical enclosure that was previously screened from the PRA analysis. The inspection finding initiated an Significance Determination Process (SDP) analysis of the configuration.

The electrical enclosure has a height of 2.3 m (7.5 ft) and width (diameter) of 0.9 m (3 ft), and the fire base height is specified as 2.0 m (6.6 ft) in accordance with the guidelines of NUREG/CR-6850 Supplement 1 [21]. The electrical enclosure is located in a compartment with a very high ceiling, and the development of a hot gas layer (HGL) has been screened based on detailed fire modeling of the worst configuration in the compartment. The electrical enclosure contains non-qualified, thermoplastic cables, and has been assigned an HRR of 464 kW based on NUREG/CR-6850 guidance [4] for the 98th percentile fire size. The ambient temperature in the compartment is 20 °C (68 °F). The cable tray contains thermoplastic cables and is located at an elevation of 4.9 m (16 ft) above the floor. The separation between the fire base and the cable tray is 2.9 m (9.5 ft). The ZOI height from the table values presented in NUREG/CR-6850 Figure F-3 is 3.2 m (10.5 ft), confirming that the cable tray is within the plume ZOI for an unobstructed plume. A diagram of the configuration evaluated is provided in Figure 6-4.

However, the electrical enclosure has a solid top with no openings in the top surface, satisfying a requirement for applying the obstructed plume treatment. The analysis is then performed using the obstructed plume credit as detailed above. Using Equation 6-1 with a bias, $B=0.62$, the total vertical ZOI is reduced to 2.3 m (7.5 ft) from the fire base height. Therefore, the cable tray is outside the obstructed electrical enclosure ZOI and only the enclosure itself will fail during the event analysis. A further reduction in the vertical ZOI could be credited to the analysis by using the 400 kW HRR as described in Table 4-2 of this report for large, closed enclosures with unqualified cables, but the additional analysis is unnecessary.

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

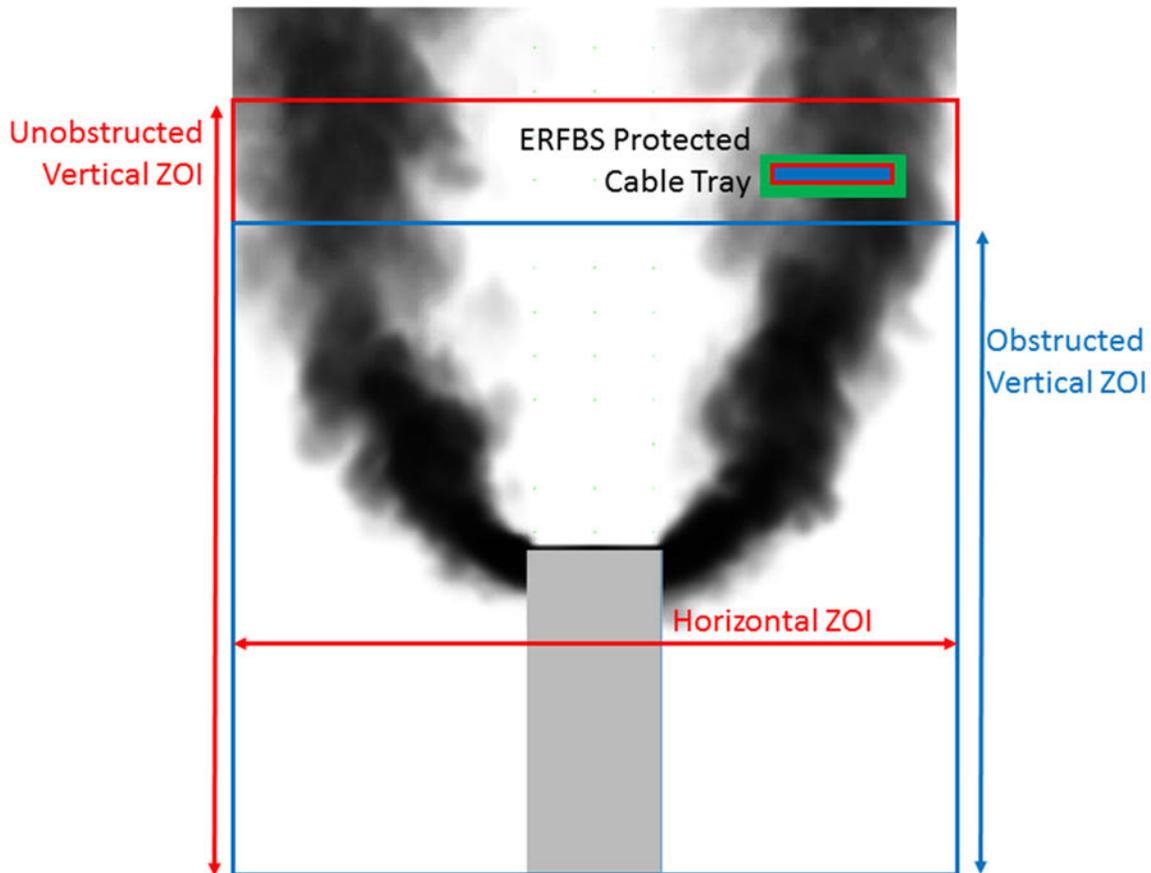


Figure 6-4
Example 4, Reduction in Vertical ZOI Due to Obstructed Plume Credit

6.2.5 Fire PRA Application (Example 5)

An electrical enclosure fire scenario is being considered for inclusion in the Fire PRA. The electrical enclosure is considered to contain multiple bundles of unqualified cable, with closed doors, and will be treated as a Group 4a Enclosure class fire with 400 kW peak HRR per Table 4-2 of this report. The enclosure has a solid top with no opening, and vents located on two of the four sides of the enclosure approximately 0.3 m (1 ft) below the top of the enclosure. The enclosure has a height of 2.3 m (7.5 ft) and an assumed diameter of 0.9 m (3 ft). The enclosure is located in a compartment with a very high ceiling, and the development of an HGL has been screened based on detailed fire modeling of the worst configuration in the compartment. The ambient temperature in the compartment is 20 °C (68 °F).

Two cable trays containing unqualified thermoplastic cables are located above the electrical enclosure. One of the cable trays, cable tray 1, is located within the plume ZOI of the electrical enclosure, and is considered to ignite as a secondary combustible. The second cable tray, cable tray 2, is located outside of the ignition source ZOI; however, the combined ZOI of the

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

electrical enclosure and the burning cable tray 1 is considered to damage tray 2. Both trays are located at an elevation of 4.7 m (15.4 ft) from the floor.

Following the guidance outlined in NUREG/CR-6850 [4] assuming the fire is at the top of the electrical enclosure, using Equation 6-1 with a bias, $B=1.0$, assuming an unobstructed source, the vertical distance above the source for which a thermoplastic cable would be damaged is 2.8 m (9.2 ft). Following the guidance outlined in Supplement 1 to NUREG 6580 [21] and placing the source at an elevation of 0.3 m (1 ft) below the top of the enclosure, the total vertical ZOI for this enclosure is found to be 4.8 m (15.7 ft) above the floor. This means that cable tray 1 is within the vertical plume ZOI of an unobstructed plume. As a result, cable tray 2 is damaged by the combined ZOI of the electrical enclosure and cable tray 1.

Repeating the analysis and crediting the effect of the obstruction caused by the enclosure, a different result is estimated. Returning to Equation 6-1 and using a bias, $B=0.62$, the total vertical ZOI becomes 4.1 m (13.5 ft) from the floor. Now, both cable trays are outside the electrical enclosure ZOI. A comparison of the change in the ZOI following the two estimates is presented graphically in Figure 6-5.

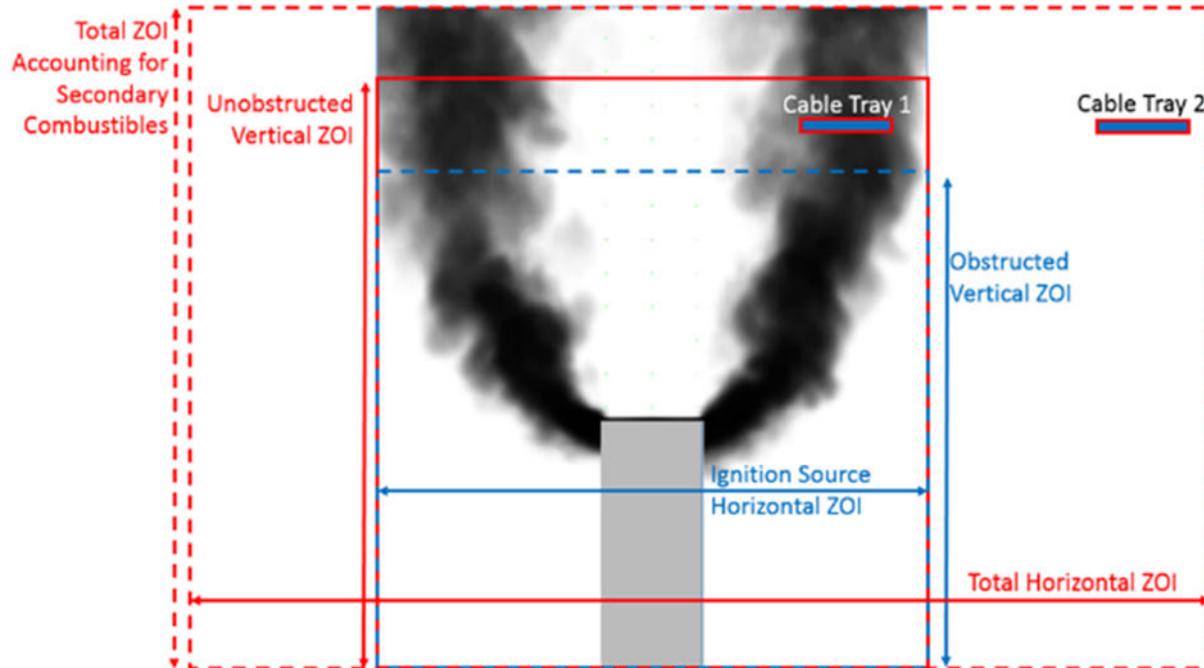


Figure 6-5
Fire PRA Example Reduction of Vertical ZOI

In Figure 6-5, the solid box represents the initial ZOI for the “unobstructed” electrical enclosure. The first and second damage states presented in the event tree above are reached by damage to the electrical enclosure and the cable tray 1 which fall within this ZOI. The larger box, bounded by the dashed line, represents the increased ZOI resulting from the combined burning of the electrical enclosure and cable tray 1. Cable tray 2 is within this larger ZOI and therefore damaged (the third damage state in the event tree above).

Accounting for the obstruction of the enclosure top, the blue solid box represents the modified ZOI for the electrical enclosure. The reduction to the vertical ZOI limits the damage to the electrical enclosure itself, and all subsequent damage states are unnecessary.

6.3 Plume Temperature and ZOI Corrections

In the FDS simulations, an area of limited information for estimating the vertical damage ZOI for fire plumes subject to an obstruction such as the top surface of an electrical enclosure was explored. Data for exploration into this phenomenon was developed using FDS Version 6.0.1 to produce a series of simulations in support of this analysis. Results from these simulations were used to justify correction to the Heskestad fire plume correlation to estimate the change in the vertical damage ZOI. A number of different parameters, including the HRR, the fire source diameter, the fire source elevation, and the geometry of the obstruction, are varied to determine their influence on the fire plume temperature rise.

The information provided for estimating the reduced vertical damage ZOI observed is independent of, and is applicable over, varying ranges of HRR, fire source diameters, and obstruction geometries. Therefore, the provided information is appropriate for representing the hazards to cables due to fire plume temperatures for practical applications in the commercial nuclear power industry.

The results suggest that the obstructed plume bias, $B = 0.62$, is appropriate for estimating plume centerline temperatures using Equation 6-3. This is equivalent to a reduction of 38% (i.e., $1-B = 1-0.62 = 0.38$) for estimating the plume temperature rise. Application of the bias in Equation 6-1 can result in an approximately 24% reduction in the vertical plume damage ZOI dimension. The reduced ZOI may result in fewer risk important targets being exposed by the ignition source, and therefore reduced risk in the fire PRA.

6.4 Application of the Correction

The obstructed plume analysis was subjected to a limited peer review. Through analysis of the results and the assumptions and limitations stated in Section 5.1.5, the following limits are provided for the implementation of the obstructed plume correction:

- The obstructed plume correction does not apply to fires with a base elevation located below the half height of the enclosure. Results suggest that fires located below the half height of the enclosure may produce plume temperatures equivalent to an unobstructed plume. Therefore, in scenarios where the fire base elevation is considered below the half height of the enclosure, the plume should be treated as an unobstructed plume. This limitation may not have any impact in commercial nuclear applications, since current fire PRA information recommends fires be located near the top of electrical enclosures (see Chapter 12 of Ref. 21).
- The obstructed plume correction does not apply to electrical enclosures that have a cumulative opening on the top plate greater than 5% of its total surface area. Therefore, any enclosure with a cumulative opening greater than 5% should be treated as an unobstructed configuration. Note that an enclosure top may have penetrations, but only as long as those penetrations are properly sealed such that they do not contribute to the cumulative opening area. Properly sealed openings include cables inside steel conduit that is fitted tightly at the top plate interface, and other penetrations sealed with approved non-combustible materials.
- The obstructed plume correction can be applied to open and closed electrical enclosures as described in Section 3.2.1 that do not screen from fire ignition source frequency

CORRECTION TO PLUME ZONE OF INFLUENCE DUE TO OBSTRUCTED PLUME EFFECTS

counting (Chapter 6 of Ref. 4) provided that the enclosure configuration conforms to all other limitations specified for the application of the obstructed plume treatment.

- The obstructed plume correction does not apply to configurations that include burning of secondary combustible materials. The obstructed plume correlation, however, may be used to establish the likelihood that secondary combustibles may be ignited through the definition of the primary ignition source ZOI. The obstructed plume correction is limited to the ignition source only. That is, in the case of secondary combustible ignition (i.e., cable trays), the subsequent analysis should follow existing information and modeling techniques.
- The obstructed plume correction does not apply to an analysis that determines the hot gas layer (HGL) damage. The plume correction may only be used for the duration of time in which thermal plume exposure is postulated but HGL temperature has not reached the damage criteria. Existing information and modeling techniques should be used to evaluate the likelihood and timing of HGL damage. Modeling techniques exist that can combine the effects of a thermal plume immersed in a HGL, although these techniques may only be applied to exposures within the thermal plume prior to the HGL damage state.
- The obstructed plume correction does not apply to analyses that determine the visibility reduction due to smoke accumulation. Smoke accumulation has not been evaluated directly in this report, and the findings of this report do not invalidate existing guidelines for the evaluation of visibility.
- The obstructed plume correction may be applied to the evaluation of the ceiling jet damage ZOI; however, careful consideration must be observed that the correction technique considers the remaining assumptions and limitations specified in Section 5.1.5. Application to the ceiling jet ZOI is justified by the direct association of the ceiling jet temperature with the thermal plume temperature.
- The obstructed plume correction does not apply to the evaluation of the horizontal thermal flame radiation ZOI. Existing information and modeling techniques should be used to evaluate the extent of the horizontal ZOI. The overall extent of the ZOI should be evaluated following the guidance in Section 5.3.8.
- The bias due to obstructed plume is not applicable to reducing the flame temperature; however, the current practice should be applied to direct flame exposures.
- The bias recommended in this report should not be applied to FDS predictions of plume temperatures. The bias correction does not apply to FDS results and is only intended for use with the Heskestad correlation. A qualified user of FDS should develop an appropriate set of inputs to address the effects of enclosure obstructions directly, and not by adjusting the output data with a bias correction.

7

SUMMARY, CONCLUSIONS, AND FUTURE RESEARCH

This section summarizes the results and conclusions described in this report with the objective of consolidating the new information for the practical application of this research. This section starts by listing the main objectives of this study so that they serve as the framework for the summary and conclusions. The specific objectives of this report are:

1. The classification of electrical enclosures in terms of function, size, combustible content, and ventilation conditions,
2. The determination of peak heat release rate (HRR) probability distributions considering specific electrical enclosure characteristics such as function, size, combustible content, and ventilation conditions, and
3. The characterization of fire plumes associated with fires in electrical enclosures.

The objectives listed above have been addressed through research focused in a number of technical areas. In order to address the classification of electrical enclosures and their corresponding flammability characterization, the results of a number of experimental test programs were evaluated. In addition, an extensive review of the fire events data that had been collected by EPRI was conducted in an effort to reflect the fire experience at NPPs in the provided enclosure classifications and the peak HRR probability distributions.

The practical implication of the provided electrical enclosure classification and peak HRR probability distributions is the ability to calculate severity factors that better reflect characteristics of the electrical enclosures. It should be noted that the severity factors are calculated using the methodology currently described in Chapter 8 and Appendices E and F of NUREG/CR-6850 [4] simply substituting the new peak HRR distributions for the original NUREG/CR-6850 [4] distributions.

In order to address the characterization of plumes generated by fires in electrical enclosures, a number of fire simulations were conducted using the Fire Dynamics Simulator (FDS) program. Fire plumes generated by fires inside an electrical enclosure may be obstructed by the enclosure walls, disrupting the fire induced flows, and at the same time producing different temperature profiles within the fire plume. The temperature profiles of these obstructed fire plumes were analyzed to develop information for determining a vertical component of the zone of influence reflecting fires inside electrical enclosures. The recommendations for determining a vertical component of the zone of influence considering fires inside the electrical enclosure relax the assumption in existing fire probabilistic risk assessment (PRA) information that fires are postulated outside the enclosures.

The research described above is bounded by specific assumptions and limitations that must be accounted for when applying the methodology in practical applications. To clarify these assumptions and limitations, detailed example applications have been developed and included in this report. The examples are intended to illustrate the implementation of the provided approach within the context of a fire PRA or fire modeling analysis.

A summary of the results of this research is described in the following sections.

7.1 Classification of Electrical Enclosures

A new classification of electrical enclosures has been developed. This new classification is based on cabinet function, volumetric size, combustible content, and ventilation configuration. The new classification options are intended to more accurately represent the electrical enclosure population and simplify the process of determining which peak HRR probability distribution is assigned to the electrical enclosure.

Based on electrical function, the electrical enclosures are grouped as follows:

- Switchgear and load centers
- Motor control centers and battery chargers
- Power inverters

The classification above is mostly for enclosures associated with power distribution. Other electrical enclosures identified as ignition sources are classified based primarily on volumetric size as follows:

- Large enclosures, characterized by having a volume larger than 1.4 m³ (50 ft³),
- Medium enclosures, characterized by having volumes between 0.34 m³ (12 ft³) and 1.4 m³ (50 ft³), and
- Small enclosures, characterized by having volumes smaller than 0.34 m³ (12 ft³).

Examples of these electrical enclosures include relay panels, termination cabinets, the main control board, etc. The initial classification of these enclosures by volumetric size provides an easy grouping process consisting of visual examination external to the enclosure during walkdowns. Large and medium volumetric classifications can be refined to account for the amount of combustible fuel loads, type of cable insulation material, and their ventilation configuration. These refinements can result in lower HRR values based on visual inspection of the cabinet internals.

7.2 Peak Heat Release Rate Probability Distributions

The classification described in the previous section provides the framework for assigning probability distributions for the peak HRR associated with the electrical enclosures. Selected probability distributions for peak HRRs were originally described in NUREG/CR-6850 [4] and applied to a given enclosure based on three factors: qualified versus unqualified cable, open versus closed enclosures, and single versus multiple cable bundles that could be ignited. This report described the new probability distributions with direct correspondence to the classification described earlier. It should be noted that the probability distributions described in Appendices E and G of NUREG/CR-6850 [4] may not need to be replaced with the ones described in this report, as they are bounding.

The revised peak HRR probability distributions (i.e., gamma distributions) for each of the new enclosure classification groups were developed based on the following factors:

- Review of experimental factors and configurations in testing programs intended to assess the HRR generated by electrical enclosure fires. Both domestic and international test programs were included within the scope of this research.
- Statistical analysis of the applicable experimental results.
- Extensive review and comparison of existing electrical enclosures configuration and operating experience in commercial nuclear plants and the influencing experimental factors.

The distributions are defined based on the 75th and 98th percentile values, with the 98th percentile value intended for use as the maximum HRR to be assumed for any enclosure in a given type/function classification group. The 98th percentile value is also the value provided for use during ignition source screening as currently described in Chapter 8 and Appendix G of NUREG/CR-6850.

Table 7-1 presents the electrical enclosure classifications and the provided peak HRR probability distributions.

As a companion to the peak HRR distributions, the working group also developed guidance for the selection of an appropriate fire diameter. NUREG/CR-6850 [4] had remained silent on this subject leaving the parameter selection up to the analyst. A new set of guidance that builds on and refines existing common practice has been presented. The guidance is discussed in Section 4.2.

**Table 7-1
Peak Heat Release Rate Distributions for Electrical Enclosures**

Enclosure Class/Function Group	Enclosure Ventilation (Open or Closed Doors)	Fuel Type* (TS/QTP/SIS or TP Cables)	Gamma Distribution Characteristics																						
			(a) Default			(b) Low Fuel Loading			(c) Very Low Fuel Loading																
			Alpha	Beta	75 th Percentile (kW)	98 th Percentile (kW)	Alpha	Beta	75 th Percentile (kW)	98 th Percentile (kW)	Alpha	Beta	75 th Percentile (kW)	98 th Percentile (kW)											
1 - Switchgear and Load Centers	Closed	TS/QTP/SIS	0.32	79	30	170	NOT APPLICABLE						0.23	111	25	200	0.38	32	15	75					
	Closed	TP	0.99	44	60	170							0.52	145	100	400	0.26	182	50	350	0.88	21	25	75	
2 - MCCs and Battery Chargers	Closed	TS/QTP/SIS	0.36	57	25	130							0.23	111	25	200	0.26	182	50	350	0.38	32	15	75	
	Closed	TP	1.21	30	50	130							0.52	73	50	200	0.38	214	100	500	0.88	21	25	75	
3 - Power Inverters	Closed	TS/QTP/SIS	0.23	111	25	200							0.23	223	50	400	0.23	223	50	400	0.27	51	15	100	45
	Closed	TP	0.52	73	50	200							0.52	145	100	400	0.26	182	50	350	0.88	12	15	45	
4a - Large Enclosures [$>1.42 \text{ m}^3$ ($>50 \text{ ft}^3$)]	Closed	TS/QTP/SIS	0.23	223	50	400							0.23	428	200	1000	0.23	428	200	1000	0.27	51	15	100	45
	Closed	TP	0.52	145	100	400							0.52	145	100	400	0.26	182	50	350	0.88	12	15	45	
	Open	TS/QTP/SIS	0.26	365	100	700							0.26	365	100	700	0.26	182	50	350	0.88	12	15	45	
	Open	TP	0.38	428	200	1000							0.38	428	200	1000	0.38	214	100	500	0.88	21	25	75	
4b - Medium Enclosures [$\leq 1.42 \text{ m}^3$ (50 ft^3)] and [$> 0.34 \text{ m}^3$ (12 ft^3)]	Closed	TS/QTP/SIS	0.23	111	25	200							0.23	111	25	200	0.23	111	25	200	0.27	51	15	100	45
	Closed	TP	0.52	73	50	200							0.52	73	50	200	0.52	36	25	100	0.88	12	15	45	
	Open	TS/QTP/SIS	0.23	182	40	325	0.23	182	40	325	0.23	182	40	325	0.88	12	15	45							
	Open	TP	0.51	119	80	325	0.51	119	80	325	0.30	72	25	150	0.88	12	15	45							
4c - Small Enclosures [$\leq 0.34 \text{ m}^3$ (12 ft^3)]	Not Applicable	All	0.88	12	15	45	NOT APPLICABLE																		

Notes for Table 7-1:

It is assumed that, based on electrical code and personnel safety compliance requirements, all switchgear, load centers, MCCs, battery chargers, and power inverters would be normally closed enclosures that are opened only when under service. For these electrical enclosures no open enclosure fire condition has been provided for and should not be assumed given a normally closed condition. If a normally open enclosure of these types is encountered, the closed enclosure distributions presented here would not apply.

1. Sub-categories **Column (b)**: Low Fuel Loading and **Column (c)**: Very Low Fuel Loading require opening enclosure doors to assess the internal configuration consistent with the discussions in Section 3 of this report.

2. See Section 3.2.1 for a discussion of the open versus closed electrical enclosure configurations.

* Per Sections 1.3 and 2.2.2, qualified TP cables (QTP - cables that have been tested and passed the IEEE-383 vertical flame spread test) and SIS wire are included in the same groups as are the TS fuel type groups.

7.3 Obstructed Plume Analysis

The investigation of fire plume temperature subject to obstructed flows was conducted using the Fire Dynamics Simulator (FDS) fire modeling program. The fire scenario configurations investigated are intended to mimic those created by fires burning inside electrical enclosures and are limited to thermal plume conditions in the early stages of the fire (i.e., before significant room temperature increases).

This study developed a characterization of fire plume temperatures subject to an obstruction so that specific information can be provided on determining the vertical component of the zone of influence. The results suggest that the obstructed plume bias, $B = 0.62$, is appropriate for estimating plume centerline temperatures using Equation 6-3. This is equivalent to a reduction of 38% (i.e., $1-B = 1-0.62 = 0.38$) for estimating plume temperature rise. Analysts are referred to Section 6.4 for specific information and restrictions on the application of these factors.

7.4 Example Applications

Examples consolidating the information described in this report were developed and included in Appendix F. These examples have been selected and designed to illustrate how to incorporate the provided methodology for modeling in electrical enclosures. The examples specifically address how to account for the assumptions and limitations associated with the research and information documented in this report. The revised guidance provided in this report can be implemented effectively and can provide significant improvement in the fire risk of actual plant configurations. The amount of reduction will vary based on specific compartment and scenario parameters.

7.5 Future Research

During the working group meetings, a number of topics were discussed with potential to impact the realism in modeling electrical enclosure fires and fire probabilistic risk assessments. A new classification system for electrical enclosures, revised peak HRR probability distributions, and an obstructed plume analysis methodology were three topics that were discussed and are presented in this report. A number of areas have been left for future research. The panel intends to reconvene and discuss if there are any remaining topics that should be pursued in the future. In addition, the U.S. Nuclear Regulatory Commission is considering additional test series to further explore the fire hazards associated with electrical enclosures.

8

REFERENCES

1. NFPA 805, "Performance-Based Standard for Fire Protection for Light-Water Reactor Electric Generating Plants," 2001 Edition, National Fire Protection Association, Quincy, MA.
2. 10 CFR 50.48 (Title 10 of the Code of Federal Regulations, Part 50, Section 50.48), "Fire Protection."
3. Appendix R to 10 CFR 50, "Fire Protection Program for Nuclear Power Facilities Operating Prior to January 1, 1979."
4. NUREG/CR-6850 and EPRI 1011989, "EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities," Volume 1: Summary and Overview and Volume 2: Detailed Methodology. Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, September 2005.
5. NUREG/CR-7197, "Heat Release Rates of Electrical Enclosure Fires (HELEN-FIRE)," K. McGrattan, S. Bareham, National Institute of Standards and Technology, December 2015.
6. IEEE-383-1974, "IEEE Standard for Type Test of Class IE Electric Cables, Field Splices, and Connections for Nuclear Power Generating Stations, The Institute of Electrical and Electronic Engineers, Piscataway, NJ, 1974.
7. EPRI 1025284, "The Updated Fire Events Database: Description of Content and Fire Event Classification," Electric Power Research Institute, Palo Alto, CA, July 2013.
8. NUREG/CR-4527, "An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets," J. Chavez, SAND86-0336, Volumes 1 and 2, April 1987.
9. VTT Publications 186, "Full Scale Fire Experiments On Electronic Cabinets," J. Mangs and O. Keski-Rahkonen, VTT Technical Research Centre of Finland, 1994.
10. VTT Publications 269, "Full Scale Fire Experiments On Electronic Cabinets II," J. Mangs and O. Keski-Rahkonen, VTT Technical Research Centre of Finland, 1996.
11. VTT Publications 521, "On the Fire Dynamics of Vehicles and Electrical Equipment," J. Mangs and O. Keski-Rahkonen, VTT Technical Research Centre of Finland, 2004.
12. Plumecocq, W., M. Coutin, S. Melis, L. Rigollet, Characterization of Closed-Doors Electrical Cabinet Fires in Compartments, Fire Safety Journal 46, 2011.
13. NUREG-2169 and EPRI 3002002936, "Nuclear Power Plant Fire Ignition Frequency and Non-Suppression Probability Estimation Using the Updated Fire Events Database," Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, December 2014.
14. NUREG/CR-7010, "Cable Heat Release, Ignition, and Spread in Tray Installations During Fire (CHRISTIFIRE), Phase 1: Horizontal Trays," U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, July 2012.
15. Merriam-Webster's Collegiate Dictionary, 11th Edition, Merriam-Webster, 2003.

REFERENCES

16. FAQ 08-0043, *Location of Fires within Electrical Cabinets*, U.S. Nuclear Regulatory Commission, May 28, 2009.
17. NUREG-1824 and EPRI 1011999, "Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications, Volume 1: Main Report," Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, May 2007.
18. NUREG-1824 Supplement 1 and EPRI 3002002182, "Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications," Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, May 2015.
19. Heskestad, Gunnar. "Engineering Relations for Fire Plumes," *Fire Safety Journal* 7.1, pp 25-32, 1984.
20. Heskestad, G., "Fire Plumes, Flame Height, and Air Entrainment," Section 2–1, *SFPE Handbook of Fire Protection Engineering*, 4th Edition, 2008.
21. NUREG/CR-6850 Supplement 1 and EPRI 1019259, "Fire Probabilistic Risk Assessment Methods Enhancements," Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, September 2010.
22. NUREG-1934 and EPRI 1023259, "Nuclear Power Plant Fire Modeling Analysis Guidelines (NPP FIRE MAG) – Final Report," Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, November 2012.
23. Technical Basis for Fire Protection Significance Determination Process (IMC 0609, Appendix F) At Power Operations, February 2005.
24. Beyler, C. L. "Fire Plumes and Ceiling Jets." *Fire Safety Journal* 11.1, pp 53-75, 1986.
25. National Institute of Standards and Technology (NIST), *Fire Dynamics Simulator (FDS) User's Guide*, Version 6.0.1, NIST Special Publication 1019, Sixth Edition, November 2013.
26. NUREG-1824 and EPRI 1011999, "Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications, Volume 7: Fire Dynamics Simulator (FDS)," Electric Power Research Institute, Palo Alto, CA and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES) Rockville, MD, May 2007.
27. McGrattan, K. B., et al., "Fire Dynamics Simulator, Technical Reference Guide, Volume 3: Validation," National Institute of Standards and Technology and VTT Technical Research Centre of Finland, Sixth Edition, November 2013.
28. FAQ 13-0004, "Clarifications on Treatment of Sensitive Electronics," NextEra Energy, Rev. 1, June 26, 2013.
29. McGrattan, K.B., et al., "Fire Dynamics Simulator User's Guide," National Institute of Standards and Technology and VTT Technical Research Centre of Finland, Sixth Edition, November 2013.
30. McGrattan, K. B., et al., "Fire Dynamics Simulator, Technical Reference Guide, Volume 1: Mathematical Model," National Institute of Standards and Technology and VTT Technical Research Centre of Finland, Sixth Edition, April 2013.
31. McGrattan, K. B., et al., "Fire Dynamics Simulator, Technical Reference Guide, Volume 2: Verification Guide," National Institute of Standards and Technology and VTT Technical Research Centre of Finland, Sixth Edition, November 2013.

32. NUREG-1805, "Fire Dynamics Tools (FDT^s) – Quantitative Fire Hazard Analysis Methods for the U.S. Nuclear Regulatory Commission Fire Protection Inspection Program," Supplement 1, Volumes 1 & 2, June 2013.
33. Zukoski, E. E., T. Kubota, and B. Cetegen. "Entrainment in Fire Plumes," Fire Safety Journal 3.3, pp 107-121, 1981.
34. Janssens, M., "Calorimetry," Section 3-2, "The SFPE Handbook of Fire Protection Engineering," 4th Edition, 2008.

Appendix A

WG MEMBERS, NON-WG CONTRIBUTORS, AND FACILITATOR RESUMES

This appendix presents the resumes of the working group (WG) members and the facilitator. Also, it includes the resumes of two non-WG experts who performed the obstructed plume simulations using the FDS fire modeling program.

Joelle DeJoseph, Jensen Hughes (previously with Duke Energy)

EDUCATION

University of Maryland, College Park, MD; May 2004

Masters of Science; Major: Fire Protection Engineering

Stevens Institute of Technology, Hoboken, NJ; May 1999

Bachelor of Engineering; Major/Concentration: Mechanical Engineering/Manufacturing

New York University, New York, NY; May 1999

Bachelor of Science; Major/Minor: Mathematics/Computer Applications

Registrations: Professional Engineer (P.E.) – North Carolina #033827

EXPERIENCE

Jensen Hughes, Raleigh, NC June 2015-present

Technical Consultant

- Technical consulting services for the commercial nuclear industry in the areas of classical fire protection, fire modeling, and NFPA 805

Duke Energy, Nuclear Generation Group, Raleigh, NC April 2010-May 2015

Fire Protection Engineer, Senior Engineer

- Fire Protection engineering supporting fire Probabilistic Risk Assessment (PRA) development for Duke Energy sites, including walkdowns and fire modeling
- Lead the transition to the NFPA 805 performance based approach for fire protection at two nuclear power plants
- Fire modeling lead for fleet fire protection at Duke Energy
- Fire PRA Peer review
- NFPA 805 License Amendment Request (LAR) audit team lead
- NFPA 805 LAR Request for Additional Information (RAI) response experience
- Subject matter expert for NFPA 805 monitoring, Very Early Warning Fire Detection Systems (VEWFDS), and surveillance optimization
- Fire Protection Program Manager experience at a nuclear power plant
- Fire Protection System Engineer experience at a nuclear power plant

Kidde Aerospace and Defense, Wilson, NC September 2006-March 2010

Fire Protection Development Engineer, Ground Vehicles

- Develop fire suppression (explosion protection) extinguisher for use in military ground vehicles
- Evaluate fire extinguishing agent effects on crew, including acid gas (specifically HF) concentration, discharge force, and decibel level
- Responsible for overseeing production manufacturing, including procurement, process, welding and pressure testing, first article inspection and conformance

Hughes Associates, Inc., Warwick, RI July 2004-September 2006

Fire Protection Engineer

- Provide design, design review, and specification development of fire protection systems. Work experience includes specification of system performance criteria, composition of design drawings, review of shop drawings, inspection of compliance with applicable codes and standards, and acceptance testing of

installed systems.

- Developed and evaluated performance-based design alternatives
- Provided design analysis of new and existing life safety systems
- Audited and tested existing fire protection systems
- Review of building code, fire prevention, and reference documents as they pertain to client issues

University of Maryland, College Park, MD July 2003-June 2004

Graduate Research Assistant, Yucca Mountain Project

- Development and implementation of a tunnel tenability assessment methodology
- Estimated intensity and duration of the fire source term for the postulated fire
- Calculated fire-induced conditions, including visibility, temperature, and gas concentrations, resulting from the specified fire source as a function of time and location
- Established risk and assess impact on project
- Review outside work, including methodologies and calculations

Bureau of Alcohol, Tobacco, and Firearms, Beltsville, MD July 2003-December 2003

Fire Research Laboratory, Student Intern

- Set-up and testing of research equipment
- Arrange and run test experiments for fire investigator classes
- Collect and document data for test fires

Affiliated Engineers Metro DC, Rockville, MD September 2002-July 2003

Affiliated Engineers NW, Seattle, WA April 2001-August 2002

Plumbing, Piping, and Fire Protection Design Engineer

- Design of plumbing and piping systems for major buildings: universities, hospitals, research centers, etc.
- Comprehensive analytical assessment of water, compressed air, vacuum, specialty gas systems for commercial uses
- Liaison between client, architect, and contractor concerning city building code and regulations

Jaros Baum & Bolles, New York, NY July 1999-September 2000

Plumbing and Fire Protection Design Engineer

- Design of entire plumbing and fire protection systems for major commercial buildings: office buildings, hotels, financial institutions, etc.
- Comprehensive analytical assessment of water systems for domestic and fire protection requirements; incl. detailed hydraulic and load calculations
- Liaison between client, architect, and contractor concerning city building code and regulations

PRESENTATIONS

- NRC Commission Briefing on NFPA 805, Fire Protection, June 19, 2014
- NEI Fire Protection Forum 2013: Safety and Operational Improvements at Harris Nuclear Plant
- NEI Fire Protection Forum 2013: Very Early Warning Fire Detection System (VEWFDS) Studies

Francisco Joglar, Jensen Hughes

EDUCATION

Ph.D., Reliability Engineering, University of Maryland, 2000

M.S., Fire Protection Engineering, University of Maryland, 1998

B.S., Industrial Engineering, University of Puerto Rico, 1997

Registered PE

VA, No. 038817 (2004)

Dr. Francisco Joglar, PE, is a Senior Consultant with 14 years' experience. Dr. Joglar has a strong background in fire modeling, statistics and uncertainty analysis. Since 2001, he has been researching and consulting in fire protection engineering and probabilistic risk assessment for the commercial nuclear industry. In the research area, he has been developing fire protection and fire risk technology for the Electric Power Research Institute (EPRI) and supporting joint research projects between EPRI and the US NRC Office of Research. In the consulting area, he has participated in numerous fire modeling and fire risk projects in various capacities including fire risk analyst, technical lead, project manager, and technical oversight. For the last six years, Dr. Joglar has been teaching a master degree level course in fire risk analysis at the University of Maryland, Department of Fire Protection Engineering. He also teaches a master degree level Fire Protection Engineering course every year at Cal Poly.

PROFESSIONAL HIGHLIGHTS

Senior Consultant, Hughes Associates, Baltimore, MD, 2012–present. Responsibilities include supervisory and managerial duties, project management, and consulting services to the commercial nuclear industry in the areas of safe shutdown analysis, fire modeling, probabilistic risk assessment, NFPA 805, and fire research.

Fire Protection Engineer, Science Applications International Corporation (SAIC), 2001–2012. Responsibilities included project management and consulting services to the commercial nuclear industry in the areas of safe shutdown analysis, fire modeling, probabilistic risk assessment, NFPA 805, and fire research. Technical lead for the following Fire PRA studies in the United States: San Onofre Nuclear Generating Station, Kewaunee Power Station, VC Summer Power Station, and Nine Mile Point-1. Internationally, has offered consulting services in Brazil for the ANGRA Unit 1 Fire PRA. Project manager for the Nine Mile Point-1 and Prairie Island Fire PRAs. In addition, served as technical lead and project manager for numerous projects associated with fire modeling and fire risk analysis. Participated as a peer reviewer for four Fire PRAs. Member of the writing committees for the following commercial nuclear industry milestone projects:

- NUREG/CR-6850/EPRI 1011989, "EPRI/NRC–RES Fire PRA Methodology for Nuclear Power Facilities Volume 2 Detailed Methodology," 2005.
- NUREG-1934/EPRI-1019195, "Nuclear Power Plant Fire Modeling Application Guide," 2012.
- NUREG-1824/ EPRI 1011999, "Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications, Volume 1". 2007.

Member of the ASME/ANS Fire PRA Standard writing committee, ASME/ANS RA-Sa-2009 Standard for Probabilistic Risk Assessment for Nuclear Power Plant Applications.

Author of the Reliability Engineering chapter of the Society of Fire Protection Engineers (SFPE) Handbook, the most widely used technical reference in the US fire protection community. Actively participates in the development of selected Fire PRA FAQ responses which are technical supplements to documented fire risk methods. Provides Fire Modeling and Fire PRA training through EPRI to Fire Protection and Fire PRA professionals in the nuclear industry.

SELECTED PUBLICATIONS AND PRESENTATIONS:

NUREG/CR-6850/EPRI 1011989, "EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities Volume 2 Detailed Methodology," 2005.

NUREG-1934/EPRI-1019195, "Nuclear Power Plant Fire Modeling Application Guide," 2012.

NUREG-1824/EPRI 1011999, "Verification and Validation of Selected Fire Models for Nuclear Power Plant Applications, Volume 1," 2007.

Joglar, F., "Reliability, Maintainability & Availability," Section/Chapter 5-3, SFPE Handbook of Fire Protection Engineering, 4th Edition, DiNenno et al. (eds.), National Fire Protection Association, Quincy, MA, 2008, pp. 5-25-5-68.

EPRI TR-1002981, "Fire Modeling Guide for Nuclear Power Plant Applications," 2002.

Presented conference papers in Probabilistic Safety Analysis (PSA) 2009, 2011, 2013, and Probabilistic Safety Analysis and Management (PSAM) 2010.

Ashley Mossa Lindeman, EPRI

EDUCATION

Worcester Polytechnic Institute May 2007
Graduated with a Bachelor of Science in Mechanical Engineering with a concentration in thermal-fluids

Rensselaer Polytechnic Institute June 2010
Graduated with a Master of Engineering in Mechanical Engineering

WORK EXPERIENCE

Electric Power Research Institute May 2013-Present
Technical Leader / Project Manager, Risk & Safety Management

- Fire PRA research management: Manage projects to further advance the research within the area of fire probabilistic risk analysis for commercial nuclear power plants. Oversee projects in the area of fire events analysis, fire-induced circuit failure, fire modeling, fire damage consequences and fire model uncertainty.
- Technical contributor to FPRA research: Participated in the classification of fire events for use in the calculation of fire ignition frequencies and non-suppression probability estimation.
- Fire PRA Training Instructor: Instructed selected portions of the fire analysis module in the joint EPRI/NRC Fire PRA Training.
- Member of the ASME/ANS Fire PRA standard writing committee

Westinghouse Electric Company June 2007-May 2013
Senior Engineer, Risk Applications and Methods II (July 2010-May 2013)

- Fire PRA model development using NUREG/CR-6850: Key individual in the fire PRA development including author or co-author on the following tasks: plant partitioning, fire ignition frequencies, zone of influence, fire scenario selection/scoping fire modeling, qualitative screening, quantitative screening and quantification. Provided peer review support for the utility during the industry peer review.
- NFPA 805 Transition and Fire PRA for Fort Calhoun Station: Authored or co-authored the following tasks in support of the Fire PRA project: plant partitioning, fire ignition frequencies, main control room habitability analysis, fire scenario selection, HRA and quantification. Provided peer review support for the utility during the industry peer review. Performed fire risk evaluations, supported the on-site NRC audit of the NFPA 805 transition, and responded to requests for additional information related to probabilistic risk assessment and fire modeling.
- Technical lead for international fire PRA: Provided support from bid and proposal phase through project initiation on differences between US methodology and EdF specific methodology. Supported Fire PRA technical questions from a multi-national team located in four different time zones.
- Industry Fire PRA Peer Review Experience: Participated in three domestic Pressurized Water Reactor Owner's Group (PWROG) fire PRA peer reviews and one international fire PRA peer review.

WG MEMBERS, NON-WG CONTRIBUTORS, AND FACILITATOR RESUMES

- Project Manager Level 1: Satisfied classroom training and on the job training requirements of the Westinghouse Project Manager Development Program
- Technical Leader Level 1: Satisfied requirements of the Technical Leader Development Program.

Engineer, Risk Applications and Methods II (June 2007-July 2010)

- Performer for international PWR safe shutdown analysis: Primary tasks involved developing component list, tracing safe shutdown flow paths, and supported execution of safe shutdown analysis using the Risk Spectrum software. Participated in walkdowns in support of both the fire and flood portions of the project.
- Piloted draft EPRI/NRC Fire HRA Guidelines (NUREG-1921) for the PWROG: Participated in operator interviews and supported development of WCAP technical report.
- Domestic fire PRA support: Performed on-site plant walkdowns, plant partitioning and fire ignition frequencies tasks.

PUBLICATIONS

- NUREG-2169 and EPRI 3002002936, Fire Ignition Frequencies and Non-Suppression Probability Estimation Using the Updated Fire Events Database, November 2014.
- OECD International Workshop on Fire PRA– Insights and Opportunities from the EPRI Updated Fire Events Database, April 2014.

Nicholas Melly, NRC

EDUCATION

The University of Maryland – College Park, MD
Bachelor of Science in Fire Protection Engineering, 2008

EXPERIENCE

U.S. Nuclear Regulatory Commission – Rockville, MD 7/2009-Present

Fire Protection Engineer

- Competed detailed circuit analysis and data processing of results for research projects which resulted in the publication of Electrical Cable Test Results and Analysis During Fire Exposure (ELECTRA-FIRE NUREG 2128)
- Managed DOE work related to the revision of NUREG/CR-6850, Integration of NFPA 805 Frequently Asked Questions, Development of generic fire PRA methods, analyses related to fire PRA methods and Level 3 PRA Evaluation
- Instructed NUREG/CR-6850 Training related to Sections 2, 4, 5, 7, 14, and 15.
- Represented the NRC at International OECD Fire-Events Database and High-Energy Arching Fault Task Group Meetings
- Presented International research plans to NRC management
- Presented papers documenting NRC fire research findings at numerous technical conferences

Jacobs Engineering Group - Conshohocken, PA 1/2009-6/2009

Fire Protection Engineer

- Designed a sprinkler system to be installed on a U.S. military facility chapel in Japan
- Designed a sprinkler system for a Pharmaceutical facility
- Designed wet pipe and dry pipe systems accounting for environmental conditions and freezer room applications
- Conducted probabilistic risk assessment and heat transfer analysis
- Evaluated protection of steel structural members under high temperature exposure conditions
- Evaluated airflow simulations over essential pharmaceutical machinery to meet safety requirements

Triad Fire Protection - Springfield, PA 6/2008-12/2008

Fire Protection Engineer

- Designed smoke detection systems and fire alarm systems
- Conducted research to identify the applicable design codes and standards for NPP applications
- Conducted hydraulic network analysis of sprinkler systems

SELECTED PUBLICATIONS

- NUREG-2169, "Nuclear Power Plant Fire Ignition Frequency and Non-Suppression Probability Estimation Using the Updated Fire Events Database: United States Fire Event Experience Through 2009"

WG MEMBERS, NON-WG CONTRIBUTORS, AND FACILITATOR RESUMES

- NUREG-2128, "Electrical Cable Test Results and Analysis During Fire Exposure (ELECTRA-FIRE), A Consolidation of Three Major Fire-Induced Circuit Cable Failure Experiments Performed Between 2001 and 2011
- Enhancements in the OECD FIRE Database - Fire Frequencies and Severity of Events, W. Werner, R. Bertrand, A. Huerta, J. S.Hyslop, N. Melly, and M. Rowekamp, Proceedings of SMiRT 21, 12th International Seminar on Fire Safety in Nuclear Power Plants and Installations, München, Germany
- Incorporation of NFPA-805 Internal Fire Scenarios into SPAR all Hazard Models S. Sancaktar, F. Ferrante, N. Melly U.S. Nuclear Regulatory Commission, Washington DC, USA 20555-0001, 2011
- OECD FIRE Database Applications and Challenges -A Recent Perspective, Marina Roewekamp, Matti Lehto, Heinz-Peter Berg, Nicholas Melly, Wolfgang Werner Paper presented at OECD/NEA/CSNI/WGRISK International Workshop on Fire PRA, Garching, Germany
- Expert Judgment: An Application in Fire-Induced Circuit Analysis, Gabriel Taylor P.E., Nicholas Melly, Tammie Pennywell, Paper presented at OECD/NEA/CSNI/WGRISK International Workshop on Fire PRA, Garching, Germany

David Miskiewicz, Engineering Planning & Management, Inc.

EDUCATION

1975–1979 B.S., Nuclear Engineering, Pennsylvania State University, State College, PA

Summary

Nuclear engineer with over 30 years of experience working in the nuclear power industry. Currently Mr. Miskiewicz is managing the Risk Services Division for EPM. David has been a practicing PRA engineer for more than 20 years with extensive industry involvement including leading, presenting and instructional roles, and is a recognized expert in PRA. He has additional experience with software development and systems and design engineering activities including work related to reactor internals and reactor vessel integrity.

EXPERIENCE

2012–Present EPM, Inc., Raleigh, NC

- Manage operations and personnel within the Risk Services Division of EPM.
- Project manager and technical lead for development of Robinson Fire PRA to support NFPA-805.
- Project oversight and consulting support for completion of Point Beach Fire PRA and LAR preparation to support NFPA-805 transition.
- Member NEI 805 Task Force and Fire PRA Task Force
- Member of ASME CNRM Subcommittee on Model Maintenance, Special Committee on Inquiries, and the Part 4 (Fire PRA Standards) writing team
- Participant in various EPRI/NRC MOU projects

2005–2012 Progress Energy, Raleigh, NC

- Support the Progress Energy Fleet of Nuclear Plants. Responsibilities include maintaining PSA models, performing PSA applications, and responding to emergent plant issues.
- Project management and technical lead for development of fire PRAs to support transition of the Progress Energy fleet to NFPA-805.
- Software owner for PSA software used at Progress Energy. Upgraded and completed in-house SQA for the latest versions of EPRI R&R software in 2006.
- Participated in Limerick Peer Review against the ASME Standard
- Member NEI 805 Task Force and Fire PRA Task Force
- Member of ASME CNRM Subcommittee on Technology, Special Committee on Inquiries, and the Fire PRA Standards writing team
- Participant in various EPRI/NRC MOU projects

2001–2005 Progress Energy, Crystal River, FL

- Support the Progress Energy Fleet of Nuclear Plants
- Primary responsible individual for CR3 PRA models and applications. Extensive interface experience with plant engineering, operations, work controls, and licensing groups.

WG MEMBERS, NON-WG CONTRIBUTORS, AND FACILITATOR RESUMES

- Applications performed include 14day Emergency Diesel AOT extension, One time AOT extensions for Service water, Chilled water, Emergency Diesels, Emergency Feedwater, and ILRT extensions for several plants.
- Experienced with product development and regulatory interface related to the Significance Determination Process [23].
- Chairman of B&W Owners Group Risk Applications Committee
- Member NEI Risk Applications Task Force
- Member ASME PSA Standard Addendum B writing team
- Participated in 3 external NEI PSA Peer Certification Teams.
- Developed Tool and database for reviewing PRAs against the ASME Standard which was a prototype for the ePSA module offered by EPRI.

1987–2001 Florida Power Corporation, Crystal River, FL

- Responsible for the CR3 PRA model and applications
- Completed extensive models updates resulting from CR3 1.5 year design outage.
- Temporarily served as the Maintenance Rule Supervisor responsible for setting up CR3 expert panel and preparing for baseline 10CFR50.65 inspection. Also, served as Chairman of Maintenance Rule Expert Panel for several years.
- Member of B&W Owners Group Risk Applications Committee
- Involved in the preparation and submittal of IPE and IPEEE for Crystal River unit 3.
- Developed various in-house software applications which significantly increased the efficiency of certain aspect of PSA analysis. These included and online risk monitoring at CR3 (pre-EOOS), a plant specific data management tool, a fire scenario evaluation tool, HRA and maintenance unavailability calculators, a level 2 bridge tree tool, and a component risk ranking tool.

1983–1998 Florida Power Corporation, Crystal River, FL & St. Petersburg, FL

- Chairman and/or member of B&W Owners Group Materials Committee and Reactor Vessel Working Group respectively from 1986-1998.
- Technical lead for development of LTOP technical specifications for CR3. Also responsible for implementation of PLTR and management of the reactor vessel surveillance program at CR3.
- Engineer in Mechanical Design group responsible for plant modifications including replacement of reactor vessel internals bolting and HPI nozzle safe ends.

1979–1983 Gilbert/Commonwealth, Inc., Reading, PA

- Field engineer working as consultant/contractor for nuclear utilities. Primary field was radioactive waste system upgrades.
- Design engineer in the radwaste management section. Participated in radwaste reduction, spent fuel storage and decommissioning projects.

Steven Nowlen, Consultant

Retired from Sandia National Laboratories in June 2014

EDUCATION AND HONORS

Appointed to the rank of Distinguished Member of the Technical Staff at Sandia National Laboratories, October 2001, an honor reserved for no more than 10% of the SNL engineering/science staff.

Master of Science, Mechanical Engineering, Michigan State University, East Lansing Michigan, March 1984.

DuPont Research Fellow, Department of Mechanical Engineering, Michigan State University, 1981-1983

Bachelor of Science with High Honor, Mechanical Engineering, Michigan State University, East Lansing Michigan, December 1980, Graduated Phi Beta Kappa

PROFESSIONAL EXPERIENCE

Since joining Sandia in 1983, I have been active in both experimental and analytical research in the fields of nuclear power plant safety with a focus on fire safety and quantitative fire risk analysis. I have been Sandia's technical and programmatic lead for the nuclear power fire research programs since 1987. My responsibilities include direct technical contributions, technical team leadership, sponsor interactions, program planning and program management. The most important application of my research has been in the development and application of probabilistic risk assessment (PRA) methods for fires in nuclear power plants; that is, quantitative assessments of the impact of fires on nuclear power plant safety and operations. I also have experience in harsh environment equipment qualification testing and accelerated thermal and radiation aging of materials.

My experimental work has included the planning, execution, evaluation, and reporting of fire safety experiments, as well as the interpretation, evaluation, and application of experimental results generated by other researchers. Specifically, I have experience in the testing of fire growth behavior, large-scale room fires, enclosure ventilation and smoke purging, cable and electrical equipment fire-induced damage, smoke particulate characterization, fire barriers, smoke damage effects on digital equipment, and cable ampacity and ampacity derating.

As a secondary aspect of my experimental experience, I have also participated in Equipment Qualification tests assessing the performance of electrical equipment in the harsh steam and radiation environments associated with nuclear power plant severe accidents. This work has included both accelerated thermal and radiation aging of electrical cables and the evaluation of equipment performance during harsh environmental exposures such as loss of coolant accidents.

Related analytical efforts in the area of fire safety have included the evaluation and validation of computer fire simulation models, the review and analysis of actual fire events in nuclear power plants, fire risk assessment analytical support work, the development and evaluation of fire risk assessment methods, and the development and evaluation of analytical methods for cable ampacity and fire barrier ampacity derating assessments. I have also participated as an expert consultant in various inspection activities for U.S. Nuclear Regulatory Commission (NRC).

I have performed training for the NRC staff in the application of the NRC Significance Determination Process (SDP) for fire protection inspection findings. I participated until my

retirement in 2014 in an effort to develop and deploy inspector training for application to those NRC licensees transitioning to the new risk-informed, performance-based fire protection requirements. I also acted as technical coordinator and classroom instructor for the annual Fire PRA training course offered as a part the NRC Office of Nuclear Reactor Research (RES) and Electric Power Research Institute (EPRI) collaboration on fire research. This training course has been conducted annually since 2005 and routinely attracts well over 100 participants per year.

I was a member of the U.S. NRC Senior Review Board for the review of Individual Plant Examination for External Events (IPEEE). I am currently a member of the ASME/ANS Joint Committee on Nuclear Risk Management Subcommittee on Standard Maintenance. I also co-chair the associated working group on fire risk.

My publication list is available on request and includes 10 journal articles, approximately 30 formal SNL technical reports, five invited conference papers and over 20 other general conference papers. I also co-authored a section of the SFPE *Handbook of Fire Protection Engineering* entitled "Risk Assessment for Nuclear Power Plants."

Notable Roles and Accomplishments

SNL technical area lead and program manager for nuclear power plant related fire research (1987-present)

Voting member of the American Society of Mechanical Engineers (ASME) American Nuclear Society (ANS) Joint Committee for Nuclear Risk Management (JCNRM) Subcommittee on Standards Maintenance

Chair of the ASME/JCNRM *Standard for Level 1 / Large Early Release Frequency Probabilistic Risk Assessment for Nuclear Power Plant Applications* Fire Working Group (RA-Sa-2009)

Leading member of the core writing team for the American Nuclear Society (ANS) Standard on Fire PRA methodology (ANSI/ANS-58.23-2007)

Lead author and NRC technical team lead for the consensus Fire PRA methodology NUREG/CR-6850 which was developed as a collaboration between the NRC and the Electric Power Research Institute (EPRI)

Technical Coordinator for development of the U.S. NRC Significance Determination Process (SDP) for risk-informed fire inspections (2003-2004)

Technical coordinator and instructor for the annual NRC/EPRI Fire PRA methodology training sessions (2004-present)

Member of the Nuclear Regulatory Commission (NRC's) Senior Review Board for the review and evaluation of licensee submittals under the Individual Plant Evaluation of External Events Program (1995-2001)

Technical advisor to the U.S. NRC staff during development of the National Fire Protection Association (NFPA) *Performance-Standard for Fire Protection for Light Water Nuclear Reactor Electric Generating Plants* (NFPA 805) (1995-2001)

Qualified as an expert witness in nuclear power plant fire safety in U.S. Federal Criminal District Court (1995)

Victor Ontiveros¹, Jensen Hughes

EDUCATION

Ph.D., Reliability Engineering, University of Maryland, 2013
M.S., Fire Protection Engineering, University of Maryland, 2010
B.S., Fire Protection Engineering, University of Maryland, 2007
A.A., General Studies, Montgomery College, 2004

Victor Ontiveros, PhD, is a recent graduate from the University of Maryland with degrees in Fire Protection and Reliability Engineering. During his studies, Dr. Ontiveros spent considerable time working on model development and uncertainty quantification. Dr. Ontiveros has extensive laboratory experience including material fatigue testing and laboratory setup and organization. He has experience performing Occupational Safety and Health inspections in spaces ranging from office space to machine shops and outdoor spaces. He has provided support in fire PRA projects at Prairie Island and Monticello Nuclear Generating Plants.

PROFESSIONAL HIGHLIGHTS

Engineer II, Hughes Associates, Baltimore, MD, present. Responsibilities include fire analysis scenario analysis, fire modeling, plant walkdowns, and fire probabilistic risk assessment.

Graduate Research Intern, Dept. of Mechanical Engineering, University of Maryland, College Park, MD, 2008–2014. Organized and set up Department of Mechanical Engineering Mechanics and Reliability Lab. Worked with Campus Facilities to ensure requirements for laboratory space were met. Administered retrofitting of load frames. Instructed and assisted fellow students in laboratory capabilities and experimental testing. Planned and researched for Ph.D. dissertation: developed and implemented accelerated fatigue experiments of aluminum alloys; and developed strain energy expended and thermodynamic entropy based models for determination of life expended. For master's thesis: accounted for uncertainty for sub-models used within fire simulation codes; updated state of knowledge using Bayesian methodology; and determined 'real' parameter values given uncertain model predictions and experimental measurements.

AWARDS

Recipient, Montgomery Scholar at Montgomery College Rockville, two-year tuition and summer study at Cambridge University, England, Summer 2003; Beacon Conference finalist in Technology and Technological Studies, 2004
Recipient, Alfred P. Sloan Foundation Minority Ph.D. Program in Mathematics, 2011–2012
Recipient, Willie M. Webb Reliability Engineering Fellowship, 2012–2013

PUBLICATIONS AND PRESENTATIONS

Ontiveros, V., "Strain Energy and Thermodynamic Entropy as Prognostic Measures of Crack Initiation in Aluminum Alloys," Ph.D. Dissertation, University of Maryland, College Park, MD, January 2014.

¹ Not a working group member.

Zhu, S.P., Huang, H.Z., Ontiveros, V., He, L.P., and Modarres, M., "Probabilistic Low Cycle Fatigue Prediction Using Energy-based Damage Parameter and Accounting for Model Uncertainty," *Int. J. Damg, Mech.*, **21**, December 2011, pp. 1128–1153.

Zhu, S.P., Huang, H.Z., Ontiveros, V., He, L.P., and Modarres, M., "Probabilistic Life Prediction for High Temperature Low Cycle Fatigue Using Energy-Based Damage Parameter and Accounting for Model Uncertainty," IDETC/CIE2001, Washington DC, August 28–31, 2011, pp. 435–443.

Smith, R., Ontiveros, V., Paradee, G., Modarres, M., and Hoffman, P., "Probabilistic Strain Energy Life Assessment Model," ICM11, Milano, Italy, June 5–9, 2011.

Ontiveros, V. and Modarres, M., "An Integrated Methodology for Assessing Model Uncertainty in Fire Simulation Codes," PSA, Wilmington, NC, March 13–17, 2011.

Ontiveros, V., Cartillier, A., and Modarres, M., "An Integrated Methodology for Assessing Fire Simulation Codes," *Nuc. Sci. Eng.*, **166**, November 2010, pp. 179–201.

Ontiveros, V., "An Integrated Methodology for Assessing Fire Simulation Code Uncertainty," Master Thesis, University of Maryland, College Park, MD, April 2010.

Ontiveros, V., Cartillier, A., Le Gac, C., and Modarres, M., "A Probabilistic Framework for Model Uncertainty in Fire Simulation Codes," *Risk Management for Tomorrow's Challenges (RM4TC)*, Washington, DC, November 15–19, 2009.

Azarkhail, M., Ontiveros, V., and Modarres, M., "A Bayesian Framework for Model Uncertainty Considerations in Fire Simulation Codes," *International Conference on Nuclear Engineering (ICONE 17)*, Brussels, Belgium, July 12–16, 2008, pp. 639–648.

David Stroup, NRC

EDUCATION

The University of Maryland – College Park, MD
Masters of Science in Mechanical Engineering, 1987
The University of Maryland – College Park, MD
Bachelor of Science in Fire Protection Engineering, 1981
Montgomery College – Rockville, MD
Associate of Arts in Fire Science, 1977

Registered Professional Engineer

Delaware, License No. 7996
Maryland, License No. 20052

EXPERIENCE

U.S. Nuclear Regulatory Commission – Rockville, MD 2/2011-Present

Senior Fire Protection Engineer Office of Nuclear Regulatory Research

- Develop and implement research projects to identify emerging technical issues in fire phenomena, fire modeling, and fire probabilistic risk assessment (PRA)
- Prepare or review fire modeling, fire PRA, and fire research reports
- Participate in the planning, formulation, and implementation of agency programs, policies, and procedures
- Provide oral and written communications on complex technical fire protection subjects to a wide variety of audiences

U.S. Nuclear Regulatory Commission – Rockville, MD 1/2008–1/2011

Fire Protection Engineer Office of Nuclear Regulatory Research

- Implemented research projects to identify emerging technical issues in fire phenomena, fire modeling, and fire probabilistic risk assessment (PRA)
- Prepared or reviewed fire modeling, fire PRA, and fire research reports

National Institute of Standards & Technology – Gaithersburg, MD 12/1995-1/2008

Research Fire Prevention Engineer Building and Fire Research Laboratory

- Conducted research and other investigative work on prediction of fire hazard development, fire risk evaluation, performance design and acceptance, evacuation analysis, performance of materials, and fire model development
- Performed research in the application of the empirical laws of thermodynamics and in heat conduction and mass diffusion in two and three dimensions
- Served as a peer reviewer for several performance-based design projects and technical guidance documents

U.S. General Services Administration – Washington, DC 11/1989–12/1995

Fire Protection Engineer Public Buildings Service

- Developed and evaluated GSA fire protection engineering practices
- Served as official GSA representative to other public and private organizations concerned with fire protection

- Provided guidance to GSA regional personnel, other Services, and Staff Offices regarding the selection, procurement, and use of fire protection equipment and construction techniques

Montgomery College –Rockville, MD 1/1990–6/1990

Instructor, Part-time Department of Engineering, Physical and Computer Sciences

Schirmer Engineering Corporation – Falls Church, VA 7/1989–11/1989

Fire Protection Engineer

- Evaluated proposed and existing buildings and other structures for compliance with various building and fire codes
- Developed alternative strategies for achieving fire safety levels equivalent to those specified in recognized fire and building codes

National Institute of Standards & Technology – Gaithersburg, MD 6/1981–7/1989

Research Fire Prevention Engineer Building and Fire Research Laboratory

- Performed theoretical and experimental research on fire build-up in compartments including planning and interpretation of experiments (bench scale and full scale), translation to usable form, data reduction, analysis, and presentation of results
- Performed experiments and analysis of data to construct computational models of fire growth and suppression

National Institute of Standards & Technology – Gaithersburg, MD 11/1980–6/1981

Fire Prevention Engineering Technician Center for Fire Research

SELECTED PUBLICATIONS

- NUREG-1805, Supplement 1, Fire Dynamics Tools (FDTs) Quantitative Fire Hazard Analysis Methods for the Nuclear Regulatory Commission Fire Protection Inspection Program, July 2013.
- NUREG-1824, Supplement 1/EPRI 3002002182, Verification and Validation of Select Fire Models for Nuclear Power Plant Applications, Draft for Public Comment, December 2014.
- NUREG-1934/EPRI 1023259, Nuclear Power Plant Fire Modeling Analysis Guidelines (NPP FIRE MAG), November 2012.
- NUREG-2122, Glossary of Risk-Related Terms in Support of Risk-Informed Decisionmaking, November 2013.
- “Flammability Hazards of Materials”, (Co-author), Fire Protection Handbook, 20th edition, Chapter 2, Section 2.3, National Fire Protection Association, 2008.

ACHIEVEMENTS

Salamander - Fire Protection Engineering Honor Society

General Services Administration Federal Engineer of the Year, 1995

Fellow – Society of Fire Protection Engineers, 2006

U.S. Department of Commerce Bronze Metal, 2007

Nuclear Regulatory Commission Federal Engineer of the Year, 2014

Member, SFPE Standards-Making Committee on Design Fire Scenarios

Society Memberships: Society of Fire Protection Engineers, National Fire Protection

Association, American Nuclear Society, and International Association of Fire Safety Science

Mano Subudhi², BNL

EDUCATION

1969 - B.S., Mechanical Engineering, Banaras Hindu University, India
1970 - M.S., Mechanical Engineering, Massachusetts Institute of Technology
1974 - Ph.D., Mechanical Engineering, Polytechnic Institute of New York

EXPERIENCE

1976-Present

Brookhaven National Laboratory, Over his career at BNL, Dr. Subudhi developed statistical methods for characterizing degradation within various components (NUREG/CR-6869). He also studied geomagnetic effects on nuclear facilities (NUREG/CR-5990), laboratory testing of electrical components (NUREG/CR-5280), and developed recommendations to improve current maintenance practices (NUREG/CR-5812). He also performed loss of coolant accident (LOCA) testing of Cables used in NPPs (NUREG/CR-6384) and did a configuration management study of radiological facilities. He participated in an International Atomic Energy Agency (IAEA) neutron monitoring experiment and a safeguard assessment of a US DOE facility, Portsmouth Gas Diffusion Plant in Ohio, for down-blending operation of highly-enriched uranium (HEU) from FSU countries to low-enriched uranium (LEU).

Dr. Subudhi is very conversant with all Subsections of the ASME Boiler and Pressure Vessel (B&PV) Code, Section III on Nuclear Power Plant Components; with IEEE Std. 323 on environmental qualification, with IEEE Std. 383 on cable qualification, and with IEEE Std. 344 on seismic qualification. He has served in working groups of these ASME and IEEE standards committees to develop various standards and guidance documents. Recently, he began work on the National Fire Protection Association (NFPA) Standard 805 requirements for fire probabilistic risk assessments (PRAs), using a risk-informed performance-based approach.

1975-1976

Bechtel Power Corp., Mechanical Engineer. Involved in the stress analysis of nuclear power plant components subjected to thermal, dead weight, seismic, thermal transients, pressure and fatigue loads; special problems including water hammer, flow-induced vibrations, and sudden valve closures; and preparation of Nuclear Class I Reports for licensing purpose. Represented Bechtel in interfacing manufacturers, clients and vendors.

SELECTED PUBLICATIONS

"Seismic Analysis of Piping Systems Subjected to Independent Support Excitations by Using Response Spectrum and Time History Methods," *BNL Technical Report No. BNL-NUREG-31296*, April 1982. Also, *Presented at the ASME Summer PVP Conference*, Portland, Oregon, PVP-Vol. 73, June 1983.

"The Assessment of Alternate Procedures for the Seismic Analysis of Multiply Supported Piping Systems," *Proceedings of the 1985 ASME PVP Conference, New Orleans, PVP-Vol. 98.3*, June 1985.

² Moderator/facilitator for the working group

"Seismic Upgrading of the Brookhaven High Flux Beam Research Reactor," *Proceedings of DOE Natural Phenomena Hazards Mitigation Conference, Las Vegas, October 1985.*

"Improving Motor Reliability in Nuclear Power Plants," *NUREG/CR-4939, BNL-NUREG-52031, Vols. 1, 2, 3, November 1987.*

"Age-Related Degradation of Westinghouse 480-Volt Circuit Breaker," *NUREG/CR-5280, BNL-NUREG-52178, Vols. 1&2, November 1990.*

"Degradation Modeling with Application to Aging and Maintenance Effectiveness Evaluations," (Co-author), *NUREG/CR-5612, BNL-NUREG-52252, March 1991.*

"Life Testing of a Low Voltage Air Circuit Breaker to Assess Age-Related Degradation", *Nuclear Technology, Vol. 97, pp.362-370, March 1992.*

"Managing Aging in Nuclear Power Plants: Insights from NRC's Maintenance Team Inspection Reports," *Nuclear Safety, Vol. 35, No. 1, January-June 1994.*

"RAPTOR Gas Gun Testing Experiment," (Co-author) Proprietary, CRADA BNL-C-96-01, June 1998.

"A Reliability Physics Model for Aging of Cable Insulation Materials," *NUREG/CR-6869, BNL-NUREG-73676-2005, March 2005.*

"Application of laser generated ultrasonic pulses in diagnostics of residual stresses in welds," *Proc. of SPIE, 2005.*

"Expert Panel Report on Proactive Material Degradation Assessment," *NUREG/CR-6923, BNL-NUREG-77111-2006, February 2007.*

"Joint Assessment of Cable Damage and Quantification of Effects from Fire (JACQUE-FIRE): Volume 1 – Phenomena Identification and Ranking Table (PIRT) Exercise for Nuclear Power Plant Fire-Induced Electrical Circuit Failure," *NUREG/CR-7150, Vol. 1, BNL-NUREG-98204-2012, EPRI 1026424, October 2012.*

"Joint Assessment of Cable Damage and Quantification of Effects from Fire (JACQUE-FIRE): Volume 2 – Expert Elicitation Exercise for Nuclear Power Plant Fire-Induced Electrical Circuit Failure," *NUREG/CR-7150, Vol. 2, BNL-NUREG-98204-2012, EPRI 3002001989, May 2014.*

Gabriel Taylor, NRC

EDUCATION

Masters of Science in Fire Protection Engineering, May 2012
Bachelor of Science in Electrical Engineering, December 2004

Registered Professional Engineer

Maryland, Fire Protection, 2013

EXPERIENCE

U.S. Nuclear Regulatory Commission - Rockville, MD August 2013- Present **Senior Fire Protection Engineer**

- Evaluated the effectiveness of aspirated smoke detection systems for use in NPP fire PRA applications
- Instructed NUREG/CR-6850 training related to fire-induced circuit failure probability estimation
- Supported Development of Post-Fire Safe Shutdown Training for Regional Inspectors
- Chaired IEEE P1848, Co-chaired IEEE 1202

U.S. Nuclear Regulatory Commission - Rockville, MD October 2007- August 2013 **Fire Protection Engineer**

- Expert Member of the Probabilistic Risk Assessment (PRA) expert elicitation on fire-induced cable damage spurious operation probability
- Expert Member of the Phenomena Identification and Ranking Table (PIRT) exercise on Nuclear Power Plant Fire-Induced Electrical Circuit Failure
- Instructed NUREG/CR-6850 training related to fire-induced circuit failure probability estimation
- Witnessed fire tests, analyzed results and wrote test reports on Duke Armored cable testing, Navy Digital I&C testing, Progress Penetration Seal Testing.
- International OECD Fire-Events Database and High Energy Arching Fault Task Group
- Managed DOE work on fire-induced failure circuit testing and conducted supplementary data analysis (DESIREE-FIRE, KATE-FIRE)
- Presented research at numerous conferences and to the Advisory Committee on Reactor Safeguards (ACRS)

U.S. Nuclear Regulatory Commission - Rockville, MD April 2005 - October 2007 **NSPDP General Engineer**

- Graduate of NSPDP Class of 2007
- DORL: Evaluated proposed changes to license amendments in regards to their effect to public safety

- ACRS: Prepared summary report for committee members and assisted with meeting preparations
- RII/Watts Bar Resident Office: Became basic inspector qualified IMC 1245 Appendix A

**The Pennsylvania State University - University Park, PA August 2003 - February 2004
Undergraduate Research Assistant, Dr. P. M. Lenahan**

- Modified magnet power supply to operate correctly using U.S. power system
- Designed data acquisition system to signal average ESR and SDR signals using LabVIEW 7
- Reviewed, ordered, and installed SDR spectroscopy system

**OSRAM Sylvania Inc. - St. Marys, PA January - March 2005 & January- August 2003
Process Engineer & Engineering Co-Op (R&D, Process, EH&S, Electrical Departments)**

- Developed and conducted tests to examine customer complaints and analyzed the safety of products
- Developed a recycling program to reduce net residual waste and increase gain from recyclable goods
- PLC programming using VersaPro for GE PLC's (Latter-logic)
- Designed and constructed electrical cabinet using AutoCAD (ergonomic layout for operator and maintenance)

ACHIEVEMENTS

Nuclear Regulatory Commission Federal Engineer of the Year, 2015

Member of NSPE

Member of IEEE, PES, ICC

Member of NFPA

Eagle Scout - Troup #95, Bucktail Council

Eta Kappa Nu (HKN) - Epsilon Chapter - National Electrical/Computer Engineering Honors Society

Dale Carnegie Program Graduate

Penn State Conservation Leadership School Graduate

Rivers Conservation Leadership School Graduate

PUBLICATIONS

Subudhi, M., Martinez-Guridi, G., Taylor, G., et. al., NUREG/CR-7150, Volume 2, "Joint Assessment of Cable Damage and Quantification of Effects from Fire (JACQUE-FIRE), Expert Elicitation Exercise for Nuclear Power Plant Fire-Induced Electrical Circuit Failure," U.S. NRC, Washington, DC, 2014.

Taylor, G., Melly, N.B., Pennywell, T., "Expert Judgment, An Application in Fire-Induced Circuit Analysis," International Workshop on Fire PRA, OECD/NEA Committee on the Safety of Nuclear Installations, Garching, Germany, April 2014.

Melly, N.B., Taylor, G., Stroup, D.W., "U.S. NRC Fire Safety Research Activities," International Workshop on Fire PRA, OECD/NEA Committee on the Safety of Nuclear Installations, Garching, Germany, April 2014.

WG MEMBERS, NON-WG CONTRIBUTORS, AND FACILITATOR RESUMES

Taylor, G., Gallucci, R.H.V., Subudhi, M., Martinez-Guiridi, G., "Fire PRA Advancements in Estimating the Likelihood of Fire-Induced Spurious Operations," American Nuclear Society, PSA 2013, International Topical Meeting on Probabilistic Safety Assessment Analysis, Columbia, SC, September 2013.

Taylor, G., Melly, N., Woods, H., Pennywell, T., Olivier, T., Lopez, C., NUREG-2128, "Electrical Cable Test Results and Analysis During Fire Exposure (ELECTRA-FIRE), A Consolidation of Three Major Fire-Induced Circuit and Cable Failure Experiments Performed Between 2001 and 2011," U.S. NRC, Washington, DC, 2013.

Subudhi, M., Higgins, J., Taylor, G.J., et.al., NUREG/CR-7150, Volume 1, "Joint Assessment of Cable Damage and Quantification of Effects from Fire (JACQUE-FIRE), Phenomena Identification and Ranking Table (PIRT) Exercise for Nuclear Power Plant Fire-Induced Electrical Circuit Failure," U.S. NRC, Washington, DC, 2012.

Taylor, G., "Evaluation of Critical Nuclear Power Plant Electrical Cable Response to Severe Thermal Fire Conditions," Masters of Science Thesis, Graduate School of the University of Maryland, College Park, MD 2012.

Taylor, G., Barrett, H., Funk, D., Nowlen, S., "Advances in Understanding the Phenomena of Electrical Cable Fire-Induced Hot Shorting," American Nuclear Society, Annual Meeting, June 2011.

Nowlen, S.P., Brown, J.W., Taylor, G.J., "Electrical Failure Behavior of Kerite® FR Insulated Electrical Cables," American Nuclear Society, Annual Meeting, June 2011.

Taylor, G., Salley, M.H., NUREG-1924, "Electrical Raceway Fire Barrier Systems in U.S. Nuclear Power Plants," U.S. NRC, Washington, DC, 2010.

Taylor, G., McGrattan, K., Nowlen, S.P., "Electrical Circuit and Cable Testing," Interflam 2010, 12th International Fire Science and Engineering Conference, University of Nottingham, UK, July 2010.

Taylor, G., Nowlen, S.P., Brown, J.W., "Direct Current Electrical Shoring in Response to Exposure Fire - The DESIREE-FIRE Project," 20th International Conference on Structural Mechanics in Reactor Technology (SMIRT 20) - 11th International Post-Conference Seminar on Fire Safety in Nuclear Power Plants and Installations," Espoo Finland, August 2009.

Taylor, G., Salley, M.H., "10 Rules of Fire Induced Cable Failure," National Institute of Standards and Technology, Annual Conference on Fire Research, Gaithersburg, MD, 2008.

Justin Williamson³, Jensen Hughes

EDUCATION

Ph.D., Mechanical Engineering, University of Maryland, 2009
M.S., Fire Protection Engineering, University of Maryland, 2004
B.S., Fire Protection Engineering, University of Maryland, 2001

Justin Williamson, PhD, is a Fire Protection Engineer with six years' experience. He has extensive experience in fire, smoke, heat and mass transfer modeling to identify and solve fire protection problems for the commercial, government, and military sectors. Dr. Williamson's experience includes research, development and analysis of advanced fire modeling. He has worked as a fire modeling software developer and has expertise in the application of model verification, validation, sensitivity and uncertainty analysis required for high level regulatory acceptance of modeling results. He is passionate about applying his scientific expertise to provide effective solutions to complex problems.

PROFESSIONAL HIGHLIGHTS

Fire Protection Engineer, Hughes Associates, Baltimore, MD, 2008–present. Responsibilities include research, development and analysis of advanced fire simulations. Models used include Fire Dynamics Simulator (FDS), Consolidated Fire and Smoke Transport (CFAST), HEATING 7.3, and Fire and Smoke SIMulator (FSSIM). Performs fundamental analysis of dynamic, thermo-physical problems associated with fire, including heat transfer, mass transfer, and fire dynamics. Developed various software tools including FSSIM and customized tools for various applications. Performed complex analyses including fire modeling code compliance evaluations, code equivalence evaluations, Fire Hazard Analyses (FHA), and support for Fire Probabilistic Risk assessment (PRA) in support of commercial, NRC and DOE facilities. Performed engineering inspections in support of fire PRA modeling for Main Control Room abandonment and NFPA 805 transition. Expertise in the application and development of model verification, validation, sensitivity and uncertainty analysis required for high level regulatory acceptance of modeling results.

Internship, Exponent, Thermal Sciences Department, Bowie, MD, 2007–2008. Handled the experimental study of spill characteristics for cryogenic liquids on water and performed CFD simulations of large scale cryogenic liquid spill and dispersion.

Graduate Research Assistant, University of Maryland, Department of Mechanical Engineering, College Park, MD, 2004–2007. Developed local extinction criteria for fire from counterflow flame studies to add more detailed combustion physics for under-ventilated fires in FDS.

Faculty Research Assistant, University of Maryland, Department of Mechanical Engineering, College Park, MD, 2004. Assisted with the Maritime Hazard Assessment Project sponsored by the Department of Defense. Examined hazards of accidental release of cryogenic fuels from cargo ships. Incorporated a partially premixed combustion model in the NIST Fire Dynamics Simulator (FDS) to examine deflagrations.

³ Not a working group member.

Graduate Research Assistant, University of Maryland, Department of Mechanical Engineering, College Park, MD, 2002–2003. Characterized thermal behavior and ignition from cigarette lighter flames. Developed an inherently safe cigarette lighter to reduce the risk of unwanted ignition from juvenile misuse.

NOTABLE PUBLICATIONS AND PRESENTATIONS

Williamson, J., "Measurements and Analysis of Extinction in Vitiated Flame Sheets," University of Maryland, College Park, MD, 2009.

Williamson, J., "Characterizing Cigarette Lighter Flames to Reduce Unwanted Ignition," University of Maryland, College Park, MD, 2003.

Williamson, J., Beyler, C., and Floyd, J., "Validation of Numerical Simulations of Compartments with Forced or Natural Ventilation using the Fire and Smoke Simulator (FSSIM), CFAST and FDS," *Interflam 2010: Proceedings of the Twelfth International Conference*, University of Nottingham, United Kingdom, July 5–7, 2010, pp. 1043–1052.

Williamson, J. and Marshall, A.W., "Characterizing the ignition hazard from cigarette lighter flames," *Fire Safety Journal*, **40** (1), February 2005, DOI: 10.1016/j.firesaf.2004.08.004.

Appendix B

OVERVIEW OF WORKING GROUP ACTIVITIES

This appendix provides a summary of the working group (WG) activities. The members of the WG convened four separate times in 2 to 2½-day meetings from April 2014 through September 2014 at the NRC's RES building in Rockville, Maryland. Specifically, meetings were held on:

1. First meeting: April 1-3, 2014
2. Second meeting: May 21-23, 2014
3. Third meeting: July 22-24, 2014
4. Fourth meeting: September 15-16, 2014

In addition, webinars and conference calls were scheduled throughout this period on an as-needed basis. During the first two meetings, the WG evaluated two major avenues to address the modeling of electrical enclosure fire hazards:

- Re-binning and redefining the peak HRR profiles for electrical enclosures (provided in Table G-1 of NUREG/CR-6850) based on the amount of combustible materials contained within electrical enclosures and the potential for an enclosure fire to grow to its maximum size (peak) when left undetected (i.e., fire severity), and then,
- For each enclosure group or class, developing information in adjusting other effects of the peak HRR profile (or distribution) in the fire analysis.

During the first meeting, the WG members identified and discussed several topics to improve the current methodology for modeling electrical enclosure fire hazards in the fire probabilistic risk assessment (PRA). Some of the items considered are presented in Table B-1.

Table B-1
Identification of Topics for Consideration

Topics or Concepts Identified	Action Taken
Classification (i.e., binning) of electrical enclosure types	A new set of enclosure classifications was developed and described in Section 3 of this report.
Characterizing the peak heat release rate for all enclosure types and other equipment (e.g., motors, pumps, dry transformers) with an electrical ignition source	A new set of peak heat release rate probability distributions is described in Section 4 of this report. The characterization of peak heat release rates for ignition sources other than electrical enclosures is under review* and therefore, not included in this report.
Effects of obstructed fire plume inside the enclosure on the vertical component of the zone of influence (i.e., fire plume temperatures)	Sections 5 and 6 of this report describe the recommended approach for incorporating the effects of obstructions in fire plume temperatures in a fire modeling analysis.

OVERVIEW OF WORKING GROUP ACTIVITIES

**Table B-1
Identification of Topics for Consideration**

Topics or Concepts Identified	Action Taken
Assessment of heat release rate growth profile based on actual fire test results and fire experience, including the pre-growth, growth, and decay phases.	This topic is under review for future research*
Evaluation of the effect of enclosure counting on the fire ignition frequency including treatment of “well-sealed” electrical enclosures in the counting process	This topic is under review for future research*
Understanding the effects of ventilation-limited conditions associated with electrical enclosure fires	<p>Section 4 of this report provides peak heat release rate distributions that are dependent on an electrical enclosure’s ventilation conditions (open or closed door configuration)</p> <p>This report does not cover the modeling heat release rates in ventilation limited conditions. This topic is under review for future research*</p>
<p>Guidelines on treatment of:</p> <ul style="list-style-type: none"> a. Small electrical enclosures b. Large enclosures, walkthrough enclosures, and main control board c. Fire propagation to adjacent enclosures d. Fire resistance of SIS (manufacturer-wired safety cables), silicon rubber (SR), and Tefzel cable insulation types 	<ul style="list-style-type: none"> a. See Table 4-2 enclosure class 4c for treatment of small electrical enclosures b. See Table 4-2 enclosure class 4 for treatment of large electrical enclosures <p>Treatment of main control board fire modeling and scenario development is under review for future research*</p> <ul style="list-style-type: none"> c. This topic is under review for future research* d. This topic is under review for future research*
Examples of fire analysis of electrical enclosure fires	Appendix F provides examples of the approach described in this report.

* “Under review for future research” does not imply that the NRC or EPRI intends to address this issue in future efforts. It is intended to recognize issues that were identified but not addressed in the current effort as documented in this report.

During the second meeting, the NRC staff presented the preliminary data of their recent fire testing of electrical enclosures at the Chesapeake Bay Detachment (CBD) facility of the Naval Research Laboratory. In addition, the NRC staff presented a preliminary evaluation of experimental data on electrical enclosure fires from all four sources (i.e., SNL, VTT, IRSN, and CBD).

Also during the second meeting, the WG decided to evaluate the results of a set of Fire Dynamics Simulator (FDS) runs that simulated the fire plume behavior for fires within electrical enclosures. This approach is referred to in this report as the obstructed plume. Preliminary simulations yielded some encouraging results and a test matrix was developed by the group for additional simulations and refinements. The simulation results were later presented and discussed during the third and fourth meetings in order to finalize the approach provided in Sections 5 and 6 of this report.

Pictures of electrical enclosures typically installed in nuclear power plants and considered in fire PRA analyses were reviewed among the WG, during the second meeting. The pictures illustrated the electrical enclosure size and plant configurations, as well as the internal components that could act as the fire ignition source. Considering the overall size/configuration, the ignition source strength, and the amount of internal combustibles, the WG subsequently reached a consensus in classifying electrical enclosures into two major categories: one based on the electrical function and the other based on the size of an enclosure. After binning the switchgear, load centers, motor control centers (MCCs), battery chargers, and power inverters into three groups within the “electrical function” major group, the WG decided to group all other remaining enclosure types (mostly control and instrument panels) into three specific subgroups based on their volumetric size (e.g., small, medium, and large). Thus, the WG classified all enclosures into six specific classification groups.

In preparation for the third meeting, a webinar was held on June 26, 2014, for the WG to discuss how to correlate peak HRR values with a specific amount of combustible materials using the videos from various fire test programs.

The third working group meeting on July 22-24, 2014, fast-tracked the technical work on the heat release rate distributions and the obstructed plume approach. The WG’s focus during the July meeting was concentrated on the HRR distributions for the enclosure classification groups developed in the prior meeting. For each enclosure type, a consensus approach was used to assign the 75th and 98th values based on the individual research, data analysis, and engineering judgment.

During the fourth meeting, the WG finalized the definitions of the volumetric classification of other enclosures, including the subcategories for large and medium categories. The WG also reached a consensus on the final HRR distribution estimates. In addition to finalizing the peak HRR values for all electrical enclosure classes, the WG reviewed the findings of the obstructed plume study. Based on the comments by several WG members, the resulting approach was finalized with additional information for completeness and clarity of all assumptions and limitations addressed in the FDS simulations.

Appendix C

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES

This appendix provides a collection of photographs for the six classification groups of electrical enclosures defined in Section 3 of this report. The intent of the information is to support the classification of electrical enclosures. The photographs represent electrical enclosures typically found in nuclear power facilities. Some of them are taken from non-nuclear sources.

It should be noted that all figures included in this appendix are intended to assist the analyst for selecting and classifying Bin 15¹ cabinets in a typical nuclear power plant (NPP). The final judgment on assigning a classification group should be based on the information given in Section 3 and adequately documented (with photo illustrating actual internal and fuel configurations).

C.1 Group 1: Switchgear and Load Centers

C.1.1 Switchgear

Switchgear is a general term covering switching and interrupting devices and their combination with associated control, instrumentation, metering, protective, and regulating devices. Common switchgear voltage classifications found in an NPP include medium voltage (4.16 kV, 6.9 kV, 7.2 kV, 12.7 kV, 13.9 kV, etc.), and low voltage (480 V, 600 V). Switchgears are used to direct flow of power to various feeders and to isolate apparatus and circuit from the power system. Figures C-1 through C-4 provide examples of external and internal photographs of medium voltage switchgear equipment.



Figure C-1
Front View of Medium Voltage Switchgear Banks

¹ In addition to Bin 15 enclosures, the enclosures here include main control board (Bin 4) and battery charger (Bin 10).



Figure C-2
Front View of 6.9 kV Switchgear Relay and Control Logic Enclosures

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-3
Internal Views of Medium Voltage Switchgear

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-4
Internal Views of Medium Voltage Switchgear, Back Showing Bus Cables (Left), Front Showing Control and Relay Enclosure (Right)

C.1.2 Low Voltage Switchgear and Load Centers

Load centers are low voltage switchgears that are typically used to distribute power to motor control centers (MCCs). Load centers commonly have a medium voltage to low voltage transformer and a lineup of low voltage switchgear. Figures C-5 through C-10 provide example photographs of low voltage switchgear/load centers.



Figure C-5
Front View of Load Center (Disconnect Switch)

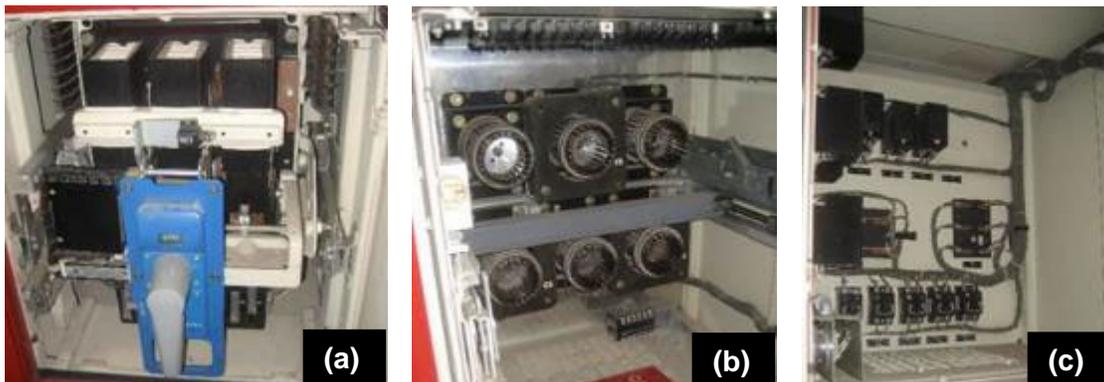


Figure C-6
Internal Views of a Load Center (a) Low Voltage Breaker, (b) Empty Breaker Cubicle, and (c) Load Center Control Cubicle

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-7
Load Center (Left) with Oil-Cooled Transformer (Right)



Figure C-8
Front View of Load Center (Right) and Transformer (Left)

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-9
Front View of Load Center (Low Voltage Switchgear)



Figure C-10
Low Voltage Load Center Breaker

C.2 Group 2: Motor Control Centers and Battery Chargers

C.2.1 Motor Control Centers

Low voltage motor control centers (MCCs) contain an externally operable circuit disconnecting means, circuit overprotection, and a magnetic motor controller with auxiliary devices combined in plug-in units in vertical assemblies. Control power transformers may be included to provide a 120 VAC power source for the control portion of the equipment, rather than use in the 480 V or 600 V supply voltage. Vertical and horizontal compartmentalized wire-ways are commonly provided to allow for ease of installation and configuration changes. Figures C-11 and C-12 provide external and internal photographs of MCCs.



Figure C-11
Front View of MCC with Three Vertical Sections



Figure C-12
Internal Views of MCC Cubicle

C.2.2 Battery Chargers

Battery chargers convert alternating current (AC) into a highly regulated direct current (DC) output that is used to charge the station backup batteries and to supply all continuous loads that may be connected to the bus. Battery chargers can be specified to accept any available input voltage, either single- or three-phase. The most common nominal AC input voltages are 120 V, 208 V, and 240 V single-phase voltage, and 120/208 V or 277/480 V for three-phase voltage. Nominal DC output voltages are 12 V, 24 V, 48 V, 125 V, and 250 V. Figures C-13 and C-14 present the external and internal photographs of battery chargers, respectively.



Figure C-13
Front View of a Battery Charger

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-14
Internal Views of Battery Chargers

C.3 Group 3: Power Inverters

An inverter changes direct current (DC) power to alternating current (AC) power. Figure C-15 presents external photographs of inverters, while Figure C-16 presents internal photographs of inverters.



Figure C-15
Power Inverters – Front and Back

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-16
Power Inverters – Internal Views

C.4 Group 4a: Large Enclosures

Large enclosures are electrical enclosures of physical volumetric dimensions greater than 1.4 m³ (50 ft³). The large enclosure category does not include power distribution enclosures such as switchgear, load centers, and MCCs. Figures C-17 through C-20 show large enclosures in the closed and open configurations.



Figure C-17
Auxiliary Shutdown Panels – Large Enclosure (Closed)

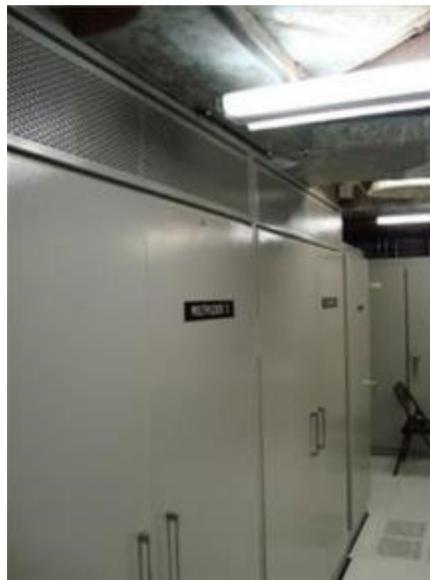


Figure C-18
Large Closed Electrical Enclosure

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-19
Large Closed Electrical Enclosure (Main Control Board – MCB)



Figure C-20
Large Open Electrical Enclosure (Walkthrough Enclosure)

C.5 Group 4b: Medium Enclosures

Medium enclosures are electrical enclosures of physical volumetric dimensions greater than 0.34 m³ (12 ft³) and less than or equal to 1.4 m³ (50 ft³). Figure C-21 presents photographs of electrical enclosures representative of the medium enclosure category.



Figure C-21
Medium Enclosure (Approximately 0.6 m x 0.6 m x 2.1 m (2 ft. x 2 ft. x 7 ft.))

C.6 Group 4c: Small Enclosures

Small enclosures are small enclosures or panels less than 0.34 m³ (12 ft³) in physical dimensions. Small switching enclosures include wall mounted distribution panels (Figures C-22 and C-24), and disconnect switches (Figure C-23).



Figure C-22
Wall Mounted Small Enclosures

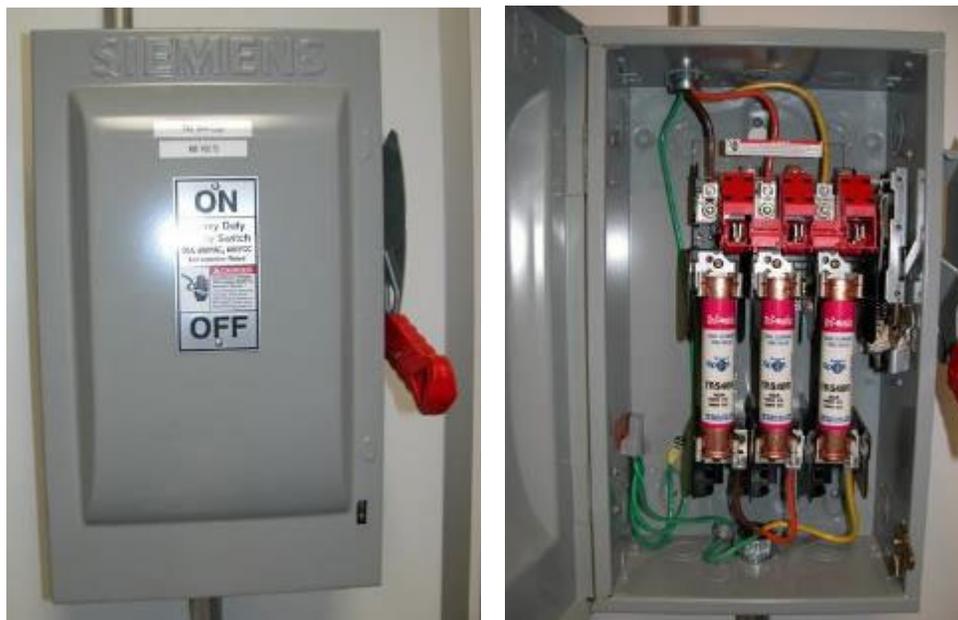


Figure C-23
Wall Mounted Low Voltage AC Fused Disconnect Switches



Figure C-24
125 VDC Distribution Panel (Left) and 120 VAC Distribution Panel (Right)

C.7 Large (Group 4a) and Medium (Group 4b) Enclosure Internals

C.7.1 “Default” Loading Configurations [Sub-Category 4a(a) and 4b(a)]

Figures C-25 through C-27 provide examples of internal electrical enclosure combustible mass and loading configurations for which the “Default” HRR values in Table 4-2 are recommended to be used.

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES

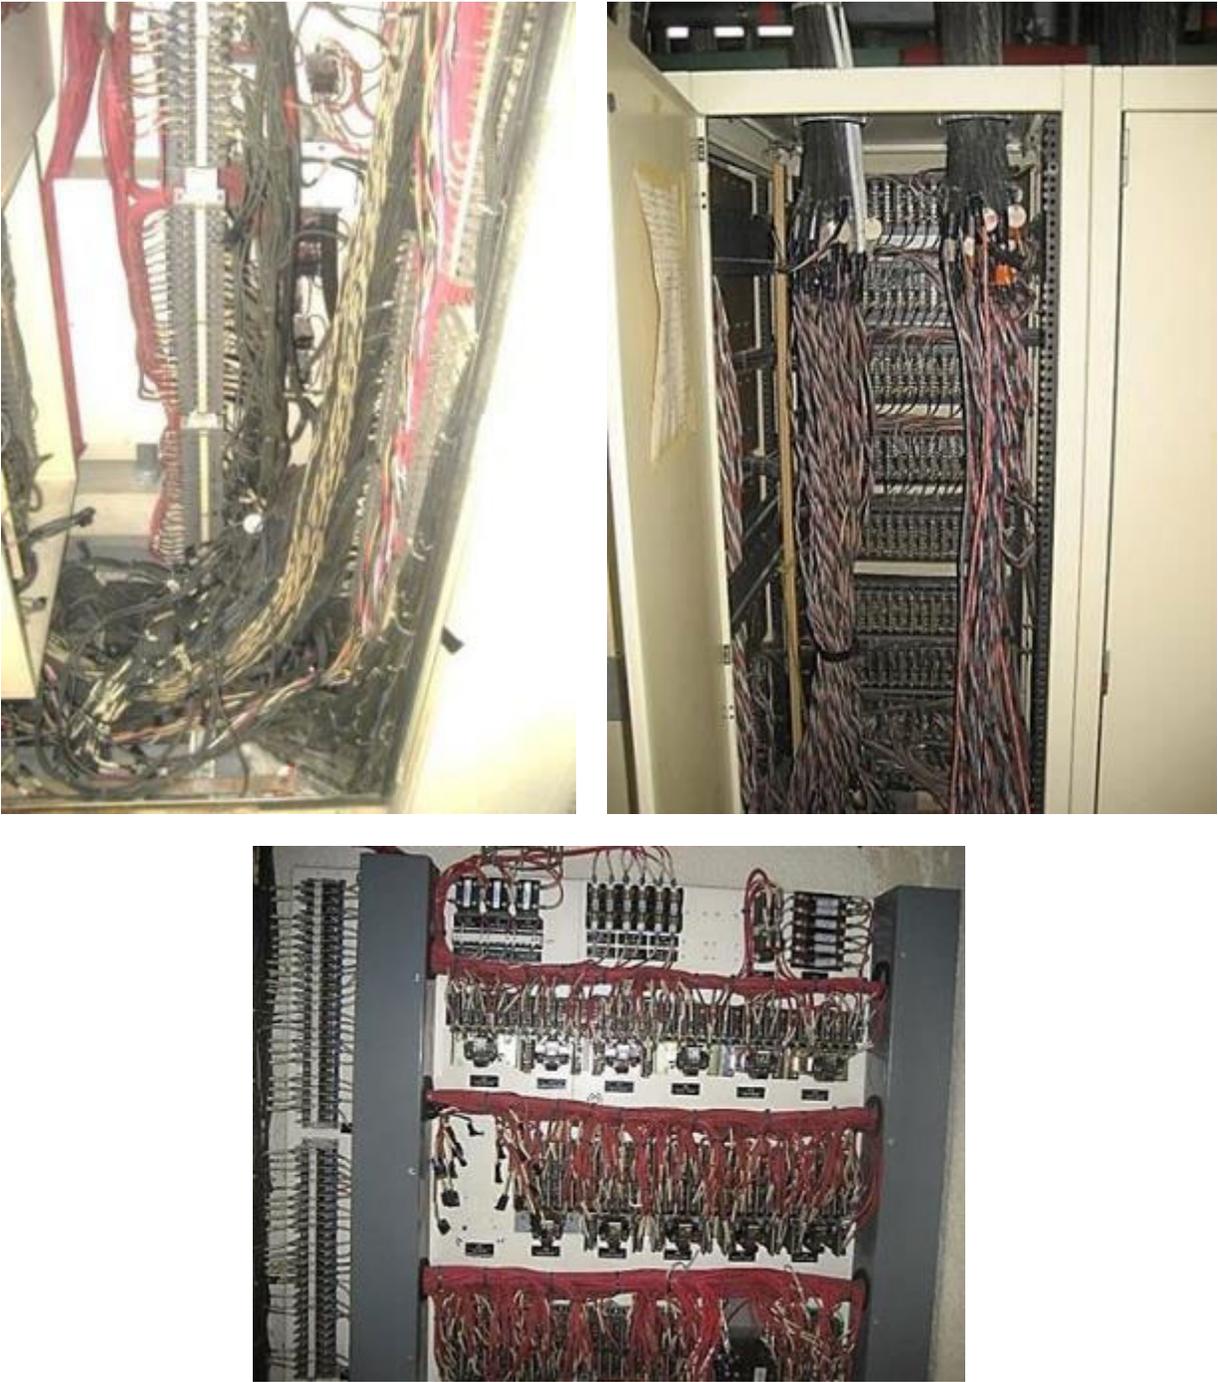


Figure C-25

Internal Enclosure Fuel Loading for Default Sub-Category (1 of 3)

Note in particular the enclosure to the upper left, which has disorderly internal enclosure wiring and loose legacy or extra field wires at the bottom.

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES

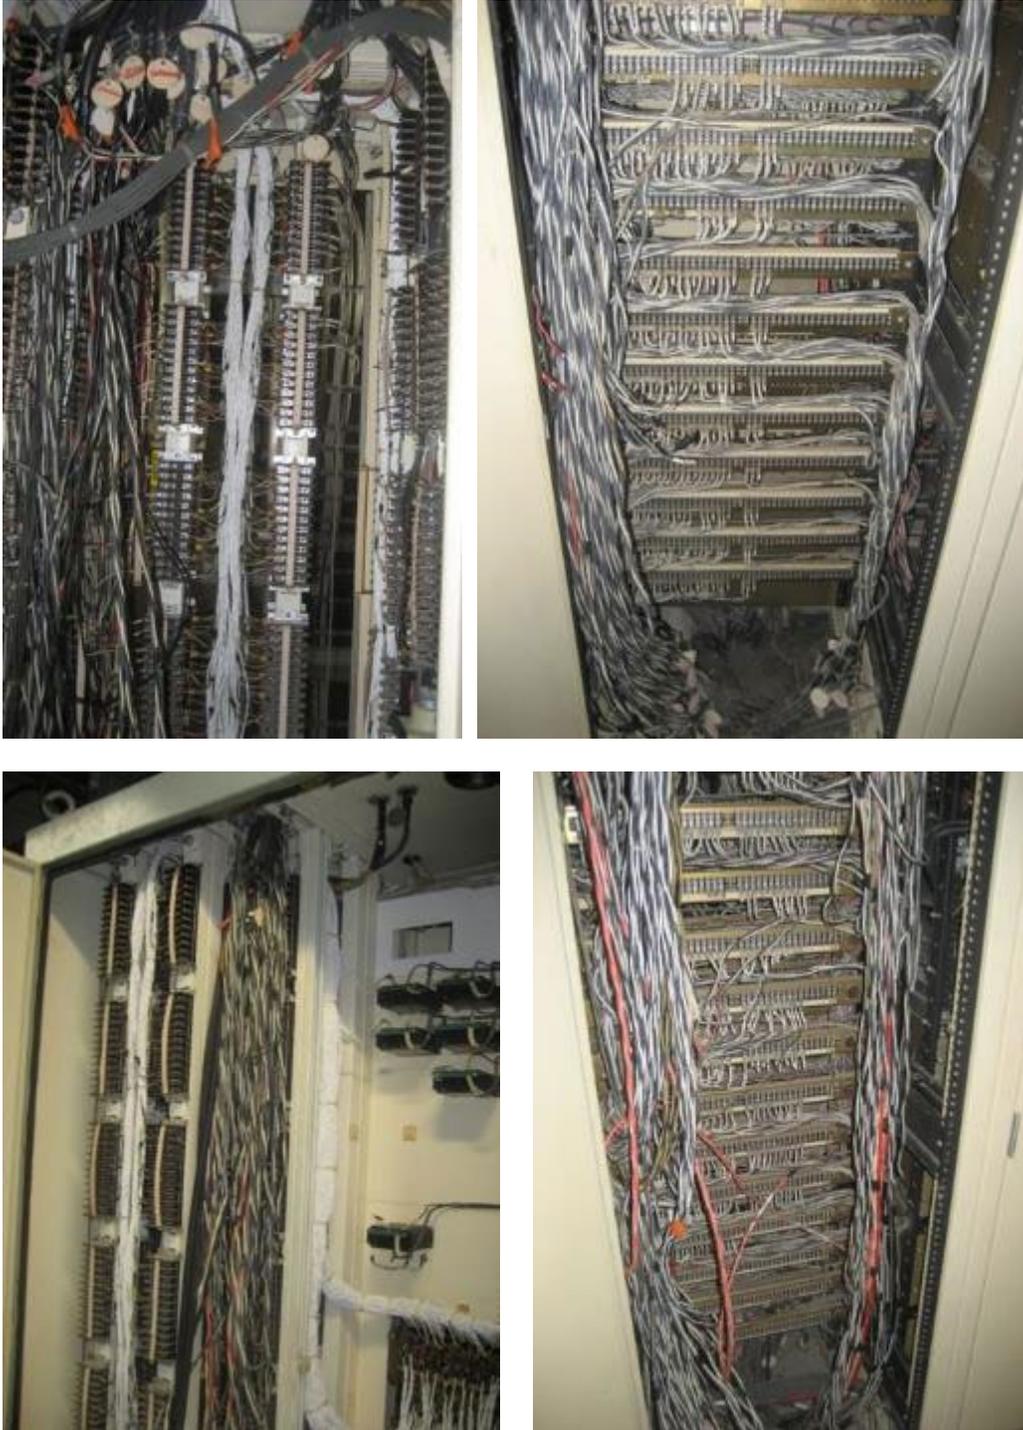


Figure C-26
Internal Enclosure Fuel Loading for Default Sub-Category (2 of 3)

The bottom examples are somewhat extreme in terms of combustible loading and loose bundling. Note in particular the enclosure to the lower left, which has a combination of orderly internal enclosure wiring (white wires on the right side of the enclosure) and loose disorderly field wires (center).



Figure C-27

Internal Enclosure Fuel Loading for Default Sub-Category (3 of 3)

Note that the enclosures on the left and right have many small cables that are not tightly bundled. The enclosure in the center has a significant load of printed circuit cards which are also combustible.

C.7.2 “Low Fuel Loading” Configurations [Sub-Category 4a(b) and 4b(b)]

“Low Fuel Loading” HRR estimates can be used for electrical enclosures whose internal panel wiring is tightly bundled throughout the enclosure. The tight bundling configuration is believed to reduce the surface area of polymeric material being heated from thermal fire conditions and limits to some extent the availability of oxygen to interact with the surface of the combustible. Thus, the tight bundling is believed to reduce the spread rate and heat release rate as shown from experimental testing, and the recommended HRR distributions in Table 4-2 could be used. Figures C-28 and C-29 present internal photographs of electrical enclosures containing panel wiring tightly bundled.

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-28
Examples of “Low Fuel Loading” Sub-Category (1 of 2)

Note that cables are neatly routed and tightly bundled and that there is a relatively low fuel loading given the overall enclosure volume.



Figure C-29

Examples of “Low Fuel Loading” Sub-Category (2 of 2)

Note that larger size cables are neatly routed and tightly bundled and that there is a relatively low fuel loading given the overall enclosure volume.

C.7.3 “Very Low Fuel Loading” Configurations [Sub-Category 4a(c) and 4b(c)]

“Very Low Fuel Loading” HRR estimates can be used for electrical enclosures that have limited internal panel wiring throughout the enclosure. To classify an electrical enclosure “Very Low Fuel Loading” the internal combustible loading of an electrical enclosure must be minimal (less than 5% combustible volume) and the HRR distributions in Table 4-2 could be used. Figure C-30 presents internal photographs of electrical enclosures with limited panel wiring representative of the “Very Low Fuel Loading” configuration.

PHOTOGRAPHS SUPPORTING CLASSIFICATION OF ELECTRICAL ENCLOSURES



Figure C-30
Examples of “Very Low Fuel Loading” Sub-Category

Appendix D

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

This appendix provides technical details for determining the alpha and beta parameters for the gamma distributions representing the peak heat release rate (HRR) for electrical enclosures. A total of 25 different electrical enclosure classifications have been assigned gamma probability distributions. The classifications are based on type of cabinets (i.e., cabinet function), size, doors open or closed, low flame spread cables (i.e., thermoset (TS), qualified thermoplastic (QTP), or SIS wire or thermoplastic (TP) cables, and cable/fuel loading. The list of data sources used in the current analysis is provided in Appendix D.1. The data classification for each cabinet fire test is presented in a matrix format in Appendix D.2. The alpha and beta parameters characterizing each gamma distribution are provided in Appendix D.3. Appendix D.3 also describes the methodology for calculating the values within the Microsoft Excel Workbook. Finally, in Appendix D.4, a figure is provided for each cabinet classification, comparing the empirical distribution and the gamma distributions recommended by the working group.

D.1 Data Sources

The following test reports contain the results of fire experiments involving electrical cabinets that are commonly used in nuclear power plants (NPPs). Following each reference, the tests that are included and excluded in the current analysis are identified.

- Chavez, J. (1987), An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets: Part I: Cabinet Effects Tests, NUREG/CR-4527 Volume 1, U.S. Nuclear Regulatory Commission, Washington, DC.
 - All tests SNL-ST1 through SNL-ST11 are included in the analysis.
 - Tests SNL-PCT1, SNL-PCT2, SNL-PCT3, SNL-PCT5, and PCT6 are included in the analysis.
 - SNL-PCT4A and SNL-PCT4C are excluded because the tests did not involve cables.
- Chavez, J., Nowlen, S. (1988), An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets: Part II: Room Effects Tests, NUREG/CR-4527 Volume 2, U.S. Nuclear Regulatory Commission, Washington, DC.
 - Tests 24 and 25 are included in the analysis
 - Test 21 and Test 22 are excluded because the tests did not involve cables.
 - Test 23 is excluded because the test involved a transient ignition source that is not representative of NPPs.
- Mangs, J., Keski-Rahkonen, O. (1994), Full Scale Fire Experiments on Electronic Cabinets, VTT Publications 186, VTT Technical Research Centre of Finland.
 - All VTT186 tests are included.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

- Mangs, J., Keski-Rahkonen, O. (1996), Full Scale Fire Experiments on Electronic Cabinets II, VTT Publications 269, VTT Technical Research Centre of Finland.
 - All VTT269 tests are included.
- Mangs, J. (2004), On the Fire Dynamics of Vehicles and Electrical Equipment, VTT Publications 521, VTT Technical Research Centre of Finland.
 - Tests 7 – 10 are included in the analysis.
 - Tests 1 – 6B are duplicate results from earlier test series (186 and 269) and therefore not included.
- Plumecocq, W., M. Coutin, S. Melis, L. Rigollet (2011), Characterization of closed-doors electrical cabinet fires in compartments, Fire Safety Journal 46, pp. 243-253.
 - CAA and CAB test series are excluded because the contents of the cabinets were not typical of electrical cabinets in NPPs; i.e., polymethyl methacrylate (PMMA).
 - CAO tests are excluded because the contents of the cabinets are not well characterized.
- McGrattan, K., S. Bareham (2014), Heat Release Rates of Electrical Enclosure Fires (HELEN-FIRE), NUREG/CR-7197, National Institute of Standards and Technology, Gaithersburg, Maryland.
 - All tests CBD-1 through CBD-112 are included.

D.2 Data Classification

The experimental data referenced in Appendix D.1 are classified in Table D-1 below. Some experimental data reported from the test series were excluded from the analysis, and these tests are listed in Table D-1b along with the reason for exclusion. The categories are based on:

Doors: Open (O) or Closed (C). In addition, closed and open door data for Power SWGR, Power MCC, and Control Small are grouped together.

Thermoset (TS), Qualified Thermoplastic (QTP), SIS, or Thermoplastic (TP) cables. For the purposes of this data classification, experiments using various types of lower flammability cables are grouped together. This included TS, SIS. And QTP. Experiments with unqualified TP cables are designated as TP.

Enclosure Size: Small (S), <0.3 m³ (12 ft³); Medium (M), 0.3 m³ to 1.7 m³ (12 ft³ to 60 ft³); Large (L), >1.4 m³ (50 ft³). Comments in the last column of Table D-1 provide exceptions to these categories, for example medium cabinets with heavy combustible loading are put in the Large classification. Notice that cabinets between 1.4 m³ and 1.7 m³ (50 ft³ and 60 ft³) are classified as both Medium and Large.

Combustible Loading: Default (D) or Low (L). This category describes how the cables are configured, based on visual inspection of photographs. Default refers to cables that are hanging loose and not neatly bundled. Low refers to cables that are neatly bundled. Default is also used when the combustible loading is unknown.

Fuel Mass: Kilograms of fuel within the cabinet

Types of Cabinets:

Power switchgear and load center (Power SWGR & LC): contains one small bundle within the breaker box; most cables are located at the top; contains three unspliced cables in the back; contains spliced cables for the control/monitoring equipment

Power motor control center and charger (Power MCC): contains one small bundle within the breaker box; most cables are located at the top; contains only three unspliced cables in the back

Control Large: Large Control cabinets (volume >1.4 m³ (50 ft³)), see comment column for exceptions

Control Medium and Inverter (Control Medium): Medium Control cabinets and inverters (volume 0.3 m³ to 1.7 m³ (12 ft³ to 60 ft³)), see comment column for exceptions

Control Small: Small Control cabinets (cabinet volume <0.3 m³ (12 ft³) or fuel mass <1 kg)

Low or VLow: The Control cabinets with "Low" or "VLow" in the title refer to the Combustible Loading of the cabinet. The experimental data for the cable-only tests is divided into two classifications—default and low—based on visual inspection. If the Combustible Loading is Low, the experimental data was actually included in the columns marked both Low and VLow. The working group developed gamma distributions for three classifications—default, low, and very low—which are used for comparison to the experimental data, as shown in Appendix D.3 and Appendix D.4.

Classification: Heat release rate (kW) or FALSE (F). For each test that is included, the peak HRR is provided in kilowatts. If the experiment is not included, FALSE (F) is indicated.

Also note that for certain of the CBD tests, a single test as reported in HELEN-FIRE has been listed as two or more sub-tests. Typically, a test (e.g., test CBD-28) may appear in two rows (e.g., CBD-28_1 and CBD-28_2). These are designations were used by the working group to characterize single HELEN-FIRE tests where the test director disrupted or reset the fire conditions while a test was ongoing. Changes introduced during the course of a test most commonly included opening the door of the electrical enclosure, increasing the nature or intensity of the ignition source (e.g., introducing a propane torch as a new ignition source), jostling the cable bundles with a pry bar, or shifting a cable bundle into the flames of the ignition source. These types of changes were generally introduced in cases where the fire was not developing beyond the ignition source or where the fire appeared to have "stalled" in its growth. Such changes were implemented at the discretion of the test director and are documented in HELEN-FIRE.

The working group treated these cases of introduced changes explicitly and generally in one of two ways. In some cases, the change was treated as effectively the re-start of a new test. For example, in certain cases no fire propagation was occurring even after a substantial time period when the test director jostled the cables with a pry bar causing an increase in fire growth. In such a case, the first part of the test (non-propagating phase) would be designated CBD-XX_1 and the behavior after the cables were jostled would be designated CBD-XX_2. In effect, the test conditions were changed and the fire behavior changed. Because the first phase of the test did not consume significant fuel, the second phase (post-change) is considered applicable to the behavior of electrical enclosure fires; hence, the two phases are treated as two separate tests in the working group's analysis. The second treatment was to dismiss the behavior of a test after a change in conditions had been introduced. For example, in some tests substantial fuel burning was observed and the fire appeared to be into the decay phase when a door might

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

be opened and/or the fuels jostled after which a mild resurgence in fire intensity might occur. A second example is a case where the door to an electrical enclosure was closed after the fire burned in an open configuration for some substantial time. In such cases, the first part of the test would be considered, but the second stage would not.

As described in Sections 2 and 3, the data analysis as presented here was used by the working group to both inform and cross-check the recommended peak HRR distributions. However, the process was designed from the outset as a data-informed, rather than data-driven, exercise. The data analysis presented here is intended to provide some quantitative comparisons between the recommended distributions and the data considered applicable to each case. However, differences are expected given that data for many of the enclosure groups is sparse. One aspect of the consensus peak HRR distributions is consistency between the enclosure groups. That is, the relative behavior of a load center as compared to a control cabinet, an MCC or a switchgear was also considered in finalizing the consensus distributions.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Test ID		Characteristics of the Experiments		Types of Cabinets (Heat Release Rate of Experiment, kW)																											
				Doors	Thermo-set or Thermo-plastic	Enclosure Size	Combustible Loading	Fuel Mass (kg) (See Comment 5)	Power SWGR & LC TP	Power SWGR & LC TS/QTP/SIS	Power SWGR & LC TP	Power MCC TS/QTP/SIS	Power MCC TP	Control Large Closed TS/QTP/SIS (Low)	Ctrl Large Closed TS/QTP/SIS (VLow)	Control Large Closed TP	Control Large Closed TP (Low)	Control Large Open TS/QTP/SIS (Low)	Control Large Open TP	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Medium Closed TS/QTP/SIS (Low)	Control Medium Closed TP	Control Medium Closed TP (Low)	Control Medium Open TS/QTP/SIS (Low)	Control Medium Open TP	Control Medium Open TP (Low)	Control Small	Comment		
SNL-PCT6		O	TS	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F		
SNL-Test24		O	TP	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
SNL-Test25		O	TP	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
VTT186-Exp1		C	TP	M	D	61.6	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT186-Exp2		C	TP	M	D	30.4	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT186-Exp3-1		C	TP	M	D	91	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT186-Exp3-2		C	TP	M	D	90.6	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT269-Exp1		C	TP	M	D	66	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT269-Exp2A		C	TP	M	D	70.7	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT269-Exp2B		C	TP	M	D	70.7	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT269-Exp2C		C	TP	M	D	70.7	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT269-Exp3		C	TP	M	D	66.4	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	1
VTT521-Exp7		C	TP	S	D	5.84	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	35
VTT521-Exp8		C	TP	S	D	5.77	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	20
VTT521-Exp9		C	TP	S	D	5.92	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	40
VTT521-Exp10		C	TP	S	D	5.94	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	20

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Test ID		Characteristics of the Experiments		Types of Cabinets (Heat Release Rate of Experiment, kW)																											
				Doors	Thermo-set or Thermo-plastic	Enclosure Size	Combustible Loading	Fuel Mass (kg) (See Comment 5)	Power SWGR & LC TP	Power SWGR & LC TS/QTP/SIS	Power MCC TP	Power MCC TS/QTP/SIS	Power MCC TS/QTP/SIS	Control Large Closed TP	Control Large Closed TP (Low)	Control Large Open TP	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Large Open TS/QTP/SIS (Low)	Control Large Open TS/QTP/SIS (VLow)	Control Large Open TP	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Med. Closed TS/QTP/SIS Low)	Control Medium Closed TP	Control Medium Closed TP (Low)	Control Medium Open TS/QTP/SIS	Control Medium Open TS/QTP/SIS (Low)	Control Medium Open TP	Control Medium Open TP (Low)	Control Small
CBD-1		O	TS	M	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-2		O	TS	M	L	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-3		O	TS	M	L	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-4		O	TS	M	L	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-5		O	TS	M	L	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-6		O	TS	M, L	L	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-7		O	TS	M, L	L	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-8		O	TS	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-9		O	TS	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-10		O	TS	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-11		O	TS	M	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-12A		C	TS	M	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-12B		C	TS	M	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-12C		O	TS	M	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-13		C	TS	M, L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-14A		C	TS	M, L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Test ID		Characteristics of the Experiments		Matrix of Experiments and Cabinet Characteristics																									
				Types of Cabinets (Heat Release Rate of Experiment, kW)																									
		Doors	Thermo-set or Thermo-plastic	Enclosure Size	Combustible Loading	Fuel Mass (kg) (See Comment 5)	Power SWGR & LC TS/QTP/SIS	Power SWGR & LC TP	Power MCC TS/QTP/SIS	Power MCC TP	Control Large Closed TS/QTP/SIS (Low)	Ctrl Large Closed TS/QTP/SIS (VLow)	Control Large Closed TP	Control Large Closed TP (Low)	Control Large Open TS/QTP/SIS (Low)	Control Large Open TP	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Medium Closed TS/QTP/SIS	Control Med. Closed TS/QTP/SIS Low)	Control Medium Closed TP	Control Medium Closed TP (Low)	Control Medium Open TS/QTP/SIS	Control Medium Open TS/QTP/SIS (Low)	Control Medium Open TP	Control Medium Open TP (Low)	Control Small	Comment	
CBD-14B		O	TS	M, L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-15A		O	TS	M, L	L	3.23	2.2	F	2.2	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-15B		C	TS	M, L	L	3.23	4	F	4	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-16		O	QTP	M, L	L	1.89	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-17		O	TS	M, L	L	2.7	0	F	0	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-18		O	QTP	M, L	L	1.76	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-19		C	TS	M, L	L	3.23	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-20		C	QTP	M, L	L	1.89	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-21		C	QTP	M, L	L	1.89	4	F	4	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-22		C	TS	M, L	L	1.76	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-23		O	TP	M, L	L	1.56	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-24		C	TS	M, L	L	0.73	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	2
CBD-25		C	TS	M	D	3.11	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-26		C	TS	M	D	3.03	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6
CBD-27A		C	TS	M	D	2.99	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6
CBD-27B		C	TS	M	D	2.99	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Test ID		Characteristics of the Experiments		Matrix of Experiments and Cabinet Characteristics																									
				Types of Cabinets (Heat Release Rate of Experiment, kW)																									
		Doors	Thermo-set or Thermo-plastic	Enclosure Size	Combustible Loading	Fuel Mass (kg) (See Comment 5)	Power SWGR & LC TS/QTP/SIS	Power SWGR & LC TP	Power MCC TS/QTP/SIS	Power MCC TP	Control Large Closed TS/QTP/SIS (Low)	Ctrl Large Closed TS/QTP/SIS (VLow)	Control Large Closed TP	Control Large Closed TP (Low)	Control Large Open TS/QTP/SIS (Low)	Control Large Open TP	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Medium Closed TS/QTP/SIS (Low)	Control Med. Closed TS/QTP/SIS (Low)	Control Medium Closed TP	Control Medium Closed TP (Low)	Control Medium Open TS/QTP/SIS	Control Medium Open TS/QTP/SIS (Low)	Control Medium Open TP	Control Medium Open TP (Low)	Control Small	Comment	
CBD-28A		C	TS	M	D	2.87	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-28B		C	TS	M	D	2.87	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-28C		C	TS	M	D	2.87	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-29		C	TS	M	D	2.64	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-30		C	TS	M	D	1.32	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-31		C	TS	M, L	D	0.73	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	28	2	
CBD-32A		C	TS	M, L	D	0.73	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	5.6	2	
CBD-32B		O	TS	M, L	D	0.73	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	11	2	
CBD-33		C	TS	M, L	D	1.46	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F		
CBD-34		C	TS	M, L	D	1.22	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-35		O	QTP	M	D	11.37	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	146	F	F	F		
CBD-36A		C	QTP	M	D	2.71	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F		
CBD-36B		O	QTP	M	D	2.71	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4	F	F	F		
CBD-37		C	QTP	M	D	5.41	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F		
CBD-38		C	QTP	M	D	4.74	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6	
CBD-39		C	QTP	M	D	5.68	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Test ID		Matrix of Experiments and Cabinet Characteristics												Types of Cabinets (Heat Release Rate of Experiment, kW)															
		Characteristics of the Experiments				Types of Cabinets (Heat Release Rate of Experiment, kW)																							
		Doors	Thermo-set or Thermo-plastic	Enclosure Size	Combustible Loading	Fuel Mass (kg) (See Comment 5)	Power SWGR & LC TP	Power SWGR & LC TS/QTP/SIS	Power SWGR & LC TS/QTP/SIS	Power MCC TP	Power MCC TS/QTP/SIS	Power MCC TS/QTP/SIS	Control Large Closed TP	Control Large Closed TP (Low)	Control Large Open TP	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Large Open TS/QTP/SIS (Low)	Control Large Open TS/QTP/SIS	Control Large Open TS/QTP/SIS (Low)	Control Med. Closed TS/QTP/SIS Low)	Control Medium Closed TP	Control Medium Closed TP (Low)	Control Medium Open TS/QTP/SIS	Control Medium Open TS/QTP/SIS (Low)	Control Medium Open TP	Control Medium Open TP (Low)	Control Small	Comment
CBD-40		C	TS	L	D	N/A	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	4
CBD-41A		C	TS/TP	L	D	5	F	F	F	F	F	122	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-41B		O	TS/TP	L	D	5	F	F	F	F	F	232	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-42		C	TS	M, L	L	2.88	F	F	F	F	F	36	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-43		C	TS	M, L	L	2.88	F	F	F	F	F	13	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-44		C	TS	M, L	D	2.88	F	F	F	F	F	31	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-45		C	TS	M, L	D	2.88	F	F	F	F	F	5	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-46		C	QTP	M, L	D	5.41	F	F	F	F	F	45	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-47		C	QTP	M, L	L	2.71	F	F	F	F	F	40	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-48		O	QTP	M, L	D	5.41	F	F	F	F	F	87	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-49		C	QTP	M, L	D	5.41	F	F	F	F	F	50	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-50		C	QTP	M, L	D	2.65	F	F	F	F	F	1	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-51		O	QTP	M, L	L	1.33	F	F	F	F	F	31	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	31
CBD-52		O	TP	M, L	D	2.17	F	F	F	F	F	122	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	122
CBD-53A		C	TP	M, L	D	2.17	F	F	F	F	F	57	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Table D-1 Matrix of Experiments and Cabinet Characteristics		Types of Cabinets (Heat Release Rate of Experiment, kW)																									
		Characteristics of the Experiments				Types of Cabinets (Heat Release Rate of Experiment, kW)																Control Small					
Test ID	Doors	Thermo-set or Thermo-plastic	Enclosure Size	Combustible Loading	Fuel Mass (kg) (See Comment 5)	Power SWGR & LC TP	Power SWGR & LC TS/QTP/SIS	Power SWGR & LC TS/QTP/SIS	Power MCC TS/QTP/SIS	Power MCC TP	Control Large Closed TS/QTP/SIS (Low)	Ctrl Large Closed TS/QTP/SIS (VLow)	Control Large Closed TP	Control Large Closed TP (Low)	Control Large Open TP (Low)	Control Large Open TP (VLow)	Control Medium Closed TS/QTP/SIS	Control Med. Closed TS/QTP/SIS Low)	Control Medium Closed TP	Control Medium Closed TP (Low)	Control Medium Open TS/QTP/SIS	Control Medium Open TS/QTP/SIS (Low)	Control Medium Open TP	Control Medium Open TP (Low)	Control Small	Comment	
CBD-107	O	TS	M	D	5.53	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	55	2
CBD-108	C	TS	M	D	1.38	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	6
CBD-109	C	QTP	M	L	5.98	F	F	F	F	F	F	F	F	F	F	F	F	64	F	F	F	F	F	F	F	F	
CBD-110A	C	TP	M, L	D	3.36	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-110B	O	TP	M, L	D	3.36	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-111A	C	QTP	M, L	D	3.12	F	F	F	F	F	F	F	F	F	F	F	F	49	F	F	F	F	F	F	F	F	
CBD-111B	O	QTP	M, L	D	3.12	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
CBD-112	O	TP	M, L	D	1.68	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F	
Comment 1	Classified as Control Large due to the high combustible loading																										
Comment 2	Categorized as Control Small due to mass <1 kg																										
Comment 3	Classified as Control Large due to many loose cables that are not neatly bundled																										
Comment 4	Experiments CBD- 1 through 10, 13, and 14 were performed in the enclosures as delivered from Bellefonte NPP. The mass of the combustibles was not measured because these materials could not be extracted from the enclosure without disrupting the original construction.																										
Comment 5	The Peak HRR is the total HRR minus the Ignition HRR and the Preheat HRR (see fuel mass column).																										
Comment 6	Combustible load estimate based on review of test video's and pictures																										

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Table D-1b Excluded Experiments and Reasons for Exclusion	
Test ID	Reason for Exclusion
SNL-PCT4A	Test not representative as these are gas burner tests- no cables.
SNL-PCT4C	Test not representative as these are gas burner tests- no cables.
SNL-Test21	Test not representative as these are gas burner tests- no cables.
SNL-Test22	Test not representative as these are gas burner tests- no cables.
SNL-Test23	Excluded- Ignition source was large/big and not representative of ignition sources in cabinets.
VTT521-Exp1	Excluded because it is same experiment as VTT269-Exp1
VTT521-Exp2A	Excluded because it is same experiment as VTT269-Exp2A
VTT521-Exp2B	Excluded because it is same experiment as VTT269-Exp2B
VTT521-Exp2C	Excluded because it is same experiment as VTT269-Exp2C
VTT521-Exp3	Excluded because it is same experiment as VTT269-Exp3
VTT521-Exp4	Excluded because it is same experiment as VTT186-Exp1
VTT521-Exp5	Excluded because it is same experiment as VTT186-Exp2
VTT521-Exp6A	Excluded because it is same experiment as VTT186-Exp3-1
VTT521-Exp6B	Excluded because it is same experiment as VTT186-Exp3-2
IRSN-CAA102	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA103	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA104	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA105	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA106	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA107	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA201	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA301	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA401	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA402	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA403	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA501	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Table D-1b Excluded Experiments and Reasons for Exclusion	
Test ID	Reason for Exclusion
IRSN-CAA502	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAA503	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB101	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB102	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB201	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB202	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB203	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB301	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB302	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB303	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAB304	IRSN tests not included because the cabinet loading was PMMA, which is not representative of the content in electrical cabinets in NPPs.
IRSN-CAO1	Test not included because flammability properties of the cabinet contents is not well characterized
IRSN-CAO2	Test not included because flammability properties of the cabinet contents is not well characterized
CBD-72	DELETE BASED ON NOT VALID TEST RESULTS

D.3 Determination of Alpha and Beta for the Gamma Distributions

For each electrical enclosure classification listed in Appendix D.2, the working group (WG) recommended a probability distribution for the peak HRR. The gamma distribution was selected as the parametric function to represent these distributions. In order to calculate the gamma distribution parameters, the working group reached consensus on heat release rate values representing the 75th and the 98th percentile of a gamma distribution. These values are provided in Table D-2 for each electrical enclosure classification. The method for calculating Alpha and Beta from Table D-2 is also provided later in this section.

Table D-2 HRR and Gamma Distribution Parameters							
Type of Cabinet	Cabinet Characteristics			HRR (kW), Working Group Suggestion		Gamma distribution parameters, best fit values	
	Ventilation Configuration	Cable Type TS/QTP/SIS or TP	Cable/Fuel Loading Conditions (Note 1)	75 th	98 th	Alpha	Beta
Power SWGR & Load Center	Closed	TS/QTP/SIS	All	30	170	0.32	79
	Closed	TP	AI	60	170	0.99	44
Power MCC & Charger	Closed	TS/QTP/SIS	All	25	130	0.36	57
	Closed	TP	All	50	130	1.21	30
Control LARGE	Closed	TS/QTP/SIS	Default	50	400	0.23	223
	Closed	TS/QTP/SIS	Low	25	200	0.23	111
	Closed	TS/QTP/SIS	Very Low	15	75	0.38	32
	Closed	TP	Default	100	400	0.52	145
	Closed	TP	Low	50	200	0.52	73
	Closed	TP	Very Low	25	75	0.88	21
	Open	TS/QTP/SIS	Default	100	700	0.26	365
	Open	TS/QTP/SIS	Low	50	350	0.26	182
	Open	TS/QTP/SIS	Very Low	15	75	0.38	32
	Open	TP	Default	200	1000	0.38	428
	Open	TP	Low	100	500	0.38	214
	Open	TP	Very Low	25	75	0.88	21
Control MEDIUM & Inverter	Closed	TS/QTP/SIS	Default	25	200	0.23	111
	Closed	TS/QTP/SIS	Low	15	100	0.27	51
	Closed	TP	Default	50	200	0.52	73
	Closed	TP	Low	25	100	0.52	36
	Open	TS/QTP/SIS	Default	40	325	0.23	182
	Open	TS/QTP/SIS	Low	15	150	0.19	92
	Open	TP	Default	80	325	0.51	119
	Open	TP	Low	25	150	0.30	72
Control SMALL	All	All	All	15	45	0.88	12

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Note (1) An entry of “All” means that this factor is not applied in selecting the applicable distribution. That is, there is only one distribution for all applicable cases (e.g., the cable/fuel loading is not a factor for some functional groups).

The alpha and beta parameters for the gamma distributions were calculated in Microsoft Excel using the “Solver” function. As an example, see the screen captures from Microsoft Excel shown in Figure D-1, Figure D-2, and Figure D-3, for the case described as “Control Large Closed TS/QTP/SIS Default”, in which the given values are 50 kW for the 75th percentile and 400 kW for the 98th percentile. For each HRR value listed in the spreadsheet in column L, the cumulative distribution of the gamma function is calculated in column M using the “Gammadist” function. At first, an estimate of alpha=1 and beta=100 is entered into cells M29 and M30.

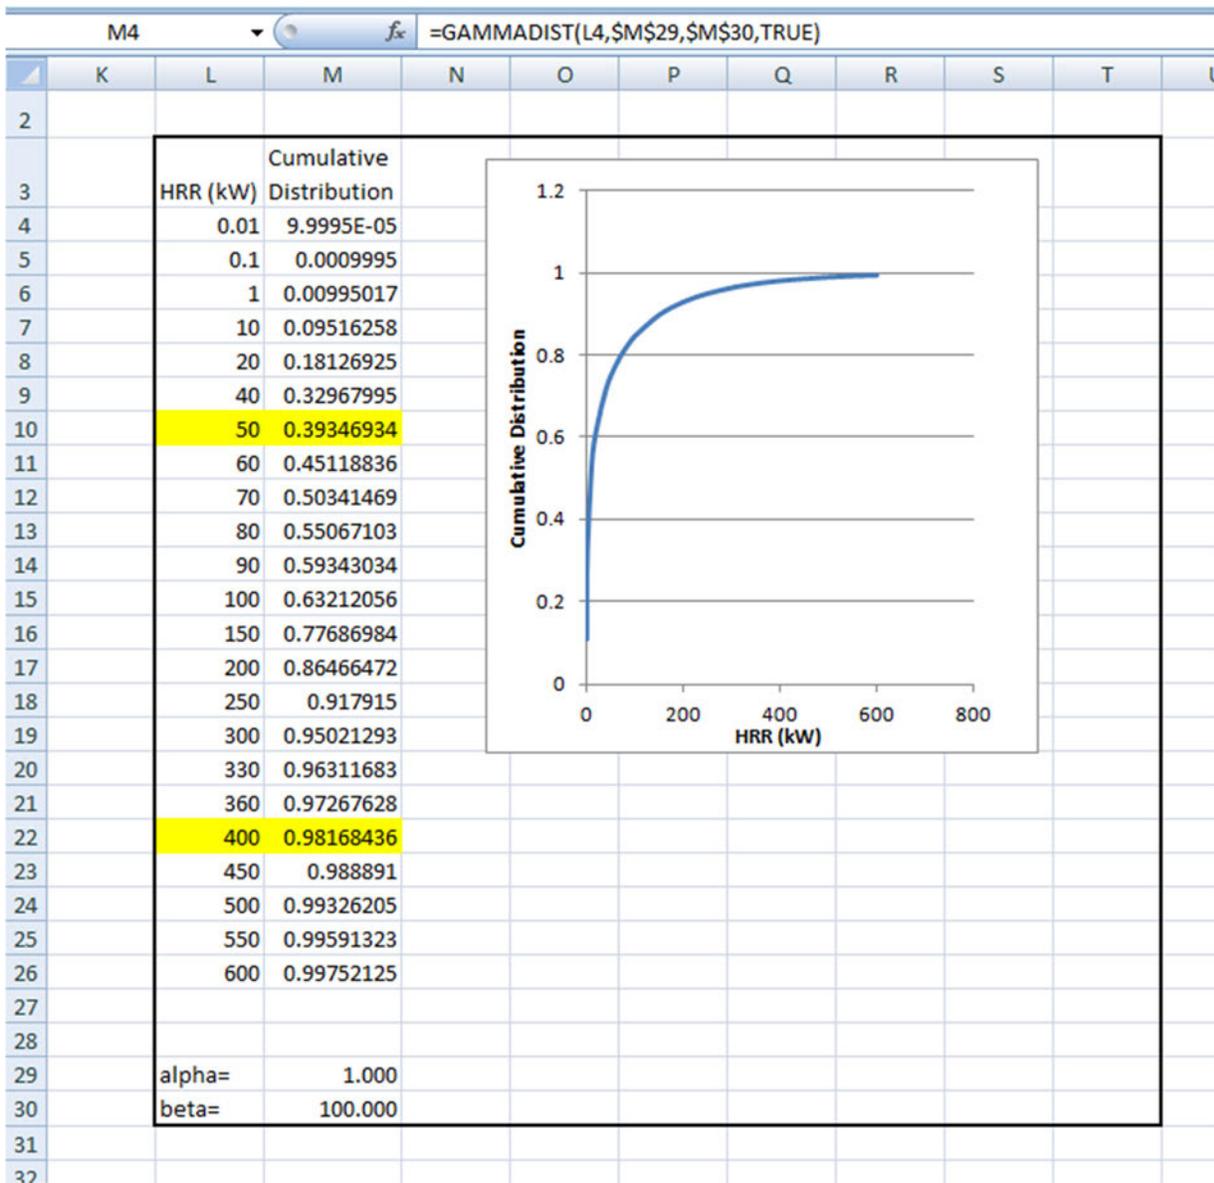


Figure D-1
Screen Capture Depicting the Initial Setup in Microsoft Excel for Determining Alpha and Beta Parameters for the Gamma Distribution

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

The best-fit values of alpha and beta are calculated as follows:

- **Step 1:** Under the “Data” tab, click “Solver” and the following box pops up. Fill in the boxes as shown and click “Solve”.

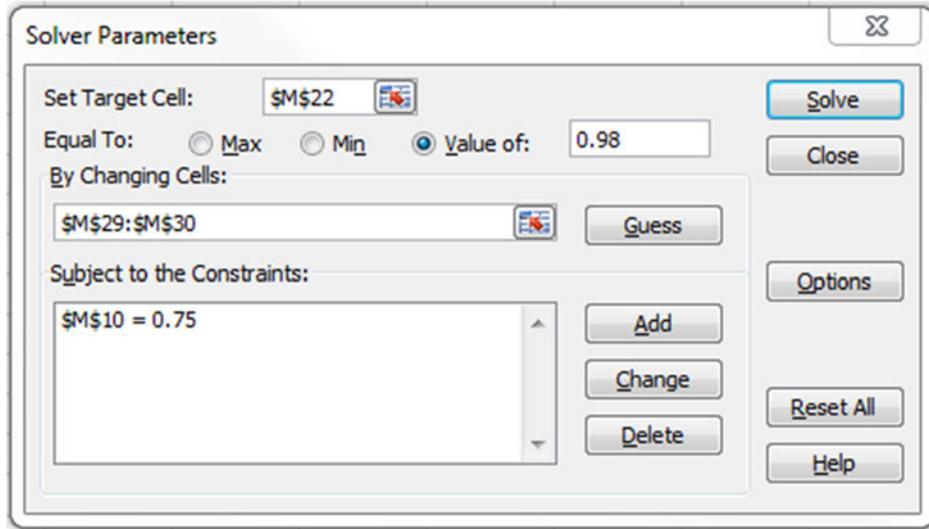


Figure D-2
Step 1 in Calculating Alpha and Beta Parameters for the Gamma Distribution Using Microsoft Excel

- **Step 2:** The following box appears. Click “OK”.

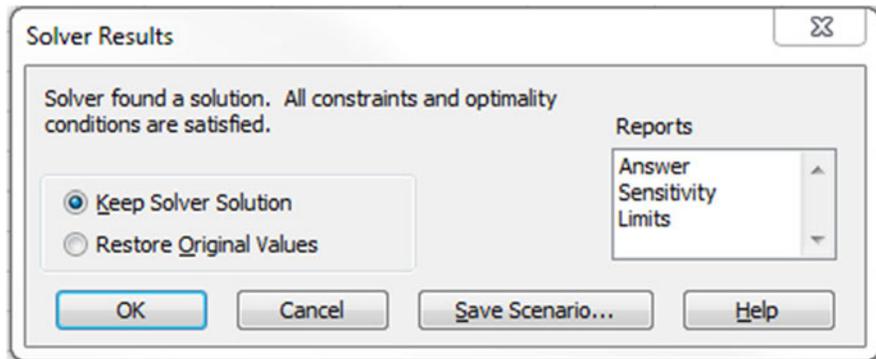


Figure D-3
Step 2 in Calculating Alpha and Beta Parameters for the Gamma Distribution Using Microsoft Excel

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

- **Result:** The best-fit values of alpha and beta appear in cells M29 and M30, as shown in Figure D-4. Checking the results shows that indeed the cumulative distribution of HRR=50 kW is 0.75 and the cumulative distribution of 400 kW is 0.98.

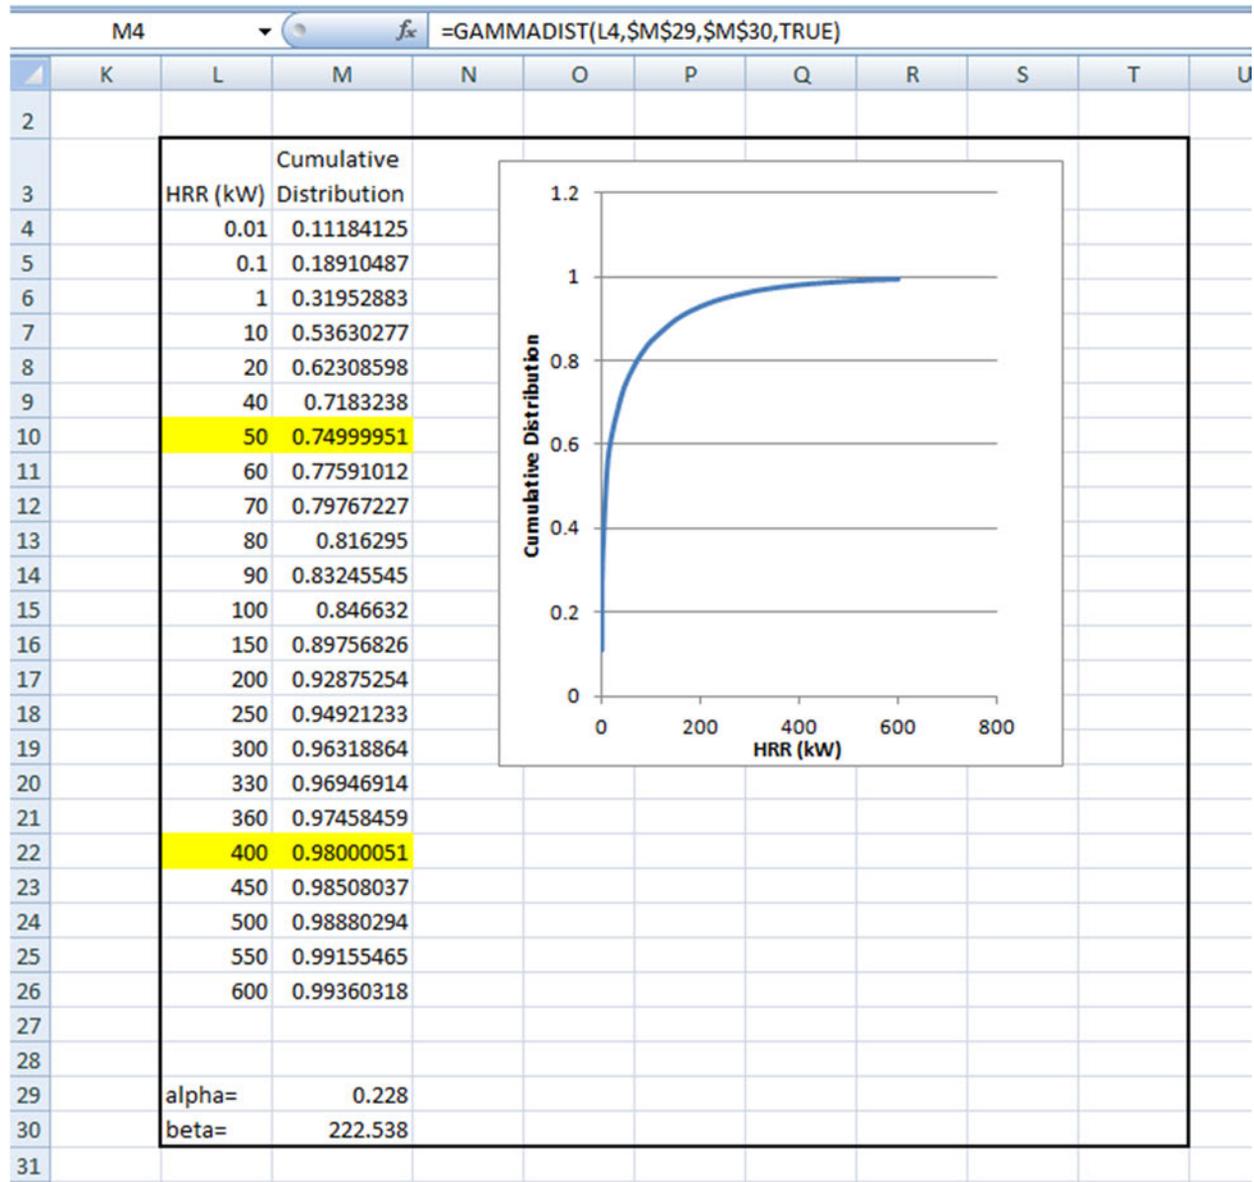


Figure D-4
Final Step in Calculating Alpha and Beta Parameters for the Gamma Distribution Using Microsoft Excel

D.4 Data Analysis

This section provides the following information:

- Plots depicting:
 - The empirical distribution developed using the selected experimental data (red dot-dash line) as assigned to each electrical enclosure classification. The empirical distributions depicted in these plots are considered nominal representations of the applicable data.
 - The best fit gamma distribution for the experimental data (green dash line). Notice that this best fit is based on the selected experimental data only for the electrical enclosure classification.
 - The gamma distribution recommended by the working group (blue solid line) for each electrical enclosure classification.
- Plots depicting the experimental data selected as representative of each electrical enclosure classification. Values above round markers list the test heat release rate value in units of kW.
- For convenience in reviewing this material, tables are provided that list the parameters for the probability distributions for each of the electrical enclosure classifications discussed in this section (see Tables D-3 through D-9). The Alpha and Beta columns refer to the parameters of the Gamma distribution function, and the 75th and 98th columns refer to the 75th and 98th percentile values of the probability distribution in kW. Each table also specifies whether the distribution applies to open or closed door configuration, TS/QTP/SIS or unqualified TP cable insulation/jacket materials, and the amount of combustible loading within the enclosure.

For some of the enclosure classifications, the assigned data sets are strong (many data points) while others are quite weak (very few data points). Significant differences do exist for certain cases when the empirical and recommended distributions are compared. In some cases the final recommended distributions are somewhat more conservative than the nominal data set while others are less conservative. As suggested earlier, this is because the working group considered the full range of tests and made decisions as to whether or not the data set fully represented each classification group. Specific considerations included in the working group deliberations are described in the sections that follow and include the following general observations:

- In some cases, the working group decided that the selected data set may not have represented worst-case conditions possible for the given enclosure classification. In such cases, the working group gave consideration to other test results that might not be considered fully applicable to the classification group but that could be used to inform the final decisions regarding the worst-case fire potential.
- In other cases, the selected data set may have been found to overstate the fire potential under more realistic conditions. In these cases, the working group may have discounted certain test results and did not attempt to fully bound the assigned data set.
- In some cases, the data sets are very sparse and provide a poor basis for assignment of a final profile. In these cases the working group considered the totality of the available data and consistency with the results for other enclosure classifications.
- The working group's recommended distributions were developed as a cohesive and self-consistent set. In all cases the final recommended distributions were informed, to at

least some degree, based on consistency with the other distributions. Hence, the recommended distributions reflect both the absolute behavior of each classification group and the relative behavior anticipated between classification groups.

- The distinctions between the TP and TS/QTP/SIS cable sub-cases follow a similar pattern for each classification group. The recommended worst-case 98th percentile values are the same for the two sub-cases, but the 75th percentile values for TS/QTP/SIS cables are half the value assigned to the corresponding TP cable case (meaning large fires are less likely given TS/QTP/SIS cables). This approach reflects previous studies of cable burning (e.g., the SNL/NRC tests) which have shown that fire spread among cables is a threshold type behavior; that is, cables are generally resistant to fire spread until a minimum threshold of energy is reached, after which fire spread begins. TS/QTP/SIS cables generally have a higher threshold for fire spread (i.e., it is harder to induce fire spread in TS/QTP/SIS cables) but tests also show that once a sustained and growing fire is created, TS/QTP/SIS cables can burn with an intensity equivalent to that of TP cables (e.g., compare SNL tests 23 and 24).
- A final factor considered in establishing the peak HRR distributions was the level of electrical energy available within the enclosure under actual operating conditions. Fire events show that most enclosure ignitions are tied to electrical faults. The working group agreed that, all other factors being equal, the presence of a higher level of electrical energy (i.e., voltage and current) would imply a greater potential for more energetic ignition events, and faster growing fires. While several tests in the available data sets have used electrical ignition sources, none used higher energy electrical ignition sources. As a result, for some of the non-control enclosure classification groups the working group chose to extend the 98th percentile (worst-case) fire conditions somewhat to reflect the higher energy levels present compared to the applicable data sets.

D.4.1 Switchgears and Load Centers

Switchgears and load centers were identified as one classification because of their functionality, which allows for a relatively easy process for identifying the electrical enclosure and assigning a peak HRR probability distribution. It should be noted that HRR profiles for switchgears and load centers have not been explicitly tested in any of the available experimental programs. The assessment of the probability distributions for the peak HRR was based on a comparison between the cable configuration in these types of enclosures, as depicted in numerous pictures inspected by the WG, and the experimental configuration of the different test series. In general terms, the WG agreed that these types of enclosures are characterized by relatively low combustible loading dominated by larger diameter power cables. Therefore, the assessment is based mostly on using tests with lower combustible loads and vertical electrical enclosures (i.e., no benchboard type enclosures) and with tightly bundled cables, resulting in lower HRRs as depicted in Figure D-5 and Figure D-6.

For the case of TS/QTP/SIS cable, the WG assessment is close to the empirical distribution developed for the selected fire tests (see the solid blue line in Figure D-5). The data sample applicable to this classification includes peak HRR values ranging from 0 kW to 82 kW. Specifically, the WG assessment for the 75th percentile is very close to the data sample selected and given the lack of specific testing for these types of cabinets a longer tail for the 98th percentile was selected based on the energy available in these enclosures when energized. In addition, some of the WG members considered tests with higher HRRs as applicable to this classification. For example, members may have considered tests having tight cable bundle arrangements with a relatively high energy ignition source. This influences the selection of the 98th percentile to ensure a potential fire intensity is captured in the distribution.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

In the case of TP cable content, there is a very small set of data given the loading configuration and cable material of the tests. The data sample applicable to this classification includes peak HRR values ranging from 7 kW to 42 kW. Therefore the recommended distribution had to be informed by other electrical enclosure classifications. For example, the WG agreed that the 75th percentile should be larger than the equivalent classification for the TS/QTP/SIS cable (i.e., 30 kW for TS/QTP/SIS and 60 kW for TP cables). In addition, given the relatively low combustible loading of these enclosures in the plant configurations, the WG agreed that the 98th percentile for both TP and TS/QTP/SIS were equivalent (i.e., 170 kW).

Table D-3
Working Group Recommended Distributions for Switchgears and Load Centers

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
SWGR & Load Center	N/A	TS/QTP/SIS	N/A	0.32	79	30	170
	N/A	TP	N/A	0.99	44	60	170

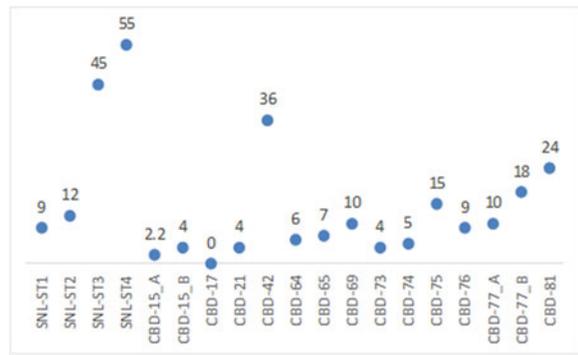
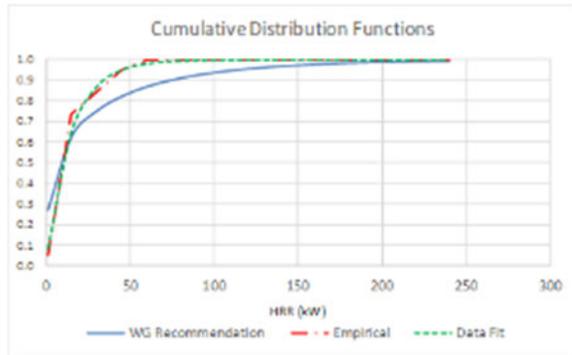


Figure A.1
Power Switchgear and Load Center TS/QTP/SIS. Values above round markers list the test heat release rate value in units of kW.

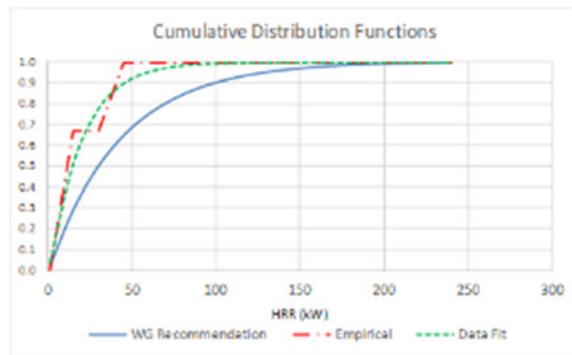


Figure D-6
Power Switchgear and Load Center TP. Values above round markers list the test heat release rate value in units of kW.

D.4.2 Motor Control Centers

As is the case with switchgears and load centers, the HRR profiles for motor control centers (MCCs) have not been explicitly tested. A classification for MCCs was developed due to its characteristic functionality and common usage in NPPs. The assessment of the probability distributions for the peak HRR was based on a comparison between the cable configuration in these types of enclosures, as depicted in numerous pictures inspected by the WG, and the experimental configuration of the different test series. In general terms, the WG agreed that these types of enclosures are characterized by relatively low combustible loading but also by a combustible loading dominated by smaller power and control cables (e.g., as compared to switchgear and load centers). Therefore, the assessment is based mostly on using tests with lower combustible loads and vertical electrical enclosures (i.e., no benchboard type enclosures). The WG identified the relatively narrow vertical risers adjacent to the breaker cubicles routing cables along the height of the motor control center as a key factor. This configuration characteristic (i.e., fire spread into the vertical riser) was considered in developing the probability distributions, which are depicted in Figure D-7 and Figure D-8.

For the case of TS/QTP/SIS cable, the WG assessment is close to the empirical distribution developed for the selected fire events. The data sample applicable to this classification includes peak HRR values ranging from 0 kW to 55 kW (see Figure D-7). Specifically, the WG assessment for the 75th percentile is very close to the data sample selected and given the lack of specific testing for these types of cabinets a longer tail for the 98th percentile was selected based on the energy available in these enclosures when energized. In addition, some of the WG members considered tests with higher HRRs as applicable to this classification (e.g., a given test may have had tight cable bundle arrangements with a relatively high energy ignition source), which influenced the selection of the 98th percentile to ensure a potential fire intensity is captured in the distribution.

In the case of TP cable content, there is a very small set of data given the loading configuration and cable material of the tests. The data sample applicable to this classification includes peak HRR values ranging from 7 kW to 42 kW (Figure D-8). Therefore the recommended distribution had to be informed by other electrical enclosure classifications. For example, the WG agreed that the 75th percentile should be larger than the equivalent classification for the TS/QTP/SIS cable. In addition, given the relatively low combustible loading of these enclosures in the plant configurations, the working group agreed that the 98th percentile values for both TP and TS/QTP/SIS were equivalent.

Table D-4
Working Group Recommended Distributions for Motor Control Centers

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
MCC & Battery Chargers	N/A	TS/QTP/SIS	N/A	0.36	57	25	130
	N/A	TP	N/A	1.21	30	50	130

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

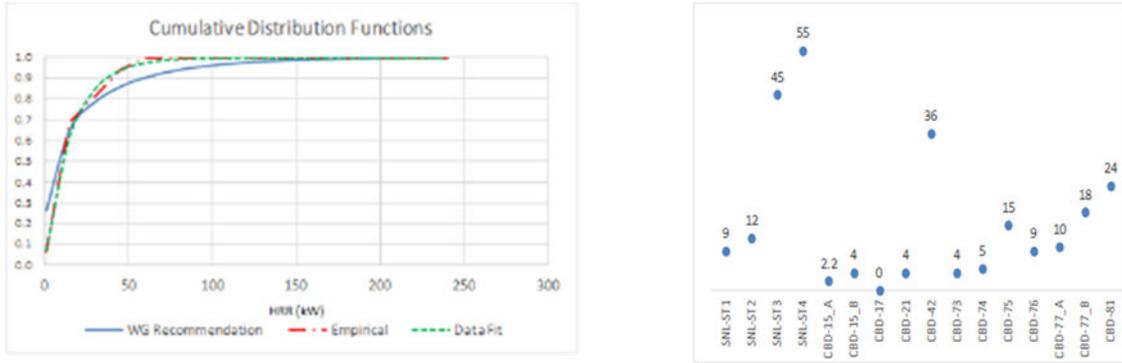


Figure D-7
Power MCC and Charger TS/QTP/SIS. Values above round markers list the test heat release rate value in units of kW.

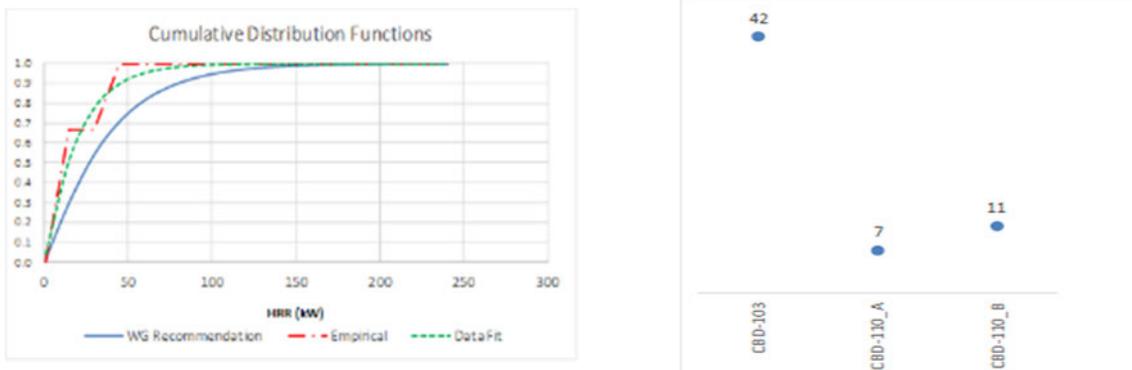


Figure D-8
Power MCC and Charger TP. Values above round markers list the test heat release rate value in units of kW.

D.4.3 Control Large Closed Electrical Enclosures

Due to the wide range of cable configurations associated with control cabinets, this classification includes six probability distributions to account for the total cable/fuel content and the type of cables in the electrical enclosure. For the case of closed large control panels with TS/QTP/SIS cable, the peak HRR in the applicable data ranges from 0 kW to 138 kW as depicted in Figure D-9, Figure D-10, and Figure D-11. The Default, Low, and Very Low fuel loading distributions recommended by the WG are close to the empirical distributions resulting from plotting the applicable data. In addition, the WG extended the 98th percentile in the Default case to 400 kW to account for potential configurations that may include combustible loading other than cables (e.g., circuit cards, etc.) and/or the recognition that once ignited, TS/QTP/SIS and TP cables could produce similar HRR values. Test 1 from VTT test series 186 was used to inform the selection of the 98th percentile value. VTT 186 may overstate the fire potential due to the arrangement of fuel near the electrical ignition point. Hence the final distributions for these two classifications represent, to some extent, a blending of the two data sets. That is, the WG agreed that the worst-case potential is similar for TS/QTP/SIS and TP cables to ignite but that TP cables spread fire more easily. The distributions for Low and Very Low fuel loading include 98th percentiles within the applicable data range.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

For the case of TP cable, the peak HRR values in the applicable data range from 0 kW to 388 kW as depicted in Figure D-12, Figure D-13, and Figure D-14. Given the “closed cabinet” configuration, the WG agreed to maintain the 98th percentiles assigned earlier to TS/QTP/SIS cables and to increase the 75th percentiles of the distribution to account for the increased fire hazard associated with TP cable.

Table D-5
Working Group Recommended Distributions for Large Control Enclosures with Closed Doors

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
Control Large	Closed	TS/QTP/SIS	Default	0.23	223	50	400
	Closed	TS/QTP/SIS	Low	0.23	111	25	200
	Closed	TS/QTP/SIS	Very Low	0.38	32	15	75
	Closed	TP	Default	0.52	145	100	400
	Closed	TP	Low	0.52	73	50	200
	Closed	TP	Very Low	0.88	21	25	75

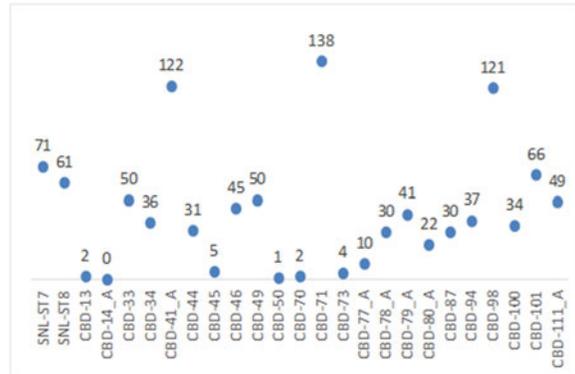
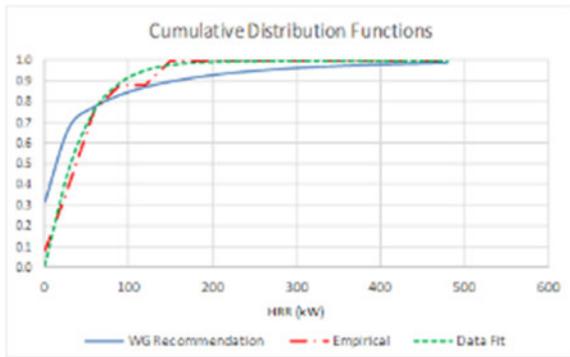


Figure D-10
Control Large Closed TS/QTP/SIS-Default. Values above round markers list the test heat release rate value in units of kW.

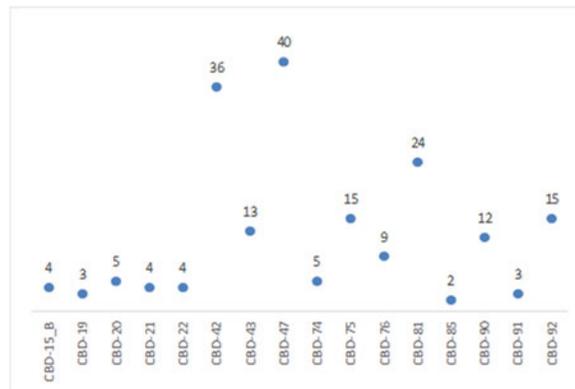
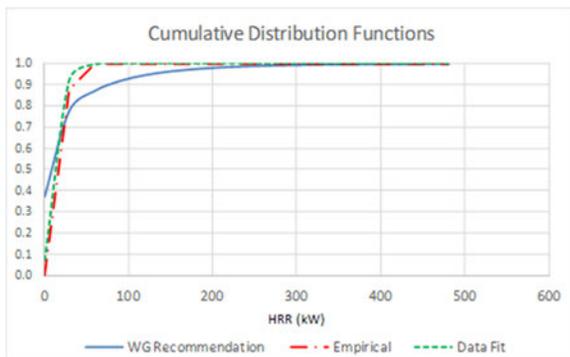


Figure D-11
Control Large Closed TS/QTP/SIS-Low. Values above round markers list the test heat release rate value in units of kW.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

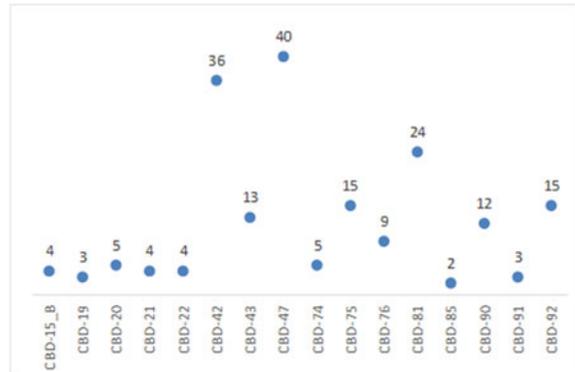
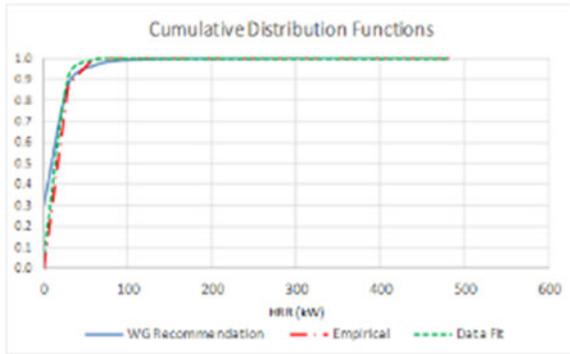


Figure D-12
Control Large Closed TS/QTP/SIS-Very Low. Values above round markers list the test heat release rate value in units of kW.

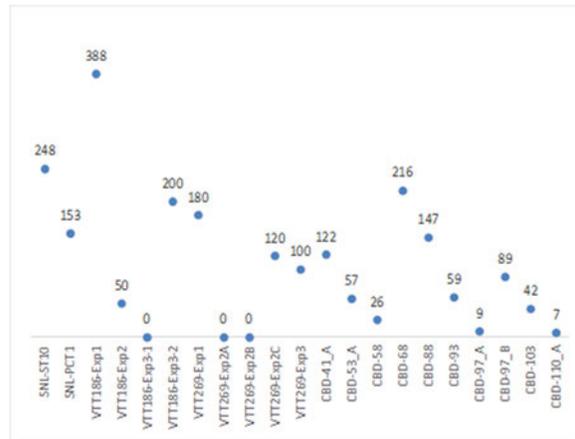
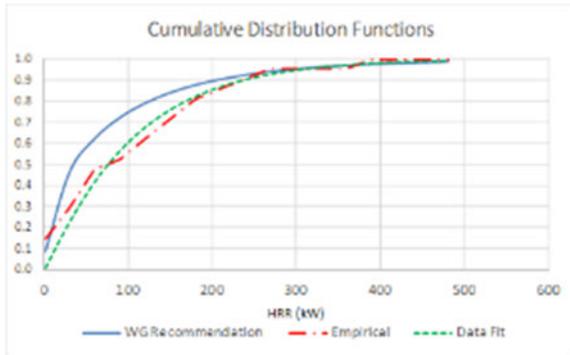


Figure D-13
Control Large Closed TP-Default. Values above round markers list the test heat release rate value in units of kW.

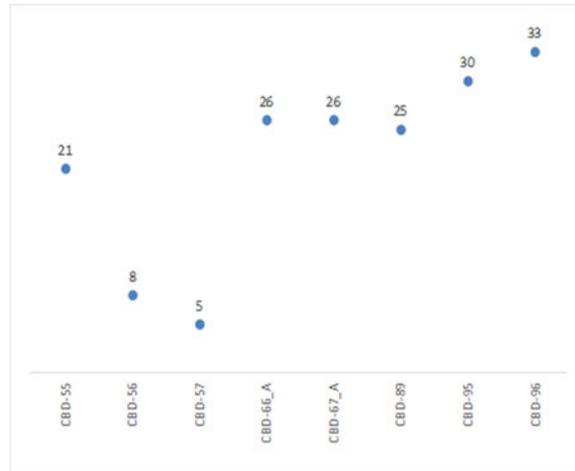
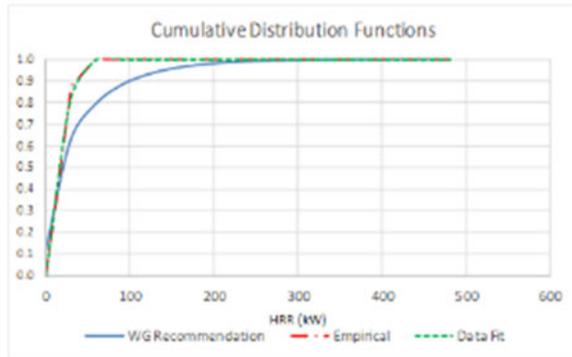


Figure D-14
Control Large Closed TP-Low. Values above round markers list the test heat release rate value in units of kW.

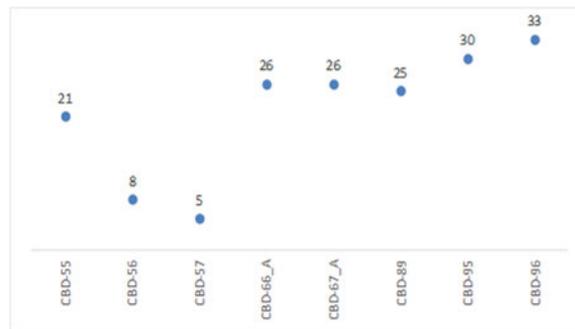
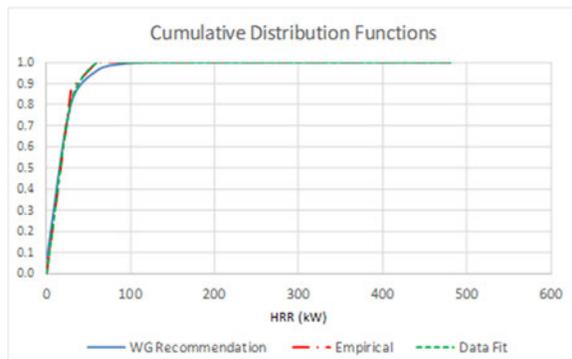


Figure D-15
Control Large Closed TP-Very Low. Values above round markers list the test heat release rate value in units of kW.

D.4.4 Control Large Open Electrical Enclosures

The large open control TS/QTP/SIS and TP classifications are associated with two of the largest experimental data sets. For the case of TS/QTP/SIS cable, one of the SNL tests (i.e., Test 23) was removed due to the large ignition source, which is not representative of ignition sources within electrical enclosures in commercial NPPs. The TP data set does include two very large fire tests (SNL Test 24 and SNL Test 25). The TS/QTP/SIS applicable data ranges from 0 kW to 268 kW, as depicted in Figure D-15, Figure D-16, and Figure D-17. The TP applicable data ranges from 5 kW to 1300 kW, as depicted in Figure D-18, Figure D-19, and Figure D-20.

In general, the distributions recommended by the WG are close to the empirical ones. The only exception is the Default distribution for open cabinets with TP cable. Recall the discussion for large cabinets earlier (i.e., the WG discounted the effects of Tests 24 and 25 because of the nature of fuel immediately adjacent to the ignition source). Therefore the empirical data suggests higher HRRs than what the WG recommended for this classification.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

Table D-6
Working Group Recommended Distributions for Large Control Enclosures with Open Doors

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
Control Large	Open	TS/QTP/SIS	Default	0.26	365	100	700
	Open	TS/QTP/SIS	Low	0.26	182	50	350
	Open	TS/QTP/SIS	Very Low	0.38	32	15	75
	Open	TP	Default	0.38	428	200	1000
	Open	TP	Low	0.38	214	100	500
	Open	TP	Very Low	0.88	21	25	75

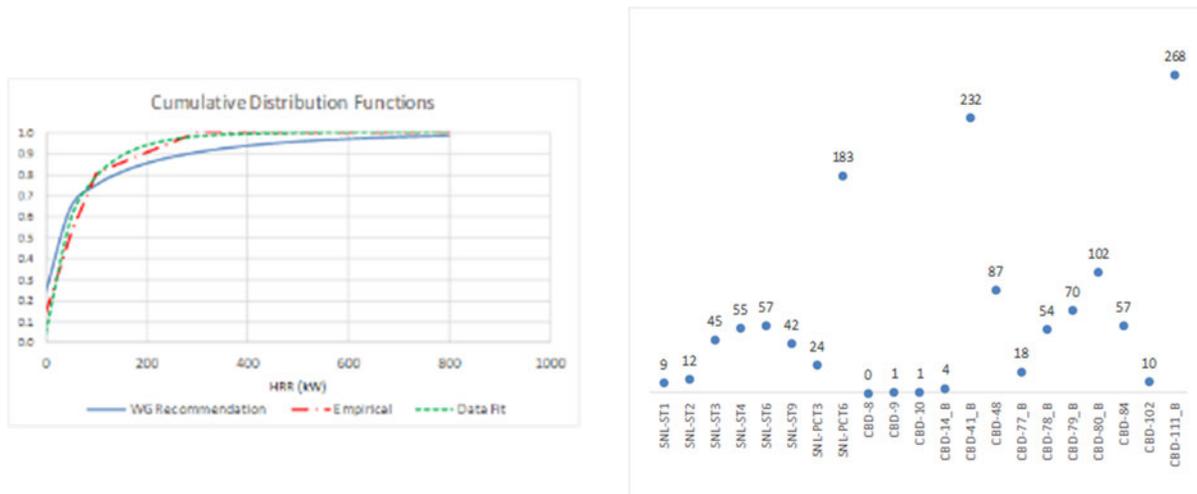


Figure D-16
Control Large Open TS/QTP/SIS-Default. Values above round markers list the test heat release rate value in units of kW.

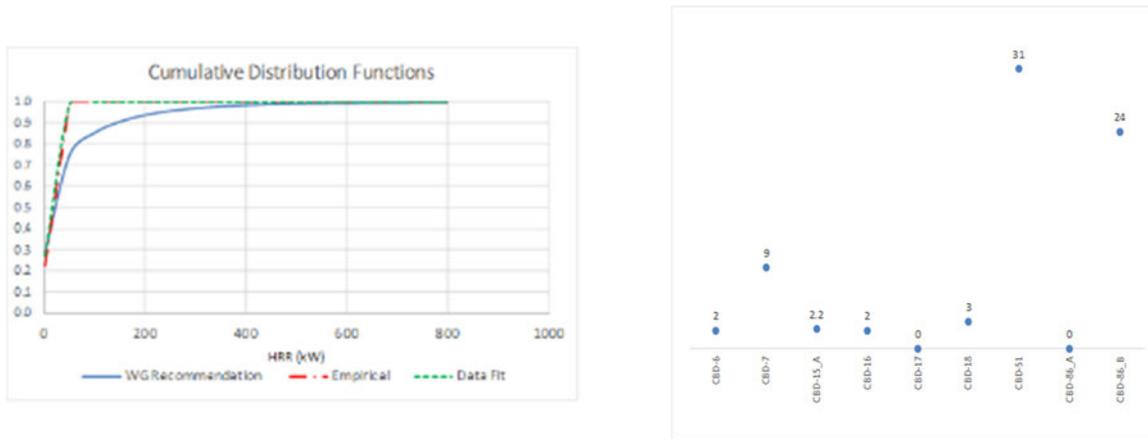


Figure D-17
Control Large Open TS/QTP/SIS-Low. Values above round markers list the test heat release rate value in units of kW.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

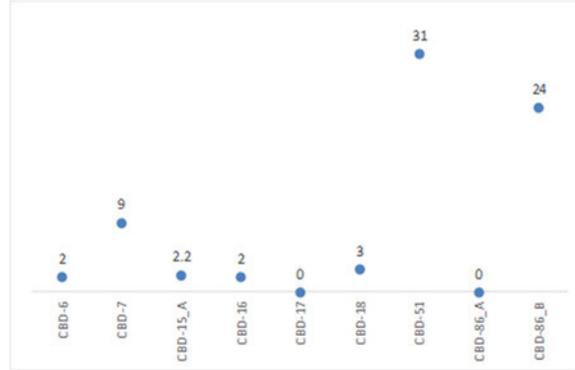
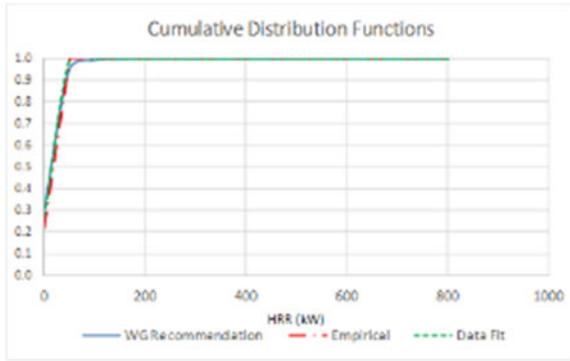


Figure D-18
Control Large Open TS/QTP/SIS-Very Low. Values above round markers list the test heat release rate value in units of kW.

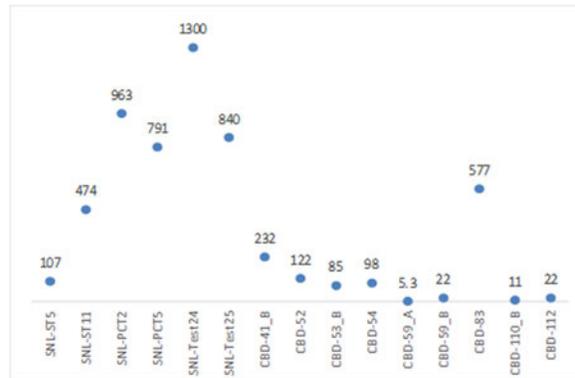
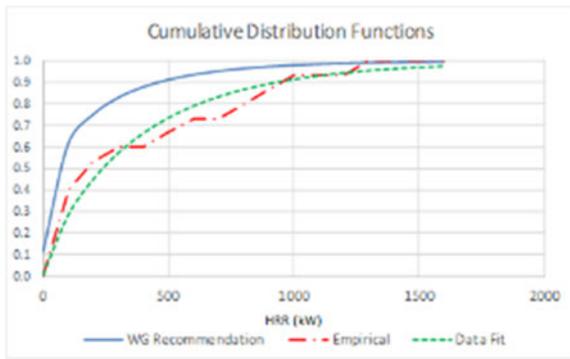


Figure D-19
Control Large Open TP-Default. Values above round markers list the test heat release rate value in units of kW.

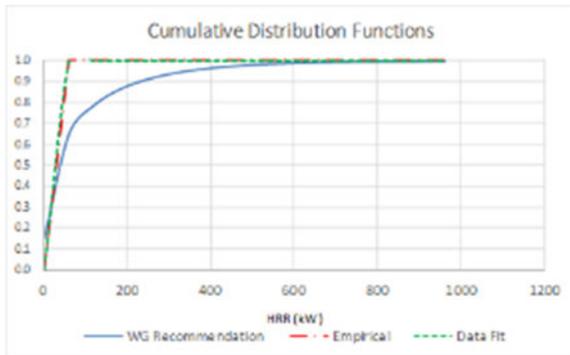


Figure D-20
Control Large Open TP-Low. Values above round markers list the test heat release rate value in units of kW.

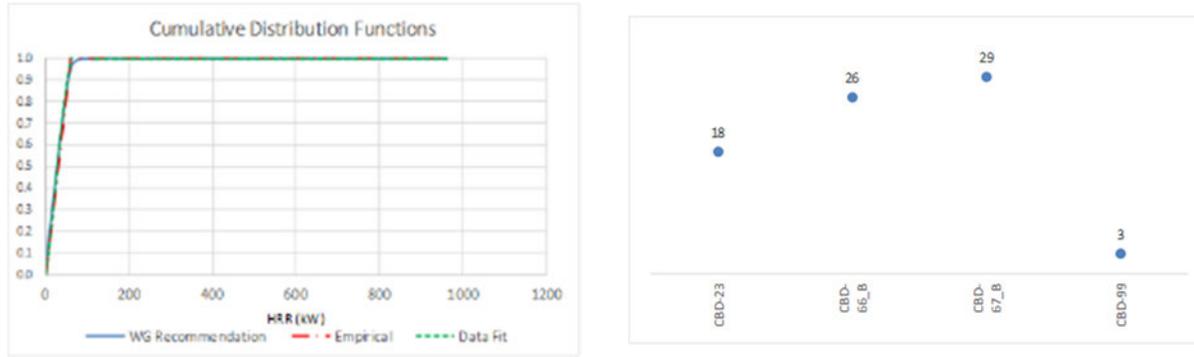


Figure A.1D-21
Control Large Open TP-Very Low. Values above round markers list the test heat release rate value in units of kW.

D.4.5 Control Medium Closed Electrical Enclosures

Due to the wide range of cable configurations associated with control cabinets, this classification includes four probability distributions to account for the cable content, ventilation conditions, and type of cables in the electrical enclosures. For the case of closed medium control panels with TS/QTP/SIS cable, the peak HRRs in the applicable data range from 0 kW to 169 kW as depicted in Figure D-21 and Figure D-22. The Default and Low distributions recommended by the WG are close to the empirical distributions resulting from plotting the applicable data. In addition, the WG agreed that the data set might not include potential worst-case conditions and decided to extend the 98th percentile in the Default case to 200 kW to account for potential configurations not included in the experimental programs. CBD Test 38 produced a peak HRR of 169 kW, which was used by the WG to inform the selection of the 98th percentile. The distribution for Low include 98th percentiles within the applicable data range.

For the case of TP cable, the peak HRR values in the applicable data range from 4 kW to 88 kW as depicted in Figure D-23 and Figure D-24. Given the “closed cabinet” configuration, the WG agreed to maintain the 98th percentiles assigned earlier to TS/QTP/SIS cables and to increase the 75th percentiles of the distribution to account for the increased fire hazard associated with TP cable. This was based in part on having a limited set of applicable data for medium panels with TP cable.

Table D-7
Working Group Recommended Distributions for Medium Control Enclosures with Closed Doors

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
Control Medium	Closed	TS/QTP/SIS	Default	0.23	111	25	200
	Closed	TS/QTP/SIS	Low	0.27	51	15	100
	Closed	TP	Default	0.52	73	50	200
	Closed	TP	Low	0.52	36	25	100

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

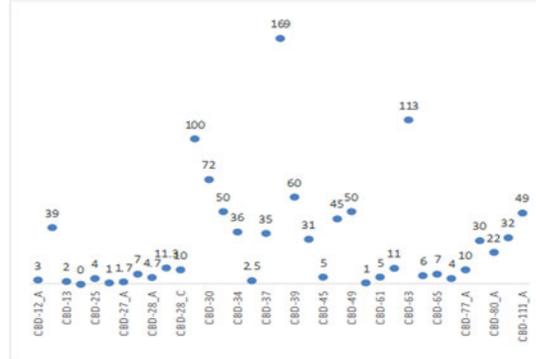
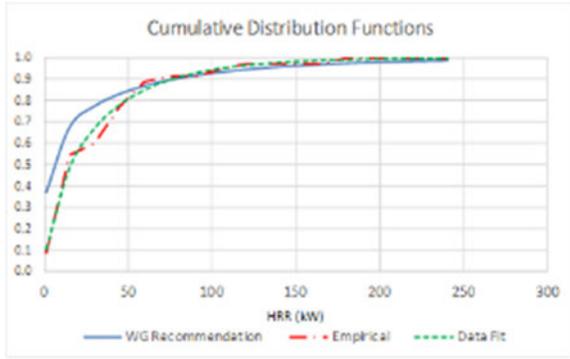


Figure A.1
Medium Closed TS/QTP/SIS-Default. Values above round markers list the test heat release rate value in units of kW.

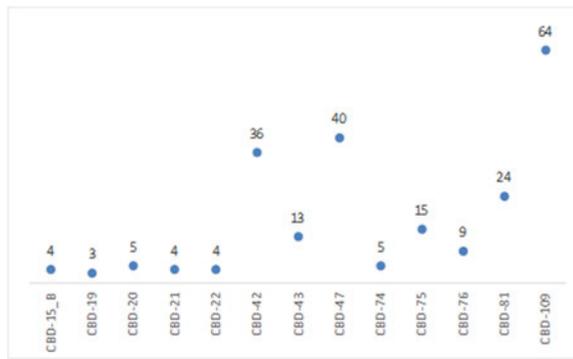
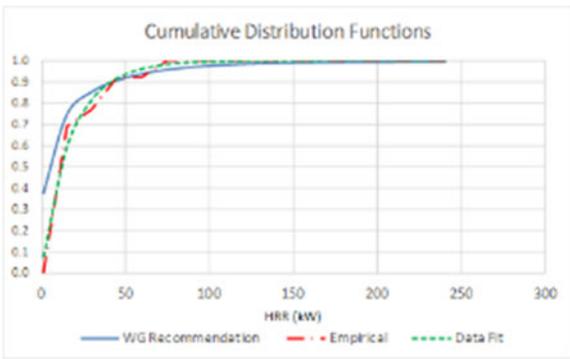


Figure D-23
Control Medium Closed TS/QTP/SIS-Low. Values above round markers list the test heat release rate value in units of kW.

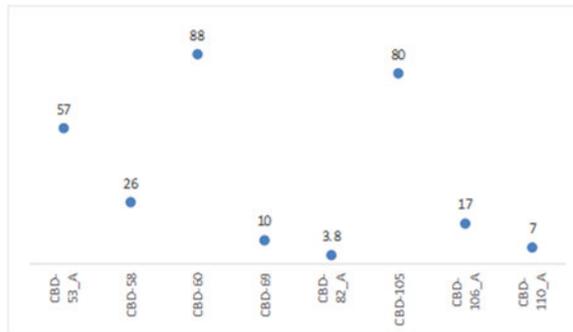
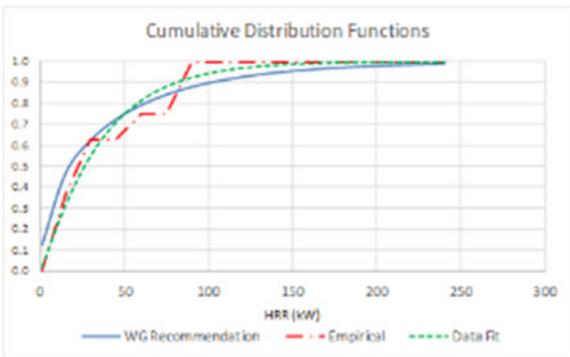


Figure D-24
Control Medium Closed TP-Default. Values above round markers list the test heat release rate value in units of kW.

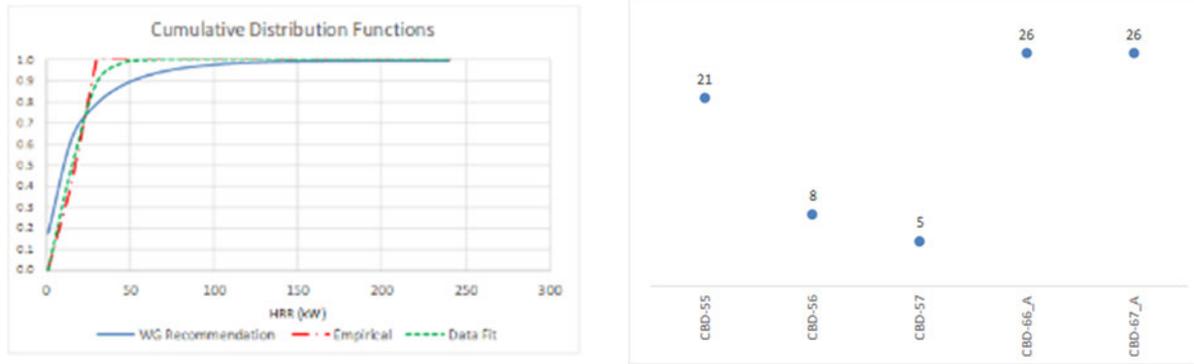


Figure D-25
Control Medium Closed TP-Low. Values above round markers list the test heat release rate value in units of kW.

D.4.6 Control Medium Open Electrical Enclosures

Due to the wide range of cable configurations associated with control cabinets, this classification includes four probability distributions to account for the total cable/fuel content and type of cables in the electrical enclosures. For the case of closed medium control panels with TS/QTP/SIS cable, the peak HRRs in the applicable data set range from 1 kW to 268 kW as depicted in Figure D-25 and Figure D-26. For the case of TP cable, peak HRR values in the applicable data range from 5 kW to 250 kW as depicted in Figure D-27 and Figure D-28.

The Default and Low distributions recommended by the WG are close to the empirical distributions resulting from plotting the applicable data. In addition, the WG extended the 98th percentile in the Default case to 325 kW to account for potential configurations that may include combustible loading other than cables (e.g., circuit cards, etc.) and/or the recognition that once ignited, TS/QTP/SIS and TP cables could produce similar HRR values. Test CBD 111B, which resulted in a peak HRR of 268 kW, was used to inform the selection of the 98th percentile value for the default distribution HRR categories.

Consistent with other HRR classifications, the 75th percentile for TP is higher than TS/QTP/SIS to account for the increased fire hazard. The distributions for Low classifications include 98th percentiles within the applicable data range.

Table D-8
Working Group Recommended Distributions for Medium Control Enclosures with Open Doors

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
Control Medium	Open	TS/QTP/SIS	Default	0.23	182	40	325
	Open	TS/QTP/SIS	Low	0.19	92	15	150
	Open	TP	Default	0.51	119	80	325
	Open	TP	Low	0.30	72	25	150

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

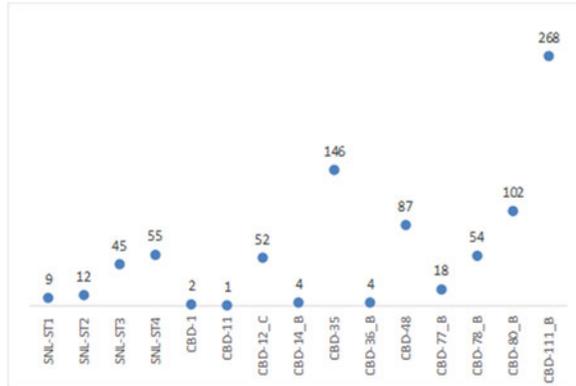
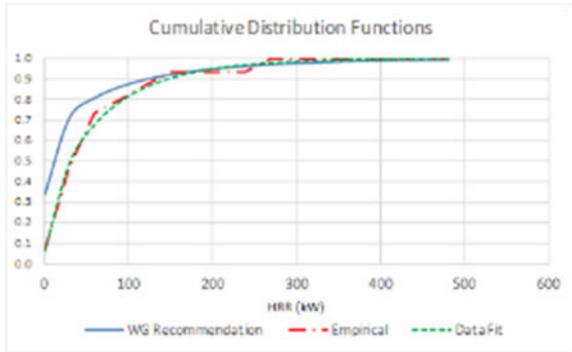


Figure D-26
Medium Open TS/QTP/SIS-Default. Values above round markers list the test heat release rate value in units of kW.

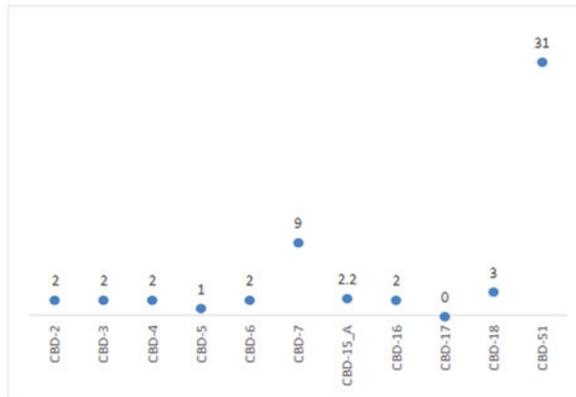
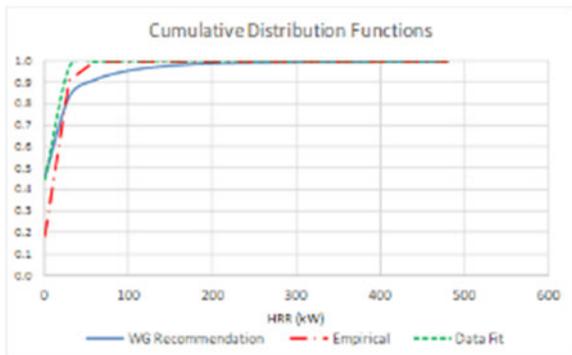


Figure D-27
Control Medium Open TS/QTP/SIS-Low. Values above round markers list the test heat release rate value in units of kW.

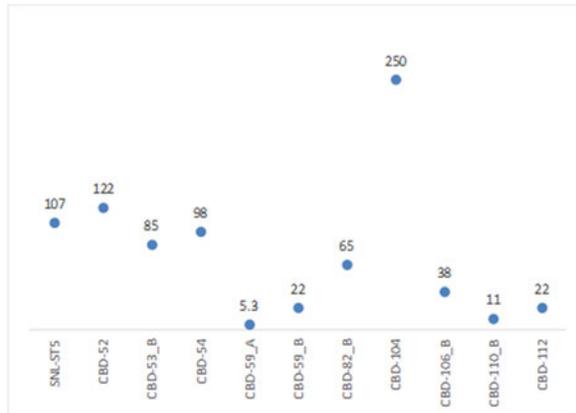
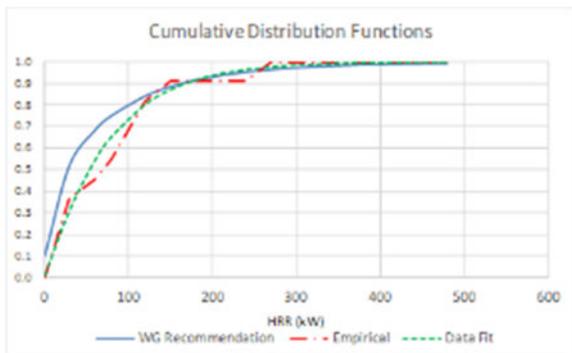


Figure D-28
Control Medium Open TP-Default. Values above round markers list the test heat release rate value in units of kW.

ELECTRICAL CABINET HEAT RELEASE RATE DATA ANALYSIS

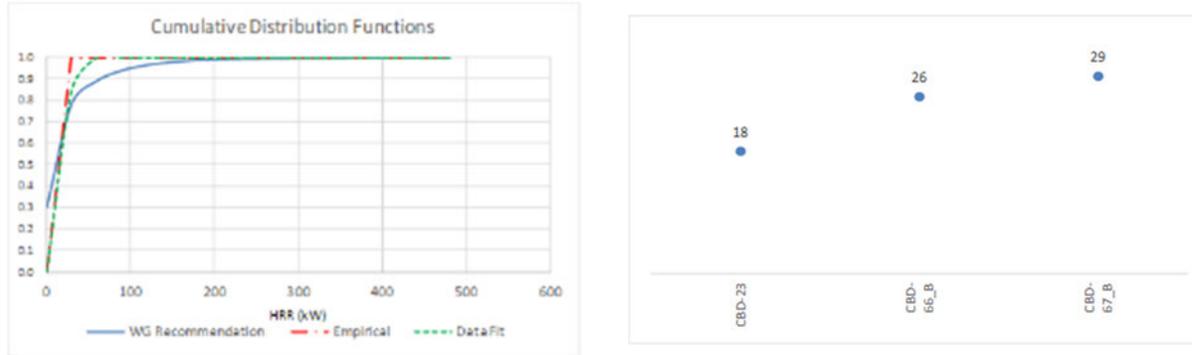


Figure D-29
Control Medium Open TP-Low. Values above round markers list the test heat release rate value in units of kW.

D.4.7 Control Medium/Very Low and Small Electrical Enclosures

Small control electrical enclosures were not specifically tested in the available experimental programs. Consequently, the WG agreed on one peak HRR distribution to cover both the control medium – very low and small electrical enclosure bins. This decision was based on available tests consisting of relatively low combustible loading and cases of higher fuel loading where little or no fire spread was observed. The applicable data, as depicted in Figure D-29, includes peak HRR values ranging from 2 kW to 55 kW. The WG agreed that the fire intensities observed from these enclosures should be small, and that the data set likely overstated the fire potential for small electrical enclosures with such limited fuel loads. The WG therefore agreed on a 75th percentile value of 15 kW. The distribution recommended by the WG is close to the empirical one developed directly from the applicable data set.

Table D-9
Working Group Recommended Distributions for Small Control Enclosures

Classification	Doors	Cable Material	Combustible Loading	Alpha	Beta	75 th (kW)	98 th (kW)
Control Small	N/A	N/A	N/A	0.88	12	15	45

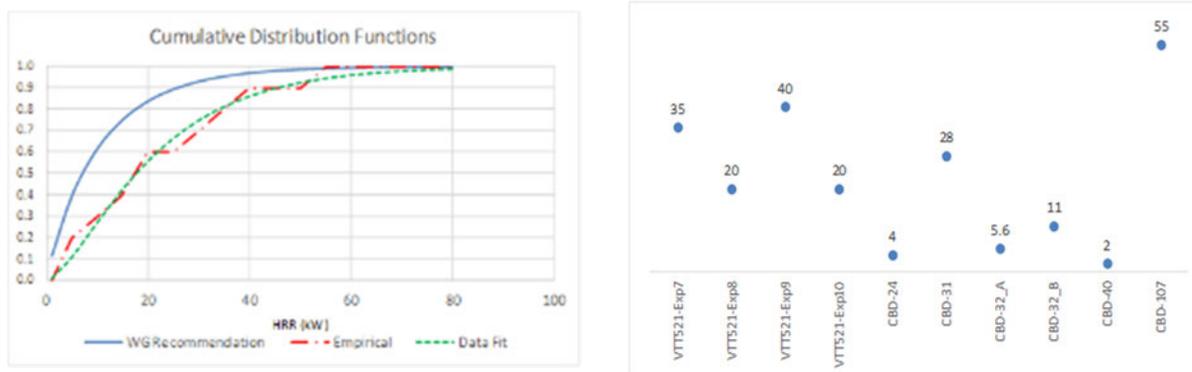


Figure D-30
Control Small. Values above round markers list the test heat release rate value in units of kW.

Appendix E

OBSTRUCTED PLUME FIRE MODELING RESULTS

THE INFORMATION FOR THIS APPENDIX IS PROVIDED IN ELECTRONIC FORMAT (SEE THE ATTACHED CD OR WEB BASED RESOURCES (EPRI.COM OR NRC.GOV)).

Appendix F

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

This appendix includes two examples illustrating the process of applying guidance documented in this report. The examples cover the recommended process for classifying electrical enclosures that are selected as ignition sources for fire probabilistic risk assessment (PRA) applications, assigning peak heat release rate (HRR) probability distributions to such enclosures, and determining their corresponding zones of influence.

F.1 Example 1: Load Center Fire with Targets in the Fire Plume

This example describes the process of assigning a peak HRR probability distribution to an electrical enclosure, determining the resulting severity factor, and defining the corresponding zone of influence. The example consists of the following steps:

1. Scenario definition
2. Classification of the electrical enclosure
3. Determination of the peak HRR distribution
4. Determination of the corresponding zone of influence (ZOI)
5. Determination of the severity factor

The following sections describe each of the above listed steps in detail.

F.1.1 Description of the Scenario

A fire is postulated in a load center cubicle (i.e., vertical section) located in a typical electrical room in a commercial nuclear power plant. The load center vertical section is 3 feet wide and 2 feet deep. The height of the enclosure is 7 feet. The scenario is depicted in Figure F-1.

There are two cable trays in the room, and each of them contains target cables that are within the scope of the Fire PRA. The cables in trays T-1 and T-2 have thermoplastic jackets and insulation. Table H-1 in NUREG/CR-6850 recommends a value of 205°C (400°F) for temperature damage criteria and 6 kW/m² (0.5 BTU/ft²s) for radiant heat damage criteria.

Cables of interest are in trays T-1 and T-2, which are located at 3 feet and 5 feet above the load center, respectively. These cable trays are exposed to fire plume conditions. Through inspection of the ignition source and cable tray layout during walkdowns and using plant drawings, the following scenario progression and target sets are evaluated:

- Target Set 0: This scenario consists of a fire damaging only the load center.
- Target Set 1: This scenario consists of damage propagating outside the load center and damage the cable tray, T-1, above the electrical enclosure—that is, damage in the fire plume less than 5 feet above the electrical enclosure. In this scenario, T-2 also fails due to the fire propagating from cable tray T-1.

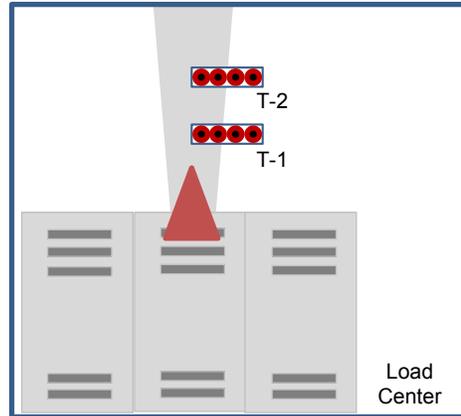


Figure F-1
Pictorial Representation of the Load Center Example

F.1.2 Classification of the Electrical Enclosure

The scenario consists of a load center. Since the load center is an electrical enclosure that has been primarily classified by its function, the classification of this electrical enclosure for the purposes of assigning a peak HRR probability distribution is straightforward. The load center is classified as “Switchgears and Load Centers” in Table 4-1 of this report. Figure F-1 depicts the load center as three cabinets. Cabinet to cabinet propagation is not considered in this example.

F.1.3 Determination of Peak Heat Release Rate Probability Distributions

Given the classification described in the previous section, the peak HRR probability distribution assigned to the load center is a Gamma with parameters Alpha = 0.99 and Beta = 44. This is the distribution listed for load centers with thermoplastic (TP) cables in Table 4-1. This probability distribution has a 98th percentile of 170 kW. Recall that the guidance in Chapter 8 of NUREG/CR-6850 recommends the use of the 98th percentile as the value to use for screening purposes.

F.1.4 Determination of the Zone of Influence

The ZOI generated by a fire in the load center is calculated using the 98th percentile of the peak HRR probability distribution as recommended in Chapter 8 and Appendix F of NUREG/CR-6850. As indicated earlier in this example, the 98th percentile value is 170 kW.

Use the Heskestad plume temperature correlation for determining the vertical component of the ZOI. Fire modeling analysts routinely use the Heskestad fire plume temperature correlation in support of Fire PRAs and other performance-based applications. Consequently, there are various practical implementations currently available for solving the correlation. Since this correlation is available within the NUREG 1805 library of programmed fire models (Chapter 9 of NUREG-1805), perform the calculation using this available tool.

The ZOI resulting from an unobstructed plume is calculated to be 6.25 feet. That is, using the following input parameters in the NUREG 1805 Chapter 9 spreadsheet:

- Heat release rate: 170 kW;
- Elevation above the fuel source: 6.25 feet;
- Area of the combustible fuel: 2 feet by 3 feet = 6 ft²; and
- Ambient temperature: 77 °F.

results in a plume temperature of 201 °C, which is conservative and sufficiently close to the damage criteria for TP cable. It should be noted that the following ambient and default values are also used throughout this example:

- Ambient air specific heat: 1.0 kJ/kg-K;
- Ambient air density: 1.18 kg/m³;
- Acceleration of gravity: 9.81 m/sec²; and
- Convective heat release rate fraction: 0.7.

Figure F-2 depicts the input block of the NUREG 1805 Chapter 9 spreadsheet model:

INPUT PARAMETERS	
Heat Release Rate of the Fire (Q)	170.00 kW
Elevation Above the Fire Source (z)	6.25 ft
Area of Combustible Fuel (A _c)	6.00 ft ²
Ambient Air Temperature (T _a)	77.00 °F

Figure F-2
Input Parameters for Fire Plume Correlation in NUREG 1805, Chapter 9 Spreadsheet

Based on the guidance documented in Section 6 of this report, the vertical component of the zone of influence generated by obstructed plumes is reduced by 24%. In this example, the resulting vertical distance is 6.25 feet x 0.76 = 4.75 feet. Notice that the cable tray T-1 is 4 feet above the base of the fire, and therefore, cannot be screened. In this scenario, cable tray T-1 is both a target, as it contains “target cables”, and an intervening combustible.

F.1.5 Determination of Severity Factors

The severity factor is calculated following the process described in Chapter 8 and Appendices E and F of NUREG/CR-6850, but using the probability distributions and the obstructed plume modeling described in this report. Specifically:

- The Heskestad fire plume correlation is used for determining the HRR necessary to generate a temperature of 205 °C at the location of the cable tray T-1. Refer to the resulting HRR as the “critical heat release rate”. Recall that the separation between the top of the load center and the bottom of the cable tray T-1 is 3 feet. The guidance in Chapter 12 of Supplement 1 of NUREG/CR-6850 suggests treating the base of the fire as 1 foot below the top of the cabinet; therefore the total separation is 4 feet. Cable tray T-2 will be subjected to a fire involving the electrical enclosure (i.e., the ignition source) and cable tray T-1.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

- Using the probability distribution specified in the previous section, the severity factor is the area under the distribution to the right of the resulting critical HRR. In other words, the severity factor is the probability that the HRR of the electrical enclosure fire will exceed the critical HRR, given its probability distribution.

The input parameters, which are listed in Figure F-3, are used in the NUREG 1805 Chapter 9 spreadsheet as follows:

INPUT PARAMETERS	
Heat Release Rate of the Fire (Q)	85.00 kW
Elevation Above the Fire Source (z)	4.00 ft
Area of Combustible Fuel (A _c)	6.00 ft ²
Ambient Air Temperature (T _a)	77.00 °F

Figure F-3
Input Parameters for Fire Plume Correlation in NUREG 1805, Chapter 9 Spreadsheet

That elevation above the fire input parameter is entered as 4 feet, which accounts for the distance of 3 feet between the top of the electrical enclosure and the cable tray T-1 and the guidance in Chapter 12 of Supplement 1 of NUREG/CR-6850, which recommends postulating the fire 1 foot below the top of the enclosure. The area of the combustible fuel results from the multiplication of the width and depth of the cabinet, i.e., 3 feet x 2 feet = 6 ft². The ambient temperature is assumed to be 77 °F for this example.

The HRR input parameter is varied in the spreadsheet until the resulting plume temperature is approximately 205 °C, which is the damage criterion for TP cables. Alternatively the “goal seek” data tool, under the “What if Analysis” tab in Microsoft Excel, can be used to solve for the HRR directly, which will lead to a resulting value of 205 °C. In this case, a HRR value of 85 kW results in a plume temperature 4 feet above the base of the fire of 204 °C. Therefore, the critical HRR is 85 kW.

The severity factor resulting from a critical HRR of 85 kW can be readily obtained using the gamma distribution function in Microsoft Excel as follows:
SF = 1-GAMMADIST(85,0.99,44,TRUE) = 0.14.

Notice that the above analysis assumes an unobstructed fire plume generated by a fire postulated outside the electrical enclosure. At this point we can incorporate the “obstructed fire plume” approach described in Sections 5 and 6 of this report. Recall from Sections 5 and 6 that the obstructed plume is expected to have a temperature 38% lower than the equivalent unobstructed one. The NUREG 1805 calculation can then be altered using the obstructed plume method which is illustrated below to clearly illustrate the process. We will use the same terms as the above example but add an additional factor to account for the 38% reduction in temperature. The effective fire diameter D is calculated as 2.76 ft (0.84 m) for a burning area of 6 sq-ft. The distance above the base of the fire z remains as 4 ft (1.22 m). All default values listed earlier in the example remain constant but an additional term, “β”, is added to account for the 38% reduction in temperature as follows:

$$\Delta T = \beta \left(9.1 \left[\frac{T_0}{(g c_p^2 \rho_0^2)} \right]^{1/3} \right) \dot{Q}_c^{2/3} (z - z_0)^{-5/3}$$

$$z_0 = -1.02D + 0.083\dot{Q}_c^{2/5} = -1.02(0.84) + 0.083(145)^{2/5} = -0.25$$

$$T = 0.62 \left[\left(9.1 \left[\frac{298.15}{(9.81 (1.0^2)(1.18^2))} \right]^{1/3} \right) (145(0.7))^{2/3} (1.22 - (-0.25))^{-5/3} + 25 \right]$$

$$T \approx 0.62(291.5) + 25 \approx 205 \text{ }^\circ\text{C}$$

The resulting critical HRR rate is calculated to be approximately 145 kW by solving the above equation. That is, a 145 kW fire generates plume temperatures of approximately 205 °C at a height of 4 ft above the base of the fire, which is the damage criterion for TP cables. With a HRR of 145 kW, the resulting severity factor is SF = 1-GAMMADIST(145,0.99,44,TRUE) = 0.04.

The severity factor is only applied to the cable tray closest to the ignition source. Since cable tray T2 could be exposed to a fire involving the ignition source and cable tray T1, given this configuration, the analysts would need to determine if the resulting fire plume exposure from the ignition source and cable tray T1 can damage cable tray T2. If it is determined that the cable tray can be damaged, the fire propagation guidance in Appendix R of NUREG/CR-6850 can be used for determining the time to damage.

F.1.6 Summary of Results

This section summarizes the example results and provides a comparison between the methods and inputs recommended in NUREG/CR-6850 and the guidance provided in this report. The numerical results using inputs in NUREG/CR-6850 were calculated using the same process described earlier in this example. The gamma distribution for vertical cabinets with unqualified cables and fires limited to one cable bundle was selected for the load center (alpha = 1.6, beta = 41.5). The results are summarized and compared in Table F-1.

**Table F-1
Summary of Results from Example 1**

NUREG/CR-6850			RACHELLE-FIRE (Unobstructed Plume)			RACHELLE-FIRE (Obstructed Plume)	
Peak HRR Probability Distribution 98 th Percentiles (kW)	Vertical ZOI (ft)	Resulting Severity Factor	Peak HRR Probability Distribution 98 th Percentiles (kW)	Vertical ZOI (ft)	Resulting Severity Factor	Vertical ZOI (ft)	Resulting Severity Factor
211 kW	7.0	0.28	170	6.25	0.14	4.75	0.04

F.2 Example 2 – Application of RACHELLE-FIRE to Realistic Plant Analysis Units

This example is a limited pilot application of the results presented in RACHELLE-FIRE to realistic plant configurations from actual Plant Analysis Units (PAU) and addresses impacts and issues that may arise when evaluating fire scenarios. The steps for this example include:

- 1) Selection of compartments to analyze
- 2) Identification of applicable ignition sources
- 3) Identification of applicable heat release rates (HRR)
- 4) Determination of appropriate zones of influence (ZOI)
- 5) Selection of targets
- 6) Determination of severity factors (SF)
- 7) Determination of core damage frequency* (CDF)

Steps 3 through 7 will be repeated for several cases in order to allow for review and comparison of results for insights on the effectiveness and potential limitations of the guidance. Each case will include the evaluation of all of the selected scenarios in each PAU. The methodology to perform the fire modeling steps follows that described in Example 1. The cases being analyzed are:

Case	Description
1	NUREG/CR-6850 guidance without significant refinement
2	NUREG/CR-6850 guidance (including supplemental guidance) with refinement of fire size and refined target selection
3	Same as Case 2 except RACHELLE-FIRE HRRs applied
4	Same as Case 2 except RACHELLE-FIRE HRRs applied with vertical ZOI adjusted to account for obstructed plume
5	Same as Case 4 except some RACHELLE-FIRE HRRs revised based on cabinet internals inspection

An additional case was also included to compare the benefits of RACHELLE-FIRE to benefits of potential modifications.

Case	Description
2a	Same as Case 2 with automatic suppression credited in the compartment

* Scenario ignition frequencies (IGF), manual non-suppression probabilities (NSP) and conditional core damage probabilities (CCDPs) are calculated using common practice; however, the details of that analysis are not included as a part of this example. The exact same methods are used for all cases. CDF is presented for evaluation of risk insights and is based on the generic equation where:

$$CDF = IGF * NSP * CCDP$$

It is noted that the purpose of this example is not to illustrate the fire modeling calculations, but to show the potential impacts of applying the new guidance given in this report to realistic plant configurations. Example 1 provides a general demonstration for the specific fire modeling calculations.

F.2.1 Selection of Compartments for Analysis

For this example, three locations (PAUs) have been selected at a plant based on the type of cabinets present and overall risk significance, to demonstrate the application and potential risk impact by applying the new guidance presented in this report. The three locations selected are shown in Figures F-4, F-5, and F-6 as fire compartments A, B, and C, respectively. All of the fire compartments can be assumed to have 3-hour fire rated walls and full room ionizing fire detection installed. None of the compartments are occupied or have automatic suppression systems. A general description for each location is as follows:

Compartment	Description
A	The compartment contains equipment primarily associated with rod control. It has a floor area of approximately 850 square feet and a ceiling height of 11 feet. The targets in this room consist of both conduits and cable trays.
B	The compartment is adjacent to the main control room and contains primarily process control cabinets. It has a floor area of approximately 600 square feet and a ceiling height of 11 feet. There are a significant number of cable trays in this location.
C	This compartment is a battery room containing both trains of station batteries and related electrical cabinets. It has a floor area of approximately 500 square feet and a ceiling height of 12 feet. There are several cable tray stacks primarily located on the back and side walls in addition to conduit targets.

F.2.2 Selection of Sources for Analysis

Only the unscreened (unscreened cabinets include those which are not considered small and well-sealed) electrical cabinet sources (reference NUREG/CR-6850 Bin 15) are included in this example. Each selected source is assigned a source number. The source locations are identified in each compartment in Figures F-4, F-5, and F-6. The sources are also listed in Table F-2. A source description and basic source dimensions are also included. Compartments A and B contain primarily control cabinets whereas compartment C is power cabinets.

F.2.3 Evaluation of Individual Cases

Each case is evaluated using the same process. The process consists of selecting the applicable HRR(s) for the ignition sources, developing the scenarios, and quantifying the risk. The scenario development in this example is based on calculating the ZOI for the selected HRR and selecting targets within the ZOI. A severity factor is also calculated based on the distance to the nearest target (see Example 1 for details of determining severity factors and ZOI). If the target set includes secondary combustibles, such as exposed cables, propagation is assumed and additional targets are included in the set.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Table F-2 Source List

Source ID	Description	Source Dimension (in)			Area	Volume
		Length	Width	Height	ft ²	ft ³
A_0312	CABINET #312	32	48	96	10.67	85.3
A_0314	DC HOLD CABINET	50	45	98	15.63	127.6
A_0315	LOGIC CABINET	50	45	98	15.63	127.6
A_0316	POWER CABINET – 2BD	24	83	98	13.83	113.0
A_0317	POWER CABINET – 2AC	24	83	98	13.83	113.0
A_0318	POWER CABINET – 1BD	24	83	78	13.83	89.9
A_0319	POWER CABINET – 1AC	24	83	98	13.83	113.0
A_0320	CORE EXIT THERMOCOUPLE CABINET	30	30	96	6.25	50.0
A_0321	IMPACT MONITORING SYSTEM CABINET	30	26	90	5.42	40.6
B_0337	CABINET #14	32	22	84	4.89	34.2
B_0338	CABINET #15	32	22	84	4.89	34.2
B_0339	CABINET #16	32	22	84	4.89	34.2
B_0340	CABINET #17	32	22	84	4.89	34.2
B_0341	CABINET #18	32	22	84	4.89	34.2
B_0343	CABINET #19	32	22	84	4.89	34.2
B_0344	CABINET #20	32	22	84	4.89	34.2
B_0345	CABINET #21	32	22	84	4.89	34.2
B_0346	CABINET #22	32	22	84	4.89	34.2
B_0347	CABINET #28	32	22	84	4.89	34.2
B_0348	CABINET #23	32	22	84	4.89	34.2
B_0349	CABINET #24	32	22	84	4.89	34.2
B_0350	CABINET #25	32	22	84	4.89	34.2
B_0352	CABINET #1	32	22	84	4.89	34.2
B_0353	CABINET #2	32	22	84	4.89	34.2
B_0354	CABINET #3	32	22	84	4.89	34.2
B_0356	CABINET #4	32	22	84	4.89	34.2
B_0357	CABINET #5	32	22	84	4.89	34.2
B_0358	CABINET #6	32	22	84	4.89	34.2
B_0359	CABINET #7	32	22	84	4.89	34.2
B_0360	CABINET #8	32	22	84	4.89	34.2
B_0361	CABINET #9	32	22	84	4.89	34.2
B_0362	CABINET #10	32	22	84	4.89	34.2
B_0363	CABINET #11	32	22	84	4.89	34.2
B_0364	CABINET #12	32	22	84	4.89	34.2
C_0183	BATTERY CHARGER – A	36	46	68	11.50	65.2
C_0184	BATTERY CHARGER – A-1	36	46	68	11.50	65.2
C_0185	MCC-A	20	40	90	5.56	41.7
C_0186	MCC-B	57	19	90	7.52	56.4
C_0188	BATTERY CHARGER – B-1	46	36	68	11.50	65.2
C_0189	BATTERY CHARGER – B	46	36	68	11.50	65.2

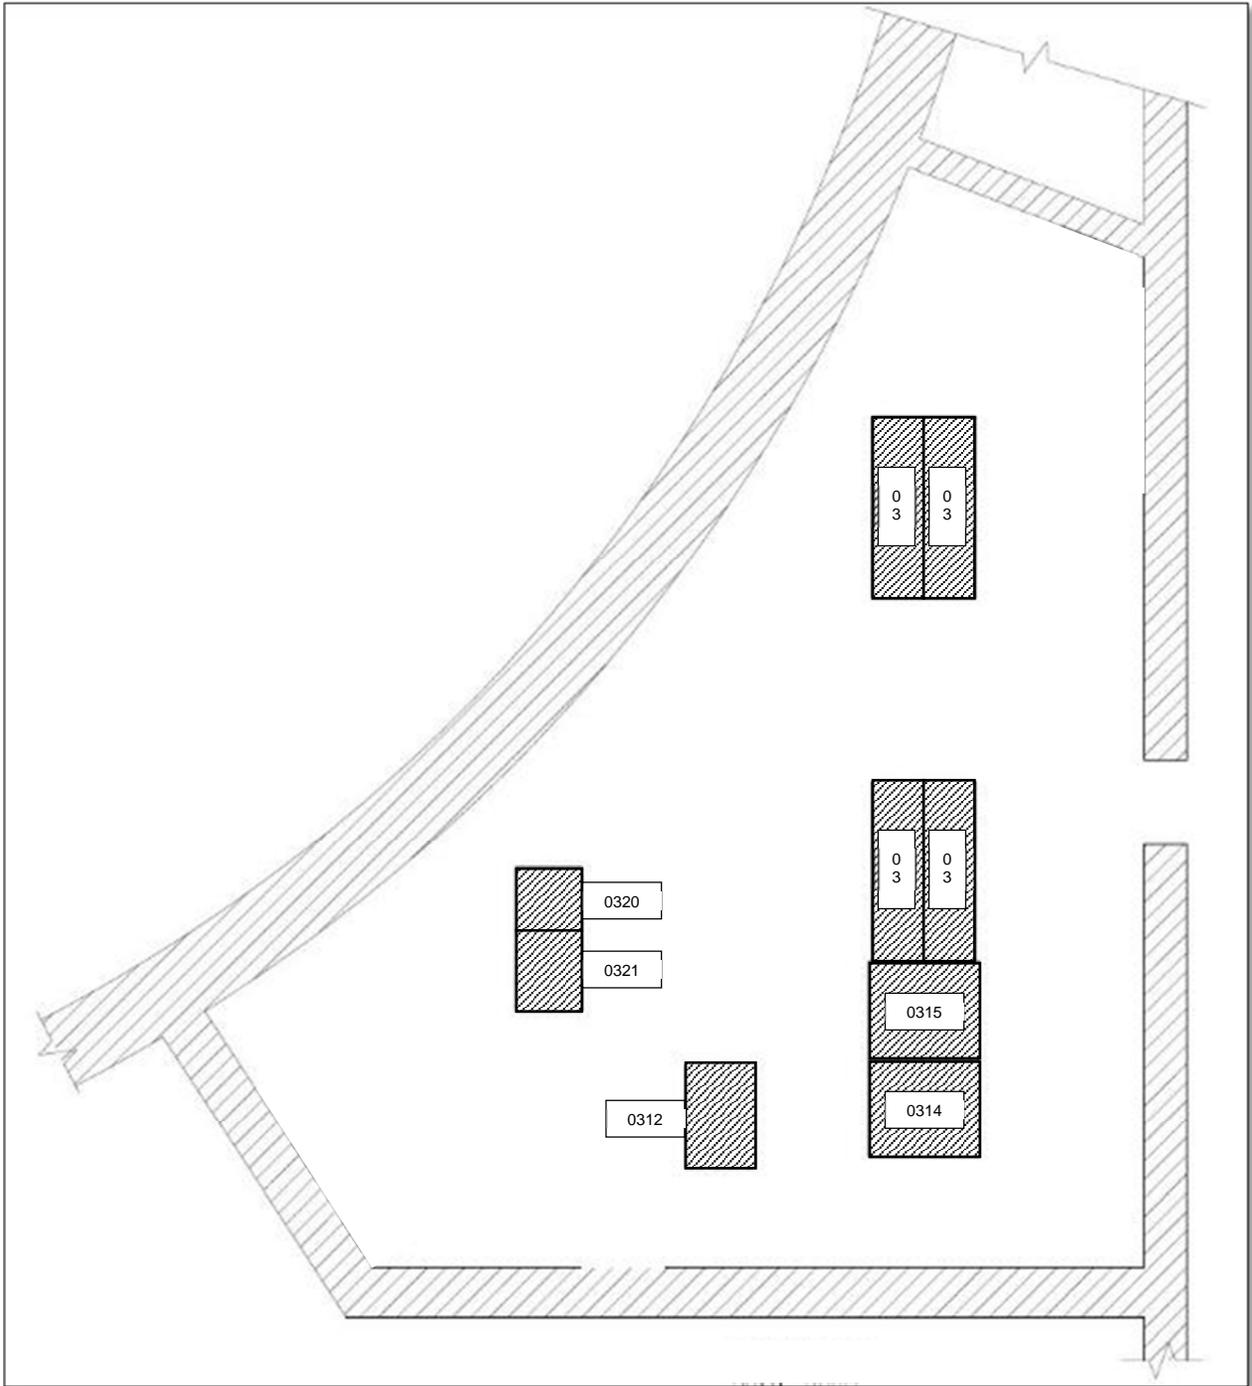


Figure F-4
Fire Compartment A

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

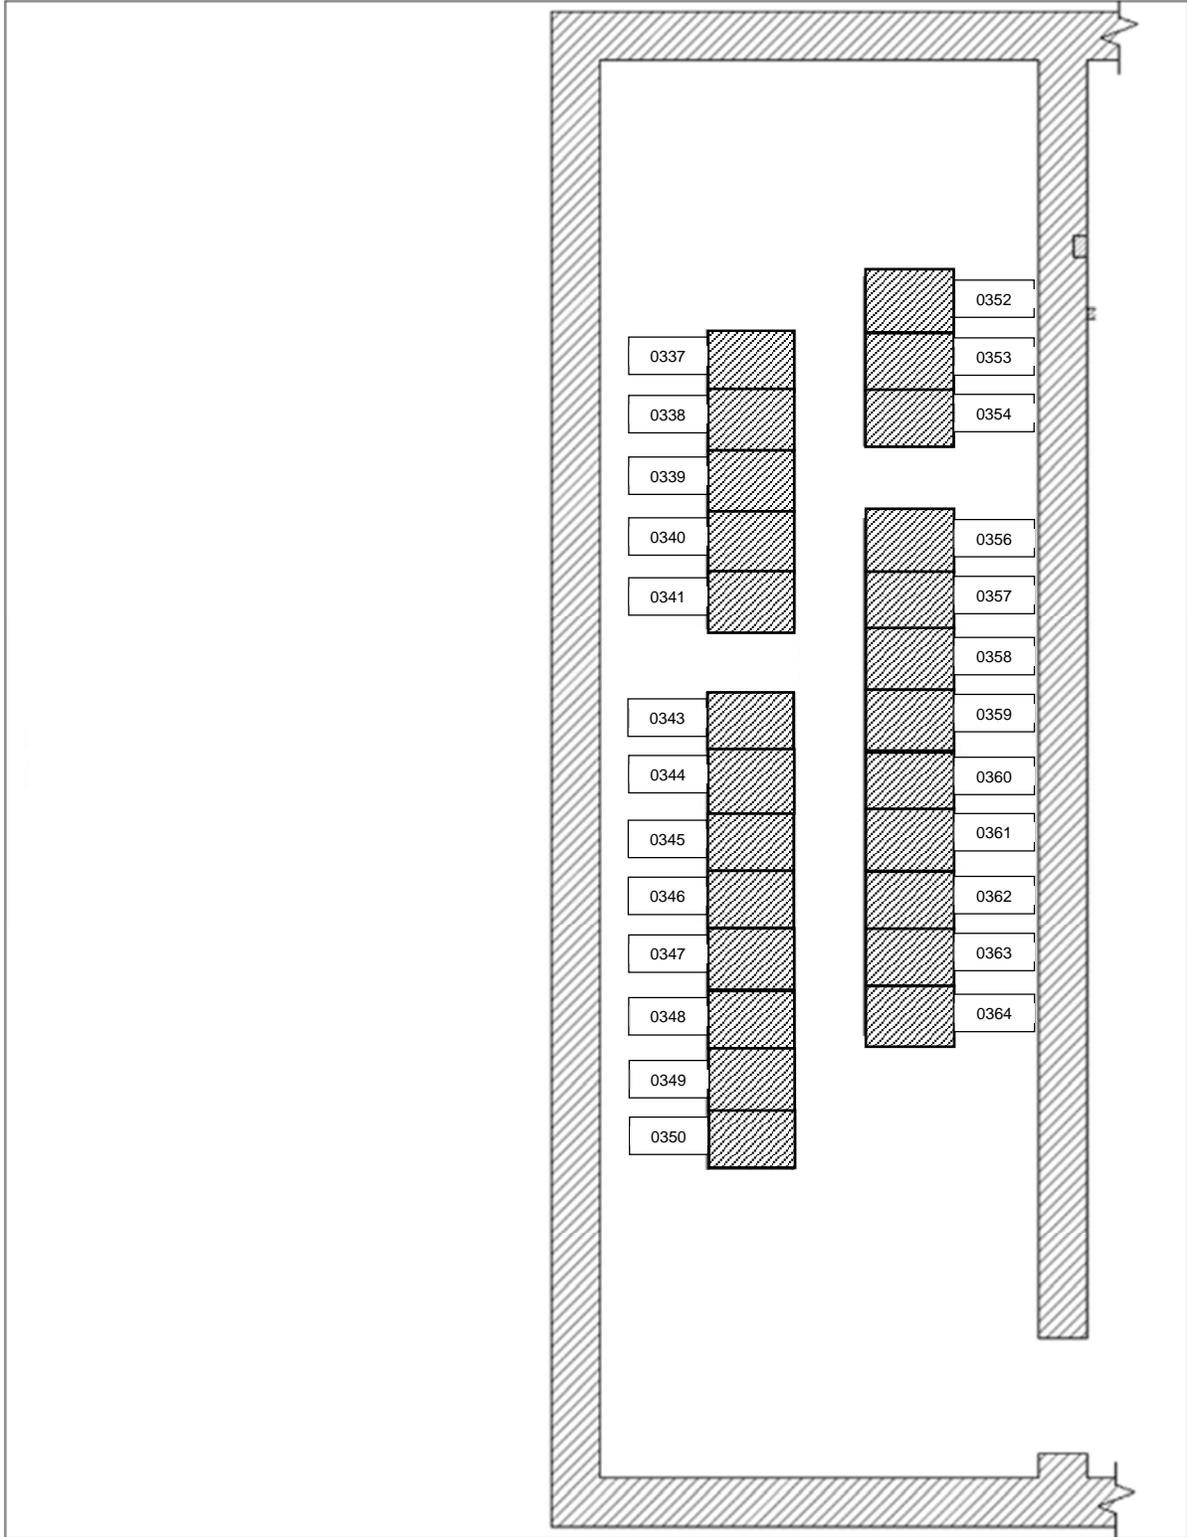


Figure F-5
Fire Compartment B

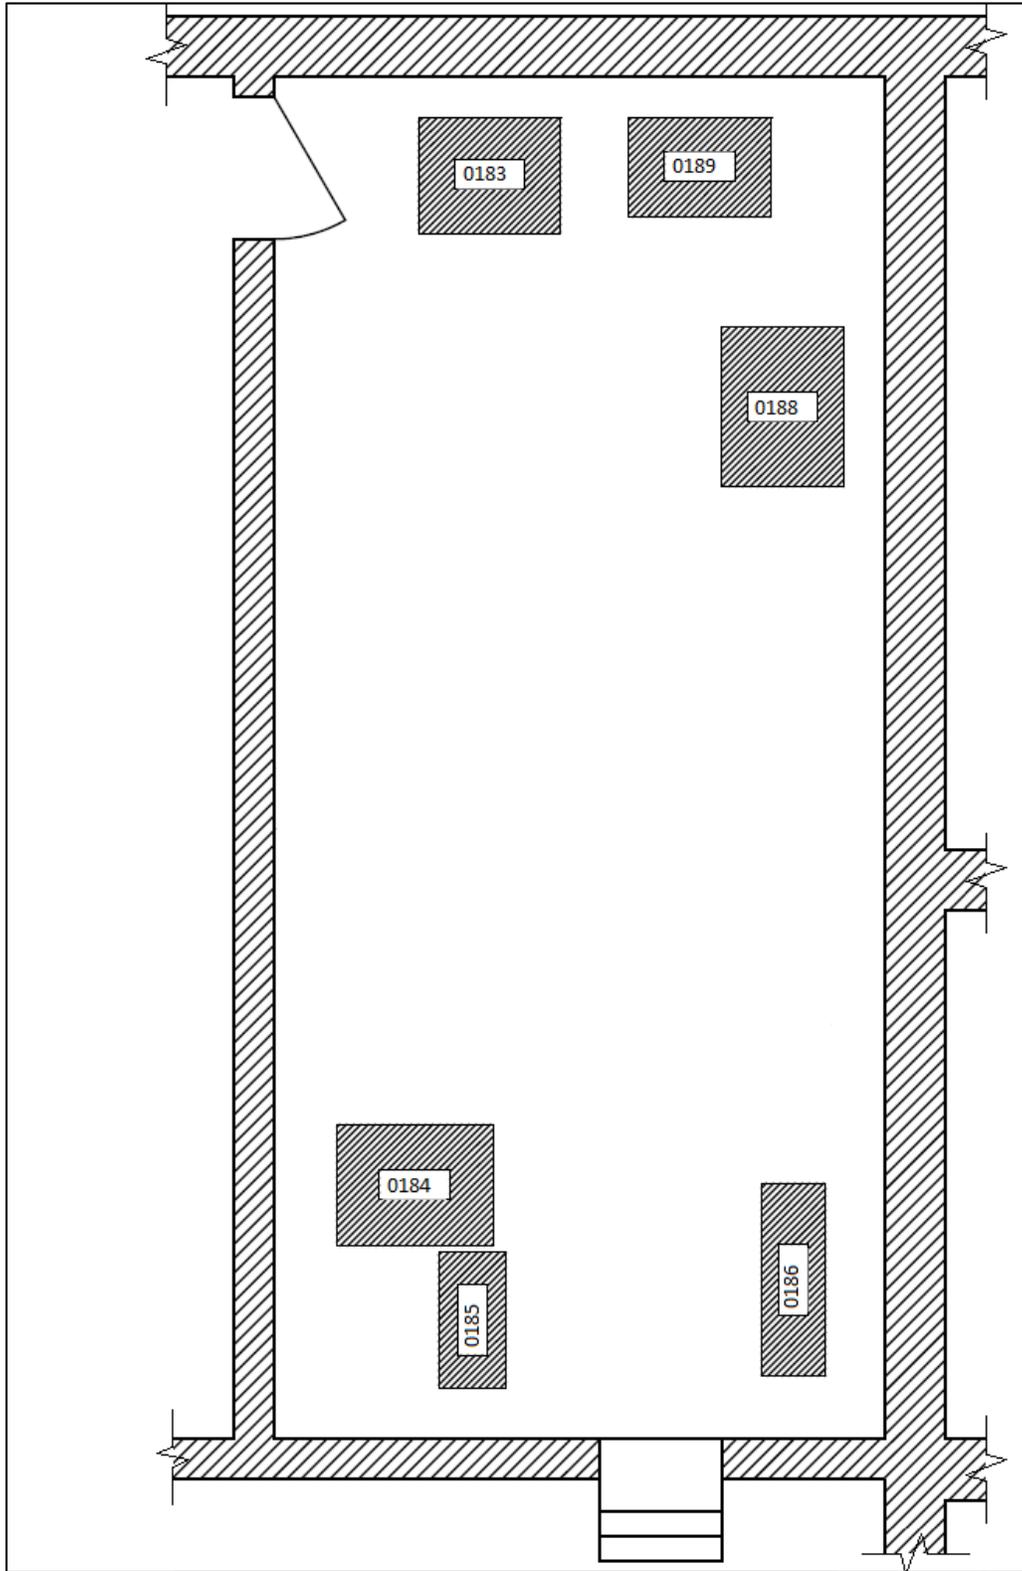


Figure F-6
Fire Compartment C

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Each scenario also evaluates fire growth and potential hot gas layer (HGL) development based on the room configuration. If suppression is unsuccessful when HGL conditions are met, all targets in the compartment are assumed failed. The details of this analysis are not part of this example, however the methods are consistent with common practice. It should also be noted that the 98th percentile HRR should always be used for screening, however selection of scenarios and additional points from the HRR distribution to evaluate is based on the judgment of the analyst as needed to achieve more realistic results.

The results for each case include the HRRs selected, SFs, HRR ZOIs, the number of targets in the ZOIs, the total CDF for the source, and the percentage of the CDF due to HGL conditions. The total CDF includes contribution from all evaluated scenarios for the source.

The following notes provide specific information to assist in assessing the data provided in Tables F-3 through F-7.

1. The cabling within the cabinets is IEEE-383 qualified or equivalent.
2. The plant is comprised primarily of thermoplastic (TP) cables. TP damage criteria are used; radiant heating damage criterion is 6 kW/m² (0.5 BTU/ft²s); temperature damage criterion is 205°C (400°F).
3. Source to target distances were initially measured from the top and sides of the cabinet. The radial distance was used to determine the nearest target.
4. A distance to first target of "NA" is an indicator that there were no external targets in the calculated ZOI.

F.2.3.1 Case 1

Case 1 defines an ignition source level analysis using methods based on NUREG/CR-6850. Each electrical cabinet is fire modeled using the 98th percentile HRR as a screening value, and the ZOIs are based on a bounding fire size located at the top of the cabinet as determined for initial source walkdowns to identify target sets. The target sets include all potential combustibles (e.g., cables, trays, raceways, conduits, etc.) observed in the ZOIs.

The electrical cabinet sources in each compartment are listed in Table F-2. Table F-3 includes additional information specific to Case 1. This includes the assigned HRR, SF, number of targets (raceways) in the ZOI, CDF and the percentage of the CDF that is due to HGL conditions.

1. HRRs were determined using NUREG/CR-6850, Table G-1:
 - a. Case 1: Vertical cabinets with qualified cable, fire limited to one cable bundle; 75th is 69 kW, 98th is 211 kW
 - b. Case 2: Vertical cabinets with qualified cable, fire in more than one cable bundle; 75th is 211 kW, 98th is 702 kW
2. Vertical ZOI (Elevation Above the Fire Source (z)) was calculated using NUREG-1805, Fire Dynamics Tools (FDT^s), Chapter 9, Estimating Centerline Temperature of a Buoyant Fire Plume, with the following input parameters:

Heat Release Rate of the Fire (Q):	Varies, see item 1
Ambient Air Temperature (T _a):	77 °F
Specific Heat of Air (c _p):	1.00 kJ/kg-K
Ambient Air Density (ρ _a):	1.18 kg/m ³
Acceleration of Gravity (g):	9.81 m/sec ²
Convective Heat Release Fraction (χ _c):	0.70
Area of Combustible Fuel (Ac):	1.0 ft ²

The inputs described above need to be evaluated to ensure that the methods used were applied within the verification and validation (V&V) range of applicability as defined in Supplement 1 of NUREG-1824.

Froude Number: The 1.0 ft² value for the area of the fuel was selected to bound all larger fuel packages. This yields an effective diameter (D) of 1.1 ft (0.34 m). The Froude Number, \dot{Q}^* , is used to determine if the HRR relative to the diameter of the fire scenario is within the range of HRR that is within the scope of NUREG-1824 Supplement 1 (acceptable range 0.2-9.1). It is calculated using the following equation (NUREG-1934, Equation 2-4):

$$\dot{Q}^* = \frac{\dot{Q}}{\rho_a c_p T_a D^2 \sqrt{gD}}$$

Flame Height Ratio: The flame length ratio, L_f/H_f, is used to determine if the flame height relative to the upper horizontal boundary of the fire scenario is within the range of HRR that is within the scope of NUREG-1824 Supplement 1 (acceptable range 0.0-1.6). The equation for the calculation of this parameter is the following (NUREG-1934, Equation 2-6):

$$l_f = D \left(3.7 \times \dot{Q}^{*2/5} - 1.02 \right)$$

HRR	Froude	Height of Target		Flame Height	Flame Length Ratio
	Q*	H _t (ft)	H _t (m)	L _f (m)	L _f /H _f
69	0.90	5.11	1.56	0.87	0.56
211	2.76	8.56	2.61	1.56	0.60
702	9.19	14.70	4.48	2.74	0.61

The vertical ZOI calculations for the Fire Froude number present an “out of range” result for a HRR of 702 kW. The “out of range” case is due to the calculation just barely exceeding the upper limit of the range, suggesting a high intensity fire for the selected fire diameter. One reason for exceeding the upper limit is the use of the 98th percentile

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

heat release rates for the corresponding fire diameters. Based on the guidance in Chapter 8 of NUREG/CR-6850, 98th percentile heat release rate values are used for screening and can be considered on the high end of the values assigned to ignition sources.

- Horizontal ZOI (Distance between Fire and Target (L)) was calculated using NUREG-1805, Fire Dynamics Tools (FDT^s), Chapter 5.1, Estimating Radiant Heat Flux from Fire to a Target Fuel at Ground Level Under Wind-Free Conditions, Solid Flame Radiation Model 2, with the following input parameters:

Heat Release Rate of the Fire (Q):	Varies, see item 1
Fuel Area or Dike Area (A_{dike}):	6.0 ft ² (reference ML12146A439)
Vertical Distance of Target from Ground (H_1):	User defined increments for each HRR such that the mid-height level of the flame, where radiation effects are maximized, was used.

Once again, the inputs described above need to be evaluated to ensure that the methods used were applied within the verification and validation (V&V) range of applicability as defined in NUREG-1824 Supplement 1.

Froude Number: The 6.0 ft² value for the area of the fuel was selected to bound all larger fuel packages. This yields an effective diameter (D) of 2.8 ft (0.84 m). The Froude Number, \dot{Q}^* , (acceptable range 0.2-9.1) again is used to determine if the HRR relative to the diameter of the fire scenario is within the range of HRR that is within the scope of NUREG-1824 Supplement 1. It is calculated using the equation presented above.

Radial Distance Ratio: The Radial Distance Ratio, r/D , is used to determine if the horizontal radial distance from the fire to the target is within the range of distances included in NUREG-1824 Supplement 1 (acceptable range 0.3-8.0). The Horizontal Distance between Target and Center of Fire, r , is defined as:

$$r = L + \frac{D}{2}$$

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

HRR	Froude	Distance between Fire and Target		Horizontal Distance between Target and Center of Fire	Radial Distance Ratio
	Q*	L (ft)	L (m)	r (m)	r/D
69	0.10	2.59	0.79	1.21	1.44
211	0.29	4.56	1.39	1.81	2.15
702	0.98	6.57	2.00	2.42	2.88

The horizontal component refers mostly to flame radiation for targets located near the flames. Consequently, ZOI calculations for the Fire Froude number are mostly “out of range” as they are based on experiments where the radiation was measured at some longer distance from the flames. The “out of range” results for the Fire Froude number are therefore expected given that the ZOI calculations define a region close to the flames. However, it should be noted that the Fire Froude Number is not the key parameter recommended for flame radiation scenarios. Table 2-5 of NUREG-1934 recommends the use of the radial distance ratio dimensionless parameter for radiation heat flux applications.

For the radial distance ratio dimensionless parameter, all the calculations that are “out of range” are on the low side of the range, suggesting again that the ZOI is characterized by distances close to the flames. These calculations were conducted with the solid flame radiation model described in Chapter 5.2 of NUREG-1805. A review of Figure 6-8 in Volume 3 of NUREG-1824 suggests that the majority of the validation results (with a few exceptions for Cable G in radiation ranges larger than the 6 kW/m² for ZOI calculations) suggest over-predictions of the flame radiation, which would result in longer horizontal distances for the ZOI. Table 4-1 in NUREG-1934 suggests an average prediction of 2.02 times greater than experimental values for radiant heat flux calculations using FDT^s.

In summary, the reason for the number of ZOI results that are “out of range” is because the ZOI distances are close to the flames, and the experiments selected for validation purposes measured radiation at longer distances from the flames. This is a limitation on the available data for validation and not necessarily a limitation on the use of the solid flame radiation model for calculating horizontal components of the ZOI for Fire PRA applications. To account for this limitation, it is noted that validation results from Figure 6-8 in Volume 3 of NUREG-1824 indicate significant heat flux over-predictions over the intensity levels used for ZOI calculations (i.e., between 6 and 11 kW/m²) that would result in longer, and therefore conservative, horizontal distances.

4. SF is developed using the same methods as discussed in Appendix F.1.5 of Example 1.
5. Based on the results provided in Table F-3 there is a varying degree of risk associated with the electrical cabinets in each compartment. There is also a significant potential for HGL conditions to develop. The initial results indicate that additional refinements should be investigated.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Table F-3
Cabinet List with NUREG/CR-6850 Based HRR (Case 1)

Source ID	Description	Source Dimens. (in)			Area ft ²	Volume ft ³	6850 HRR		98th ZOI (in)		To First Target inches	SF	98th # Targets	98th # Trays	CDF	% HGL
		Length	Width	Height			98th	Horizontal	Vertical							
A_0312	CABINET #312	32	48	96	10.7	85.3	211	211	55	104	32	0.648	3	0.00E+00	0.0%	
A_0314	DC HOLD CABINET	50	45	98	15.6	127.6	702	702	79	176	29	0.828	20	9.26E-07	98.2%	
A_0315	LOGIC CABINET	50	45	98	15.6	127.6	702	702	79	176	29	0.828	20	1.02E-06	98.4%	
A_0316	POWER CABINET - 2BD	24	83	98	13.8	113.0	702	702	79	176	35	0.786	5	0.00E+00	0.0%	
A_0317	POWER CABINET - 2AC	24	83	98	13.8	113.0	702	702	79	176	29	0.828	30	4.12E-06	32.5%	
A_0318	POWER CABINET - 1BD	24	83	78	13.8	89.9	702	702	79	176	32	0.807	10	1.12E-08	0.0%	
A_0319	POWER CABINET - 1AC	24	83	98	13.8	113.0	702	702	79	176	30	0.821	34	2.10E-06	31.7%	
A_0320	CORE EXIT THERMOCOUPLE CABINET	30	30	96	6.3	50.0	702	702	79	176	N/A	0.000	4	0.00E+00	0.0%	
A_0321	IMPACT MONITORING SYSTEM CABINET	30	26	90	5.4	40.6	211	211	55	104	8	0.917	3	0.00E+00	0.0%	
B_0337	CABINET #14	32	22	84	4.9	34.2	702	702	79	176	5	0.958	37	7.93E-07	4.3%	
B_0338	CABINET #15	32	22	84	4.9	34.2	702	702	79	176	5	0.958	34	7.93E-07	4.3%	
B_0339	CABINET #16	32	22	84	4.9	34.2	702	702	79	176	5	0.958	33	1.05E-07	32.4%	
B_0340	CABINET #17	32	22	84	4.9	34.2	702	702	79	176	5	0.958	29	3.53E-08	96.3%	
B_0341	CABINET #18	32	22	84	4.9	34.2	702	702	79	176	5	0.958	25	3.53E-08	96.3%	
B_0343	CABINET #19	32	22	84	4.9	34.2	702	702	79	176	5	0.958	24	3.55E-08	95.7%	
B_0344	CABINET #20	32	22	84	4.9	34.2	702	702	79	176	5	0.958	22	3.59E-08	94.7%	
B_0345	CABINET #21	32	22	84	4.9	34.2	702	702	79	176	5	0.958	21	3.43E-08	99.3%	
B_0346	CABINET #22	32	22	84	4.9	34.2	702	702	79	176	5	0.958	21	3.40E-08	99.9%	
B_0347	CABINET #28	32	22	84	4.9	34.2	702	702	79	176	5	0.958	19	3.40E-08	99.9%	
B_0348	CABINET #23	32	22	84	4.9	34.2	702	702	79	176	5	0.958	19	3.53E-08	96.3%	
B_0349	CABINET #24	32	22	84	4.9	34.2	702	702	79	176	5	0.958	15	3.53E-08	96.3%	
B_0350	CABINET #25	32	22	84	4.9	34.2	702	702	79	176	5	0.958	13	3.53E-08	96.3%	
B_0352	CABINET #1	32	22	84	4.9	34.2	702	702	79	176	5	0.958	26	1.82E-08	92.6%	
B_0353	CABINET #2	32	22	84	4.9	34.2	702	702	79	176	5	0.958	22	1.82E-08	92.6%	
B_0354	CABINET #3	32	22	84	4.9	34.2	702	702	79	176	5	0.958	21	1.82E-08	92.8%	
B_0356	CABINET #4	32	22	84	4.9	34.2	702	702	79	176	5	0.958	15	1.84E-08	91.6%	
B_0357	CABINET #5	32	22	84	4.9	34.2	702	702	79	176	5	0.958	12	1.84E-08	91.6%	
B_0358	CABINET #6	32	22	84	4.9	34.2	702	702	79	176	5	0.958	14	1.95E-08	86.4%	
B_0359	CABINET #7	32	22	84	4.9	34.2	702	702	79	176	5	0.958	19	2.79E-08	94.5%	
B_0360	CABINET #8	32	22	84	4.9	34.2	702	702	79	176	5	0.958	18	1.88E-08	89.8%	
B_0361	CABINET #9	32	22	84	4.9	34.2	702	702	79	176	5	0.958	17	1.84E-08	91.6%	
B_0362	CABINET #10	32	22	84	4.9	34.2	702	702	79	176	5	0.958	17	1.71E-08	98.5%	
B_0363	CABINET #11	32	22	84	4.9	34.2	702	702	79	176	5	0.958	17	1.84E-08	91.5%	
B_0364	CABINET #12	32	22	84	4.9	34.2	702	702	79	176	5	0.958	15	1.82E-08	92.6%	
C_0183	BATTERY CHARGER - A	36	46	68	11.5	65.2	211	211	55	104	15	0.854	11	7.16E-07	77.5%	
C_0184	BATTERY CHARGER - A-1	36	46	68	11.5	65.2	211	211	55	104	7	0.924	20	1.06E-06	83.5%	
C_0185	MCC-A	20	40	90	5.6	41.7	211	211	55	104	N/A	0.000	3	1.18E-07	0.0%	
C_0186	MCC-B	57	19	90	7.5	56.4	211	211	55	104	N/A	0.000	4	1.99E-08	0.0%	
C_0188	BATTERY CHARGER - B-1	46	36	68	11.5	65.2	211	211	55	104	10	0.900	7	1.91E-07	97.4%	
C_0189	BATTERY CHARGER - B	46	36	68	11.5	65.2	211	211	55	104	40	0.538	3	1.82E-09	0.0%	

F.2.3.2 Case 2

For Case 2 the scenarios were refined in several ways. First, a second HRR was selected at the 75th percentile from the distribution. For quantification, a two point model was used where 10% of the ignition frequency was applied to the 98th percentile HRR and 90% was applied to the 75th percentile HRR. Also, a more realistic fire size using actual cabinet dimensions was applied, and the fire was placed at one foot below the top of the cabinet in accordance with FAQ 08-0043, "Location of Fires Within Electrical Cabinets". Finally, the cable tray targets were reviewed to more realistically address propagation and fire growth. Table F-4 provides the updated data and results. This case represents a baseline to compare the impacts of applying revised HRRs from RACHELLE-FIRE (Cases 3, 4, and 5)

1. The 98th percentile HRRs for each cabinet are the same as in Case 1.
2. Vertical ZOI (z) is calculated using NUREG-1805, Fire Dynamics Tools (FDT^s), Chapter 9, Estimating Centerline Temperature of a Buoyant Fire Plume, with the same input parameters as Case 1, with the exception of the Area of Combustible Fuel (A_c).

The Froude Number is evaluated for each cabinet to ensure that the value for the area of the fuel is within its V&V range of applicability (acceptable range 0.2-9.1). For cabinets where the Fire Froude number is "out of range" on the upper bound, the area of the fuel was adjusted (diameter decreased) to correspond to the maximum acceptable Froude Number. For "out of range" cases below the acceptable range, the actual cabinet dimension was used. This ensures that the results for each vertical ZOI case remain applicable and conservative.

3. Horizontal ZOI (L) was calculated using NUREG-1805, Fire Dynamics Tools (FDT^s), Chapter 5.1, "Estimating Radiant Heat Flux from Fire to a Target Fuel at Ground Level Under Wind-Free Conditions, Solid Flame Radiation Model 2", with the same input parameters as Case 1, with the exception of the Area of Combustible Fuel (A_c).

Once again, the Froude Number is evaluated for each cabinet to ensure that the value for the area of the fuel is within its V&V range of applicability (acceptable range 0.2-9.1). For cabinets where the Fire Froude number is "out of range" on the upper bound, the area of the fuel was adjusted (diameter decreased) to correspond to the maximum acceptable Froude Number. For "out of range" cases below the acceptable range, the actual cabinet dimension was used. This ensures that the results for each vertical ZOI case remain applicable and conservative.

4. SF is developed using the same methods as discussed in Appendix F.1.5 of Example 1.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Table F-4 Cabinet List with NUREG/CR-6850 Based HRR and Scenario Refinements

Source ID	Description	6850 HRR		75th ZOI (in)		98th ZOI (in)		98th ZOI (in)		To First Target inches	SF	75th # Targets	98th # Targets	75th # Trays	98th # Trays	CDF	% HGL
		75th	98th	Horizontal	Vertical	Horizontal	Vertical	Horizontal	Vertical								
A_0312	CABINET #312	69	211	34	56	54	88	54	88	44	0.299	3	3	0	0	0.00E+00	0.0%
A_0314	DC HOLD CABINET	211	702	54	88	86	142	86	142	41	0.478	13	20	3	5	1.58E-07	96.5%
A_0315	LOGIC CABINET	211	702	54	88	86	142	86	142	41	0.478	20	20	5	5	3.09E-07	97.4%
A_0316	POWER CABINET - 2BD	211	702	54	88	86	142	86	142	46	0.440	4	5	0	0	0.00E+00	0.0%
A_0317	POWER CABINET - 2AC	211	702	54	88	86	142	86	142	41	0.478	25	30	7	8	1.74E-06	25.6%
A_0318	POWER CABINET - 1BD	211	702	54	88	86	142	86	142	42	0.471	10	10	0	0	4.87E-09	0.0%
A_0319	POWER CABINET - 1AC	211	702	54	88	86	142	86	142	40	0.486	25	34	5	8	9.11E-07	19.0%
A_0320	CORE EXIT THERMOCOUPLE CABINET	211	702	54	88	80	156	80	156	N/A	0.000	4	4	0	0	0.00E+00	0.0%
A_0321	IMPACT MONITORING SYSTEM CABINET	69	211	34	56	54	88	54	88	19	0.620	3	3	0	0	0.00E+00	0.0%
B_0337	CABINET #14	211	702	54	88	76	160	76	160	17	0.802	24	37	4	4	6.74E-08	11.0%
B_0338	CABINET #15	211	702	54	88	76	160	76	160	17	0.802	29	34	4	4	6.74E-08	11.0%
B_0339	CABINET #16	211	702	54	88	76	160	76	160	17	0.802	26	33	4	4	1.41E-08	52.5%
B_0340	CABINET #17	211	702	54	88	76	160	76	160	17	0.802	23	29	4	4	8.70E-09	85.0%
B_0341	CABINET #18	211	702	54	88	76	160	76	160	17	0.802	20	25	4	4	8.70E-09	85.0%
B_0343	CABINET #19	211	702	54	88	76	160	76	160	17	0.802	18	24	4	4	8.72E-09	84.9%
B_0344	CABINET #20	211	702	54	88	76	160	76	160	17	0.802	14	22	4	4	9.19E-09	80.5%
B_0345	CABINET #21	211	702	54	88	76	160	76	160	17	0.802	13	21	4	4	7.43E-09	99.6%
B_0346	CABINET #22	211	702	54	88	76	160	76	160	17	0.802	14	21	4	4	7.41E-09	99.8%
B_0347	CABINET #28	211	702	54	88	76	160	76	160	17	0.802	12	19	4	4	7.41E-09	99.8%
B_0348	CABINET #23	211	702	54	88	76	160	76	160	17	0.802	12	19	4	4	8.70E-09	85.0%
B_0349	CABINET #24	211	702	54	88	76	160	76	160	17	0.802	12	15	4	4	8.70E-09	85.0%
B_0350	CABINET #25	211	702	54	88	76	160	76	160	17	0.802	12	13	4	4	8.70E-09	85.0%
B_0352	CABINET #1	211	702	54	88	76	160	76	160	17	0.802	17	26	2	2	8.16E-09	83.7%
B_0353	CABINET #2	211	702	54	88	76	160	76	160	17	0.802	18	22	2	2	8.16E-09	83.7%
B_0354	CABINET #3	211	702	54	88	76	160	76	160	17	0.802	14	21	2	2	8.13E-09	84.0%
B_0356	CABINET #4	211	702	54	88	76	160	76	160	17	0.802	10	15	2	2	8.24E-09	82.8%
B_0357	CABINET #5	211	702	54	88	76	160	76	160	17	0.802	9	12	2	2	8.24E-09	82.8%
B_0358	CABINET #6	211	702	54	88	76	160	76	160	17	0.802	10	14	2	2	8.81E-09	77.5%
B_0359	CABINET #7	211	702	54	88	76	160	76	160	17	0.802	12	19	2	2	8.24E-09	82.8%
B_0360	CABINET #8	211	702	54	88	76	160	76	160	17	0.802	15	18	2	2	8.62E-09	79.2%
B_0361	CABINET #9	211	702	54	88	76	160	76	160	17	0.802	15	17	2	2	8.24E-09	82.8%
B_0362	CABINET #10	211	702	54	88	76	160	76	160	17	0.802	16	17	2	2	6.96E-09	98.2%
B_0363	CABINET #11	211	702	54	88	76	160	76	160	17	0.802	15	17	2	2	8.18E-09	83.5%
B_0364	CABINET #12	211	702	54	88	76	160	76	160	17	0.802	14	15	2	2	8.16E-09	83.7%
C_0183	BATTERY CHARGER - A	69	211	34	56	54	88	54	88	19	0.620	10	11	4	4	3.48E-07	79.7%
C_0184	BATTERY CHARGER - A-1	69	211	34	56	54	88	54	88	19	0.620	19	20	5	5	4.71E-07	83.6%
C_0185	MCC-A	69	211	34	56	54	88	54	88	N/A	0.000	3	3	0	0	1.18E-07	0.0%
C_0186	MCC-B	69	211	34	56	54	88	54	88	N/A	0.000	4	4	1	1	1.99E-08	0.0%
C_0188	BATTERY CHARGER - B-1	69	211	34	56	54	88	54	88	16	0.660	7	7	2	2	3.08E-09	0.0%
C_0189	BATTERY CHARGER - B	69	211	34	56	54	88	54	88	42	0.322	0	3	0	1	3.11E-10	0.0%

F.2.3.3 Case 3

For Case 3 revised HRRs were applied using the guidance described in RACHELLE-FIRE Table 4-1 and Table 4-2 as described below:

- Group 2: MCCs and Battery Chargers; 75th is 25 kW, 98th is 130 kW
- Group 4a(a): Large Enclosures, Closed; 75th is 50 kW, 98th is 400 kW
- Group 4b(a): Medium Enclosures, Closed; 75th is 25 kW, 98th is 200 kW

Other scenario parameters are consistent with Case 2. Table F-5 provides the updated data and results.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Table F-5
Cabinet List with RACHELLE-FIRE HRRs (Case 3)

Source ID	Description	Binning Group		75th ZOI (in)		98th ZOI (in)		To First Target inches	SF	75th # Targets	98th # Targets	75th # Trays	98th # Trays	CDF	% HGL
		Table 4.1 and 4.2	HRR	Horizontal	Vertical	Horizontal	Vertical								
A_0312	CABINET #312	4a(a), Closed, TP	50	400	30	49	69	113	0.189	3	3	0	0	0.00E+00	0.0%
A_0314	DC HOLD CABINET	4a(a), Closed, TP	50	400	30	49	69	113	0.202	3	16	0	4	4.83E-08	98.7%
A_0315	LOGIC CABINET	4a(a), Closed, TP	50	400	30	49	69	113	0.202	3	20	0	5	8.45E-08	97.7%
A_0316	POWER CABINET – 2BD	4a(a), Closed, TP	50	400	30	49	69	113	0.180	1	5	0	0	0.00E+00	0.0%
A_0317	POWER CABINET – 2AC	4a(a), Closed, TP	50	400	30	49	69	113	0.202	1	26	0	7	4.46E-07	27.1%
A_0318	POWER CABINET – 1BD	4a(a), Closed, TP	50	400	30	49	69	113	0.197	3	10	0	0	1.29E-09	0.0%
A_0319	POWER CABINET – 1AC	4a(a), Closed, TP	50	400	30	49	69	113	0.206	5	32	0	7	2.37E-07	25.5%
A_0320	CORE EXIT THERMOCOUPLE CABINET	4b(a), Closed, TP	25	200	22	37	53	86	0.000	4	4	0	0	0.00E+00	0.0%
A_0321	IMPACT MONITORING SYSTEM CABINET	4b(a), Closed, TP	25	200	22	37	53	86	0.281	3	3	0	0	0.00E+00	0.0%
B_0337	CABINET #14	4b(a), Closed, TP	25	200	22	37	53	86	0.296	16	23	4	4	3.84E-09	65.7%
B_0338	CABINET #15	4b(a), Closed, TP	25	200	22	37	53	86	0.296	11	22	4	4	3.84E-09	65.7%
B_0339	CABINET #16	4b(a), Closed, TP	25	200	22	37	53	86	0.296	12	23	4	4	3.82E-09	66.2%
B_0340	CABINET #17	4b(a), Closed, TP	25	200	22	37	53	86	0.296	16	19	4	4	3.82E-09	66.2%
B_0341	CABINET #18	4b(a), Closed, TP	25	200	22	37	53	86	0.296	15	20	4	4	3.82E-09	66.2%
B_0343	CABINET #19	4b(a), Closed, TP	25	200	22	37	53	86	0.296	12	17	4	4	3.82E-09	66.2%
B_0344	CABINET #20	4b(a), Closed, TP	25	200	22	37	53	86	0.296	11	14	4	4	4.23E-09	59.8%
B_0345	CABINET #21	4b(a), Closed, TP	25	200	22	37	53	86	0.296	9	12	4	4	2.53E-09	99.8%
B_0346	CABINET #22	4b(a), Closed, TP	25	200	22	37	53	86	0.296	8	9	4	4	2.53E-09	99.8%
B_0347	CABINET #28	4b(a), Closed, TP	25	200	22	37	53	86	0.296	8	12	4	4	2.53E-09	99.8%
B_0348	CABINET #23	4b(a), Closed, TP	25	200	22	37	53	86	0.296	11	12	4	4	3.82E-09	66.2%
B_0349	CABINET #24	4b(a), Closed, TP	25	200	22	37	53	86	0.296	11	12	4	4	3.82E-09	66.2%
B_0350	CABINET #25	4b(a), Closed, TP	25	200	22	37	53	86	0.296	7	12	3	4	3.82E-09	66.2%
B_0352	CABINET #1	4b(a), Closed, TP	25	200	22	37	53	86	0.296	6	17	2	2	2.16E-09	39.1%
B_0353	CABINET #2	4b(a), Closed, TP	25	200	22	37	53	86	0.296	8	13	2	2	2.16E-09	39.0%
B_0354	CABINET #3	4b(a), Closed, TP	25	200	22	37	53	86	0.296	4	12	2	2	2.13E-09	39.6%
B_0356	CABINET #4	4b(a), Closed, TP	25	200	22	37	53	86	0.296	6	8	2	2	2.13E-09	39.6%
B_0357	CABINET #5	4b(a), Closed, TP	25	200	22	37	53	86	0.296	4	8	2	2	2.15E-09	39.3%
B_0358	CABINET #6	4b(a), Closed, TP	25	200	22	37	53	86	0.296	4	10	2	2	2.31E-09	36.6%
B_0359	CABINET #7	4b(a), Closed, TP	25	200	22	37	53	86	0.296	5	9	2	2	2.16E-09	39.0%
B_0360	CABINET #8	4b(a), Closed, TP	25	200	22	37	53	86	0.296	6	11	2	2	2.55E-09	33.2%
B_0361	CABINET #9	4b(a), Closed, TP	25	200	22	37	53	86	0.296	4	14	2	2	2.15E-09	39.3%
B_0362	CABINET #10	4b(a), Closed, TP	25	200	22	37	53	86	0.296	9	16	2	2	8.62E-10	98.0%
B_0363	CABINET #11	4b(a), Closed, TP	25	200	22	37	53	86	0.296	9	14	2	2	2.16E-09	39.0%
B_0364	CABINET #12	4b(a), Closed, TP	25	200	22	37	53	86	0.296	5	14	2	2	2.16E-09	39.0%
C_0183	BATTERY CHARGER – A	2, TP	25	130	22	37	44	72	0.340	5	10	2	4	8.74E-08	56.2%
C_0184	BATTERY CHARGER – A-1	2, TP	25	130	22	37	44	72	0.340	19	19	5	5	2.43E-07	82.7%
C_0185	MCC-A	2, TP	25	130	22	37	44	72	0.000	0	0	0	0	1.18E-07	0.0%
C_0186	MCC-B	2, TP	25	130	22	37	44	72	0.000	0	0	0	0	1.99E-08	0.0%
C_0188	BATTERY CHARGER – B-1	2, TP	25	130	22	37	44	72	0.374	7	7	2	2	1.76E-09	0.0%
C_0189	BATTERY CHARGER – B	2, TP	25	130	22	37	44	72	0.140	0	1	0	0	0.00E+00	0.0%

F.2.3.4 Case 4

In addition to updated HRRs, Case 4 accounts for the obstructed plume due to the cabinet enclosure. Based on the guidance presented in this report, the plume temperature will exhibit a 38% temperature reduction (Section 6) resulting in a vertical ZOI reduction of 24% (Section 6). These reductions were applied and the CDFs calculated using the same process as for cases 1 and 2. The results are presented in Table F-6.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Table F-6
Cabinet List with RACHELLE-FIRE HRRs and Obstructed Plume (Case 4)

Source ID	Description	Binning Group		HRR		75th ZOI (in)		98th ZOI (in)		To First Target inches	SF	75th # Targets	98th # Targets	75th # Trays	98th # Trays	CDF	% HGL
		Table 4.1 and 4.2		50	400	30	37	69	84								
A_0312	CABINET #312	4a(a), Closed, TP	50	400	30	37	69	84	44	0.118	0	3	0	0	0.00E+00	0.0%	
A_0314	DC HOLD CABINET	4a(a), Closed, TP	50	400	30	37	69	84	41	0.129	0	16	0	4	4.83E-08	98.7%	
A_0315	LOGIC CABINET	4a(a), Closed, TP	50	400	30	37	69	84	41	0.129	0	20	0	5	8.45E-08	97.7%	
A_0316	POWER CABINET – 2BD	4a(a), Closed, TP	50	400	30	37	69	84	46	0.110	0	5	0	0	0.00E+00	0.0%	
A_0318	POWER CABINET – 2AC	4a(a), Closed, TP	50	400	30	37	69	84	41	0.129	0	26	0	7	4.46E-07	27.1%	
A_0319	POWER CABINET – 1BD	4a(a), Closed, TP	50	400	30	37	69	84	42	0.125	0	10	0	0	1.29E-09	0.0%	
A_0319	POWER CABINET – 1AC	4a(a), Closed, TP	50	400	30	37	69	84	40	0.133	0	32	0	7	2.37E-07	25.5%	
A_0320	CORE EXIT THERMOCOUPLE CABINET	4b(a), Closed, TP	25	200	22	28	53	64	N/A	0.000	4	4	0	0	0.00E+00	0.0%	
A_0321	IMPACT MONITORING SYSTEM CABINET	4b(a), Closed, TP	25	200	22	28	53	64	19	0.204	3	3	0	0	0.00E+00	0.0%	
B_0337	CABINET #14	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	17	23	4	4	3.19E-09	58.7%	
B_0338	CABINET #15	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	12	22	4	4	3.19E-09	58.7%	
B_0339	CABINET #16	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	13	23	4	4	3.16E-09	59.2%	
B_0340	CABINET #17	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	17	19	4	4	3.16E-09	59.3%	
B_0341	CABINET #18	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	16	20	4	4	3.16E-09	59.3%	
B_0343	CABINET #19	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	12	17	4	4	3.16E-09	59.3%	
B_0344	CABINET #20	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	11	14	4	4	1.88E-09	99.8%	
B_0345	CABINET #21	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	9	12	4	4	1.88E-09	99.8%	
B_0346	CABINET #22	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	8	9	4	4	1.88E-09	99.8%	
B_0347	CABINET #28	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	8	12	4	4	1.88E-09	99.8%	
B_0348	CABINET #23	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	11	12	4	4	3.16E-09	59.3%	
B_0349	CABINET #24	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	11	12	4	4	3.16E-09	59.3%	
B_0350	CABINET #25	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	7	12	3	4	3.16E-09	59.3%	
B_0352	CABINET #1	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	6	17	2	2	2.16E-09	39.1%	
B_0353	CABINET #2	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	8	13	2	2	2.16E-09	39.0%	
B_0354	CABINET #3	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	4	12	2	2	2.13E-09	39.6%	
B_0356	CABINET #4	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	6	8	2	2	2.13E-09	39.6%	
B_0357	CABINET #5	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	4	8	2	2	2.15E-09	39.3%	
B_0358	CABINET #6	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	4	10	2	2	2.28E-09	37.1%	
B_0359	CABINET #7	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	5	9	2	2	2.16E-09	39.1%	
B_0360	CABINET #8	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	6	11	2	2	2.54E-09	33.3%	
B_0361	CABINET #9	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	4	14	2	2	2.15E-09	39.3%	
B_0362	CABINET #10	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	9	16	2	2	8.61E-10	98.1%	
B_0363	CABINET #11	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	9	14	2	2	2.16E-09	39.0%	
B_0364	CABINET #12	4b(a), Closed, TP	25	200	22	28	53	64	17	0.219	5	14	2	2	2.16E-09	39.0%	
C_0183	BATTERY CHARGER – A	2, TP	25	130	22	28	44	54	19	0.235	2	10	0	4	6.12E-08	80.2%	
C_0184	BATTERY CHARGER – A-1	2, TP	25	130	22	28	44	54	19	0.235	19	19	5	5	1.74E-07	82.9%	
C_0185	MCC-A	2, TP	25	130	22	28	44	54	N/A	0.000	0	0	0	0	1.18E-07	0.0%	
C_0186	MCC-B	2, TP	25	130	22	28	44	54	N/A	0.000	0	0	0	0	1.99E-08	0.0%	
C_0188	BATTERY CHARGER – B-1	2, TP	25	130	22	28	44	54	16	0.270	7	7	2	2	1.29E-09	0.0%	
C_0189	BATTERY CHARGER – B	2, TP	25	130	22	28	44	54	42	0.063	0	1	0	0	0.00E+00	0.0%	

F.2.3.5 Case 5

For cabinets contributing significantly to risk, additional internal inspections were made to evaluate the fuel loading level, fuel type, and cable bundling arrangement to see if further reduction to the cabinet's HRR was possible. The following photos show cabinets for which the HRR could be further reduced.

Fire Compartment A**Source 0315**

Figure F-7
Photos of Source 0315 Outside (right cabinet in photo) and Inside

The fuel load for Source 0315 (Figure F-7) is a single cable bundle that is tightly bound and does not hang loosely. However the circuit cards present are in moderate quantities.

Based on the guidance provided in Table 4-1, re-binning the cabinet from Default (Table 4-2, Group 4a(a)) to Low (Table 4-2, Group 4a(b)) is not justified. The amount of circuit cards precludes re-grouping to a lower combustible load.

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

Source 0319

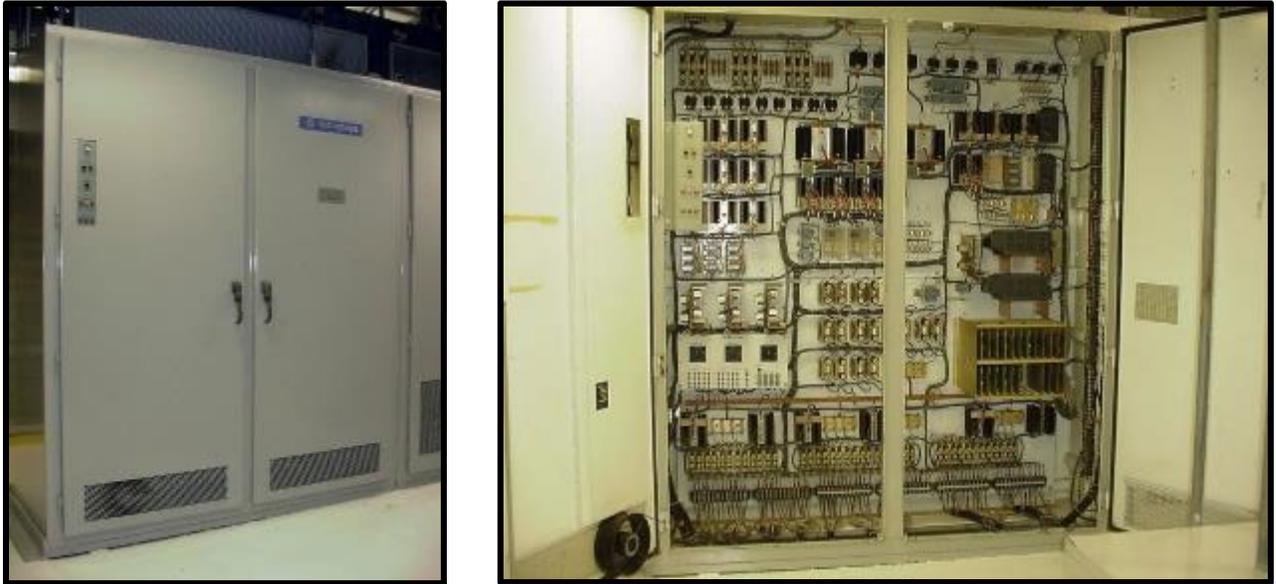


Figure F-8
Photos of Source 0319 Outside and Inside

Sources 0317 and 0319 (Figure F-8) are both power cabinets with similar combustible loading. The fuel load is at most moderate and the cable bundle arrangement is comprised of tightly bundled cables and arranged in an orderly manner. There are only a handful of exposed printed circuit cards present.

Based on the guidance provided in Table 4-1, re-binning the cabinet from Default (Table 4-2, Group 4a(a)) to Low (Table 4-2, Group 4a(b)) is acceptable.

Fire Compartment B

Source 0362



Figure F-9
Photo of Source 0362 Outside



Figure F-10
Photo of Source 0362 Inside Front

EXAMPLES OF ENCLOSURE FIRE ANALYSIS



Figure F-11
Photos of Source 0362 Inside Rear

Source 0362 (Figures F-9, F-10, and F-11) is indicative of all other power cabinets within this compartment. The fuel load is at most moderate, with very few cables. Most of the cabinet is comprised of non-combustible material.

Based on the guidance provided in Table 4-1, re-binning the cabinet from Default (Table 4-2, Group 4b(a)) to Low (Table 4-2, Group 4b(b)) is acceptable. HRRs were applied as follows:

- Group 2: Battery Chargers; 75th is 25 kW, 98th is 130 kW
- Group 4a(a): Large Enclosures, Closed; 75th is 50 kW, 98th is 400 kW
- Group 4a(b): Large Enclosures, Closed; 75th is 25 kW, 98th is 200 kW
- Group 4b(a): Medium Enclosures, Closed; 75th is 25 kW, 98th is 200 kW
- Group 4b(b): Medium Enclosures, Closed; 75th is 15 kW, 98th is 100 kW

**Table F-7
Credit for Inspecting Cabinet Internals (Case 5)**

Source ID	Description	Binning Group		HRR	75th ZOI (in)		98th ZOI (in)		To First Target inches	SF	75th # Targets	98th # Targets	75th # Trays	98th # Trays	CDF	% HGL
		Table 4.1 and 4.2			Horizontal	Vertical	Horizontal	Vertical								
A_0312	CABINET #312	4a(a), Closed, TP	50	400	30	37	69	84	44	0.118	0	3	0	0	0.00E+00	0.0%
A_0314	DC HOLD CABINET	4a(a), Closed, TP	50	400	30	37	69	84	41	0.129	0	16	0	4	4.83E-08	98.7%
A_0315	LOGIC CABINET	4a(a), Closed, TP	50	400	30	37	69	84	41	0.129	0	20	0	5	8.45E-08	97.7%
A_0316	POWER CABINET – 2BD	4a(a), Closed, TP	50	400	30	37	69	84	46	0.110	0	5	0	0	0.00E+00	0.0%
A_0317	POWER CABINET – 2AC	4a(b), Closed, TP	25	200	22	28	53	64	41	0.084	0	14	0	4	2.08E-08	99.7%
A_0318	POWER CABINET – 1BD	4a(a), Closed, TP	50	400	30	37	69	84	42	0.125	0	10	0	0	1.29E-09	0.0%
A_0319	POWER CABINET – 1AC	4a(b), Closed, TP	25	200	22	28	53	64	40	0.087	0	16	0	2	1.31E-10	0.0%
A_0320	CORE EXIT THERMOCOUPLE CABINET	4b(a), Closed, TP	25	200	22	28	53	64	N/A	0.000	4	4	0	0	0.00E+00	0.0%
A_0321	IMPACT MONITORING SYSTEM CABINET	4b(a), Closed, TP	25	200	22	28	53	64	19	0.204	3	3	0	0	0.00E+00	0.0%
B_0337	CABINET #14	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	16	21	4	4	3.00E-09	56.1%
B_0338	CABINET #15	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	11	20	4	4	3.00E-09	56.1%
B_0339	CABINET #16	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	12	20	4	4	2.98E-09	56.7%
B_0340	CABINET #17	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	16	18	4	4	2.97E-09	56.7%
B_0341	CABINET #18	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	14	19	4	4	2.97E-09	56.7%
B_0343	CABINET #19	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	12	13	4	4	2.97E-09	56.7%
B_0344	CABINET #20	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	11	14	4	4	3.38E-09	49.9%
B_0345	CABINET #21	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	9	11	4	4	1.69E-09	99.8%
B_0346	CABINET #22	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	8	9	4	4	1.69E-09	99.8%
B_0347	CABINET #23	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	8	11	4	4	1.69E-09	99.8%
B_0348	CABINET #28	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	11	11	4	4	2.97E-09	56.7%
B_0349	CABINET #24	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	11	12	4	4	2.97E-09	56.7%
B_0350	CABINET #25	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	7	12	3	4	2.97E-09	56.7%
B_0352	CABINET #1	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	5	16	2	2	1.32E-09	0.0%
B_0353	CABINET #2	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	7	12	2	2	1.32E-09	0.0%
B_0354	CABINET #3	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	4	11	2	2	1.29E-09	0.0%
B_0356	CABINET #4	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	6	7	2	2	1.29E-09	0.0%
B_0357	CABINET #5	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	4	7	2	2	1.29E-09	0.0%
B_0358	CABINET #6	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	4	6	2	2	1.41E-09	0.0%
B_0359	CABINET #7	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	4	7	2	2	1.30E-09	0.0%
B_0360	CABINET #8	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	5	10	2	2	1.69E-09	0.0%
B_0361	CABINET #9	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	4	14	2	2	1.30E-09	0.0%
B_0362	CABINET #10	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	9	13	2	2	2.76E-12	0.0%
B_0363	CABINET #11	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	8	13	2	2	1.32E-09	0.0%
B_0364	CABINET #12	4b(b), Closed, TP	15	100	18	23	40	48	17	0.199	5	13	2	2	1.32E-09	0.0%
C_0183	BATTERY CHARGER – A	2, TP	25	130	22	28	44	54	19	0.235	2	10	0	4	6.12E-08	80.2%
C_0184	BATTERY CHARGER – A-1	2, TP	25	130	22	28	44	54	19	0.235	19	19	5	5	1.74E-07	82.9%
C_0185	MCC-A	2, TP	25	130	22	28	44	54	N/A	0.000	0	0	0	0	1.18E-07	0.0%
C_0186	MCC-B	2, TP	25	130	22	28	44	54	N/A	0.000	0	0	0	0	1.99E-08	0.0%
C_0188	BATTERY CHARGER – B-1	2, TP	25	130	22	28	44	54	16	0.270	7	7	2	2	1.29E-09	0.0%
C_0189	BATTERY CHARGER – B	2, TP	25	130	22	28	44	54	42	0.063	0	1	0	0	0.00E+00	0.0%

F.2.3.6 Additional Case 2a

In many plants modifications are required to reduce risk. In this example, Case 2 represents an analysis that has applied a significant amount of fire modeling refinement; however, the risk may still be higher than required to meet the application. Because a high percentage of the risk is due to HGL development, the addition of an automatic suppression system may be an option.

Case 2a was added to compare the benefits of applying the RACHELLE-FIRE guidance compared to installing a modification to provide automatic suppression. The automatic suppression is assumed to be 95% effective at preventing fire spread beyond the local damage set (i.e., preventing HGL). The results for Case 2a are presented in Table F-8. Note that manual suppression is included in both Case 2 and 2a and also has some impact on HGL development.

Table F-8
Case 2 with Automatic Suppression Credit (Case 2a)

Source ID	Description	CDF	% HGL
A_0312	CABINET #312	0.00E+00	0.0%
A_0314	DC HOLD CABINET	4.26E-08	86.6%
A_0315	LOGIC CABINET	5.29E-08	83.8%
A_0316	POWER CABINET – 2BD	0.00E+00	0.0%
A_0317	POWER CABINET – 2AC	1.49E-06	3.5%
A_0318	POWER CABINET – 1BD	4.87E-09	0.0%
A_0319	POWER CABINET – 1AC	8.19E-07	2.9%
A_0320	CORE EXIT THERMOCOUPLE CABINET	0.00E+00	0.0%
A_0321	IMPACT MONITORING SYSTEM CABINET	0.00E+00	0.0%
B_0337	CABINET #14	6.61E-08	8.7%
B_0338	CABINET #15	6.61E-08	8.7%
B_0339	CABINET #16	1.25E-08	46.0%
B_0340	CABINET #17	7.04E-09	81.5%
B_0341	CABINET #18	7.04E-09	81.5%
B_0343	CABINET #19	7.05E-09	81.3%
B_0344	CABINET #20	7.53E-09	76.2%
B_0345	CABINET #21	5.77E-09	99.4%
B_0346	CABINET #22	5.75E-09	99.7%
B_0347	CABINET #28	5.75E-09	99.7%
B_0348	CABINET #23	7.04E-09	81.5%
B_0349	CABINET #24	7.04E-09	81.5%
B_0350	CABINET #25	7.04E-09	81.5%
B_0352	CABINET #1	7.04E-09	81.1%
B_0353	CABINET #2	7.04E-09	81.1%
B_0354	CABINET #3	7.01E-09	81.4%
B_0356	CABINET #4	7.12E-09	80.1%
B_0357	CABINET #5	7.12E-09	80.1%
B_0358	CABINET #6	7.69E-09	74.2%
B_0359	CABINET #7	7.12E-09	80.1%
B_0360	CABINET #8	7.50E-09	76.1%
B_0361	CABINET #9	7.12E-09	80.1%
B_0362	CABINET #10	5.83E-09	97.8%
B_0363	CABINET #11	7.05E-09	80.9%
B_0364	CABINET #12	7.04E-09	81.1%
C_0183	BATTERY CHARGER – A	1.17E-07	35.1%
C_0184	BATTERY CHARGER – A-1	1.32E-07	35.4%
C_0185	MCC-A	1.18E-07	0.0%
C_0186	MCC-B	1.99E-08	0.0%
C_0188	BATTERY CHARGER – B-1	3.08E-09	0.0%
C_0189	BATTERY CHARGER – B	3.11E-10	0.0%

F.2.4 Results Review

Table F-9 provides a summary of the CDF results by compartment for each of the cases evaluated. The CDFs for Case 1 indicate relatively high risk numbers prior to applying more refined fire modeling. Before evaluating the RACHELLE-FIRE HRRs it is desired to apply currently available guidance as described in Appendix F.2.3.2 in order to get a realistic measure of the potential CDF impacts using the revised guidance. From Table F-10 it can be seen that there was about 64% reduction in CDF due to the refinements applied. These results are used as the baseline to evaluate the RACHELLE-FIRE impacts.

**Table F-9
Compartment CDF Comparison**


Compartment	Case 1	Case 2	Case 3	Case 4	Case 5
A	8.18E-06	3.13E-06	8.18E-07	8.18E-07	1.55E-07
B	2.27E-06	3.31E-07	7.13E-08	6.28E-08	5.02E-08
C	2.10E-06	9.61E-07	4.69E-07	3.74E-07	4.01E-07
all	1.26E-05	4.42E-06	1.36E-06	1.25E-06	6.06E-07

**Table F-10
CDF Reduction Percentages Between Cases**

Compartment	Case 1to2	Case 2to3	Case 3to4	Case 4to5	Case 2to4	Case 2to5
A	61.8%	73.8%	0.0%	81.0%	73.8%	95.0%
B	85.4%	78.4%	12.0%	20.2%	81.0%	84.8%
C	54.3%	51.1%	20.4%	0.0%	61.1%	61.1%
all	64.8%	69.3%	7.7%	53.8%	71.6%	86.9%

Applying the revised guidance presented in RACHELLE-FIRE resulted in an overall calculated CDF reduction of nearly 87% for the locations evaluated. However, the benefits varied based on the room configurations. Tables F-11 through F-14 provide a comparison of specific parameters, and results for the various cases.

The most obvious contribution to the CDF reduction is due to the reduction of the severity factors (Table F-13). Overall severity factors were reduced by about 74% on average. This reduction represents the fraction of the HRR distribution that can cause damage to targets. Figure F-12 provides a comparison of the possible change in severity factors based on MCC HRRs between NUREG/CR-6850 guidance and RACHELLE-FIRE guidance assuming qualified cables, thermoplastic targets, and other parameters used for this example.

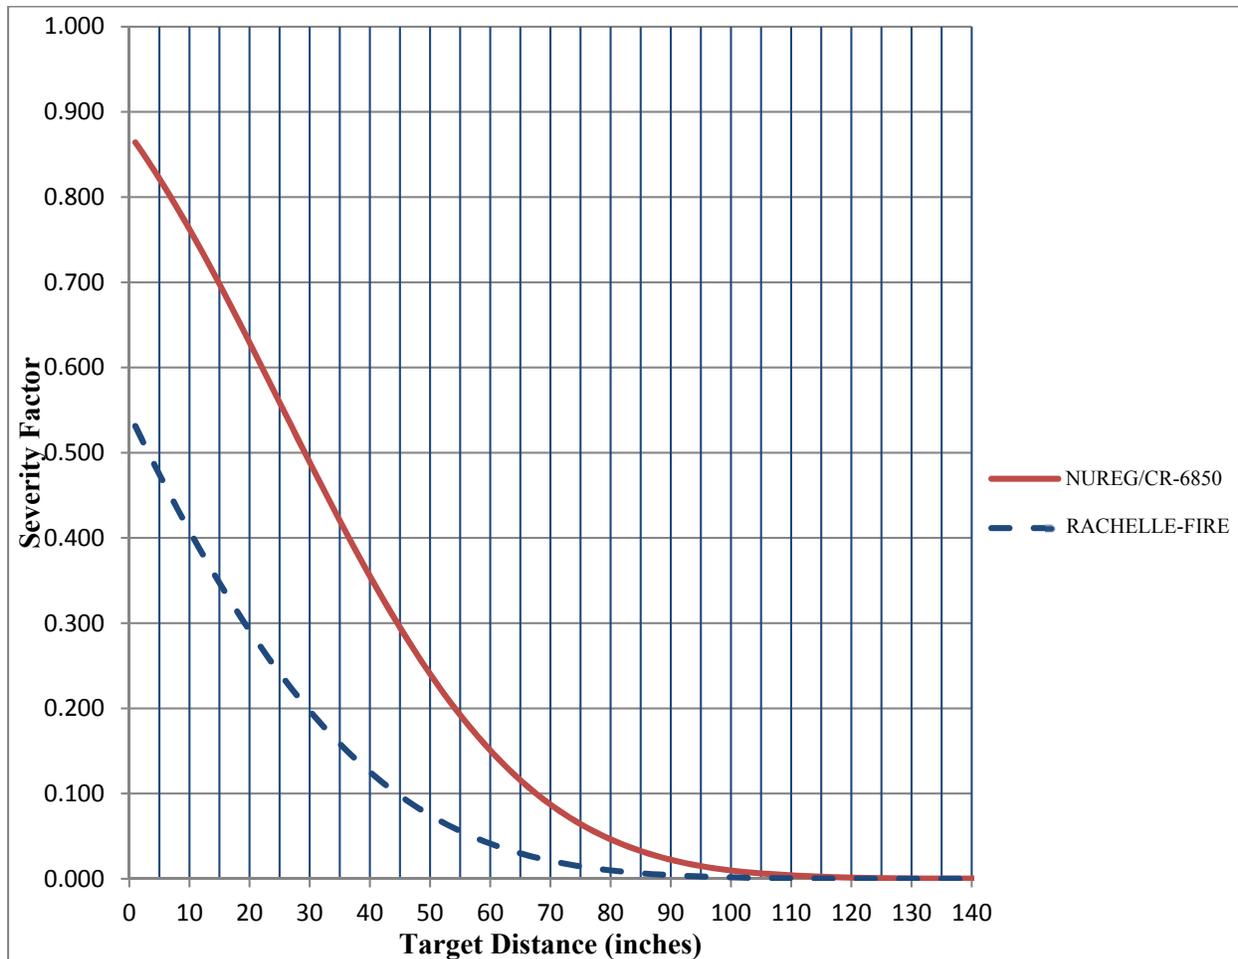

**Figure F-12
Severity Factor Comparison**

The CDF is also reduced based on a smaller ZOI for the RACHELLE-FIRE HRRs. The smaller ZOIs allow some targets to be excluded from the analysis. The total number of targets was reduced by 36% for the 98th percentile fires, and 54% for the 75th percentile fires (Ref. Table F-12). The largest impact was due to the reduction in horizontal ZOI because most of these targets were not involved in fire propagation. The vertical ZOI showed less impact due to the propagation of secondary combustibles (i.e., cable trays). It follows that there can still be a significant potential to develop HGL even with the updated HRRs applied. This is mainly a function of the amount of secondary combustibles and nearness to the ignition source. In some scenarios, the percentage of CDF due to HGL increased because the number of targets in the local target set was reduced but the probability of developing HGL did not change if the nearest cable tray was still within the ZOI.

The impacts vary by compartment based on the source target configurations and the room parameters. Compartment A had the greatest CDF reduction at 95%. Compartment A is an average room with most targets at least 24 inches from the source. Compartment B also had a significant CDF reduction of about 84%. A substantial benefit was realized in these

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

compartments based on the HRR refinements in Case 5. Compartment C had less impact but still saw a 61% reduction in CDF by applying the guidance. The impacts from treatment of obstructed plumes varied from less than 1% up to 20% reduction in CDF for compartments A and C respectively.

A comparison was also made based on adding suppression versus applying the RACHELLE-FIRE guidance. The results presented in Table F-11 show that the CDF reduction of the modification was not as much as from applying the RACHELLE-FIRE guidance.

**Table F-11
Modification Impact Comparison**

Compartment	Case 2 (no supp)	Case 2a (w/supp)	Case 5 (no supp)	Case 2to2a	Case 2to5
A	3.13E-06	2.41E-06	1.55E-07	23.0%	95.0%
B	3.31E-07	2.96E-07	5.02E-08	10.4%	84.8%
C	9.61E-07	3.90E-07	4.01E-07	59.4%	61.1%
all	4.42E-06	3.10E-06	6.06E-07	29.9%	86.9%

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

**Table F-12
Comparison of Number of Targets**

Source ID	# of Targets (98th)					# of Targets (75th)				
	Case 1	Case 2	Case 3	Case 4	Case 5	Case 1	Case 2	Case 3	Case 4	Case 5
A_0312	3	3	3	3	3	N/A	3	3	0	0
A_0314	20	20	16	16	16	N/A	13	3	0	0
A_0315	20	20	20	20	20	N/A	20	3	0	0
A_0316	5	5	5	5	5	N/A	4	1	0	0
A_0317	30	30	26	26	14	N/A	25	1	0	0
A_0318	10	10	10	10	10	N/A	10	3	0	0
A_0319	34	34	32	32	16	N/A	25	5	0	0
A_0320	4	4	4	4	4	N/A	4	4	4	4
A_0321	3	3	3	3	3	N/A	3	3	3	3
B_0337	37	37	23	23	21	N/A	24	16	17	16
B_0338	34	34	22	22	20	N/A	29	11	12	11
B_0339	33	33	23	23	20	N/A	26	12	13	12
B_0340	29	29	19	19	18	N/A	23	16	17	16
B_0341	25	25	20	20	19	N/A	20	15	16	14
B_0343	24	24	17	17	13	N/A	18	12	12	12
B_0344	22	22	14	14	14	N/A	14	11	11	11
B_0345	21	21	12	12	11	N/A	13	9	9	9
B_0346	21	21	9	9	9	N/A	14	8	8	8
B_0347	19	19	12	12	11	N/A	12	8	8	8
B_0348	19	19	12	12	11	N/A	12	11	11	11
B_0349	15	15	12	12	12	N/A	12	11	11	11
B_0350	13	13	12	12	12	N/A	12	7	7	7
B_0352	26	26	17	17	16	N/A	17	6	6	5
B_0353	22	22	13	13	12	N/A	18	8	8	7
B_0354	21	21	12	12	11	N/A	14	4	4	4
B_0356	15	15	8	8	7	N/A	10	6	6	6
B_0357	12	12	8	8	7	N/A	9	4	4	4
B_0358	14	14	10	10	6	N/A	10	4	4	4
B_0359	19	19	9	9	7	N/A	12	5	5	4
B_0360	18	18	11	11	10	N/A	15	6	6	5
B_0361	17	17	14	14	14	N/A	15	4	4	4
B_0362	17	17	16	16	13	N/A	16	9	9	9
B_0363	17	17	14	14	13	N/A	15	9	9	8
B_0364	15	15	14	14	13	N/A	14	5	5	5
C_0183	11	11	10	10	10	N/A	10	5	2	2
C_0184	20	20	19	19	19	N/A	19	19	19	19
C_0185	3	3	0	0	0	N/A	3	0	0	0
C_0186	4	4	0	0	0	N/A	4	0	0	0
C_0188	7	7	7	7	7	N/A	7	7	7	7
C_0189	3	3	1	1	1	N/A	0	0	0	0
Total	702	702	509	509	448	0	544	274	257	246

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

**Table F-13
Severity Factor Comparison**

Source ID	Severity Factor				
	Case 1	Case 2	Case 3	Case 4	Case 5
A_0312	0.648	0.299	0.189	0.118	0.118
A_0314	0.828	0.478	0.202	0.129	0.129
A_0315	0.828	0.478	0.202	0.129	0.129
A_0316	0.786	0.440	0.180	0.110	0.110
A_0317	0.828	0.478	0.202	0.129	0.084
A_0318	0.807	0.471	0.197	0.125	0.125
A_0319	0.821	0.486	0.206	0.133	0.087
A_0320	0.000	0.000	0.000	0.000	0.000
A_0321	0.917	0.620	0.281	0.204	0.204
B_0337	0.958	0.802	0.296	0.219	0.199
B_0338	0.958	0.802	0.296	0.219	0.199
B_0339	0.958	0.802	0.296	0.219	0.199
B_0340	0.958	0.802	0.296	0.219	0.199
B_0341	0.958	0.802	0.296	0.219	0.199
B_0343	0.958	0.802	0.296	0.219	0.199
B_0344	0.958	0.802	0.296	0.219	0.199
B_0345	0.958	0.802	0.296	0.219	0.199
B_0346	0.958	0.802	0.296	0.219	0.199
B_0347	0.958	0.802	0.296	0.219	0.199
B_0348	0.958	0.802	0.296	0.219	0.199
B_0349	0.958	0.802	0.296	0.219	0.199
B_0350	0.958	0.802	0.296	0.219	0.199
B_0352	0.958	0.802	0.296	0.219	0.199
B_0353	0.958	0.802	0.296	0.219	0.199
B_0354	0.958	0.802	0.296	0.219	0.199
B_0356	0.958	0.802	0.296	0.219	0.199
B_0357	0.958	0.802	0.296	0.219	0.199
B_0358	0.958	0.802	0.296	0.219	0.199
B_0359	0.958	0.802	0.296	0.219	0.199
B_0360	0.958	0.802	0.296	0.219	0.199
B_0361	0.958	0.802	0.296	0.219	0.199
B_0362	0.958	0.802	0.296	0.219	0.199
B_0363	0.958	0.802	0.296	0.219	0.199
B_0364	0.958	0.802	0.296	0.219	0.199
C_0183	0.854	0.620	0.340	0.235	0.235
C_0184	0.924	0.620	0.340	0.235	0.235
C_0185	0.000	0.000	0.000	0.000	0.000
C_0186	0.000	0.000	0.000	0.000	0.000
C_0188	0.900	0.660	0.374	0.270	0.270
C_0189	0.538	0.322	0.140	0.063	0.063
Avg.	0.841	0.651	0.256	0.184	0.169

EXAMPLES OF ENCLOSURE FIRE ANALYSIS

**Table F-14
Comparison of HGL Fraction**

Source ID	CDF					HGL				
	Case 1	Case 2	Case 3	Case 4	Case 5	Case 1	Case 2	Case 3	Case 4	Case 5
A_0312	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.0%	0.0%	0.0%	0.0%	0.0%
A_0314	9.26E-07	1.58E-07	4.83E-08	4.83E-08	4.83E-08	98.2%	96.5%	98.7%	98.7%	98.7%
A_0315	1.02E-06	3.09E-07	8.45E-08	8.45E-08	8.45E-08	98.4%	97.4%	97.7%	97.7%	97.7%
A_0316	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.0%	0.0%	0.0%	0.0%	0.0%
A_0317	4.12E-06	1.74E-06	4.46E-07	4.46E-07	2.08E-08	32.5%	25.6%	27.1%	27.1%	99.7%
A_0318	1.12E-08	4.87E-09	1.29E-09	1.29E-09	1.29E-09	0.0%	0.0%	0.0%	0.0%	0.0%
A_0319	2.10E-06	9.11E-07	2.37E-07	2.37E-07	1.31E-10	31.7%	19.0%	25.5%	25.5%	0.0%
A_0320	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.0%	0.0%	0.0%	0.0%	0.0%
A_0321	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.0%	0.0%	0.0%	0.0%	0.0%
B_0337	7.93E-07	6.74E-08	3.84E-09	3.19E-09	3.00E-09	4.3%	11.0%	65.7%	58.7%	56.1%
B_0338	7.93E-07	6.74E-08	3.84E-09	3.19E-09	3.00E-09	4.3%	11.0%	65.7%	58.7%	56.1%
B_0339	1.05E-07	1.41E-08	3.82E-09	3.16E-09	2.98E-09	32.4%	52.5%	66.2%	59.2%	56.7%
B_0340	3.53E-08	8.70E-09	3.82E-09	3.16E-09	2.97E-09	96.3%	85.0%	66.2%	59.3%	56.7%
B_0341	3.53E-08	8.70E-09	3.82E-09	3.16E-09	2.97E-09	96.3%	85.0%	66.2%	59.3%	56.7%
B_0343	3.55E-08	8.72E-09	3.82E-09	3.16E-09	2.97E-09	95.7%	84.9%	66.2%	59.3%	56.7%
B_0344	3.59E-08	9.19E-09	4.23E-09	3.57E-09	3.38E-09	94.7%	80.5%	59.8%	52.5%	49.9%
B_0345	3.43E-08	7.43E-09	2.53E-09	1.88E-09	1.69E-09	99.3%	99.6%	99.8%	99.8%	99.8%
B_0346	3.40E-08	7.41E-09	2.53E-09	1.88E-09	1.69E-09	99.9%	99.8%	99.8%	99.8%	99.8%
B_0347	3.40E-08	7.41E-09	2.53E-09	1.88E-09	1.69E-09	99.9%	99.8%	99.8%	99.8%	99.8%
B_0348	3.53E-08	8.70E-09	3.82E-09	3.16E-09	2.97E-09	96.3%	85.0%	66.2%	59.3%	56.7%
B_0349	3.53E-08	8.70E-09	3.82E-09	3.16E-09	2.97E-09	96.3%	85.0%	66.2%	59.3%	56.7%
B_0350	3.53E-08	8.70E-09	3.82E-09	3.16E-09	2.97E-09	96.3%	85.0%	66.2%	59.3%	56.7%
B_0352	1.82E-08	8.16E-09	2.16E-09	2.16E-09	1.32E-09	92.6%	83.7%	39.1%	39.1%	0.0%
B_0353	1.82E-08	8.16E-09	2.16E-09	2.16E-09	1.32E-09	92.6%	83.7%	39.0%	39.0%	0.0%
B_0354	1.82E-08	8.13E-09	2.13E-09	2.13E-09	1.29E-09	92.8%	84.0%	39.6%	39.6%	0.0%
B_0356	1.84E-08	8.24E-09	2.13E-09	2.13E-09	1.29E-09	91.6%	82.8%	39.6%	39.6%	0.0%
B_0357	1.84E-08	8.24E-09	2.15E-09	2.15E-09	1.29E-09	91.6%	82.8%	39.3%	39.3%	0.0%
B_0358	1.95E-08	8.81E-09	2.31E-09	2.28E-09	1.41E-09	86.4%	77.5%	36.6%	37.1%	0.0%
B_0359	2.79E-08	8.24E-09	2.16E-09	2.16E-09	1.30E-09	94.5%	82.8%	39.0%	39.1%	0.0%
B_0360	1.88E-08	8.62E-09	2.55E-09	2.54E-09	1.69E-09	89.8%	79.2%	33.2%	33.3%	0.0%
B_0361	1.84E-08	8.24E-09	2.15E-09	2.15E-09	1.30E-09	91.6%	82.8%	39.3%	39.3%	0.0%
B_0362	1.71E-08	6.96E-09	8.62E-10	8.61E-10	2.76E-12	98.5%	98.2%	98.0%	98.1%	0.0%
B_0363	1.84E-08	8.18E-09	2.16E-09	2.16E-09	1.32E-09	91.5%	83.5%	39.0%	39.0%	0.0%
B_0364	1.82E-08	8.16E-09	2.16E-09	2.16E-09	1.32E-09	92.6%	83.7%	39.0%	39.0%	0.0%
C_0183	7.16E-07	3.48E-07	8.74E-08	6.12E-08	6.12E-08	77.5%	79.7%	56.2%	80.2%	80.2%
C_0184	1.06E-06	4.71E-07	2.43E-07	1.74E-07	1.74E-07	83.5%	83.6%	82.7%	82.9%	82.9%
C_0185	1.18E-07	1.18E-07	1.18E-07	1.18E-07	1.18E-07	0.0%	0.0%	0.0%	0.0%	0.0%
C_0186	1.99E-08	1.99E-08	1.99E-08	1.99E-08	1.99E-08	0.0%	0.0%	0.0%	0.0%	0.0%
C_0188	1.91E-07	3.08E-09	1.76E-09	1.29E-09	1.29E-09	97.4%	0.0%	0.0%	0.0%	0.0%
C_0189	1.82E-09	3.11E-10	0.00E+00	0.00E+00	0.00E+00	0.0%	0.0%	0.0%	0.0%	0.0%
Total/Avg.	1.26E-05	4.42E-06	1.36E-06	1.25E-06	5.79E-07	65.9%	59.3%	46.6%	45.4%	32.9%

F.2.5 Conclusions

The revised guidance provided in RACHELLE-FIRE can be implemented effectively and can provide significant improvement in the fire risk of actual plant configurations. The amount of reduction from using the previous guidance will vary based on specific compartment and scenario parameters. Some specific insights are listed below.

- The new guidance can result in significantly reduced severity factors. This reduction is a direct result of reduced HRRs. This effect is pronounced for the non-power oriented functional classification groups (4a-4c), as most of the distributions are weighted more toward the lower end than in the previous guidance.
- Accounting for cabinet effects such as the obstructed plume nature of fires in closed cabinets provides significant reduction in the calculated vertical ZOI, and SF. Previous guidance treated the source fires as open fires. The new guidance addresses cases where the fire is inside of an enclosure.
- Reduction of the horizontal ZOI had the most impact in screening additional targets. This is primarily due to fire growth considerations involving secondary combustibles that have a greater impact on targets above the source rather than to the sides.
- Fire growth due to propagation of secondary combustibles may still drive results, especially if HGL is possible. The reduced HRRs and revised guidance had very little impact on fire propagation in cable trays.
- Inspection of cabinet internals can result in significant benefits for risk reduction. Control cabinets vary greatly. By opening the cabinets and inspecting the internal configuration, reduced HRRs can be justified in many instances.
- This example also provided some insights into the significance of applying refined fire modeling methods including a source specific fire size. Although bounding fire sizes may be more efficient to use for initial walkdowns and target selection, significant benefits can be obtained in many scenarios by applying source specific fire sizes.
- Applying the RACHELLE-FIRE guidance can provide useful insights for decisions regarding the need or justification of installing modifications.

It should be noted that the examples presented in Appendix F represent specific configurations and are a subset of a full compartment analysis. The example demonstrates potential impacts that may be obtained by applying the updated heat release rates and methods presented in this report.

BIBLIOGRAPHIC DATA SHEET
(See instructions on the reverse)

NUREG-2178 Vol. 1
Final

2. TITLE AND SUBTITLE

Refining and Characterizing Heat Release Rates from Electrical Enclosures during Fire
(RACHELLE-FIRE)
Volume 1: Peak Heat Release Rates and Effect of Obstructed Plume

3. DATE REPORT PUBLISHED

MONTH	YEAR
April	2016

4. FIN OR GRANT NUMBER

5. AUTHOR(S)

N. Melly (NRC), D. Stroup (NRC), G. Taylor (NRC), M. Subudhi (BNL),
S. Nowlen (Consultant), A. Lindeman (EPRI), J. DeJoseph (Duke Energy),
F. Joglar (Jensen Hughes), V. Ontiveros (Jensen Hughes), J. Williamson (Jensen Hughes),
D. Miskiewicz (EPM)

6. TYPE OF REPORT

Technical

7. PERIOD COVERED (Inclusive Dates)

8. PERFORMING ORGANIZATION - NAME AND ADDRESS (If NRC, provide Division, Office or Region, U. S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.)

9. SPONSORING ORGANIZATION - NAME AND ADDRESS (If NRC, type "Same as above", if contractor, provide NRC Division, Office or Region, U. S. Nuclear Regulatory Commission, and mailing address.)

Division of Risk Analysis
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

Electric Power Research Institute
3420 Hillview Avenue
Palo Alto, CA 94304

10. SUPPLEMENTARY NOTES

M.H. Salley, NRC Project Manager

11. ABSTRACT (200 words or less)

The Refining And Characterizing Heat Release Rates From Electrical Enclosures During Fire (RACHELLE-FIRE) program involves a working group of experienced fire protection and fire probabilistic risk assessment researchers and practitioners focused on enhancing the methodology used to model electrical enclosure fires in nuclear power plants (NPPs). This report documents the results from the working group's efforts to develop technical information in three areas: (1) classification of electrical enclosures in terms of function, size, contents, and ventilation, (2) determination of peak heat release rate (HRR) probability distributions considering specific electrical enclosure characteristics, and (3) development of a method to account for the impact of the enclosure on the vertical thermal zone of influence (ZOI) above the enclosure during fire. Electrical enclosures have been classified in groups based on their electrical function, contents and size. Peak HRR distributions for the different classification groups have been developed. These distributions are based on the results of different experimental programs intended to measure the HRR associated with fires in electrical enclosures. Peak HRR values can be refined based on visual inspection of the interior of the enclosures. In order to provide a comprehensive characterization of electrical enclosure fires, the working group evaluated the temperature characteristics of fire plumes associated with these events using the Fire Dynamics Simulator (FDS) program. Computer simulations of various enclosure configurations were developed for evaluating the fire burning inside electrical enclosures and the fire plume temperature characteristics that would be generated. Based on this research, new fire plume temperature profiles reflecting the obstructed nature of fire plumes generated from fires inside electrical enclosures are provided.

12. KEY WORDS/DESCRIPTORS (List words or phrases that will assist researchers in locating the report.)

Electrical Enclosure, Fire Hazard Analysis (FHA), Fire Modeling, Fire Probabilistic Risk Assessment (PRA), Fire Probabilistic Safety Assessment (PSA), Fire Protection, Fire Safety, Heat Release Rate, Nuclear Power Plant, Risk-informed Performance-based (RI/PB) Regulation,

13. AVAILABILITY STATEMENT

unlimited

14 SECURITY CLASSIFICATION

(This Page)

unclassified

(This Report)

unclassified

15. NUMBER OF PAGES

16. PRICE



Federal Recycling Program



**UNITED STATES
NUCLEAR REGULATORY COMMISSION**
WASHINGTON, DC 20555-0001

OFFICIAL BUSINESS



**NUREG-2178, Vol. 1
Final**

**Refining And Characterizing Heat Release Rates From Electrical
Enclosures During Fire (RACHELLE-FIRE)**

April 2016