


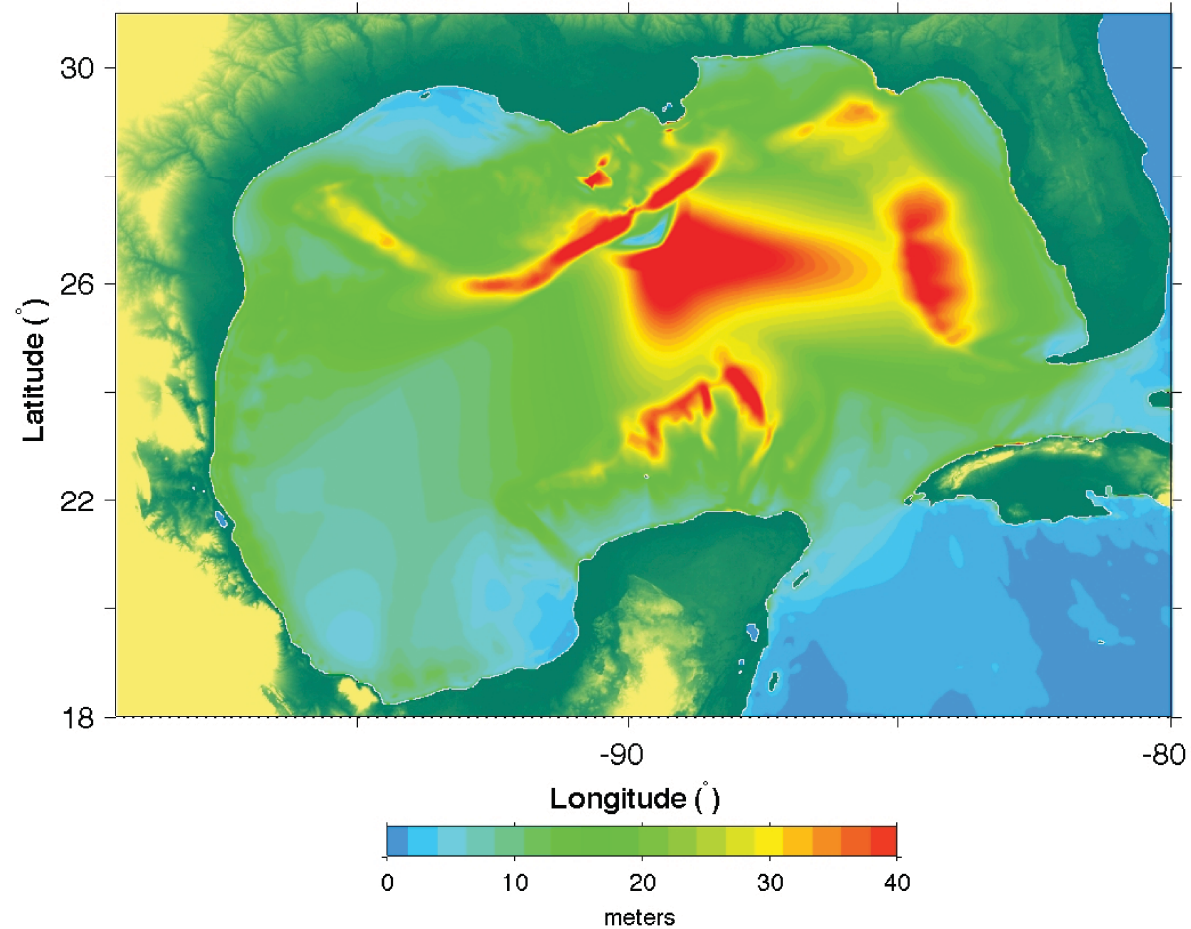

Duke Energy Florida
Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

Mississippi Canyon Landslide Event Simulation,
Dynamic (NHWAVE) Source:
Maximum Water Level
Generated During Simulation (Grid A)
FIGURE 2.4.6-256

Rev 6