


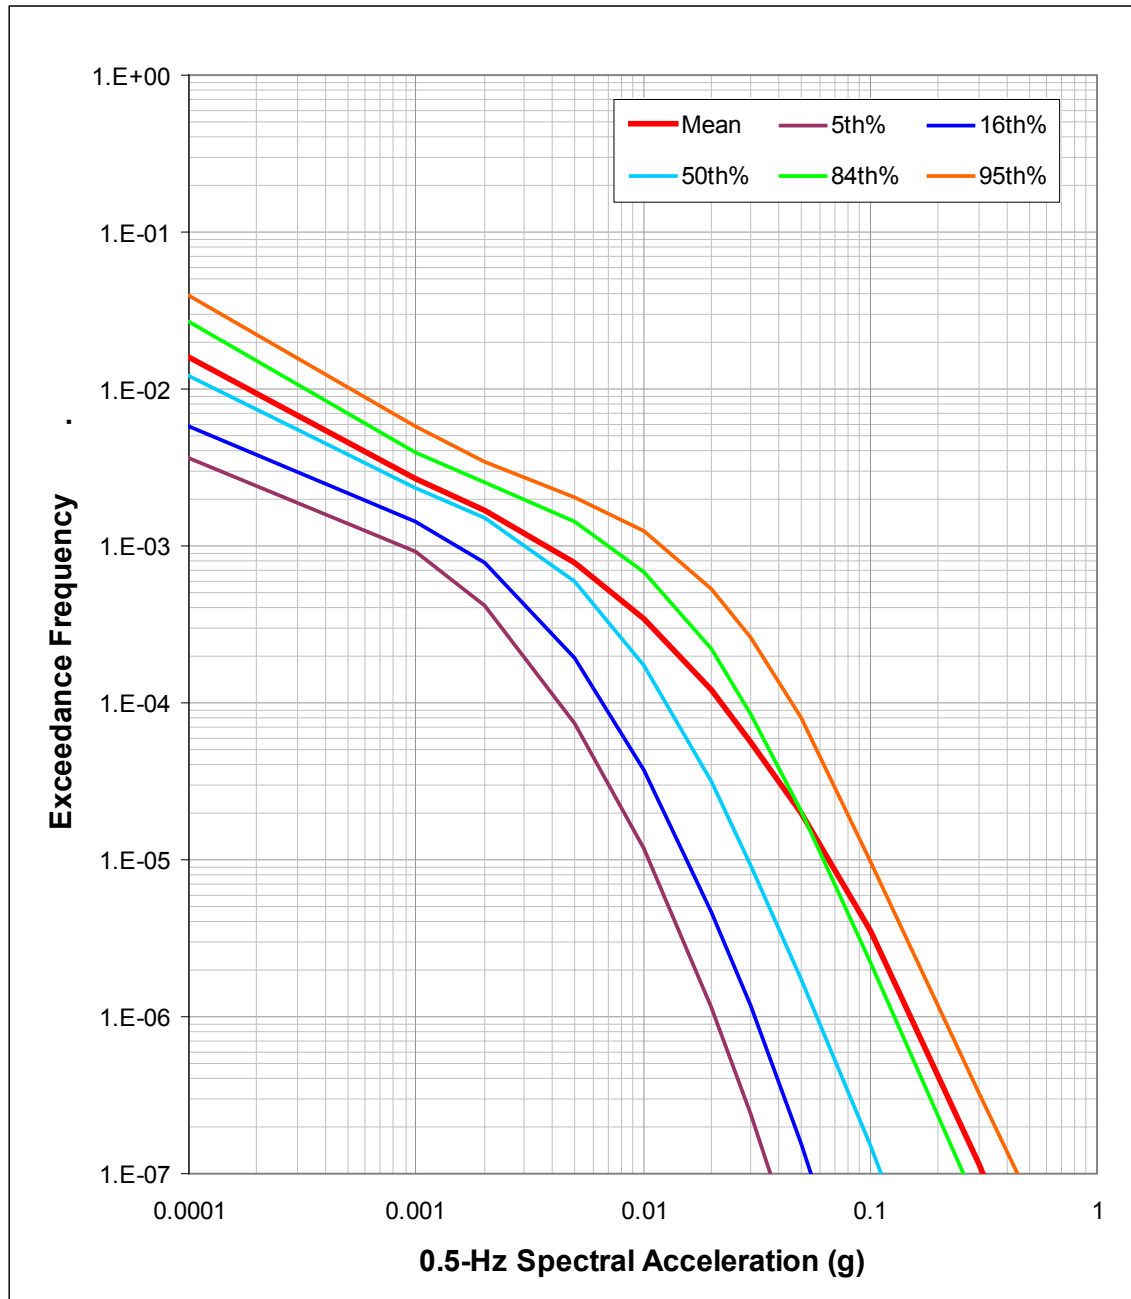

Duke Energy Florida  
**Levy Nuclear Plant  
Units 1 and 2  
Part 2, Final Safety Analysis Report**

Generic CEUS Hard Rock Hazard Results  
for 0.5-Hz Spectral Accelerations  
for the LNP Site  
FIGURE 2.5.2-226 Rev 6