


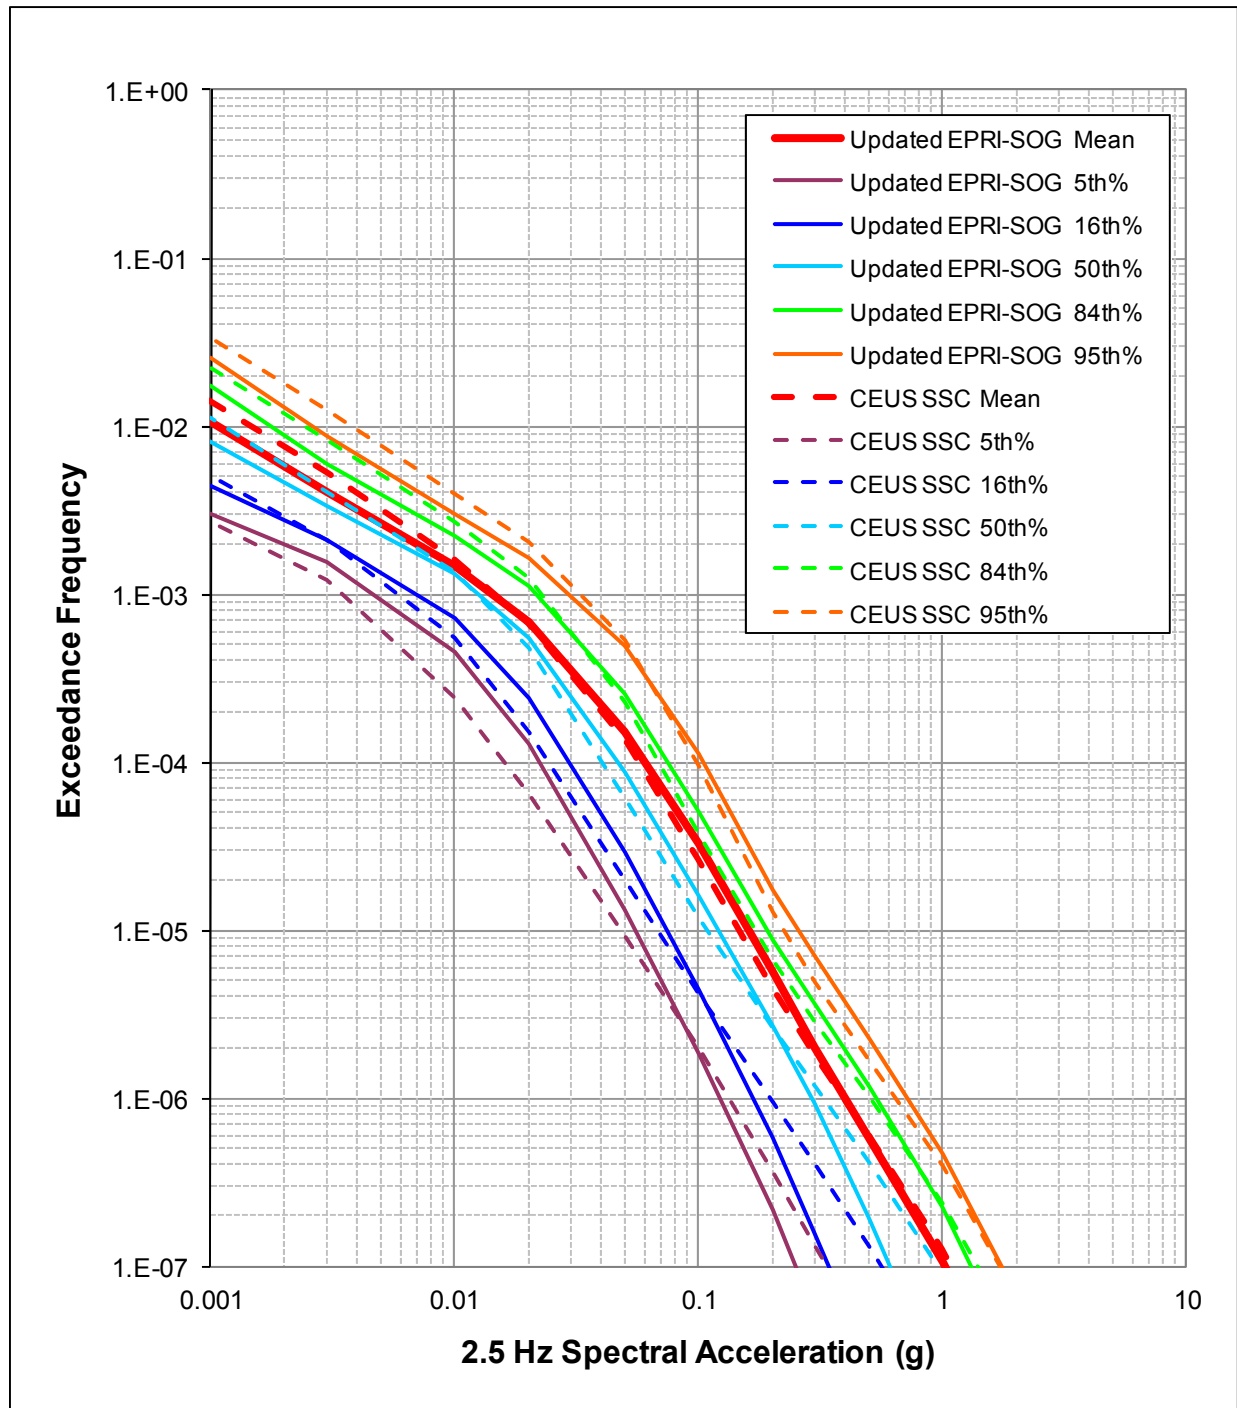

Note: Results are for generic CEUS hard rock
and 5 percent damping

Duke Energy Florida
Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

2.5 Hz Spectral Acceleration Hazard for
the LNP Site Computed Using Updated
EPRI-SOG and CEUS SSC Models

FIGURE 2.5.2-334

Rev 6