


WILLIAM STATES LEE III
NUCLEAR STATION UNITS 1 AND 2

Passive Core Cooling System
Piping and Instrumentation Diagram

FIGURE 6.3-201 (Sheet 2 of 3)

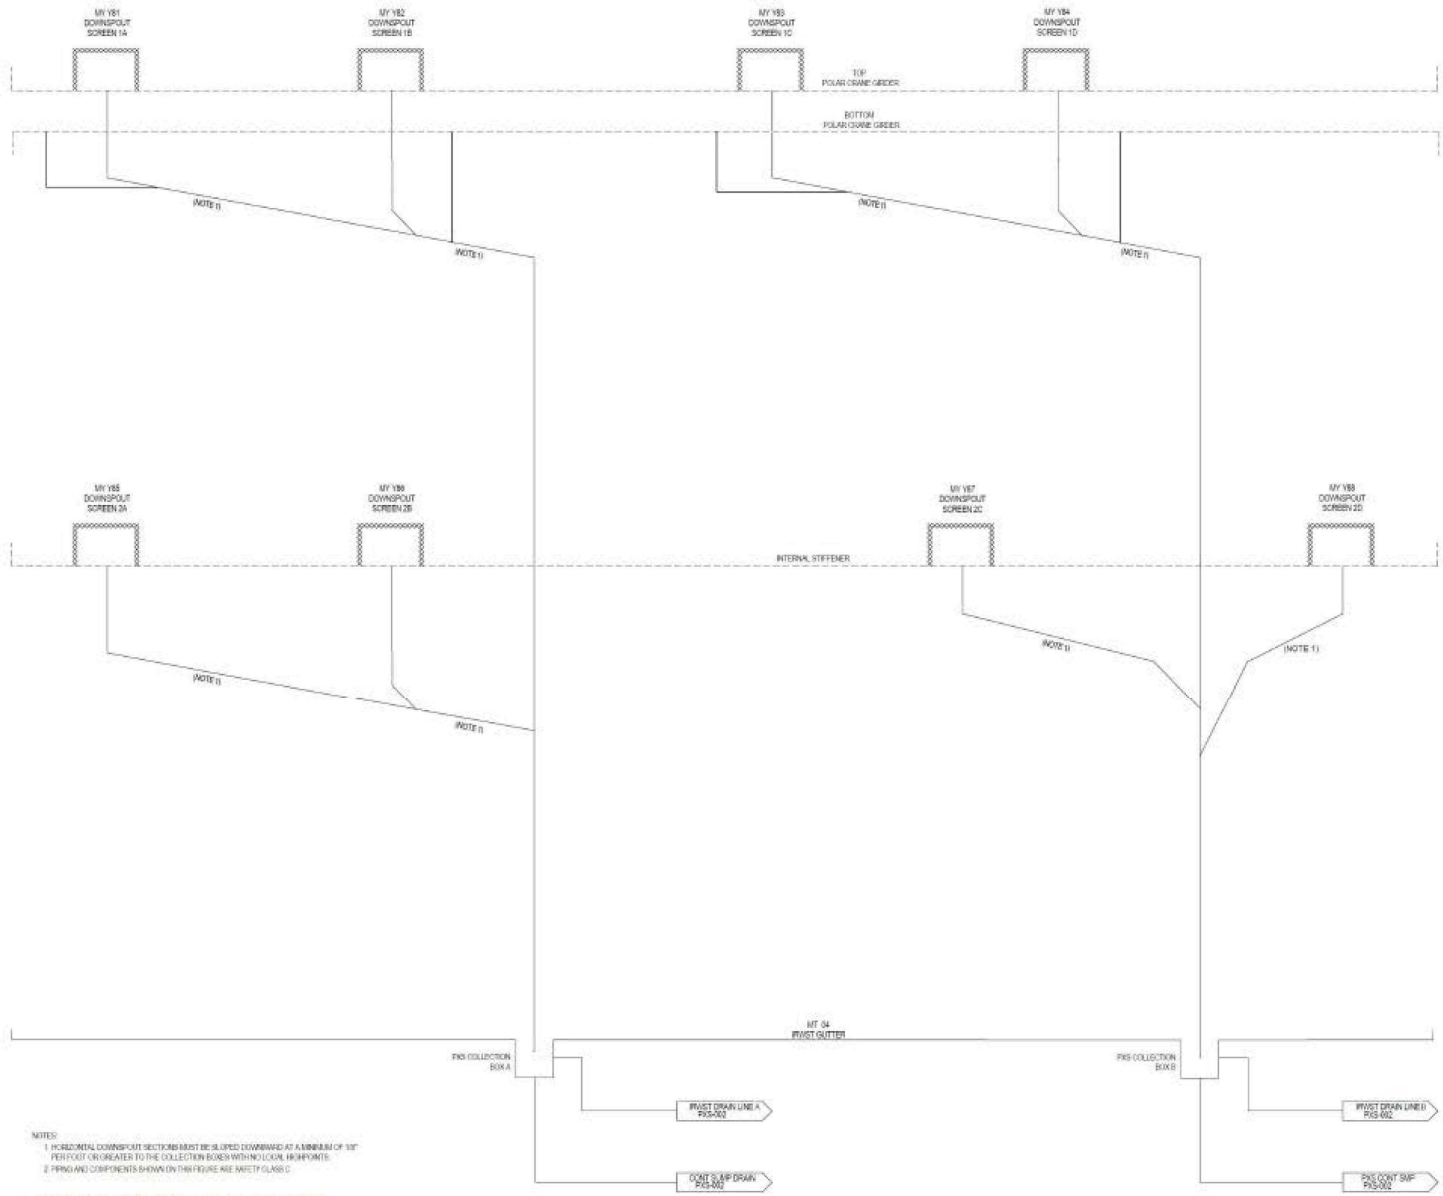

NOTES:
1. HORIZONTAL DOWNSPOUT SECTIONS MUST BE SLOPED DOWNWARD AT A MINIMUM OF 1/8" PER FOOT OR GREATER TO THE COLLECTION BOXES WITH NO LOCAL HIGHPOINTS.
2. PIPING AND COMPONENTS SHOWN ON THIS FIGURE ARE SUBJECT TO CLASS C.

VENTS, DRAINS AND TEST CONNECTIONS ARE INCLUDED IN THE SYSTEM DESIGN BUT NOT SPECIFICALLY SHOWN ON DEC FIGURES.

P&ID REPRESENTS SYSTEM FUNCTIONAL ARRANGEMENT. DETAILS INTERNAL TO THE SYSTEM MAY DIFFER AS A RESULT OF IMPLEMENTATION FACTORS SUCH AS VENDOR SPECIFIC COMPONENT REQUIREMENTS.

WILLIAM STATES LEE III
NUCLEAR STATION UNITS 1 AND 2

Passive Core Cooling System
Piping and Instrumentation Diagram

FIGURE 6.3-201 (Sheet 3 of 3)

Rev. 9