

V. C. Summer Nuclear Station
Bradham Blvd & Hwy 215, Jenkinsville, SC 29065
Mailing Address:
P.O. Box 88, Jenkinsville, SC 29065
DominionEnergy.com



April 27, 2020

ATTN: Document Control Desk
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555-001

Serial No. 20-165
LIC/TS/R0
Docket No. 50-395
License No. NPF-12

DOMINION ENERGY SOUTH CAROLINA, INC. (DESC)
VIRGIL C. SUMMER NUCLEAR STATION UNIT 1
DOCKET NO. 50-395
OPERATING LICENSE NO. NPF-12
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT

Enclosed is the DESC Annual Radiological Environmental Operating Report as required by Section 6.9.1.6 of the Virgil C. Summer Nuclear Station Technical Specifications.

If there are any questions, please call Ms. Tracey Stewart at (803) 931-5663.

Sincerely,

A handwritten signature in black ink, appearing to read "R. Haselden", written over a horizontal line.

Robin R. Haselden
General Manager, Organization Effectiveness
V. C. Summer Nuclear Station

Enclosure

cc: w/o Enclosure unless noted
G. J. Lindamood – Santee Cooper
L. Dudes – NRC Region II (w/Enclosure)
S. A. Williams – NRC Project Manager
NRC Resident Inspector (w/Enclosure)
C. Logan – ANI (w/Enclosure)
Anu Nair – SCDHEC (w/Enclosure)
Daemon Hobbs – SCDHEC (w/Enclosure)




ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT VIRGIL C. SUMMER NUCLEAR STATION


FOR THE OPERATING PERIOD
JANUARY 1, 2019 - DECEMBER 31, 2019




Prepared by:


Brett Williams, Specialist
Health Physics

Reviewed by:

 04/22/2020
Casey Carlson, Supervisor
Health Physics

Approved by:

 04/22/2020
Todd Ellison, Manager
Health Physics and Safety Services

EXECUTIVE SUMMARY

This Annual Radiological Environmental Operating Report describes the V.C. Summer Environmental Monitoring Program and the program results for the calendar year 2019.

Included are the identification of sample locations, descriptions of environmental sampling and type of analysis. Comparisons of present environmental radioactivity levels and preoperational environmental data, land use census evaluation, doses calculated from environmental measurements, and a summary of environmental radiological sampling results are presented. Quality assurance practices, sampling deviations and unavailable samples are also discussed.

Sampling activities were conducted as prescribed by the Offsite Dose Calculation Manual (ODCM) for V.C. Summer Nuclear Station (VCSNS) and applicable Health Physics Procedures. Required analyses were performed and detection limits met for required samples with deviations noted. Samples were collected comprising one thousand two hundred sixty-six analyses (1,266) performed to compile the data for the 2019 Environmental Report. Supplemental samples comprising three hundred six (306) analyses were performed on some media for additional information. Based on the results from the annual land use census, the current number of sampling sites for V.C. Summer Nuclear Station is sufficient.

Radionuclides observed in the environment in 2019 from V.C. Summer effluent releases were within the range of concentrations observed in the past. Radiation dose calculated from sample results is less than observed with normal fluctuation in natural background. It is therefore concluded that VCSNS operations have no significant radiological impact on the health and safety of the public or the environment.

TABLE OF CONTENTS

	<u>PAGE</u>
INTRODUCTION	1
DESCRIPTION OF THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM	2
LAND USE CENSUS	4
MONITORING RESULTS AND DISCUSSION	4
CONCLUSION	7

LIST OF TABLES

<u>TABLE</u>		<u>PAGE</u>
1	Monitoring Methods for Critical Radiation Exposure Pathways	3
2	2019 Fission and Activated Corrosion Product Activity in Sediment	7
3	Required Sampling Site Locations	8
4	Results of the 2019 Land Use Census Verification	11
5	Critical Receptor Evaluation for 2019	12
6	Radiological Environmental Monitoring Program Specifications	13
7	Supplemental Radiological Environmental Monitoring	18
8	Radiological Environmental Monitoring Program Summary for 2019	22
9	Radiological Environmental Monitoring Program Preoperational (Baseline) Summary	28
10	Results of 2019 Environmental Inter-Comparison Program with Independent Lab, Eckert & Ziegler Analytics, Inc.	33
11	2019 Environmental Sampling Program Deviations	35

LIST OF FIGURES

FIGURE

- 1-1 Control Site Locations (50 mile radius around the Virgil C. Summer Nuclear Station)
- 1-2 Radiological Monitoring Program Local Indicator Sample Sites (5 mile radius around Virgil C. Summer Nuclear Station)
- 1-3 Radiological Monitoring Program Local Indicator Sample Sites (1 mile radius around Virgil C. Summer Nuclear Station)
- 1-4 Radiological Monitoring Program Security Area Ground Water Sites.
- 1-5 Radiological Monitoring Program Protected Area Ground Water Sites and Independent Spent Fuel Storage Installation (ISFSI).

INTRODUCTION

Virgil C. Summer Nuclear Station (VCSNS) utilizes a pressurized water reactor rated at 2900 MWt (990 MWe gross). The station is located adjacent to the Monticello Reservoir near Jenkinsville, South Carolina and approximately 26 miles northwest of Columbia. VCSNS achieved initial criticality on October 22, 1982, reached 50% power December 12, 1982 and 100% power June 10, 1983 following steam generator feed water modifications. Steam generators were replaced in the fall of 1994. During the ninth refuel the plant was uprated to 2900 MWt (990 MWe gross). VCSNS is currently operating in the 25th fuel cycle.

VCSNS is operating in conjunction with the adjacent Fairfield Pump Storage Facility (FPSF) which consists of eight reversible pump-turbine units of 60 MWe capacity each. During periods of off-peak power demand, base load generating capacity is used to pump water from Parr Reservoir to Monticello Reservoir. Monticello Reservoir has a surface area of approximately 6800 acres and lies about 150 feet above Parr Reservoir whose full pool area is approximately 4400 acres. The pump-turbine units operate in the generating mode to meet peak system loads while Monticello Reservoir also provides condenser cooling water for VCSNS. Cooling water intake and discharge structures are separated by a jetty to ensure adequate circulation within the reservoir.

VCSNS is located in Fairfield County which, along with Newberry County, makes up the principle area within a 10 mile radius of the plant. This area is mainly forest with only about 30% devoted to small farming activities principally producing small grains, feed crops and beef cattle. Significant portions of Lexington and Richland Counties are encompassed within the 20 mile radius of the plant and exhibit similar agricultural activities. Columbia, the state capital, is the only large city within the 50 mile radius of the plant. Small agricultural concerns are predominant, but make up less than 50% of the land area. The main industrial activity is concentrated around Columbia and is generally greater than 20 miles from the VCSNS.

Liquid effluents from VCSNS are released into the Monticello/Parr Reservoirs at two discharge points: the Circulating Water Discharge Canal (CWDC) and the FPSF Penstocks. Non-nuclear drains are released to the CWDC. Effluent from the liquid waste processing system and processed steam generator blow down are released through the penstocks. Radioactive gaseous effluents from VCSNS are released from two points: the Main Plant Vent and the Reactor Building Purge Exhaust, all considered ground level releases.

In 2012 construction began on the Independent Spent Fuel Storage Installation (ISFSI), and concluded in January 2016. The first dry cask storage campaign began March 26, 2016 and finished in the first week of May 2016. Four casks were loaded during this evolution. A second campaign during the second quarter of 2019 loaded four additional casks to the ISFSI for a total of eight casks.

Radioactive liquid and gaseous releases from the facility and their potential influence on the surrounding biota and man are the primary concern of the Radiological Environmental Monitoring Program at VCSNS. This report summarizes the results of the Radiological Environmental Monitoring Program conducted during 2019. Data trends, control/indicator and preoperational/operational data, inter-comparisons, and other data interpretations are presented.

DESCRIPTION OF THE RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

The Radiological Environmental Monitoring Program is carried out in its entirety by Dominion Energy South Carolina. The program has been designed to meet the following general commitments:

1. To analyze selected samples in important anticipated pathways for the qualification and quantification of radionuclides released to the environment surrounding VCSNS.
2. To establish correlations between levels of environmental radioactivity and radioactive effluents from VCSNS operation.

The program utilizes the concepts of control/indicator and preoperational /operational inter-comparisons in order to evaluate the adequacy of radioactivity source control and to realistically verify the assessment of environmental radioactivity levels and subsequent radiation dose to man.

Sample media and analysis sensitivity requirements have been established to ensure that the maximum dose pathways are monitored and sensitivities represent a small fraction of annual release limits. These required Lower Limits of Detection (LLD's) are verified to have been met by calculating Minimum Detectable Activity (MDA) for each sample based on actual counting parameters relevant to each sample. In all cases the achieved MDA was lower than the LLD. Effluent dispersion characteristics, demography, hydrology and land use have been considered in selection of environmental sampling locations. These criteria were used to establish both the preoperational and operational phases of the Radiological Environmental Monitoring Program. Elements of the program monitor the impact of both gaseous and liquid effluents released from VCSNS.

Specific methods used in monitoring the pathways of these effluents which may lead to radiation exposure of the public, based on existing demography, are summarized below in Table 1. Requirements of the Radiological Environmental Monitoring Program are specified in the VCSNS Offsite Dose Calculation Manual (ODCM).

Table 1 - Monitoring Methods for Critical Radiation Exposure Pathways

Effluent Release Type	Exposure Pathway	Monitoring Media
Gaseous	Immersion Dose and other External Dose	Thermoluminescent Dosimetry (TLD) Area Monitoring, Air Sampling,
	Vegetation (Ingestion)	Vegetation and Food Crop Sampling,
Liquid	Milk (Ingestion)	Milk Sampling, Grass (Forage) Sampling
	Fish (Ingestion)	Fish Sampling,
	Water & Shoreline Exposure (Ingestion and Immersion)	Surface Water Sampling, Ground Water Sampling, Shoreline and Bottom Sediment Sampling,
	Drinking Water (Ingestion)	Drinking Water Sampling

Monitoring sites indicative of plant operating conditions are generally located within a 5 mile radius of the plant. Table 6 provides a list of ODCM required sampling locations. Table 7 provides a list of supplemental sampling locations. Maps showing radiological environmental sampling locations within a radius of approximately 5 miles from VCSNS are presented as Figures 1-2 through 1-5. Figure 1-1 shows monitoring sites at distances greater than 10 miles from the plant. Background radiation levels vary across the monitored area of interest.

In addition to preoperational/operational data inter-comparisons, control/indicator data inter-comparisons are utilized. This is done to assess the probability that any observed abnormal measurement of radioactivity concentration is due to random or regional fluctuations rather than to a true increase in local environmental radioactivity concentration.

Environmental data is gathered through multiple types of sampling and measurements at specific locations. Several multiple sampling combinations are in use around the VCSNS. For example, all air sampling locations serve as environmental dosimetry monitoring locations. At these locations, airborne plant effluents are monitored for gamma immersion dose (noble gases), in addition to air contaminants. Monitoring locations Site 6 (1.0 mile ESE) and Site 7 (1.0 mile E) have broadleaf vegetation gardens for monitoring gaseous effluent deposition (ingestion pathway) in the two sectors having the highest deposition coefficients (D/Q) with real potential for exposure. Monitoring location Site 18 (16.5 miles S) serves as a control location for direct radiation and Site 40 (11.9 miles SSE) serves as a control location for garden monitoring.

Liquid effluents are monitored using three different monitoring media (fish, bottom sediment and surface water) at the two most probable affected bodies of water around the plant: Site 21, Parr Reservoir (2.7 miles SSW) and Site 23, Monticello Reservoir (0.5 miles ESE). The control location for liquid effluent comparisons is at Site 22, Neal Shoals (26.0 miles NNW) on the Broad River.

Quality of analytical measurements is demonstrated by participation in a laboratory inter-comparison program. Results of the inter-comparison program with an outside vendor and VCSNS Count Room were satisfactory in 2019 and are summarized in Table 10. The results of each of these quality control checks of the Radiological Environmental Monitoring Program verify the technical credibility of analytical data generated and reported by the program.

LAND USE CENSUS

Annually a land use census is performed within a 5 mile radius of VCSNS to verify the appropriate siting of sample locations. In addition, the location of the maximum exposed individual (MEI) is identified to ensure the appropriate location is used for calculation of offsite dose impact from Summer Station gaseous effluents. The results of the land use census performed in 2019 are included in Table 4. A verification of the maximum exposed individual location is presented in Table 5. Identification of the highest offsite dose locations was performed by calculating a hypothetical dose based on source term from the Operating License Environmental Report and 2019 meteorological data. Exposure pathways modeled in the analysis were those identified during the land use census.

The location and pathway presently used in the ODCM for offsite organ dose calculations (E 1.1 miles - residence/garden) was found to have the highest calculated dose. In addition, the ODCM required environmental gardens (ESE 1.0 and E 1.0 miles) were found to have calculated doses higher than any real receptor. There were no milking animals or dairy activity found within 5 kilometers of VCSNS. Therefore, changes to the ODCM gaseous effluent calculations or garden sample locations are not indicated.

MONITORING RESULTS AND DISCUSSION

The results of the Radiological Environmental Monitoring Program for 2019 are summarized in Table 8. For comparison, preoperational data are summarized in Table 9. The Radiological Environmental Program attained a program compliance rate of approximately 99.5%. A listing of program deviations and their respective causes are included in Table 11. Analysis of the impact of these omissions verified that program quality has not been affected.

Corbicula harvest for possible human consumption was observed in Lake Monticello in 2005. Since that time Corbicula analysis has been incorporated in the Supplemental Sampling Program. Samples were collected and analyzed for gamma emitting isotopes. No gamma emitting nuclides were detected.

Gross beta activities measured in air particulate samples collected at indicator locations around VCSNS were consistent with preoperational levels and not statistically significant from control locations. The highest site-specific mean activity ($2.32\text{E-}2 \text{ pCi/m}^3$) was measured at indicator location Site 30 (Construction Site Gate 0.5 miles SSW). The results indicate that the operation of VCSNS has not contributed to detectable increases of airborne gross beta activity in the environment.

Gamma spectroscopy measurements of composited air particulate samples and activated charcoal cartridges support the gross beta activity trend. Only natural background

activities were detected. The highest MDA levels for ^{134}Cs , ^{137}Cs and ^{131}I were $1.91\text{E-}3$, $2.13\text{E-}3$ and $1.82\text{E-}2$ pCi/m³, respectively and all met program analytical requirements for detection capability. The control site ^{134}Cs highest MDA level of $2.07\text{E-}3$ was slightly higher than the indicator sites. Air sample collection rate for indicator/control air samples was 99%.

Environmental dosimetry measurements did not differ significantly from preoperational measurements. Indicator and control dosimetry measurements also showed no appreciable differences. Comparison with other operational years shows no statistically significant difference. Monitoring location Site 55 (St. Barnabas Church 2.8 miles E) was the indicator location showing the highest mean exposure rate of $1.13\text{E+}1$ $\mu\text{R/hr}$. This value is consistent with the highest mean exposure rate of $1.40\text{E+}1$ $\mu\text{R/hr}$ measured during the preoperational period. In April of 2015 six TLD sites were added to the Environmental Dosimetry program. These added TLD's were placed around the boundary of the Independent Spent Fuel Storage Installation (ISFSI) which began cask storage on March 26, 2016. To date there has been no statistically significant increase in dose rate above background from Dry Cask Storage activities. TLD sample collection rate for all indicator/control was 100%.

Gamma spectroscopy measurements of surface water samples did not indicate the presence of activated corrosion or fission products above the respective MDA for indicator sites. Tritium analysis did not indicate the presence of tritium above the respective MDA for indicator sites. Sample collection rate for all indicator/control surface water samples was 100%.

Gamma spectroscopy measurements of the ODCM required ground water samples did not indicate the presence of activated corrosion or fission products above the respective MDAs. Tritium was detected within the site boundary at Site 123 (NPDES Well GW-16 0.34 miles SSE), in four quarterly samples at concentrations of $1.11\text{E+}3$ pCi/L, $1.27\text{E+}3$ pCi/L, $1.20\text{E+}3$ pCi/L, and $1.18\text{E+}3$ pCi/L. GW-16 is a shallow supplemental monitoring site used to monitor for chemical contaminants around the Industrial and Sanitary Waste Treatment System. If this ground water represented a credible exposure pathway, maximum dose projection assuming consumption of 730 liters per year would result in a dose that does not exceed 0.1 mrem. Tritium was also detected in one sample at Site 114 (NPDES Well GW-13A 0.39 miles SE), at a concentration of $3.41\text{E+}2$ pCi/L. These levels are substantially less than the $2.00\text{E+}4$ pCi/L drinking water standard.

Tritium was also detected in three (3) supplemental ground water de-watering wells within the Nuclear Station Protected Area. Sampling of these wells indicated tritium concentrations ranging from $2.97\text{E+}2$ pCi/L to $7.69\text{E+}2$ pCi/L for De-Watering well Site 116 (DW-14), Site 117 (DW-15), $3.63\text{E+}2$ pCi/L to $3.14\text{E+}3$ pCi/L, and Site 118 (DW-16) had one sample above MDA at a concentration of $4.10\text{E+}2$ pCi/L. These wells drain outside the Protected Area through a storm water drainage system. All monthly composite samples collected during 2019 at the discharge point did not contain detectable levels of tritium. Minimum detectable activity was less than 500 pCi/L for these samples demonstrating doses less than 0.04 mrem. Sample collection rate for indicator/control ground water samples was 100%.

Gamma spectroscopy measurements of drinking water samples collected from Site 28 (Jenkinsville water supply) and Site 17 (Columbia Water Works 25.0 miles SE) did not indicate the presence of activated corrosion or fission product activity above the respective MDAs. Tritium was detected above MDA in 2 samples taken at Site 17 (Columbia Water Works 25.0 miles SE) at concentrations of $6.46\text{E}+2$ pCi/L and $7.69\text{E}+2$ pCi/L. These concentrations are well below the required drinking water LLD of $2.0\text{E}+3$ pCi/L. Sample collection rate for indicator/control drinking water samples was 100%.

There were no milk samples collected in 2019. Milk sampling is required to be performed at the three highest dose locations within 5 kilometers of the plant or at 5 to 8 kilometers of the plant, if doses are calculated to be greater than 1 mrem/year. Presently there are no locations meeting this criteria for indicator dairies. The closest dairy is approximately 7 kilometers from the plant (see Table 4). Milk samples will be obtained from this dairy if gaseous releases from the plant exceed 5% of quarterly organ dose limits or radionuclides (attributed to the operation of VCSNS) are detected in broadleaf vegetation, grass or air samples at concentrations greater than required LLDs.

Gamma spectroscopy measurement of supplemental grass samples collected indicated ^{137}Cs in 4 of 12 samples at Site 2 (transmission line 1.2 miles SW) at concentrations ranging from $3.33\text{E}+1$ pCi/kg to $7.16\text{E}+1$ pCi/kg. The maximum preoperational control activity was $3.40\text{E}+2$ pCi/kg. Sample collection rate for indicator/control supplemental grass was 100%.

Gamma spectroscopy measurements were performed on supplemental grass and soil samples collected in response to a liquid effluent spill in 2011 at Site 25 (Fairfield Pump Storage Remediation Area 0.9 miles WNW). None of the grass and soil samples collected indicated the presence of activated corrosion or fission products above the respective MDAs.

Gamma spectroscopy measurements of the broadleaf samples collected did not indicate the presence of activated corrosion or fission products above the respective MDAs. All of the required indicator/control broadleaf samples were collected.

Gamma spectroscopy measurements of all non-leafy (other vegetation) supplemental samples collected did not indicate the presence of activated corrosion or fission products above the respective MDA.

Gamma spectroscopy measurements of all fish samples collected did not indicate the presence of activated corrosion or fission products above the respective MDA. All of the required indicator/control fish samples were collected.

Gamma spectroscopy measurements of sediment samples detected ^{137}Cs in 2 of 4 indicator samples taken at Site 21 (Parr Res. 2.7 miles SSW) at concentrations of $6.02\text{E}+1$ and $4.13\text{E}+1$ pCi/kg. ^{137}Cs was also detected in 2 of 2 control samples taken at Site 22 (Neal Shoals 26 miles NNW) at concentrations of $2.18\text{E}+1$ pCi/kg and $3.87\text{E}+1$ pCi/kg. Historically ^{137}Cs levels at the control site have ranged from $1.8\text{E}+1$ pCi/kg to $1.0\text{E}+3$ pCi/kg. The level of ^{137}Cs observed at Site 21 (Parr Res. 2.7 miles SSW) is consistent with background conditions in the environment. However, if the ^{137}Cs was attributed to Summer Station the dose would be 0.005 mrem/year. All required indicator/control sediment samples were collected.

Table 2 - 2019 Fission and Activated Corrosion Product Activity in Sediment

Location	Radionuclide	Activity (pCi/kg)		Corresponding Calculated Annual Dose Equivalent (mrem/yr)	
				Total Body	
Parr Reservoir	¹³⁷ Cs	Maximum	Mean	Maximum	Mean
		6.02E+1	5.08E+1	5.06E-3	4.27E-3

CONCLUSION

As in previous years of VCSNS operation, the presence of fission product activity attributed to residual fallout from atmospheric weapons testing and the Chernobyl accident were detected in environmental media including sediment and grass.

No detectable fission or activation product activity attributed to VCSNS operations was observed in environmental media with the exception of:

- Tritium in supplemental ground water samples taken at Site 123 (NPDES Well GW-16 0.34 miles SSE) within the nuclear station owner controlled area.
- Tritium in supplemental ground water samples taken at Sites 116 (DW-14), Site 117 (DW-15), and Site 118 (DW-16) within the nuclear station protected area.
- Tritium in ground water sample taken at Site 114 (NPDES Well GW-13A 0.39 miles SE) within the nuclear station owner controlled area.
- Tritium in drinking water samples taken at Site 17 (Columbia Water Works 25 miles SE).

The average natural background for direct exposure as determined from control locations is 70.4 mrem/year. The hypothetical calculated maximum exposure for drinking water and sediment exposure is well within the normal fluctuations of natural terrestrial and cosmic background. This dose would not be expected to result in observable effect on the ecosystem or general public. The results of the Radiological Environmental Monitoring Program, therefore, substantiate the continuing adequacy of source control at VCSNS and conformance of station operation to 10 CFR 50, Appendix I design objectives.

Table 3 - Required Sampling Site Locations

Site No.	Description	Distance¹ (Miles)	Direction²	Sample Type(s)³
1	Borrow Pit	1.2	179.8 S	DQ
2	Transmission Line	1.2	225.0 SW	AP, RI, DQ
3	Firing Range	1.2	270.0 W	DQ
4	Fairfield Hydro	1.2	289.5 WNW	DQ
5	Transmission Line Entrance	0.9	144.0 SE	DQ
6	Environmental Lab Garden	1.0	111.0 ESE	AP,RI,GA,DQ,GW
7	Environmental Lab Garden	1.0	97.8 E	AP,RI,DQ, GA
8	Monticello Res. S of Rd 224	1.5	62.0 ENE	DQ
9	Ball Park	2.3	41.6 NE	DQ
10	Meteorological Tower #2	2.5	25.5 NNE	DQ
12	Old Hwy 99	4.2	349.4N	DQ
13	North Dam	2.9	333.0 NNW	DQ
14	Dairy (Shealy) ⁴	6.5	277.0 W	MK,GR
16	Dairy (Parr) ⁴	20.0	275.5 W	MK,GR
16a	TLD Location	28.0	278.6W	DQ
17	Columbia Water Works	25.0	144.0 SE	AP,RI,DQ,DW
18	Pine Island Club	16.5	165.0 S	DQ
19	Residence/Little Saluda	21.0	224.0 SSW	DQ
20	Residence/Whitmire	22.0	309.5 NW	DQ
21	Parr Reservoir	2.7	199.5 SSW	SW,FH,BS
22	Neal Shoals	26.0	343.1 NNW	SW,FH,BS
23	Discharge Canal (Mont, Res.)	0.5	104.5 ESE	SW,FH,BS
26	On Site Well (P2)	460 Ft	270.0 W	GW
27	On Site Well (P5)	510 Ft	180.0 S	GW
28	Jenkinsville Post Office	2.8	170.2 SE	DW
29	Trans. Line WSW of VCSNS	1.0	260.6 WSW	DQ
30	Oak Tree North of Borrow Pit ⁶	1.0 / 0.5	196.2 SSW	DQ, AP, RI
31	McCrorey-Liston School	6.6	11.5 NNE	DQ
32	Clark Bridge Road and Brooks Drive	4.6	24.0 NNE	DQ
33	Rd 48 near Hwy 213	4.2	68.0 ENE	DQ
34	Rd 419 North of Hwy 60	4.9	111.0 ESE	DQ
35	Glenn's Bridge Road	4.6	132.0 SE	DQ
36	Woods at Jenkinsville Post Office	3.1	151.0 SSE	DQ
37	Residence	4.9	304.8 NW	DQ
39	Lake Murray Water Treatment Facility	14.0	168.0 SSE	DW
40	Emergency Operations Facility ⁷	11.9	157.0 SSE	GA, GR
41	Below Catwalk at Trestle	3.8	182.0 S	DQ
42	Broad River Rd (Peak Residence)	3.8	198.0 SSW	DQ
43	Hwy 176 and Rd 435	5.2	236.0 SW	DQ
44	Rd 28 at Cannon's Creek	2.8	256.6 WSW	DQ
45	Rd 33 at Pomaria	5.8	253.2 WSW	DQ
46	Rd 28 at Heller's Creek	3.7	291.5 WNW	DQ
47	Fairfield Tailrace	1.0	316.0 NW	DQ

Table 3 (cont) – Required Sampling Site Locations

Site No.	Description	Distance¹ (Miles)	Direction²	Sample Type(s)³
52	Monticello (Rd 11)	3.8	13.0 NNE	DQ
53	Rd 359	3.0	46.5 NE	DQ
54	Jenkinsville School	1.7	72.5 ENE	DQ
55	St. Barnabas Church	2.8	91.5 E	DQ
56	Old Jenkinsville Dinner	2.0	144.0 SE	DQ
58	Residence	2.5	157.0 SSE	DQ
59	New Nuclear Deployment ⁵	2.6	170.2 SSE	DQ, GW
60	Rd 98 near Rd 28	3.5	274.6 W	DQ
78	ISFSI - North	0.14	133 NW	DQ
79	ISFSI – North East	266 Ft	102 WNW	DQ
80	ISFSI – South East	256 Ft	61 WSW	DQ
81	ISFSI - South	0.10	63 WSW	DQ
82	ISFSI –South West	0.15	91 W	DQ
83	ISFSI – North West	0.15	104 WNW	DQ
101	Remediation Well (B-2)	300 Ft	NNW	GW
102	Remediation Well (B-6)	400 Ft	NE	GW
103	Remediation Well (DW-13)	80 Ft	NE	GW
106	Remediation Well (DW-7)	250 Ft	SE	GW
108	Remediation Well (DW-19)	250 Ft	W	GW
110	Remediation Well (B-36)	300 Ft	NW	GW
112	NPDES Well (GW-9)	0.36	331 SSE	GW
113	NPDES Well (GW-12)	0.33	332 SSE	GW
114	NPDES Well (GW-13A)	0.39	317 SE	GW

Table 3 (cont) – Required Sampling Site Locations

Footnotes

1. Distance given is the distance between the site location and the VCSNS reactor containment building.
2. Direction given in degrees from true north-south line through center of reactor containment building.
3. Sample Types:

AP = Air Particulate	GW = Ground Water	GA = Garden
RI = Air Radioiodine	DW = Drinking Water	FH = Fish
DQ = Quarterly TLD	MK = Milk	BS = Bottom Sediment
SW = Surface Water	GR = Grass (Forage)	
4. Sites 14 and 16 are not presently in use. If conditions change, requiring a renewal of dairy sampling these sites will be reactivated.
5. Site 30 consists of two locations in the same sector. The air sampler is located 0.5 miles from the reactor to support construction of a new facility. The TLD is located 1.0 mile from the reactor in the same sector.
6. Site 40 (11.9 miles SSE) serves as a control location for garden monitoring which is the location of the Station's Emergency Operating Facility.

Table 4 - Results of the 2019 Land Use Census Verification

SECTOR	NEAREST RESIDENCE	MILES	NEAREST GARDEN	MILES	NEAREST CATTLE	No. MILKED	MILES	NEAREST GOAT	No. MILKED	MILES
N	P. Oliver	3.73								
NNE	Thomas Crumblin	2.96								
NE	Gregery Guinyard Jr.	1.5								
ENE	Bessie Gregg	1.53								
E	Roy Mcadory	1.18								
ESE	Carie Lee Martin	1.04								
SE	Mary White	1.44								
SSE	Ronnie Mann	2.39								
S	Kelly Boulware	3.54	Alston Farm	3.57	Shirley Counts	0	4.9			
SSW	1678 Broad River Rd	3.02								
SW	1762 Broad River Rd	2.84	Marvin Miller	3.39						
WSW	243 Peak Rd	3.25			Steve All	0	5.2	Steve All	0	4.82
W	Mayer Windmill Rd	2.49			141 Haven Ln ©	0	2.2			
W	Jacob Graham (Dairy)	5.14			Jacob Graham (Dairy)	90	4.82			
WNW	C C Mann	2.59								
NW	Louise Workman	3.86								
NNW	Frank March	2.86								

- (A) Change In Closest Residence
- (B) Change In Closest Garden
- (C) Change In Closest Beef Cattle
- (D) Change In Closest Goat

Table 5 Critical Receptor Evaluation for 2019

NAME	SECTOR	MILES	PATHWAY	X/Q	D/Q	DOSE* mRem/y
P. Oliver	N	3.73	Res	2.05E-07	6.05E-10	7.64E-03
T. Crumblin	NNE	2.96	Res	3.91E-07	1.31E-09	1.47E-02
G. Guinyard, Jr.	NE	1.5	Res	2.33E-06	7.37E-09	8.72E-02
B. Gregg	ENE	1.53	Res	1.80E-06	5.58E-09	6.75E-02
Garden 7	E	1	Res, Gar	3.99E-06	1.34E-08	3.62E+00
R. Mcadory	E	1.18	Res	2.68E-06	8.87E-09	1.01E-01
Garden 6	ESE	1	Res, Gar	2.64E-06	8.11E-09	2.22E+00
C. L. Martin	ESE	1.04	Res	2.40E-06	7.32E-09	8.95E-02
M. White	SE	1.44	Res	7.98E-07	3.22E-09	3.02E-02
R. Mann	SSE	2.39	Res	1.51E-07	8.02E-10	5.82E-03
K. Boulware	S	3.54	Res	6.87E-08	5.12E-10	2.72E-03
Alston Rd Farm	S	3.57	Res, Gar	6.75E-08	5.03E-10	1.28E-01
S. Counts	S	4.9	Res, B	3.55E-08	2.49E-10	2.61E-02
1678 Broad River Rd	SSW	3.02	Res	9.97E-08	9.59E-10	4.06E-03
1762 Broad River Rd	SW	2.84	Res	9.11E-08	1.18E-09	3.86E-03
M. Miller ¹	SW	3.39	Res, B	6.16E-08	7.83E-10	1.94E-01
243 Peak Rd	WSW	3.25	Res	6.42E-08	5.97E-10	2.60E-03
S. All	WSW	4.82	Res, G	2.80E-08	2.48E-10	4.08E-03
S. All	WSW	5.2	B	2.40E-08	2.10E-10	2.09E-02
S. All***	WSW	N/A	Res, G, B	N/A	N/A	2.49E-02
Mayer Windmill Rd	W	2.49	Res	1.35E-07	8.58E-10	5.28E-03
141 Haven Ln	W	2.55	Res	1.29E-07	8.11E-10	5.01E-03
141 Haven Ln	W	2.2	B	1.78E-07	1.15E-09	1.14E-01
141 Haven Ln***	W	N/A	Res, B	N/A	N/A	1.19E-01
Graham Dairy	W	5.14	Res	2.97E-08	1.67E-10	1.15E-03
Graham Dairy	W	4.82	C/M	3.38E-08	1.92E-10	1.70E-01
Graham Dairy***	W	N/A	Res, C/M	N/A	N/A	1.72E-01
CC Mann	WNW	2.59	Res	8.40E-08	3.90E-10	3.20E-03
L. Workman	NW	3.86	Res	8.23E-08	3.38E-10	3.12E-03
F. March	NNW	2.86	Res	3.01E-07	1.03E-09	1.13E-02
ODCM Organ Dose	E	1.1	Res, Gar	3.17E-06	1.05E-08	2.84E+00

Pathway

Res = Residence

Gar = Garden

B = Beef

C/M = Cow/Milk(Infant)

G = Goat

G/M = Cow/Milk(Infant)

Footnotes:

¹ Maximum exposed individual.

* Hypothetical dose based on Operating License Environmental Report Source Term.

** ODCM required environmental gardens.

*** Doses summed to give total for receptor

Table 6 – Radiological Environmental Monitoring Program Specifications

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
AIRBORNE: I. Particulate	A) 3 Indicator samples from locations close to the site boundary, in different sectors, of the highest calculated annual average ground level D/Q or dose. ²	Continuous sampler operation with weekly collection.	2 7 30	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
	B) 1 Indicator sample to be taken close to the site boundary in the sector corresponding to the residence having the highest anticipated offsite ground level concentration or dose. ²	Continuous sampler operation with weekly collection.	6	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
	C) 1 Indicator sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A). ^{2,4}	Continuous sampler operation with weekly collection.	N/A	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
	D) 1 Control sample to be taken at a location at least 10 air miles from the site and not in the most prevalent wind directions. ²	Continuous sampler operation with weekly collection.	17	Gross beta following filter change; Quarterly composite (by location) for gamma isotopic.
II. Radioiodine	A) 3 Indicator samples to be taken at two locations as given in I(A) above.	Continuous sampler operation with weekly canister collection.	2 7 30	Gamma Isotopic for Iodine 131 weekly.
	B) 1 Indicator sample to be taken at the location as given in I(B) above.	Continuous sampler operation with weekly canister collection.	6	Gamma Isotopic for Iodine 131 weekly.
	C) 1 Indicator sample to be taken at the location as given in I(C) above.	Continuous sampler operation with weekly canister collection.	N/A	Gamma Isotopic for Iodine 131 weekly.
	D) 1 Control sample to be taken at a location similar in nature to I(D) above.	Continuous sampler operation with weekly canister collection.	17	Gamma Isotopic for Iodine 131 weekly.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
III. Direct	A) 13 Indicator stations to form an inner ring of stations in the 13 accessible sectors within 1 to 2 miles of the plant.	Monthly or quarterly exchange ^{5,7} two or more dosimeters at each location.	1,2,3,4,5,6, 7,8,9,10,29, 30,47	Gamma dose monthly or quarterly.
	B) 16 indicator stations to form an outer ring of stations in the 16 accessible sectors within 3 to 5 miles of the plant.	Monthly or quarterly exchange ^{5,7} two or more dosimeters at each location.	12,13,32,33, 34,35,36,37, 41,42,43,44, 46,53,55,60	Gamma dose monthly or quarterly.
	C) 11 Stations to be placed in special interest areas such as population centers, nearby residences, schools and in 4 or 5 areas to serve as controls.	Quarterly exchange ⁷ ; two or more dosimeters at each location.	16,17,18,19, 20,31,45,52, 54,56,58	Gamma dose quarterly.
	D) 6 Stations to be placed around the ISFSI boundary.	Quarterly exchange ⁷ ; two or more dosimeters at each location.	78,79,80,81, 82,83	Gamma & neutron dose quarterly.
WATERBORNE IV. Surface Water	A) 1 Indicator sample downstream to be taken at a location which allows for mixing a dilution in the ultimate receiving river.	Time composite samples ⁶ with collection every month. ⁵	21 ³	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
	B) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Time composite samples ⁶ with collection every month. ⁵	22 ³	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
	C) 1 Indicator sample to be taken in the upper reservoir of the pumped storage facility at the plant discharge canal.	Time composite samples ⁶ with collection every month. ⁵	23 ³	Gamma isotopic monthly with quarterly composite (by location) to be analyzed for tritium. ⁷
V. Ground Water	A) 12 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.	Quarterly grab sampling. ⁷	6, 26, 27, 101-103, 106, 108,110, 112-114	Gamma isotopic and tritium analyses quarterly. ⁷
	B) 1 Control sample from unaffected location.	Quarterly grab sampling. ⁷	59	Gamma isotopic and tritium analyses quarterly. ⁷

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
VI. Drinking Water	A) 1 Indicator sample from a nearby public ground water supply source.	Monthly grab sampling. ⁵	28	Monthly ⁵ gamma isotopic and gross beta analyses and quarterly ⁷ composite for tritium analyses.
	B) 1 Indicator (finished water) sample from the nearest downstream water supply.	Monthly composite sampling.	17	Monthly ⁵ gamma isotopic and gross beta analyses and quarterly ⁷ composite for tritium analyses.
	C) 1 Control (finished water) sample from an unaffected water supply.	Monthly composite sampling.	39	Monthly ⁵ gamma isotopic and gross beta analyses and quarterly ⁷ composite for tritium analyses.
INGESTION: VII. Milk ⁴	A) Samples from milking animals in 3 locations within 5 km having the highest dose potential. If there are none then 1 sample from milking animals in each of 3 areas between 5 to 8 km distance where doses are calculated to be greater than 1 mrem per year. ¹⁰	Semimonthly when animals are on pasture ⁸ , monthly other times. ⁵	To be supplied when milk animals are found in accordance with criteria VII.A.	Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times. ⁵
	B) 1 Control sample to be taken at the location of a dairy > 20 miles distance and not in the most prevalent wind direction. ²	Semimonthly when animals are on pasture ⁸ , monthly other times. ^{5,11}	16	Gamma isotopic and I-131 analysis semimonthly ⁸ when animals are on pasture, monthly other times. ⁵
	C) 1 Indicator grass (forage) sample to be taken at the location of one of the dairies being sampled meeting the criteria of VII(A), above, when animals are on pasture.	Monthly when available. ⁵	To be supplied when milk animals are found in accordance with criteria VII.A.	Gamma isotopic.
	D) 1 Control grass (forage) sample to be taken at the location of VII(B) above.	Monthly when available. ^{5,11}	16	Gamma isotopic.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
VIII. Food Products	A) 2 samples of broadleaf vegetation grown in the 2 nearest offsite location of highest calculated annual average ground level D/Q if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5 to 8 km where the doses are calculated to be greater than 1 mrem/yr. ¹⁰	Monthly when available. ⁵	6 7	Gamma isotopic on edible portion.
	B) 1 Control sample for the same foods taken at least 10 miles distance and not in the most prevalent wind direction if milk sampling is not performed within 3 km or if milk sampling is not performed at a location within 5 to 8 km where the doses are calculated to be greater than 1 mrem/yr. ¹⁰	Monthly when available. ⁵	40	Gamma isotopic on edible portion.
IX. Fish	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual ⁹ collection. ¹	23 ³	Gamma isotopic on edible portions semiannually. ⁹
	B) 1 Indicator sample to be taken at a location in the lower reservoir.	Semiannual ⁹ collection. ¹	21 ³	Gamma isotopic on edible portions semiannually. ⁹
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual ⁹ collection. ¹	22 ³	Gamma isotopic on edible portions semiannually. ⁹
AQUATIC: X. Sediment	A) 1 Indicator sample to be taken at a location in the upper reservoir.	Semiannual grab sample. ⁹	23 ³	Gamma isotopic.
	B) 1 Indicator sample to be taken on or near the shoreline of the lower reservoir.	Semiannual grab sample. ⁹	21 ³	Gamma isotopic.
	C) 1 Control sample to be taken at a location on the receiving river sufficiently far upstream such that no effects of pumped storage operation are anticipated.	Semiannual grab sample. ⁹	22 ³	Gamma isotopic.

Table 6 (cont) - Radiological Environmental Monitoring Program Specifications

FOOTNOTES

1. Fish include 3 groups (Bass, Bream/Crappie, Catfish/Carp.)
2. Sample site locations are based on 5-year average meteorological analysis.
3. Though generalized areas are noted for simplicity of sample site enumeration, airborne, water and sediment sampling is done at the same location, whereas biological sampling sites are generalized areas in order to reasonably assure availability of samples.
4. Milking animal and garden survey results will be analyzed annually. If the survey should indicate new activity the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of three Indicator locations.
5. Not to exceed 35 days.
6. Time composite samples are samples which are collected with equipment capable of collecting an aliquot at time intervals which are short relative to the compositing period.
7. At least once per 100 days.
8. At least once per 18 days.
9. At least once per 200 days.
10. The dose shall be calculated for the maximum organ and age group, using the guidance/methodology contained in Regulatory Guide 1.109, Rev. 1 and the parameters particular to the site.
11. Milk and forage sampling at the control location is only required when locations meeting the criteria of VII(A) are being sampled.

Table 7 – Supplemental Radiological Environmental Monitoring

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
AIRBORNE: S-I. Particulate	A) 1 Indicator sample monitoring the nearest community with the highest anticipated dose or ground level concentration.	Continuous sampler operation with weekly collection.	8	Gross beta following filter change; Monthly Composite (by location) for gamma isotopic.
S-II. Radioiodine	A) 1 Indicator sample to be taken from the location of S-1(A) above.	Continuous sampler operation with weekly collection.	8	Gamma isotopic for I-131 weekly.
S-III. Direct	A) 5 stations to be placed within the exclusion boundary.	Quarterly exchange ⁷ ; two or more dosimeters at each location.	61,62,63, 68 & 99	Gamma dose quarterly.
	B) 2 stations to be placed around VCSNS sludge lagoons.	Quarterly exchange ⁷ ; two or more dosimeters at each location.	94,97	Gamma dose quarterly.
WATERBORNE: S-IV. Surface Water	A) 1 indicator sample to be taken of the combined wastewater discharge.	Composite samples with monthly collection. ^{13,5}	77	Gamma isotopic and tritium.
	B) 1 Indicator sample taken at each storm drain outfall.	Daily sample with monthly composite.	72,73	Gamma isotopic and tritium.
S-VI. Drinking Water	A) 1 Indicator (finished water) sample to be taken on site.	Quarterly.	99	Quarterly gamma isotopic, gross beta and tritium analysis.
	B) 1 Indicator (finished water) sample of public system.	Quarterly.	31	Quarterly gamma isotopic, gross beta and tritium analysis.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
INGESTION: S-VII. Milk ⁴	A) 1 Sample from one of the nearest affected dairies at or beyond 5 miles.	Biweekly grab sample. ^{8,14,+}	14	Gamma isotopic and I-131 analysis biweekly.
	B) 1 Control sample to be taken at the location of a dairy greater than 20 miles distance and not in the most prevalent wind direction.	Biweekly grab sample. ^{8,14,+}	16	Gamma isotopic and I-131 analysis biweekly.
	C) 1 Indicator grass (forage) sample to be taken at the location of S-VII(A) above.	Monthly when available. ¹⁴	14	Gamma isotopic.
S-VII. Milk ⁴	D) 1 Control grass (forage) sample to be taken at the location of S-VII(B) above.	Monthly when available. ¹⁴	16	Gamma isotopic.
	E) 2 Indicator grass (forage) samples to be taken at 2 of the locations beyond but as close to the exclusion boundary as practical where the highest offsite sectorial ground level concentrations are anticipated.	Monthly when available.	2,7	Gamma isotopic.
	F) 1 Control grass (forage) sample to be used for routine monitoring along with S-VII(E) above.	Monthly when available.	40	Gamma isotopic.
	G) 1 Indicator grass (forage) sample to be taken at location of penstock leak.	Quarterly when available.	25	Gamma isotopic.
S-VIII. Food Products	A) 1 Indicator sample of various types of foods grown in the area surrounding the plant (root, fruit, grain).	Annually during growing season. ¹¹	6,7	Gamma isotopic on edible portion.
	B) 1 Control sample of various types of foods grown. (root, fruit, grain).	Annually during growing season. ¹¹	40	Gamma isotopic on edible portion.
Corbicula	C) 1 Indicator sample of edible portions.	Semiannual.	23	Gamma isotopic.

Exposure Pathway and/or Sample	Criteria for Selection of Sample Number & Location	Sampling and Collection Frequency	Sample Location	Type & Frequency of Analysis
S-IX. Sediment/Sludge	A) 1 Indicator sample from each storm drain outfall.	Semiannually.	72,73	Gamma isotopic.
	B) 3 Indicator sludge samples taken at sludge lagoons 006A, 006B & 008.	Semiannually.	On site	Gamma isotopic.
	C) 1 Indicator sample of topsoil from penstock spill area.	Annually	25	Gamma isotopic.
S-X. Ground Water	A) 11 Indicator samples to be taken within the exclusion boundary and in the direction of potentially affected ground water supplies.	Quarterly grab sampling. ⁷	107,111, 115 -123	Gamma isotopic and tritium analyses quarterly. ⁷

Table 7 (cont) – Supplemental Radiological Environmental Monitoring

FOOTNOTES

1. Reserved for future use.
 2. Reserved for future use.
 3. Reserved for future use.
 4. Milking animal and garden survey results will be analyzed annually. If the survey should indicate new activity the owners shall be contacted with regard to a contract for supplying sufficient samples. If contractual arrangements can be made, site(s) will be added for additional milk sampling up to a total of 3 Indicator locations.
 5. Not to exceed 35 days.
 6. Reserved for future use.
 7. At least once per 100 days.
 8. At least once per 18 days.
 9. At least once per 200 days.
 10. Reserved for future use.
 11. At least once per 400 days.
 12. Reserved for future use.
 13. Weekly, when circulating water is not operational.
 14. Milk and grass (forage) sampling is not required unless VCSNS gaseous releases exceed 5% of quarterly organ dose limits or radionuclides (attributed to VCSNS operation) are detected in broadleaf vegetation, grass or air samples at concentrations greater than required LLD. Sampling should continue for two months after plant releases are reduced to less than trigger levels and milk contamination levels have returned to background levels.
- + The ODCM requires semimonthly sampling when animals are on pasture, monthly at other times.

Table 8 – Radiological Environmental Monitoring Program Summary for 2019

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Air Particulate (pCi/m ³)	Gross Beta (309)	7.19E-3 (1.0E-2)	2.29E-2 (258/258) (6.95E-3 to 4.75E-2)	Site 30, Construction Site Gate, (0.5 miles SSW)	2.32E-2 (52/52) (8.76E-3 to 4.75E-2)	2.21E-2 (51/51) (5.80E-3 to 4.24E-2)	0
	Gamma Spec (72)						
	¹³⁴ Cs	1.91E-3 (5.0E-2)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.13E-3 (6.0E-2)	All < LLD			All < LLD	0
Air Radioiodine (pCi/m ³)	¹³¹ I (309)	1.82E-2 (7.0E-2)	All < LLD			All < LLD	0
Direct (TLD) ⁵ (μR/hr)	Gamma(136) Quarterly	N/A	8.15E+0 (116/116) (4.20E+0 to 1.24E+1)	Site 55, St. Barnabas, (2.8 miles E)	1.13E+1 (4/4) (1.08E+1 to 1.24E+1)	8.04E+0 (20/20) (4.87+0 to 1.05E+1)	0
	Gamma(24) Special Interest	N/A	8.45E+0 (24/24) (4.56E+0 to 1.20E+1)	Site 31, McCrory Liston, (6.6 miles NNE)	1.10E+1 (4/4) (1.03E+1 to 1.19E+1)	N/A	0
Surface Water (pCi/l)	³ H (36)	4.94+2 (2.0E+3)	All < LLD		All < LLD	All < LLD	0
	Gamma Spec(36)						
	⁵⁴ Mn	1.84E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	2.16E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	4.57E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	2.13E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	3.98E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	3.60E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	2.73E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.82E+0 (1.5E+1)	All < LLD			All < LLD	0

Table 8 (cont.) - Radiological Environmental Monitoring Program Summary for 2019

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Surface Water (Continued)	¹³⁷ Cs	2.21E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	1.73E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	4.74E+0 (1.5E+1)	All < LLD			All < LLD	0
Ground Water (pCi/l)	³ H (52)	4.97E+2 2.00E+3	3.41E+2 (1/48) (3.41E+2 to 3.41+2)	NPDES Well (GW-13A), 0.39 miles SE	3.41E+2 (1/4) (3.41E+2 to 3.41+2)	All < LLD	0
	Gamma Spec (52)						
	⁵⁴ Mn	3.72E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	4.18E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	8.78E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	5.24E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	1.27E+1 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	8.82E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	4.70E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	4.69E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	5.81E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	2.46E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	4.83E+0 (1.5E+1)	All < LLD			All < LLD	0

Table 8 (Cont.) - Radiological Environmental Monitoring Program Summary for 2019

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Drinking Water ⁶ (pCi/l)	Gross Beta (36)	3.07E+0 (4.00E+0)	3.56E+0 (7/24) (2.61E+0 to 3.99+0)	Site 28, Jenkinsville Post Office, (2.8 miles, SE)	3.73E+0 (5/12) (2.97E+0 to 3.99+0)	2.79E+0 (4/12) (2.13E+0 to 3.64E+0)	0
	³ H (36)	4.79E+2 (2.0E+3)	7.08E+2 (2/24) (6.46E+2 to 7.69+2)	Site 17, Columbia Water Works, (25 miles, SE)	7.08E+2 (2/12) (6.46E+2 to 7.69+2)	All < LLD	0
	Gamma Spec (72) ⁹						
	⁵⁴ Mn	4.94E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	4.67E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	1.04E+1 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	5.72E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	1.49E+1 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	6.88E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	4.25E+0 (1.5E +1)	All < LLD			All < LLD	0
	¹³¹ I	4.68E-1 (1.0E+0)	All < LLD			All < LLD	0
	¹³⁴ Cs	5.32E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	5.78E+0 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	2.97E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La	8.43E+0 (1.5E+1)	All < LLD			All < LLD	0

Table 8 (Cont.) - Radiological Environmental Monitoring Program Summary for 2019

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Broadleaf Vegetation (pCi/kg wet)	Gamma Spec (36)						
	¹³¹ I	2.01E+1 (6.0E+ 1)	All < LLD			All < LLD	0
	¹³⁴ Cs	2.06E+1 (6.0E+ 1)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.40E+1 (8.0E+1)	All < LLD			All < LLD	0
Fish ⁷ (pCi/kg wet)	Gamma Spec (18)						
	⁵⁴ Mn	1.80E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁵⁸ Co	1.74E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁵⁹ Fe	4.41E+1 (2.6E+2)	All < LLD			All < LLD	0
	⁶⁰ Co	2.10E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁶⁵ Zn	3.78E+1 (2.6E+2)	All < LLD			All < LLD	0
	¹³⁴ Cs	1.36E+1 (1.3E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.98E+1 (1.5E+2)	All < LLD			All < LLD	0

Table 8 (Cont.) - Radiological Environmental Monitoring Program Summary for 2019

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed ¹	Lower Limit of Detection ² Actual (Max.)	All Indicator Locations Mean ³ (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ³ (#/total #) (Range)	Number of Nonroutine Reported ⁴ Measurements
				Name (Distance & Direction)	Mean ³ (#/total #) (Range)		
Sediment (pCi/kg) ⁸	Gamma Spec (6)						
	⁵⁴ Mn	1.54E+1 N/A	All < LLD			All < LLD	0
	⁵⁸ Co	1.62E+1 N/A	All < LLD			All < LLD	0
	⁶⁰ Co	1.23E+1 N/A	All < LLD			All < LLD	0
	¹³⁴ Cs	1.18E+1 (1.5E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.01E+1 (1.8E+2)	5.08E+1 (2/4) (4.13E+1 to 6.02E+1)	Site 21, Parr Reservoir, (2.7 miles SSW)	5.08E+1 (2/2) (4.13E+1 to 6.02E+1)	3.03E+1 (2/2) (2.18E+1 to 3.87E+1)	0

Table 8 (cont) - Radiological Environmental Monitoring Program Summary for 2019

Footnotes

1. Includes indicator and control analyses. Site 8, Air Particulates and Air Radioiodines are included as indicators. Does not include other supplemental samples.
2. Values given are maximum MDA values for indicator locations calculated from the program data analyses. The maximum acceptable LLD values allowed from NRC guidelines are given in parentheses.
3. Mean and range are based on detectable measurements only. The fractions of detectable measurements (i.e., number of positive results/total number of measurements) at specific locations are indicated in parentheses.
4. Any confirmed measured level of radioactivity in any environmental medium that exceeds the reporting requirements of ODCM, Section 1.4.1.2.
5. Detection sensitivity is approximately 10 mrem/yr (1.0 μ R/hr).
6. Elevated levels of ^{214}Pb and ^{214}Bi were observed in Jenkinsville drinking water samples. The values are not reported here because they are naturally occurring (do not originate from VCSNS) and furnish no quantifiable information of interest.
7. Fish include 3 groups (Bass, Bream/Crappie, Cat fish/Carp.)
8. Elevated levels of ^{214}Pb and ^{214}Bi plus other ^{226}Ra daughter products and ^{228}Ac plus other ^{232}Th daughter products were observed in all sediment samples. The values are not reported here because they are naturally occurring (do not originate from VCSNS) and furnish no quantifiable information of interest.
9. Drinking water resin prepared and counted for ^{131}I as separate sample.

Table 9– Radiological Environmental Monitoring Program Preoperational (Baseline) Summary

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
Air Particulate (pCi/m ³) (1981-1982)	Gross Beta (1300)	4.1E-3 (1.0E-2)	1.1E-1 (562/564) ⁴ (1.3E-2 to 5.5E-1)	Site 13, North Dam, (2.9 miles, NNW)	1.3E-1 (52/52) (2.1E-2 to 5.5E-1)	1.2E-1 (153/155) (7.9E-3 to 6.1E-1)	0
			2.7E-2 (456/462) ⁴ (9.3E-3 to 6.6E-2)	Site 8, Mon. Res. S of Rd 224, (1.5 ENE)	3.0E-2 (42/42) (1.2E-2 to 6.0E-2)	2.8E-2 (125/126) (1.2E-2 to 5.8E-2)	
	Gamma Spec (307)						
	¹³⁴ Cs	3.0E-3 (1.0E-2)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.1E-3 (1.0E-2)	3.2E-3 (22/241) (1.5E-3 to 5.2E-3)	Site 10, Met Tower, (2.4 miles, NNE)	3.8E-3 (2/22) (2.5E-3 to 5.2E-3)	4.2E-3 (4/66) (3.2E-3 to 5.6E-3)	0
Air Radioiodine (pCi/m ³) (1982)	¹³¹ I (290)	3.6E-2 (7.0E-2)	All < LLD			All < LLD	0
Direct (TLD) ⁵ (μR/hr) (1978-1982)	Gamma (1220) Monthly	0.5 N/A	9.9 (915/915) (6.7 to 14.7)	Site 13, North Dam, (2.9 miles, NNW)	13.1 (61/61) (12.2 to 14.2)	9.7 (305/305) (6.4 to 13.5)	0
	Gamma (161) Quarterly	0.5 N/A	10.2 (154/154) (6.8 to 14.7)	Site 55, St. Barnabas Church, (2.8 miles, E)	14.0(7/7) (13.1 to 14.7)		0
Surface Water (pCi/l) (1981-1982)	³ H (43)	1.1E+3 (2.0E+3)	1.4E+3 (18/29) (1.1E+3 to 2.4E+3)	Site 17, Columbia Canal, (24.7 mile SE)	1.6E+3 (2/7) (1.4E+3 to 1.8E+3)	1.2E+3 (6/14) (6.7E+2 to 1.6E+3)	0
	Gamma Spec (140)						
	⁵⁴ Mn	2.7E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	2.9E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	6.0E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	2.4E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	7.9E-1 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	5.2E-1 (1.5E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	3.3E-1 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.0E-1 (1.5E+1)	All < LLD			All < LLD	0

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
	¹³⁷ Cs	2.2E-1 (1.8E+1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	2.2E+0 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La (1982 only)	5.5E-1 (1.5E+1)	All < LLD			All < LLD	0
Ground Water (pCi/l) (1981-1982)	³ H (29)	9.0E+2 (2.0E+3)	1.5E+3 (16/16) (9.5E+2 to 2.3E+3)	Site 26, Onsite Well P4, (265 ft, W)	1.6E+3 (8/8) (9.5E+2 to 2.3E+3)	1.3E+3 (13/13) (1.0E+3 to 1.9E+3)	0
	Gamma Spec (32)						
	⁵⁴ Mn	3.7E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁸ Co	3.8E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁵⁹ Fe	7.8E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁶⁰ Co	3.8E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁶⁵ Zn	8.1E+0 (3.0E+1)	All < LLD			All < LLD	0
	⁹⁵ Zr	6.8E+0 (1.5E+1)	All < LLD			All < LLD	0
	⁹⁵ Nb	4.6E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.7E+0 (1.5E + 1)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.8E+0 (1.8E + 1)	All < LLD			All < LLD	0
	¹⁴⁰ Ba	1.9E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹⁴⁰ La (1982 only)	5.0E0 (1.5E+1)	All < LLD			All < LLD	0
Drinking Water ⁶ (pCi/l) (1981-1982)	Gross Beta ⁷	(2.0E+0)					
	³ H (14)	6.3E+2 (1.0E+3)	7.8E+2 (6/14) (6.8E+2 to 9.8E+2)	Site 28, Jenkinsville, (2.0 miles, SE) ⁷	8.4E+2 (3/7) (7.0E+2 to 9.8E+2)		0
	Gamma Spec (44)						
	⁵⁴ Mn	3.0E-1 (1.5E+1)	All < LLD				0
	⁵⁸ Co	2.7E-1 (1.5E+1)	All < LLD				0

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
	⁵⁹ Fe	9.6E0 (3.0E+1)	All < LLD				0
	⁶⁰ Co	2.6E-1 (1.5E+1)	All < LLD				0
	⁶⁵ Zn	3.4E-1 (3.0E+1)	All < LLD				0
	⁹⁵ Zr	4.8E-1 (1.5E+1)	All < LLD				0
	¹³¹ I	3.4E-1 (1.5E+1)	All < LLD				0
	⁹⁵ Nb	7.4E-1 (1.0E+0)	All < LLD				0
	¹³⁴ Cs	2.2E-1 (1.0E+1)	All < LLD				0
	¹³⁷ Cs	2.4E-1 (1.8E+1)	All < LLD				0
	¹⁴⁰ Ba	2.5E0 (6.0E+1)	All < LLD				0
	¹⁴⁰ La (1982 only)	4.4E-1 (1.5E+1)	All < LLD				0
Milk (pCi/l) (1981-1982)	Gamma Spec (94)						
	¹³¹ I	6.3E-1 (1.0E+0)	All < LLD			All < LLD	0
	¹³⁴ Cs	3.3E+0 (1.5E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	4.6E0 (1.5E+1)	4.1E+0 (8/47) (2.8E+0 to 6.1E+0)	Site 14, Dairy, (5.1 miles, W)	4.1E+0 (8/47) (2.8E+0 to 6.1E+0)	5.7E+0 (37/47) (3.7E+0 to 9.2E+0)	0
	¹⁴⁰ Ba	1.1E+1 (1.5E + 1)	All < LLD			All < LLD	0
	¹⁴⁰ La	4.4E+0 (1.5E+1)	All < LLD			All < LLD	0
Grass (pCi/kg wet) (1981-1982)	Gamma Spec (82)						
	¹³¹ I	6.7E+1 (6.0E+1)	All < LLD			All < LLD	0
	¹³⁴ Cs	2.7E+1 (8.0E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	3.3E+1 (8.0E+1)	5.0E+1 (13/51) (1.6E+1 to 1.6E+2)	Site 14, Dairy, (5.1 miles, W)	5.9E+1 (5/29) (1.6E+1 to 1.6E+2)	1.3E+2 (6/31) (1.3E+1 to 3.4E+2)	0

Medium or Pathway Sampled (Unit of Measurement and Reporting Period)	Type and Total Number of Analyses Performed	Lower Limit of Detection ¹ Actual (Max.)	All Indicator Locations Mean ² (#/total #) (Range)	Location with Highest Annual Mean		Control Locations Mean ² (#/total #) (Range)	Number of Nonroutine Reported ³ Measurements
				Name (Distance & Direction)	Mean ² (#/total #) (Range)		
Broadleaf Vegetation (pCi/kg wet) (1980-1982)	Gamma Spec (10)						
	¹³¹ I	3.7E+1 (6.0E+1)	All < LLD				0
	¹³⁴ Cs	1.9E+1 (8.0E+1)	All < LLD				0
	¹³⁷ Cs	2.1E+1 (8.0E+1)	3.1E+1 (2/7) (1.8E+1 to 3.6E+1)	Site 2, Trans. Line, (1.2 miles, SW)	3.6E+1 (1/1) (Single Value)	All < LLD	0
Other Vegetation (pCi/kg wet) (1980-1982)	Gamma Spec (32)						
	¹³⁴ Cs	8.4E+0 (8.0E+1)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.0E+1 (8.0E+1)	All < LLD			All < LLD	0
Fish (pCi/kg wet) (1980 - 1982)	Gamma Spec (92)						
	¹³⁴ Cs	1.4E+1 (1.3E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	1.8E+1 (1.3E+2)	2.8E+1 (50/71) (1.1E+1 to 1.0E+2)	Site 24, Recreation Lake, (5.5 miles, N)	3.4E+1 (17/23) 1.2E+1 to 1.0E+2)	3.1E+1 (19/21) (1.0E+1 to 7.9E+1)	0
	⁵⁸ Co	2.6E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁵⁴ Mn	1.8E+1 (1.3E+2)	All < LLD			All < LLD	0
	⁵⁹ Fe	9.0E+1 (2.6E+2)	All < LLD			All < LLD	0
	⁶⁵ Zn	4.1E+1 (2.6E+2)	All < LLD			All < LLD	0
	⁶⁰ Co	1.8E+1 (1.3E+2)	All < LLD			All < LLD	0
Sediment (pCi/kg) (1980-1982)	Gamma Spec (24)						
	¹³⁴ Cs	2.3E+1 (1.5E+2)	All < LLD			All < LLD	0
	¹³⁷ Cs	2.4E+1 (1.5E+2)	1.7E+2 (12/18) (2.6E+1 to 4.5E+2)	Site 21, Parr Reservoir, (2.7 miles, SSW)	2.6E+2 (6/6) (2.6E+1 to 4.5E+2)	4.2E+2 (6/6) (1.8E+1 to 1.0E+3)	0

Table 9 (Cont.)- Radiological Environmental Monitoring Program Preoperational (Baseline) Summary

Footnotes

1. Values given are MDA values calculated from the program data analyses with maximum acceptable LLD values allowed from NRC guidelines given in parentheses.
2. Mean and range are based on detectable measurements only. The fractions of detectable measurements at specific locations are indicated in parentheses.
3. A non-routine measurement is any confirmed measured level of radioactivity in an environmental medium that exceeds the reporting requirements of VCSNS ODCM, Section 1.4.1.2.
4. The baseline values are high because of the fallout from the Chinese bomb test in 1980. The first set of data reflects the 1981 baseline. The second set of data reflects the 1982 baseline, essentially free of bomb test fallout. The 1982 data covers the period 1/1/82 - 10/22/82.
5. Detection sensitivity is approximately 5 mrem/yr (0.5 μ R/hr) determined from the analyses of five years of preoperational data.
6. No control location was specified for drinking water during the preoperational monitoring period.
7. Inconclusive data.

**Table 10 - Results of 2019 Environmental Inter-Comparison Program with
Independent Lab, Eckert & Ziegler Analytics, Inc.**

Comparison Study (Measurement Unit)	Date	Nuclides	Vendor Lab Results	Env Lab Results	Agreement
Gamma Isotopic Liquid 1 Liter (pCi/l)	3/29	¹³¹ I	86.5	95.9	Yes
		¹⁴¹ Ce	113	107	Yes
		⁵¹ Cr	284	302	Yes
		¹³⁴ Cs	155	151	Yes
		¹³⁷ Cs	191	213	Yes
		⁵⁸ Co	139	148	Yes
		⁵⁴ Mn	139	152	Yes
		⁵⁹ Fe	154	187	Yes
		⁶⁵ Zn	214	236	Yes
		⁶⁰ Co	290	296	Yes
Gamma Composite Filter (pCi)	10/8	¹⁴¹ Ce	91.9	97.6	Yes
		⁵¹ Cr	182	200	Yes
		¹³⁴ Cs	114	94.6	Yes
		¹³⁷ Cs	83	90.6	Yes
		⁵⁸ Co	96.3	104	Yes
		⁵⁴ Mn	84.9	88.4	Yes
		⁵⁹ Fe	81.7	99.2	Yes
		⁶⁵ Zn	161	190	Yes
		⁶⁰ Co	116	113	Yes
Alpha/Beta Water (pCi/l)	3/27	Alpha	152	130	Yes
		Beta	286	324	Yes
Gamma Isotopic Pulverized Soil (pCi/kg)	4/12	¹⁴¹ Ce	186	175	Yes
		⁵¹ Cr	464	445	Yes
		¹³⁴ Cs	254	219	Yes
		¹³⁷ Cs	312	323	Yes
		⁵⁸ Co	227	229	Yes
		⁵⁴ Mn	227	254	Yes
		⁵⁹ Fe	252	298	Yes
		⁶⁵ Zn	349	360	Yes
		⁶⁰ Co	474	459	Yes
I-131 Solid (pCi)	3/15	¹³¹ I	105	105	Yes

Comparison Study (Measurement Unit)	Date	Nuclides	Vendor Lab Results	Env Lab Results	Agreement
Tritium (pCi/l)	4/24	^3H	13100	13800	Yes
Gross Beta Filter (pCi)	10/17	^{137}Cs	217	231	Yes
Charcoal Cartridge (pCi)	9/22	^{131}I	94.4	101	Yes
Gamma Isotopic Liquid 4 Liter (pCi/l)	9/18	^{131}I	89.9	101	Yes
		^{141}Ce	127	144	Yes
		^{51}Cr	251	270	Yes
		^{134}Cs	157	159	Yes
		^{137}Cs	114	129	Yes
		^{58}Co	133	144	Yes
		^{54}Mn	117	134	Yes
		^{59}Fe	112	134	Yes
		^{65}Zn	222	260	Yes
		^{60}Co	160	178	Yes

Table 11 – 2019 Environmental Sampling Program Deviations

Media	Sample Location	Month (Week No.)	Cause for Deviation
Air Samples	Site 17	Apr (16)	Loss of power due to construction
	Site 07	Aug (32)	Pump motor failed
	Site 07	Dec (50)	Pump motor failed



LEGEND

- CONTROL SAMPLE LOCATIONS
- A=AIR PARTICULATE SITE
- D=DIRECT (TLD) SITE
- I=AIRBORNE RADIOIODINE SITE
- W=WATER SITE
- O=OTHER (GARDEN PRODUCTS, FISH, SEDIMENT, GRASS, MILK)

REFERENCE:
THE BASE FOR THIS MAP WAS PREPARED FROM A
PORTION OF USGS STATE OF GEORGIA, 1970.





South Carolina Electric & Gas Co.
Virgil C. Summer Nuclear Station

Regional Location Map

Figure 1-1

REV. DATE 12-8

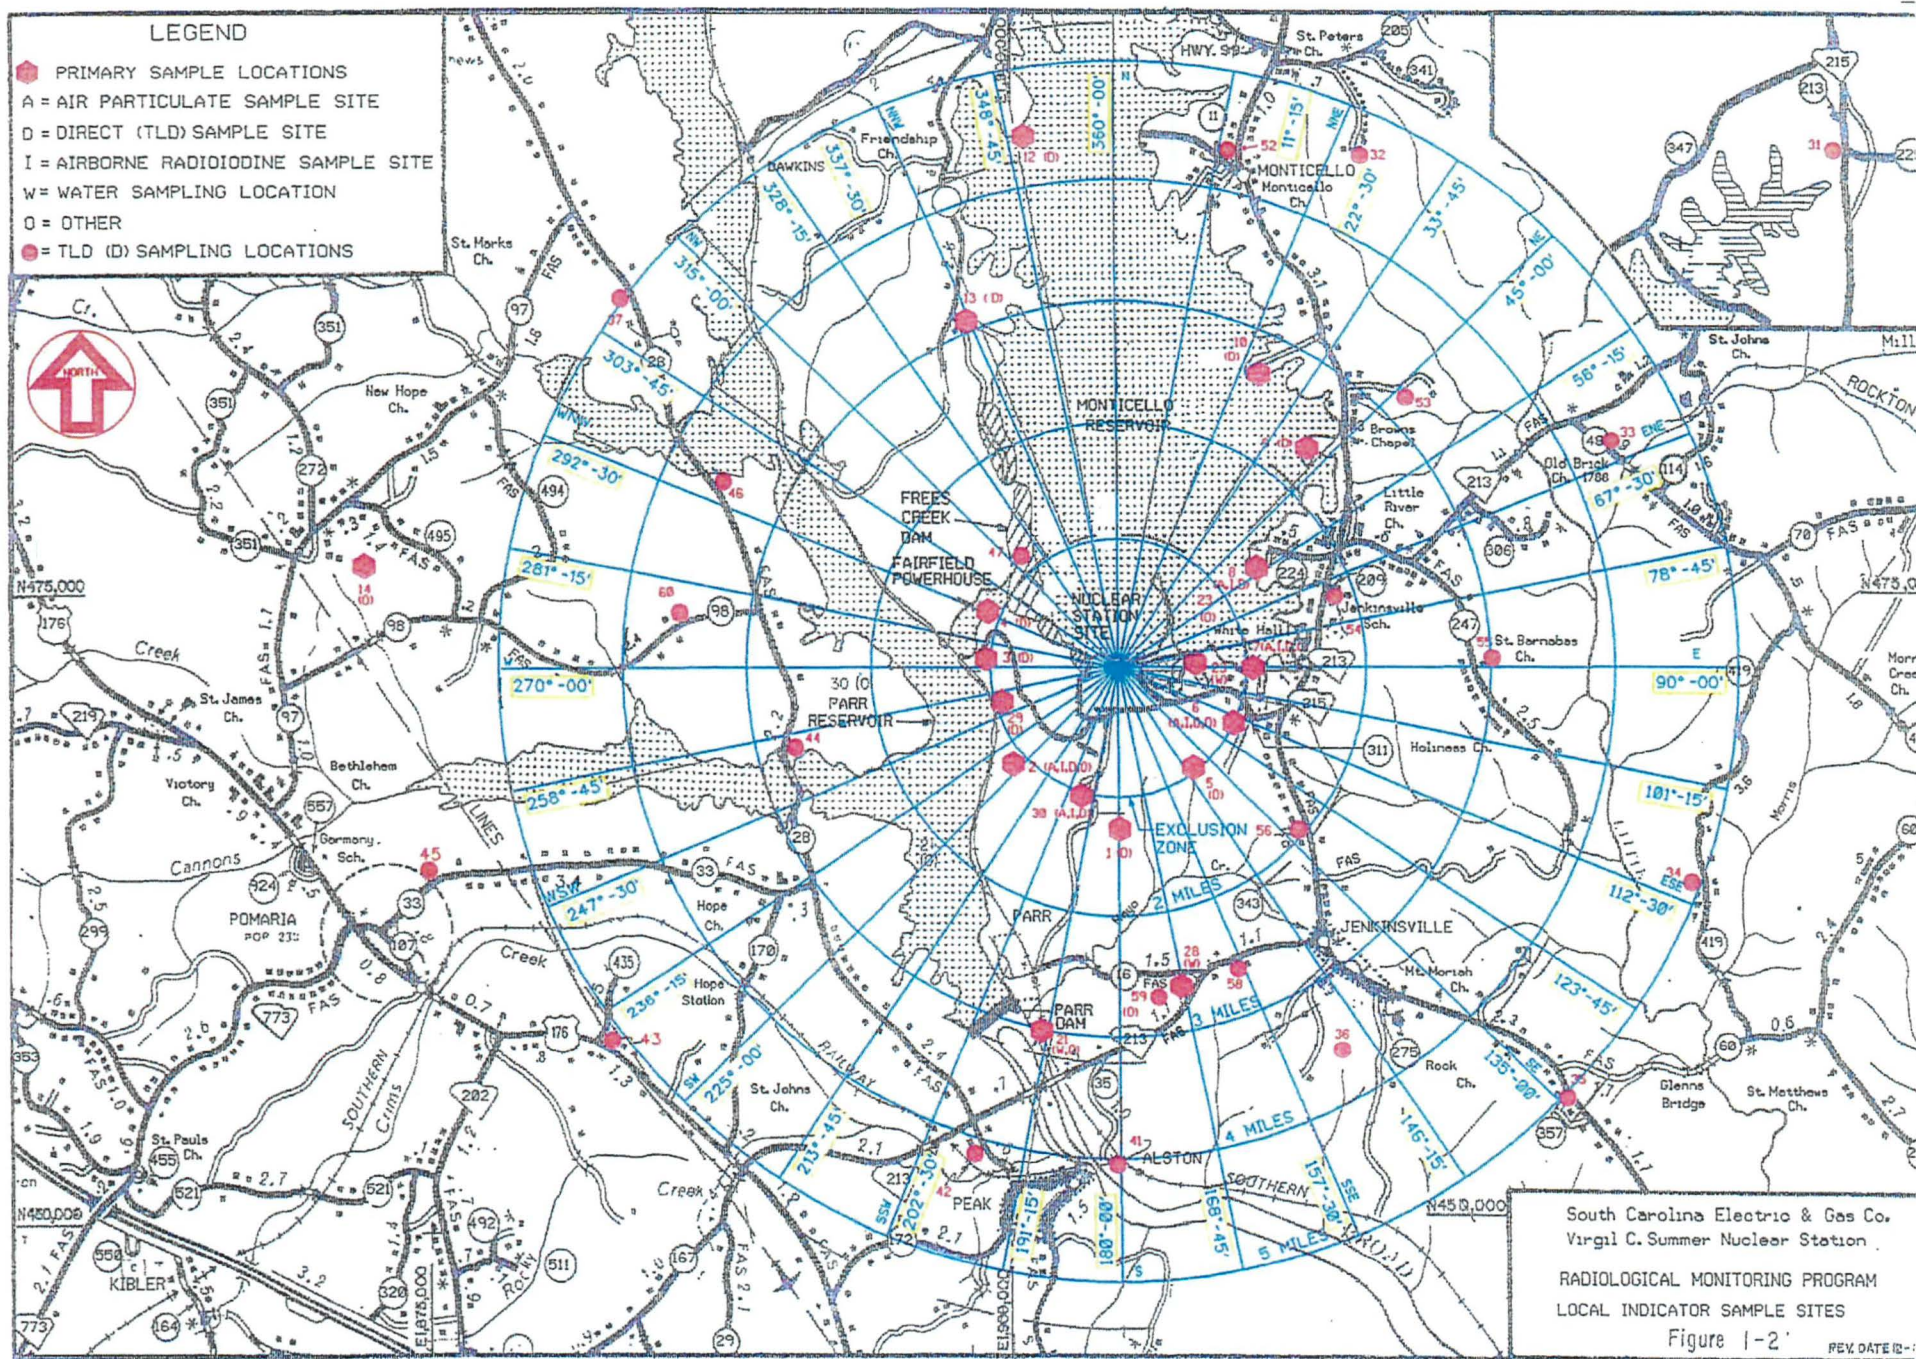

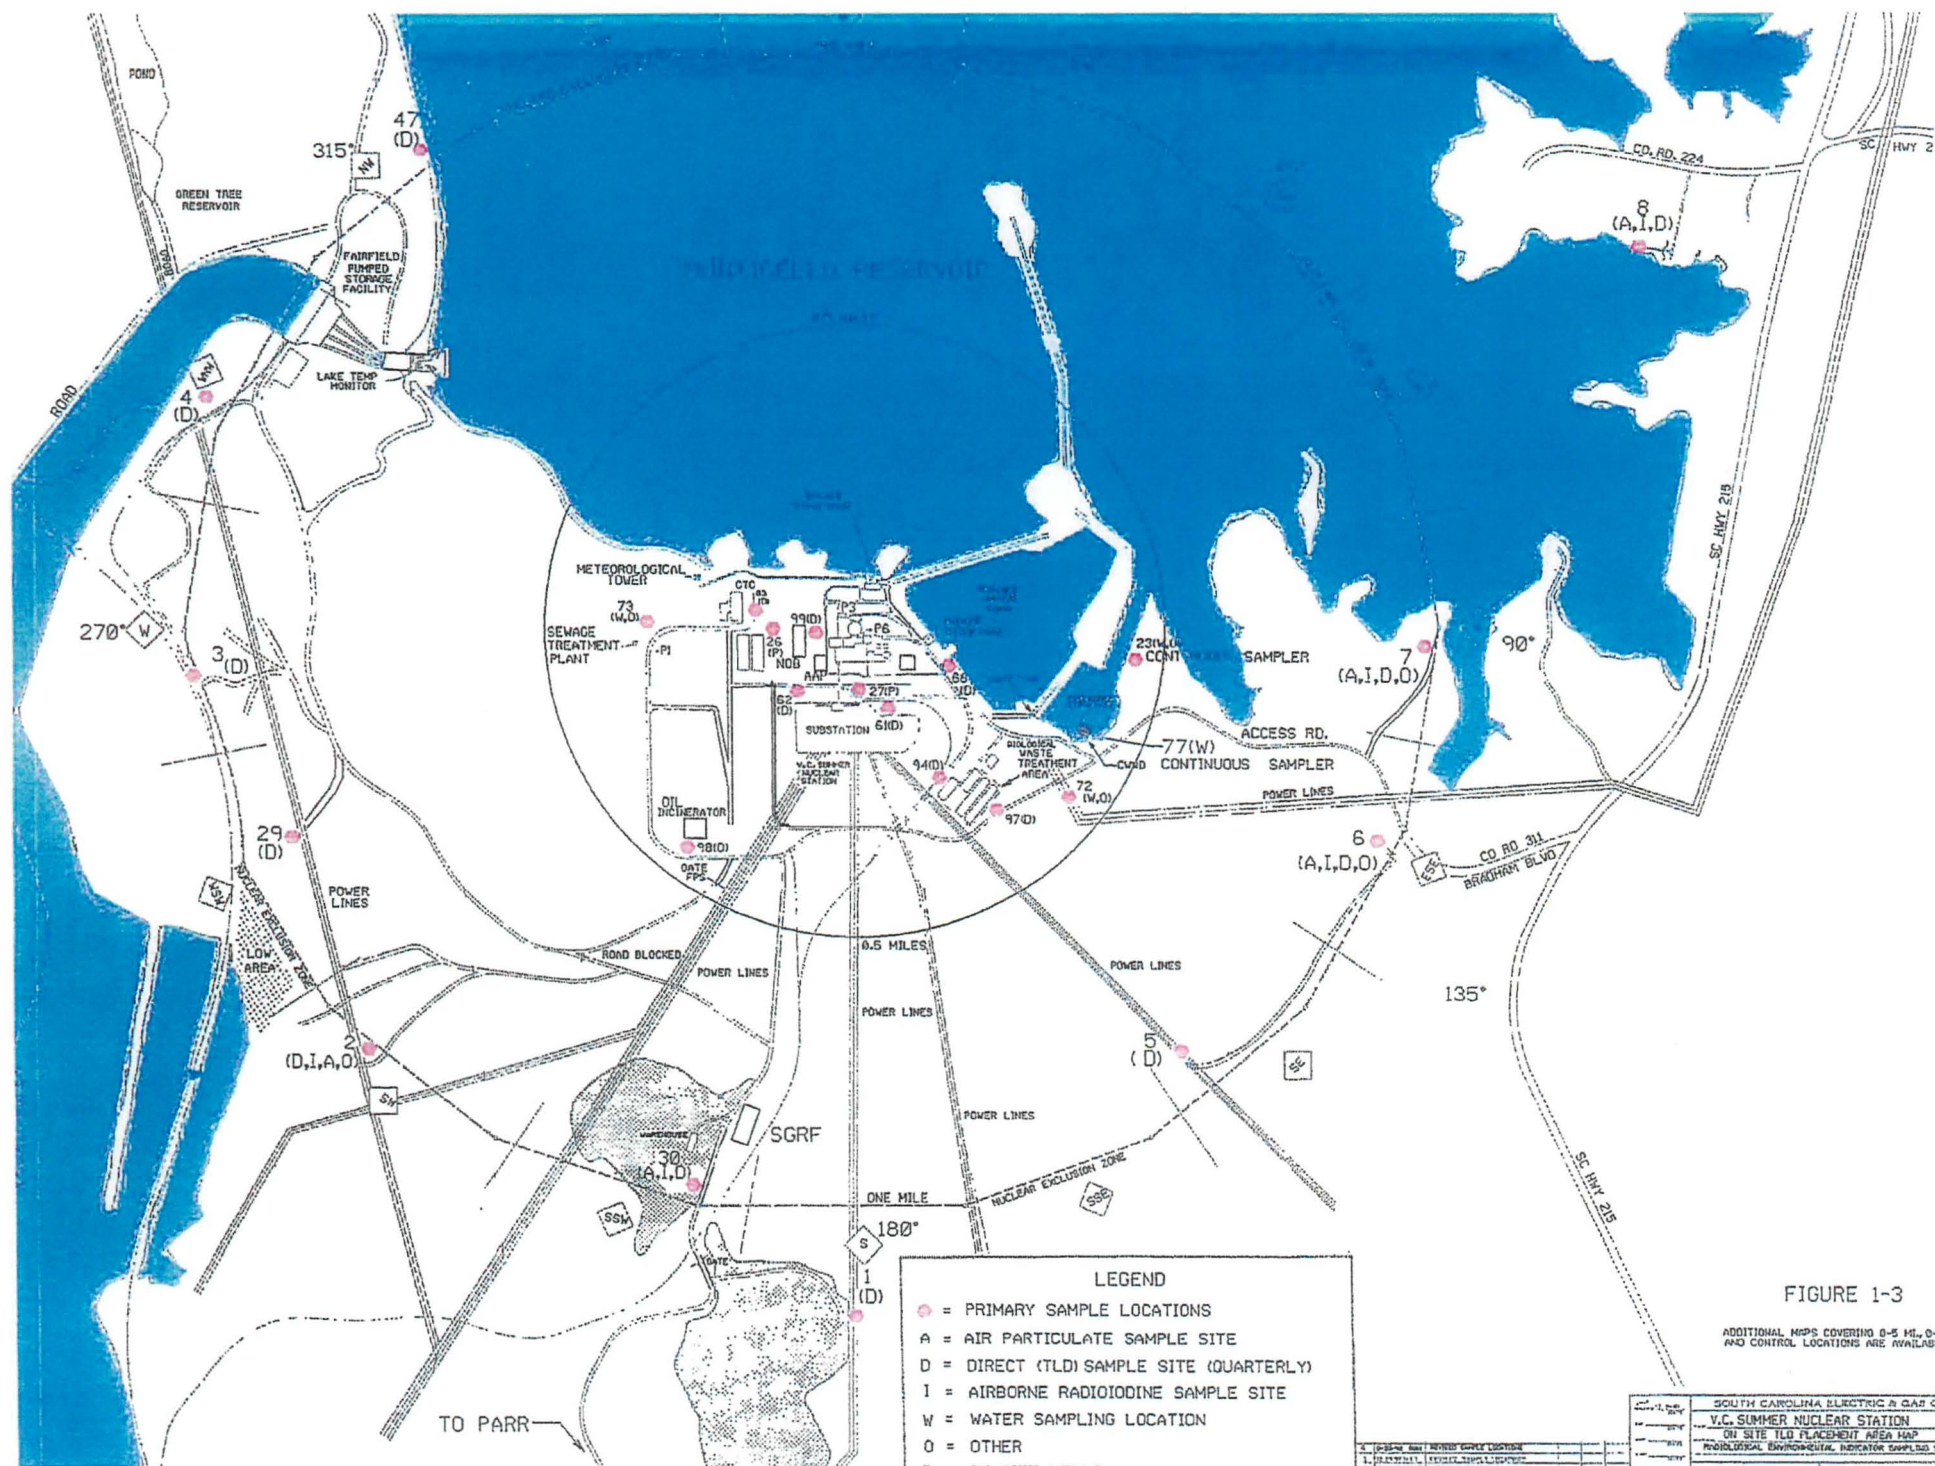

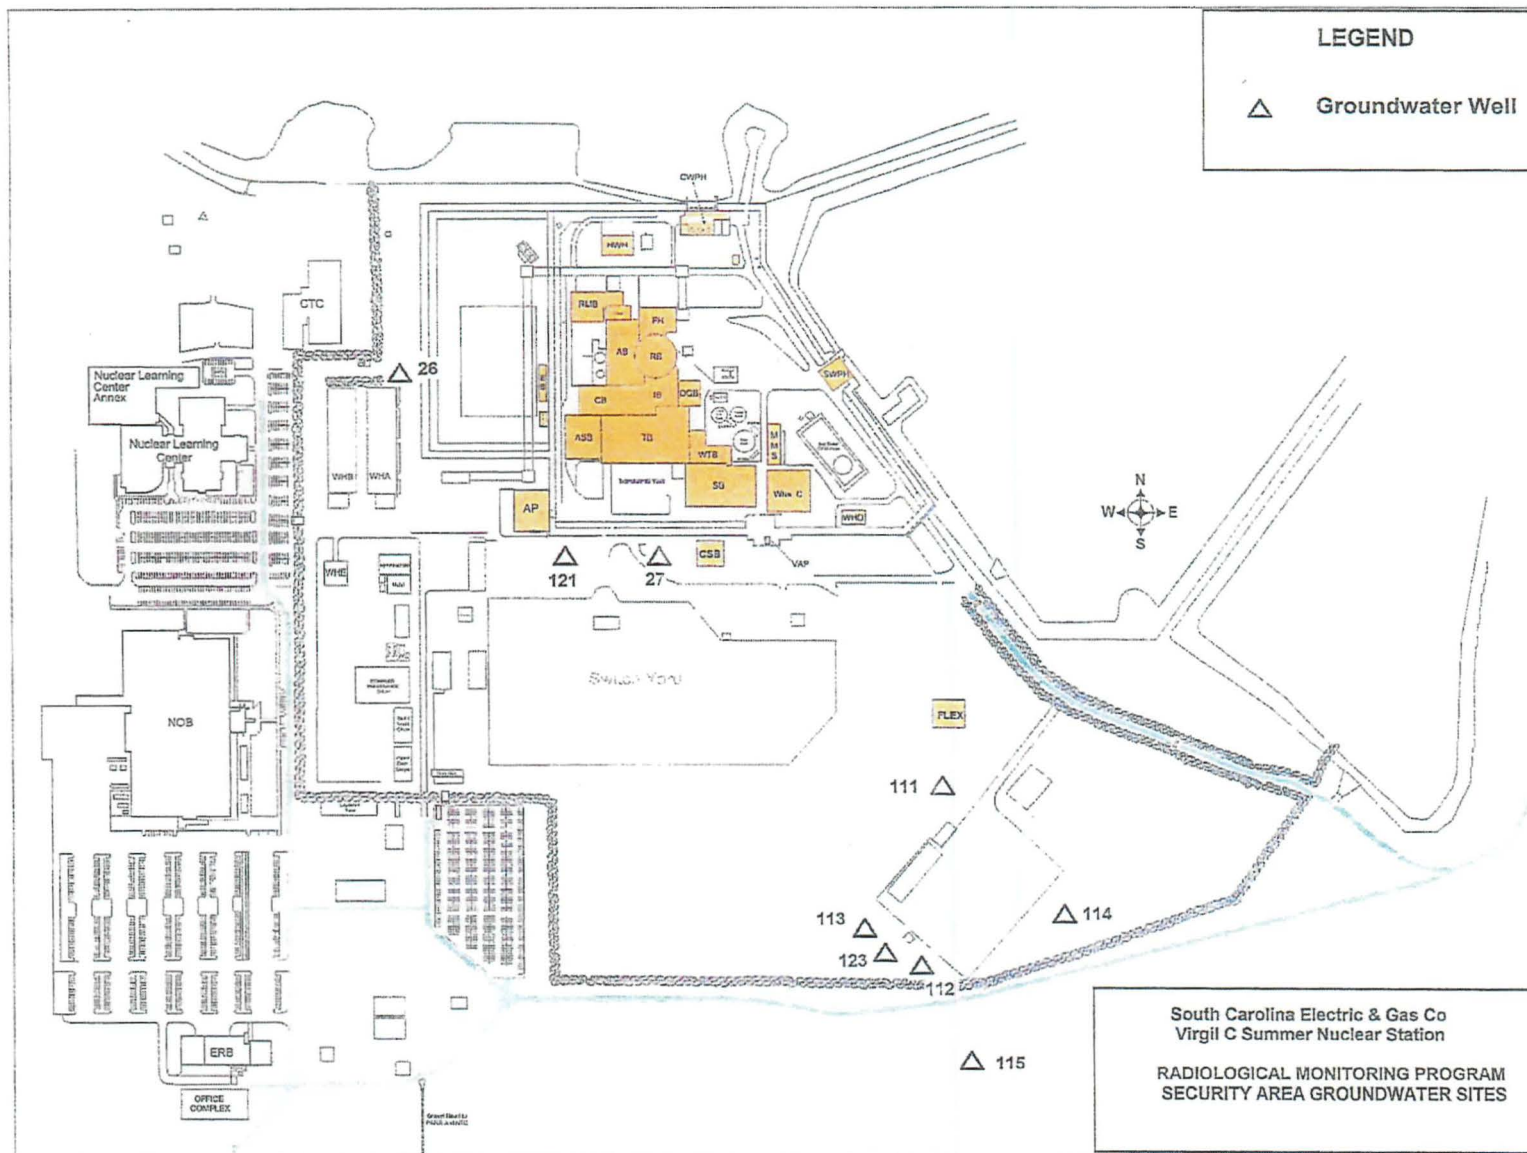


Figure 1-4

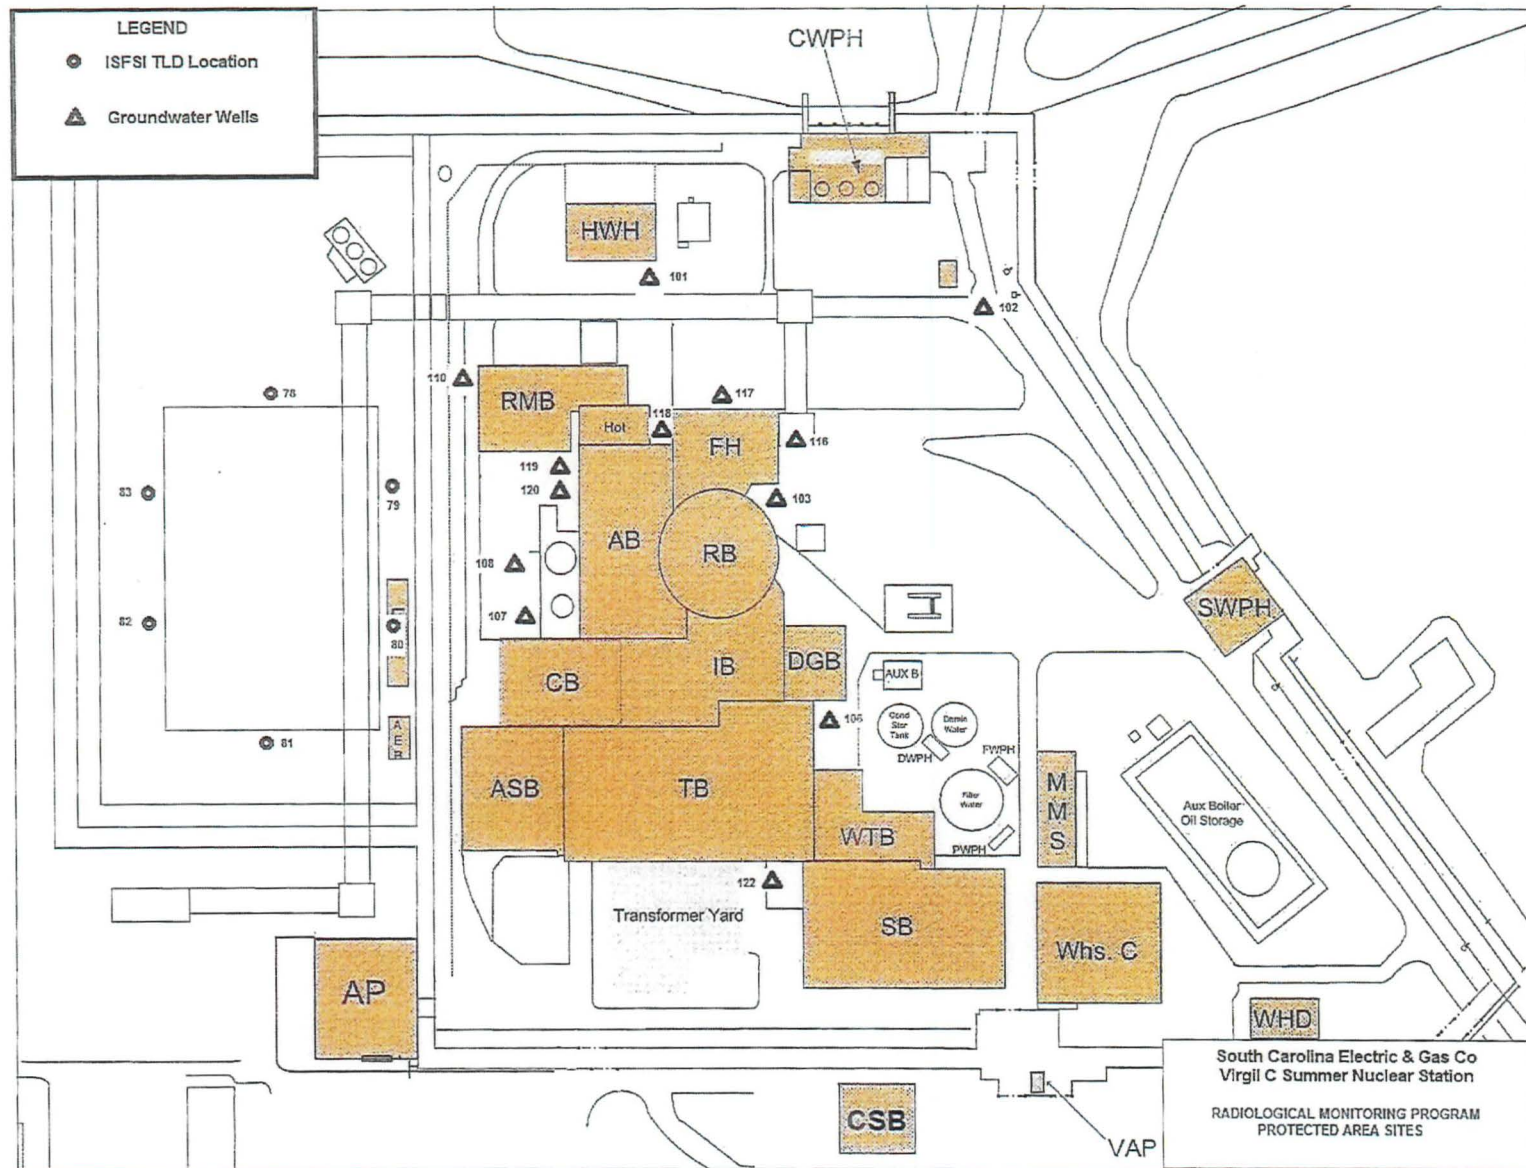


Figure 1-5